



KEY PLAN

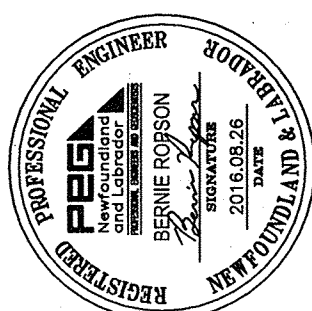

 **ENGINEERING**
PERMIT J0291

STANTEC CONSULTING LTD.

BR 04642

Signature or Member Number
(Member-In-Responsible Charge)

ISSUED FOR TENDER	AUG 26 2016
0	date
revisions	

**NORTHWEST ATLANTIC
FISHERIES CENTRE
MAIN ELECTRICAL
UPGRADES**

drawing	dessin
---------	--------

PARTIAL FLOOR PLANS
H17/G18, 017/N18

designed	B. B. Benson	conçu
----------	--------------	-------

date March 2016

drawn J. Dillon
designer

2010	approved	approved
------	---------------------	----------

date _____

Tender	Soumission
1.	1.
2.	2.
3.	3.
4.	4.
5.	5.
6.	6.
7.	7.
8.	8.
9.	9.
10.	10.
11.	11.
12.	12.
13.	13.
14.	14.
15.	15.
16.	16.
17.	17.
18.	18.
19.	19.
20.	20.
21.	21.
22.	22.
23.	23.
24.	24.
25.	25.
26.	26.
27.	27.
28.	28.
29.	29.
30.	30.
31.	31.
32.	32.
33.	33.
34.	34.
35.	35.
36.	36.
37.	37.
38.	38.
39.	39.
40.	40.
41.	41.
42.	42.
43.	43.
44.	44.
45.	45.
46.	46.
47.	47.
48.	48.
49.	49.
50.	50.
51.	51.
52.	52.
53.	53.
54.	54.
55.	55.
56.	56.
57.	57.
58.	58.
59.	59.
60.	60.
61.	61.
62.	62.
63.	63.
64.	64.
65.	65.
66.	66.
67.	67.
68.	68.
69.	69.
70.	70.
71.	71.
72.	72.
73.	73.
74.	74.
75.	75.
76.	76.
77.	77.
78.	78.
79.	79.
80.	80.
81.	81.
82.	82.
83.	83.
84.	84.
85.	85.
86.	86.
87.	87.
88.	88.
89.	89.
90.	90.
91.	91.
92.	92.
93.	93.
94.	94.
95.	95.
96.	96.
97.	97.
98.	98.
99.	99.
100.	100.

Sandy Ok 2016-04-12


FWGSC Project Manager Administrateur de projets | PSGC

project number	no. au projet
D 070040 004	

100101771011



E110

E-DRM/GOD-E: 543115

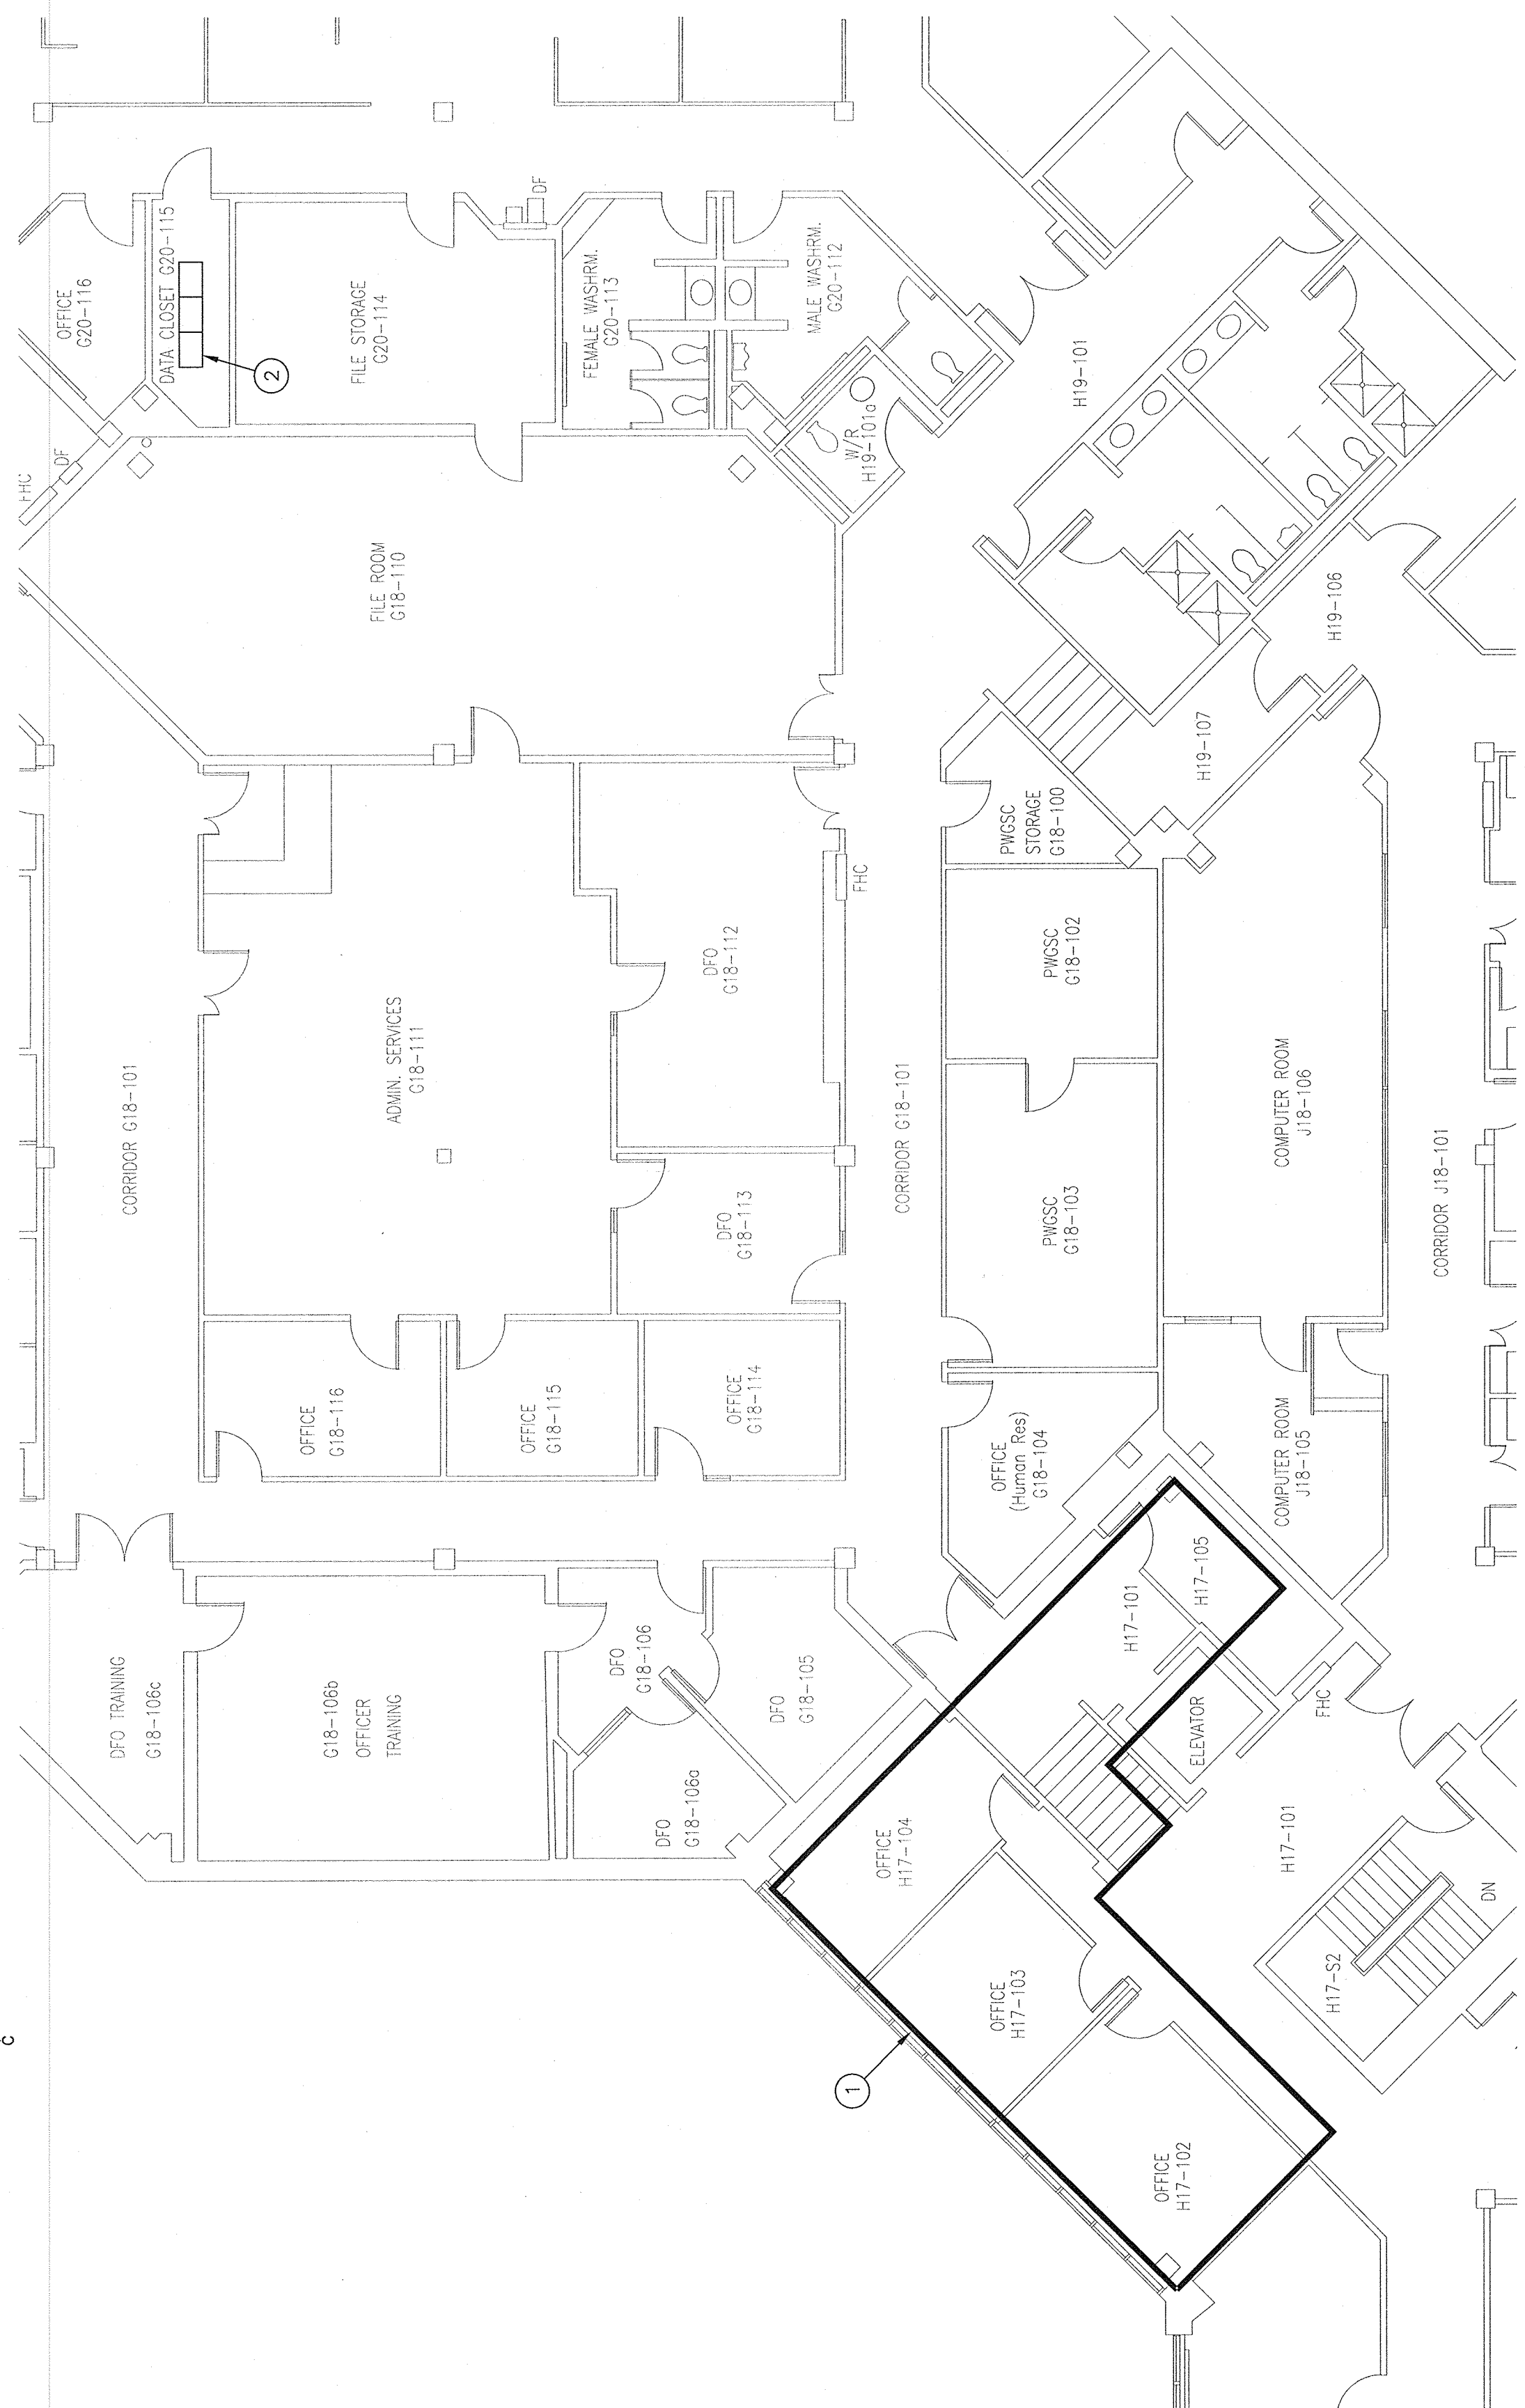

- ① OUTLINE OF EXISTING H7 ELECTRICAL ROOM, FLOOR BELOW, SHOWN FOR REFERENCE.
SEE DRAWING 3/E-102 FOR APPROXIMATE LOCATION OF DATA DROP.
- ② ROUTE NEW CAT 6 CABLE IN 27mmø CONDUIT FROM H7 ELECTRICAL ROOM TO EXISTING DATA RACK IN DATA ROUTE G20-115 AS INDICATED. ALL NEW DATA DROPS FOR H7 ELECTRICAL ROOM UNDER THIS CONTRACT TO BE ROUTED BACK TO THIS CLOSET AND TERMINATED ON NEW CAT6 PATCH PANEL IN EXISTING RACK.

H17/G18 POD PARTIAL FLOOR PLAN – LEVEL 1

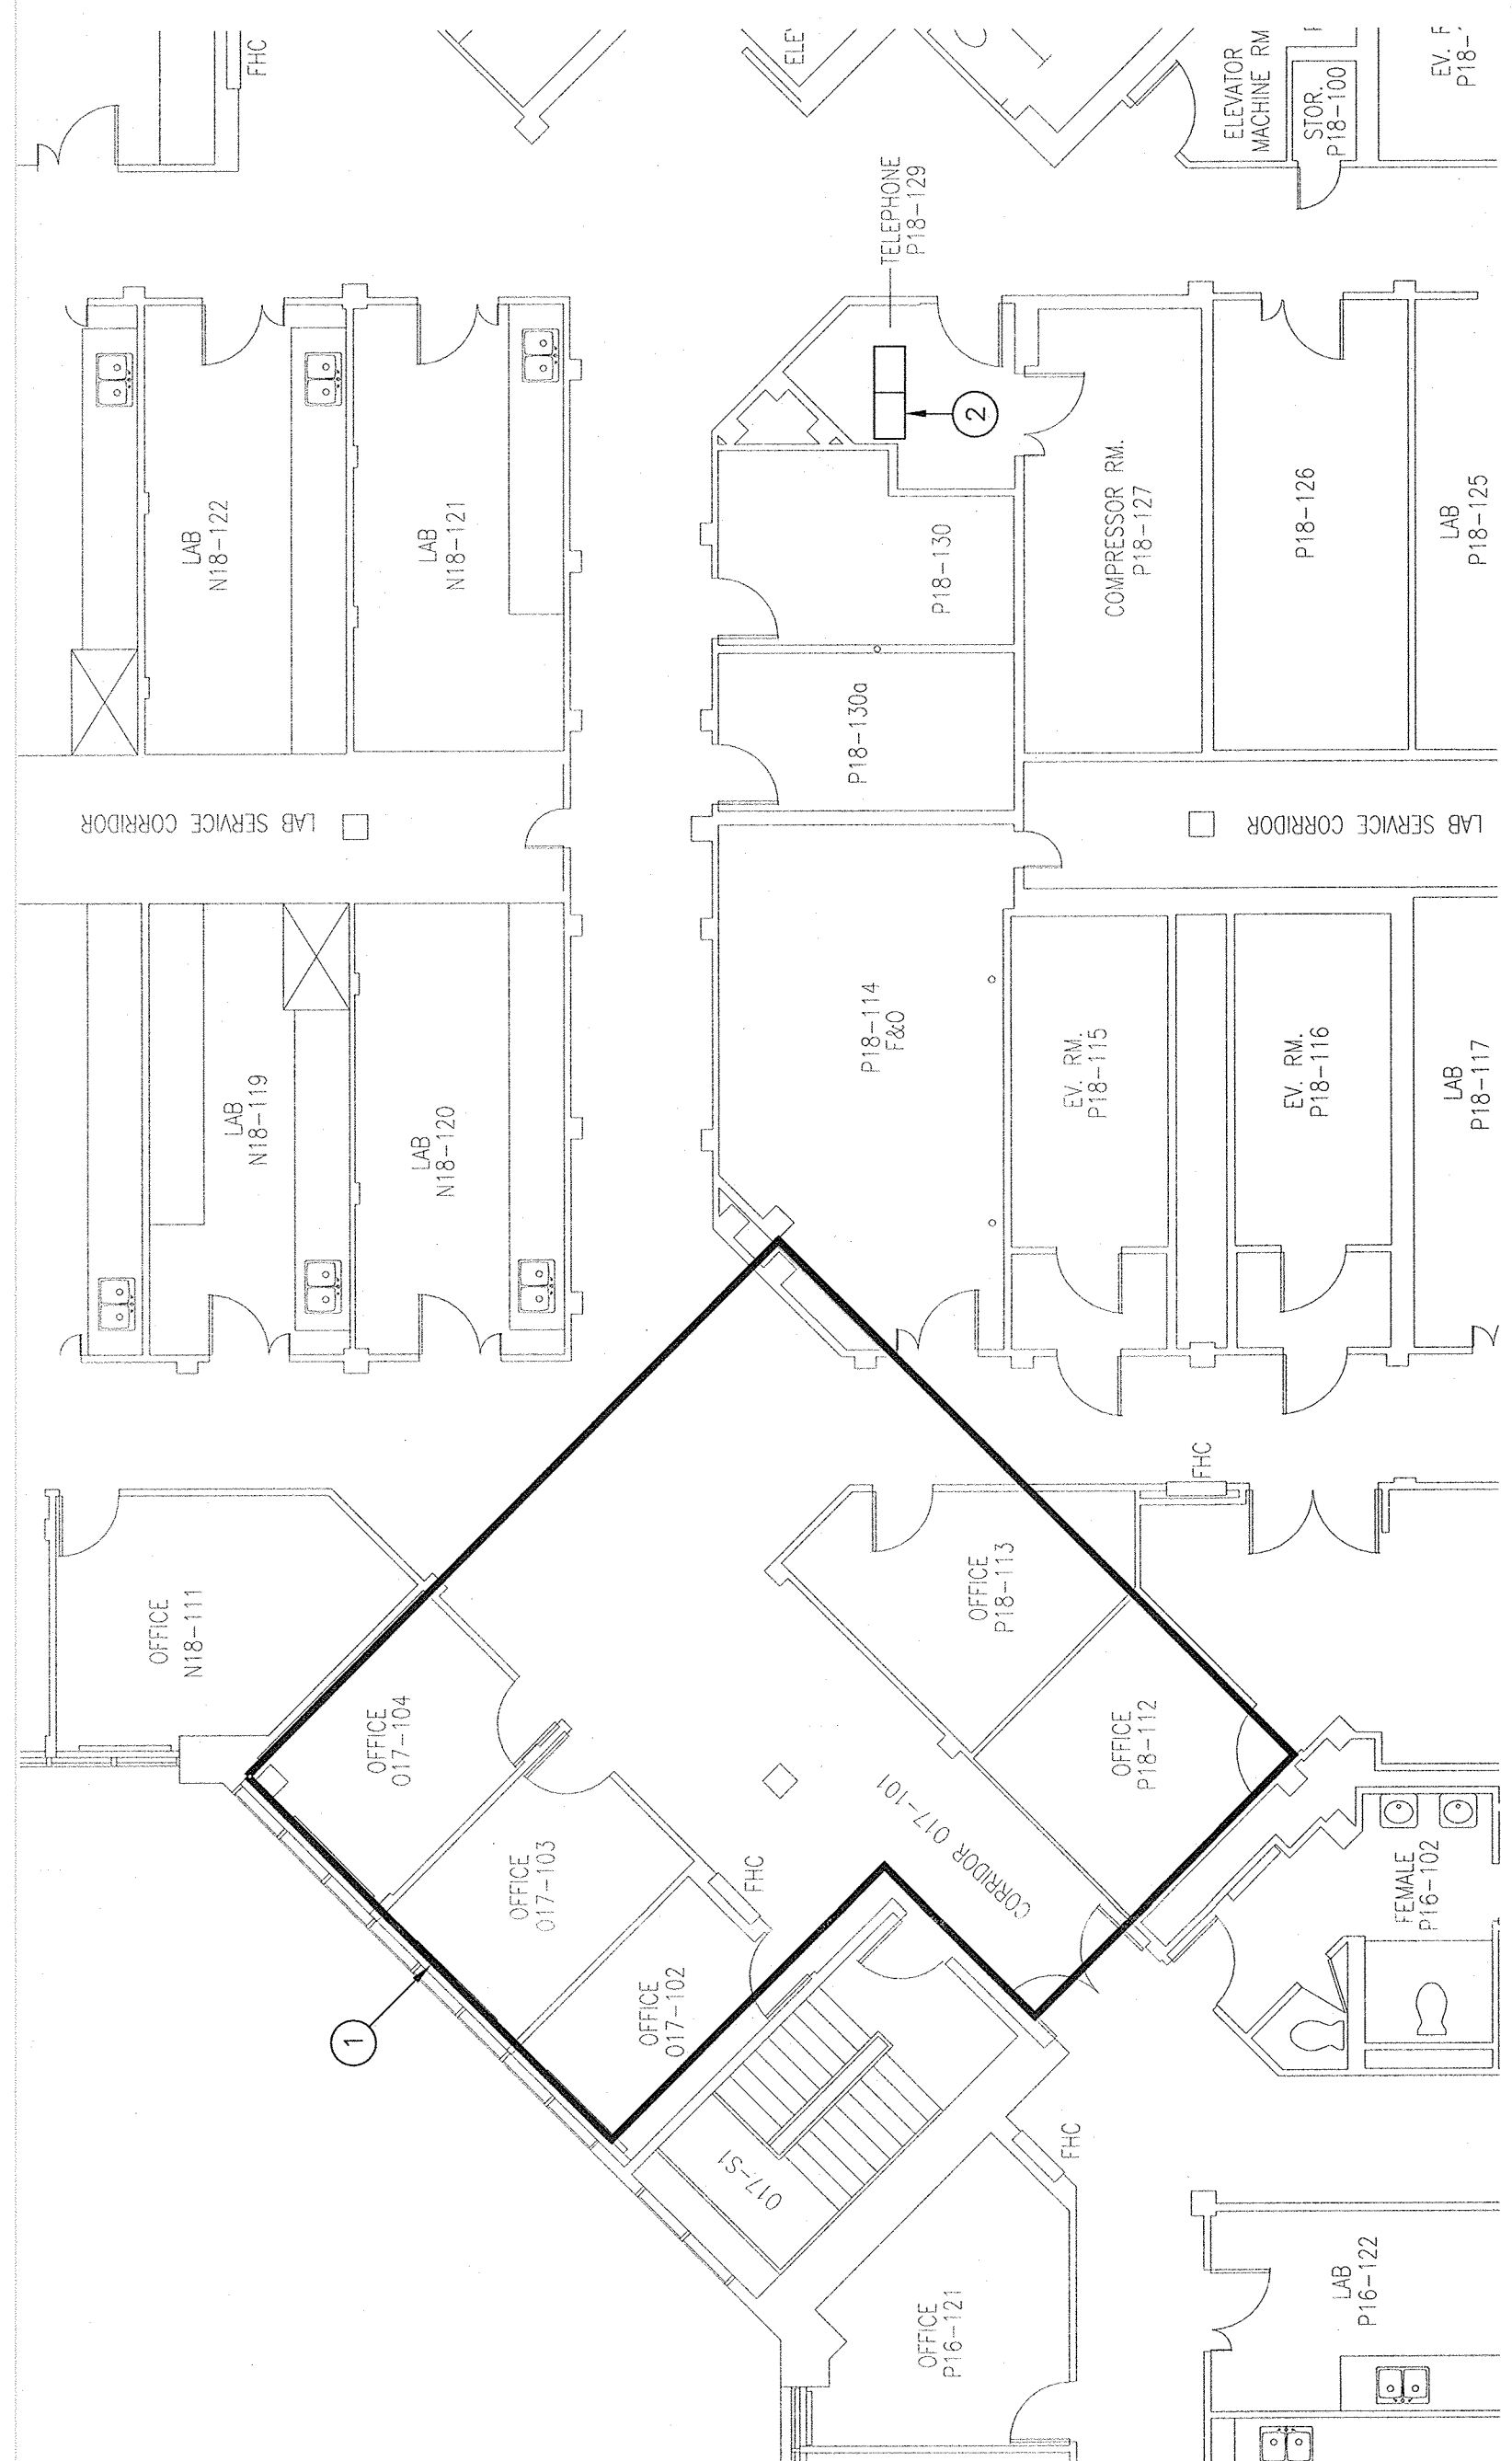

- ① OUTLINE OF EXISTING 017 ELECTRICAL ROOM FLOOR BELOW SHOWN FOR REFERENCE.
SEE DRAWING 4/FE-102 FOR APPROXIMATE LOCATION OF DATA DROP.
- ② ROUTE NEW CAT 6 CABLE IN 27mmø CONDUIT FROM 017 ELECTRICAL ROOM TO EXISTING DATA RACK IN DATA CLOSET P18-129 AS INDICATED. ALL NEW TERMINATED ON 017 ELECTRICAL ROOM UNDER THIS CONTRACT TO BE ROUTED BACK TO THIS CLOSET. ALL NEW DATA ON NEW CAT6 PATCH PANELS IN EXISTING RACK.

Q017/N18 POD PARTIAL FLOOR PLAN – LEVEL 1

