

SPECIFICATION

SITWORKS
CARTWRIGHT, NL


F6879-167008

PREPARED FOR

Fisheries and Oceans Canada

DATE

August 25, 2016
Revision 1

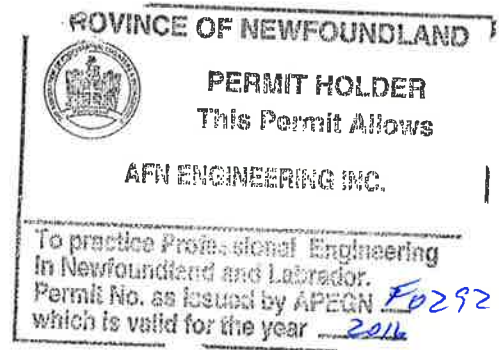

List of Drawings

Page 1

Siteworks

Cartwright, NL

2016-08-23

DRAWING NO

TITLE

C1	EXISTING SITE PLAN
C2	NEW SITE PLAN
C3	FENCE DETAILS
C4	DETAILS AND SITE SECTION

Siteworks

Cartwright, NL

2016-08-23

<u>Section</u>	<u>Title</u>	<u>Pages</u>
01 10 10	GENERAL INSTRUCTIONS	10
01 33 00	SUBMITTAL PROCEDURES	5
01 35 24	SPECIAL PROCEDURES ON FIRE SAFETY REQUIREMENTS	5
01 35 25	SPECIAL PROCEDURES ON LOCKOUT REQUIREMENTS	7
01 35 29	HEALTH AND SAFETY REQUIREMENTS	12
01 35 43	ENVIRONMENTAL PROCEDURES	2
01 50 00	TEMPORARY FACILITIES	1
01 74 11	CLEANING	1
01 78 00	CLOSEOUT SUBMITTALS	1
02 93 30	SODDING	5
31 23 25	ROCK AND GRAVEL FILL	2
32 31 13	CHAIN LINK FENCE	3

Siteworks
Cartwright, NL

2016-08-23

1.1 SCOPE

- .1 The work consists of the furnishing of all plant, labour, equipment and material for site works associated with a new boat storage area in Cartwright, Labrador, NL, in strict accordance with specifications and accompanying drawings and subject to all terms and conditions of the Contract.
- .2 Where electrical work is required, do all work in consultation with the Utility in accordance with the latest edition of the Canadian Electrical Code.

1.2 DESCRIPTION OF WORK

- .1 In general, work under this contract consists of, but is not limited to, the following:

Civil works

- Clear site of all trees, brush, vegetation, root mat, etc.
- Excavate as required to subgrades and side slopes and remove and dispose of all unsuitable material.
- Connect to existing, as applicable, and install underground services to within 1.5m of future building and trailer, including culverts, septic sewer system, and water line.
- Backfill site as required to finish grades.
- Install chain link fencing.
- Coordinate with local utility for overhead power supply, routing and installation.

Install Owner's Trailer - Scope of work to include relocation of trailer and setting in place and make ready for use

- Relocate Owner-supplied trailer from RCMP compound and set in place on new site.
- Level trailer on jack stands and wood cribbing.
- Connect services including water, sewer

and power and make ready for use.

- Skirt in trailer with wood framing, including pressure treated plywood, pressure treated wood framing, insulation, and access door.
- Construct pressure treated wood landing and stairs to each man-door to NBC.

Do not proceed with any portion of the work until the Departmental Representative has approved the Contractor's written work plan.

1.3 SITE OF WORK

- .1 Work will be carried out in Cartwright in Labrador, NL.

1.4 DATUM

- .1 If requested by the Contractor, the Departmental Representative will establish a benchmark prior to the start of work activities.

1.5 FAMILIARIZATION WITH SITE

- .1 Before submitting a bid, bidders should visit the site and its surroundings to review and verify the form, nature and extent of the work, materials needed for the completion of the work, the means of access to the site, any accommodations they may require, and in general shall obtain all necessary information as to risks, contingencies and other circumstances which may influence or affect their bid or costs to do the work. No allowance shall be made subsequently in this connection on account of error or negligence to properly observe and determine the conditions that will apply.
- .2 Contractors, bidders or those they invite to site are to review specification Section 01 35 29 - Health and Safety Requirements before visiting site. Take all appropriate safety measures for any visit to site, either before or after

acceptance of bid.

- .3 Obtain prior permission from the Departmental Representative before carrying out such site inspection.

1.6 CODES AND STANDARDS

- .1 Perform work in accordance with the latest edition of the National Building Code of Canada, and any other code of provincial or local application including all amendments up to project bid closing date provided that in any case of conflict or discrepancy, the more stringent requirements shall apply.
- .2 Materials and workmanship must meet or exceed requirements of specified standards, codes and referenced documents.

1.7 TERM ENGINEER

- .1 Unless specifically stated otherwise, the term Engineer where used in the Specifications and on the Drawings shall mean the Departmental Representative.

1.8 SETTING OUT WORK

- .1 Set grades and layout work in detail from control points and grades established by Departmental Representative.
- .2 Assume full responsibility for and execute complete layout of work to locations, lines and elevations indicated or as directed by Departmental Representative.
- .3 Provide devices needed to layout and construct work.
- .4 Supply such devices required to facilitate Departmental Representative's inspection of work.

1.9 COST BREAKDOWN

- .1 Before submitting first progress claim submit breakdown of Contract price in detail as directed by Departmental Representative and aggregating contract price.
- .2 Provide cost breakdown in same format as the numerical and subject title system used in this specification project manual and thereafter sub-divided into major work components as directed by Departmental Representative.
- .3 Upon approval by Departmental Representative, cost breakdown will be used as basis for progress payment.
- .4 This will be a lump sum project. Individual work items will not be measured separately for payment.

1.10 WORK SCHEDULE

- .1 Submit within 7 work days of notification of acceptance of bid, a construction schedule showing commencement and completion of all work within the time stated on the Bid and Acceptance Form and the date stated in the bid acceptance letter.
- .2 Provide sufficient details in schedule to clearly illustrate entire implementation plan, depicting efficient coordination of tasks and resources, to achieve completion of work on time and permit effective monitoring of work progress in relation to established milestones.
- .3 As a minimum, work schedule to be prepared and submitted in the form of Bar (GANTT) Charts, indicating work activities, tasks and other project elements, their anticipated durations and planned dates for achieving key activities and major

project milestones provided in sufficient details and supported by narratives to demonstrate a reasonable plan for completion of project within designated time. Generally Bar Charts derived from commercially available computerized project management system are preferred but not mandatory.

- .4 Submit schedule updates on a minimum bi-weekly basis and more often, when requested by Departmental Representative, due to frequent changing project conditions. Provide a narrative explanation of necessary changes and schedule revisions at each update.
- .5 The schedule, including all updates, shall be to Departmental Representative's approval. Take necessary measures to complete work within approved time. Do not change schedule without Departmental Representative's approval.
- .6 All work on the project will be completed within the time indicated on the Bid and Acceptance Form.

1.11 ABBREVIATIONS

- .1 Following abbreviations of standard specifications have been used in this specification and on the drawings:
 - CGSB - Canadian Government Specifications Board
 - CSA - Canadian Standards Association
 - NLGA - National Lumber Grades Authority
 - ASTM - American Society for Testing and Materials
- .2 Where these abbreviations and standards are used in this project, latest edition in effect on date of bid call will be

considered applicable.

1.12 SITE
OPERATIONS

- .1 Arrange for sufficient space adjacent to project site for conduct of operations, storage of materials and so on. Exercise care so as not to obstruct or damage public or private property in area. All arrangements for space and access will be made by Contractor.

1.13 PROJECT
MEETINGS

- .1 Departmental Representative will arrange project meetings and assume responsibility for setting times and recording minutes.
- .2 Project meetings will take place on site of work unless so directed by the Departmental Representative.
- .3 Departmental Representative will assume responsibility for recording minutes of meetings and forwarding copies to all parties present at the meetings.
- .4 Have a responsible member of firm present at all project meetings.

1.14 PROTECTION

- .1 Store all materials and equipment to be incorporated into work to prevent damage by any means. Note that there will be no temporary storage space available in the existing building for the Contractor.
- .2 Repair or replace all materials damaged in transit or storage to the satisfaction of Departmental Representative and at no cost to Canada.

1.15 EXISTING
SERVICES

- .1 Where work involves breaking into or connecting to existing services, carry out work at times directed by governing authorities, with minimum of disturbance to site operations, and tenant operations.

Siteworks
Cartwright, NL

2016-08-23

- .2 Before commencing work, establish location and extent of service lines in area of work and notify Departmental Representative of findings.
- .3 Submit schedule to and obtain approval from Departmental Representative for any shut-down or closure of services. Provide temporary services when directed by Departmental Representative to maintain critical facility systems.

1.16 DOCUMENTS
REQUIRED

- .1 Maintain at job site, one copy each of the following:
 - .1 Contract Drawings
 - .2 Specifications
 - .3 Addenda
 - .4 Contract and any resulting amendments signed by contracting authority.
 - .5 Test Reports
 - .6 Copy of Approved Work Schedule
 - .7 Site specific Health and Safety Plan and other safety related documents.

1.17 PERMITS

- .1 Obtain and pay for all permits, certificates and licenses as required by Municipal, Provincial, Federal and other Authorities.
- .2 Provide appropriate notifications of project to municipal and provincial inspection authorities.
- .3 Obtain compliance certificates as prescribed by legislative and regulatory provisions of municipal, provincial and federal authorities as applicable to the performance of work.
- .4 Submit to Departmental Representative, copy of application submissions and approval documents received for above referenced authorities.

Siteworks
Cartwright, NL

2016-08-23

- .5 Comply with all requirements, recommendations and advice by all regulatory authorities unless otherwise agreed in writing by Departmental Representative. Make requests for such deviations to these requirements sufficiently in advance of related work.

1.18 CUTTING,
FITTING AND
PATCHING

- .1 Execute cutting, including excavation, fitting and patching required to make work fit properly.

1.19 ACCEPTANCE

- .1 Prior to the issuance of the Certificate of Substantial Performance, in company with Departmental Representative, make a check of all work. Correct all discrepancies before final inspection and acceptance.

1.20 WORKS
COORDINATION

- .1 Responsible for coordinating the work of the various trades, where the work of such trades interfaces with each other.
- .2 Convene meetings between trades whose work interfaces and ensure that they are fully aware of the areas and the extent of where interfacing is required. Provide each trade with the plans and specifications of the interfacing trade, as required, to assist them in planning and carrying out their respective work.
- .3 Canada will not be responsible for or held accountable for any extra costs incurred as a result of the failure to carry out coordination work. Disputes between the various trades as a result of their not being informed of the areas and extent of interface work shall be the sole responsibility of the General Contractor

and shall be resolved at no extra cost to Canada.

1.21 CONTRACTOR'S
USE OF SITE

- .1 Responsible for arranging the storage of materials on or off site, and any materials stored at the site which interfere with any of the day to day activities at or near the site will be moved promptly at the Contractor's expense, upon request by Departmental Representative.
- .2 Exercise care so as not to obstruct or damage public or private property in the area.
- .3 At completion of work, restore area to its original condition. Damage to ground and property will be repaired by Contractor. Remove all construction materials, residue, excess, etc., and leave site in a condition acceptable to Departmental Representative.

1.22 WORK
COMMENCEMENT

- .1 Mobilization to project site is to commence immediately after acceptance of bid and submission of Site Specific Safety Plan and insurance and bonding documentation, unless otherwise agreed by Departmental Representative.
- .2 Project work on site is to commence as soon as possible, with a continuous reasonable work force, unless otherwise agreed by Departmental Representative.
- .3 Delivery challenges, coordination with site users, and the location of the work site may require the use of longer working days and additional work force to complete the project within the specified completion time.

- .4 Make every effort to ensure that sufficient material and equipment is delivered to site at the earliest possible date after acceptance of bid and replenished as required.

PART 1 - GENERAL

1.1 SECTION
INCLUDES

- .1 Product data.
- .2 Samples.
- .3 Certificates.

1.2 SUBMITTAL
GENERAL REQUIREMENTS

- .1 Submit to Departmental Representative for review submittals listed, including samples, certificates and other data, as specified in other sections of the Specifications. Note that any and all changes to the contract will have to be approved in writing by the Contracting Authority. Departmental Representative will provide a list of required samples/product data sheets to be provided, after contract award.
- .2 Submit with reasonable promptness and in orderly sequence so as to allow for Departmental Representative's review and not cause delay in Work. Failure to submit in ample time will not be considered sufficient reason for an extension of Contract time and no claim for extension by reason of such default will be allowed.
- .3 Do not proceed with work until relevant submissions are reviewed by Departmental Representative.
- .4 Present product data, samples and mock-ups in SI Metric units.
- .5 Where items or information is not produced in SI Metric units, provide soft converted values.
- .6 Review submittals prior to submission to Departmental Representative. Ensure during review that necessary requirements have been

determined and verified, required field measurements or data have been taken, and that each submittal has been checked and co-ordinated with requirements of Work and Contract Documents.

.1 Submittals not stamped, signed, dated and identified as to specific project will be returned unexamined by Departmental Representative and considered rejected.

.7 Notify Departmental Representative, in writing at time of submission, identifying deviations from requirements of Contract Documents stating reasons for deviations.

.8 Verify field measurements and affected adjacent work and coordinate.

.9 Contractor's responsibility for errors and omissions in submission is not relieved by Departmental Representative's review of submittals.

.10 Contractor's responsibility for deviations in submission from requirements of Contract Documents is not relieved by Departmental Representative's review.

.11 Submittal format: paper originals, or alternatively clear and fully legible photocopies of originals. Facsimiles are not acceptable, except in special circumstances pre-approved by Departmental Representative. Poorly printed non-legible photocopies or facsimiles will not be accepted and be returned for resubmission.

.12 Make changes or revision to submissions which Departmental Representative may require, consistent with Contract Documents and resubmit as directed by Departmental Representative. When resubmitting, notify Departmental Representative in writing of any

revisions other than those requested.

- .13 Keep one reviewed copy of each submittal document on site for duration of Work.

1.3 PRODUCT DATA

- .1 Product data includes drawings, diagrams, illustrations, schedules, performance charts, brochures and other data which are to be provided by Contractor to illustrate details of a portion of Work.
- .2 Submit sufficient copies of product data which are required by the General Contractor and sub-contractors plus 2 copies which will be retained by Departmental Representative. Ensure sufficient numbers are submitted to enable one complete set to be included in each of the maintenance manuals specified, if applicable.
- .3 Allow 10 calendar days for Departmental Representative's review of each submission.
- .4 Adjustments or corrections made on product data by Departmental Representative are not intended to change Contract Price. If adjustments affect value of Work, advise Departmental Representative in writing prior to proceeding with Work.
- .5 If upon review by Departmental Representative, no errors or omissions are discovered or if only minor corrections and comments are made, fabrication and installation may proceed upon receipt of shop drawings. If product data are rejected and noted to be Resubmitted, do not proceed with that portion of work until resubmission and review of corrected product data, through same submission procedures indicated above.
- .6 Accompany each submission with transmittal letter, containing:

- .1 Date.
- .2 Project title and project number.
- .3 Contractor's name and address.
- .4 Identification and quantity of each product data and sample.
- .5 Other pertinent data.
- .7 Submissions shall include:
 - .1 Date and revision dates.
 - .2 Project title and project number.
 - .3 Name and address of:
 - .1 Subcontractor.
 - .2 Supplier.
 - .3 Manufacturer.
 - .4 Contractor's stamp, signed by Contractor's authorized representative certifying approval of submissions, verification of field measurements and compliance with Contract Documents.
 - .5 Cross references to particular details of contract drawings and specifications section number for which product data submission addresses.
 - .6 Details of appropriate portions of Work.
- .8 After Departmental Representative's review, distribute copies.
- .9 The review of samples and product data by the Departmental Representative or their delegated representative is for sole purpose of ascertaining conformance with general concept. This review shall not mean that the Departmental Representative approves the detail design inherent in the product data, responsibility for which shall remain with Contractor submitting same, and such review shall not relieve Contractor of responsibility for errors or omissions in product data or of responsibility for meeting all requirements of the construction and Contract Documents. Without restricting generality of foregoing, Contractor is responsible for dimensions to be confirmed

and correlated at job site, for information that pertains solely to fabrication processes or to techniques of construction and installation and for co-ordination of Work of all sub-trades.

1.4 SCHEDULES,
PERMITS AND
CERTIFICATES

- .1 Upon acceptance of bid, submit to Departmental Representative copy of Work Schedule and various other schedules, permits, certification documents and project management plans as specified in other sections of the Specifications.
- .2 Submit copy of permits, notices, compliance Certificates received by Regulatory Agencies having jurisdiction and as applicable to the Work.
- .3 Submission of above documents to be in accordance with Submittal General Requirements procedures specified in this section.

- 1.1 SECTION INCLUDES .1 Fire Safety Requirements.
- .2 Hot Work Permit.
- 1.2 RELATED WORK .1 Section 01 35 29 - Health and Safety Requirements.
- 1.3 REFERENCES .1 Fire Protection Standards issued by Fire Protection Services of Human Resources Development Canada as follows:
- .1 National Fire Code - Standard for Construction Operations - latest edition (http://www.hrsdc.gc.ca/eng/labour/fire_protection/policies_standards/commissioner/301/page00.shtml).
- .2 National Fire Code - Standard for Welding and Cutting - latest edition (http://www.hrsdc.gc.ca/eng/labour/fire_protection/policies_standards/commissioner/302/page00.shtml).
- .3 FCC standards, may also be viewed at the Regional Labour Canada Office located at Baine Johnson Centre, 10 Fort William Place, St. John's, NL, A1C 1K4; Telephone 1-800-641-4049; fax 1-709-772-5985.
- 1.4 DEFINITIONS .1 Hot Work defined as:
- .1 Welding work.
- .2 Cutting of materials by use of torch or other open flame devices.
- .3 Grinding with equipment which produces sparks.
- 1.5 SUBMITTALS .1 Submit copy of Hot Work Procedures and sample of Hot Work permit to Departmental Representative for review, within five (5) calendar days after notification of acceptance of bid.
- .2 Submit in accordance with the Submittal General Requirements specified in Section

01 33 00.

1.6 FIRE SAFETY
REQUIREMENTS

- .1 Implement and follow fire safety measures during Work. Comply with following:
 - .1 National Fire Code, latest edition.
 - .2 Fire Protection Standards FCC 301 and FCC 302 - latest edition.
 - .3 Federal and Provincial Occupational Health and Safety Acts and Regulations as specified in Section 01 35 29 - Health and Safety Requirements.
- .2 In event of conflict between any provisions of above authorities the most stringent provision will apply. Should a dispute arise in determining the most stringent requirement, Departmental Representative will advise on the course of action to be followed.

1.7 HOT WORK
AUTHORIZATION

- .1 Obtain Departmental Representative's written "Authorization to Proceed" before conducting any form of Hot work on site.
- .2 To obtain authorization submit to Departmental Representative:
 - .1 Contractor's typewritten Hot Work Procedures to be followed on site as specified below.
 - .2 Description of the type and frequency of Hot Work required.
 - .3 Sample Hot Work Permit to be used.
- .3 Upon review and confirmation that effective fire safety measures will be implemented during performance of hot work, Departmental Representative will provide authorization to proceed as follows:
 - .1 Issue one written "Authorization to Proceed" covering the entire project for duration of work or;
 - .2 Separate work, or segregate certain parts of work, into individual entities. Each

entity requiring a separately written "Authorization to Proceed" from Departmental Representative. Follow Departmental Representative's directives in this regard.

- .4 Requirement for individual authorization based on:
 - .1 Nature or phasing of work;
 - .2 Risk to Facility operations;
 - .3 Quantity of various trades needing to perform hot work on project or;
 - .4 Other situation deemed necessary by Departmental Representative to ensure fire safety on premises.
- .5 Do not perform any Hot Work until receipt of Departmental Representative's written "Authorization to Proceed" for that portion of work.

1.8 HOT WORK PROCEDURES

- .1 Develop and implement safety procedures and work practices to be followed during the performance of Hot Work.
- .2 Procedures to include:
 - .1 Requirement to perform hazard assessment of site and immediate hot work area for each hot work event in accordance with Hazard Assessment and Safety Plan requirements of Section 01 35 29.
 - .2 Use of a Hot Work Permit system for each hot work event.
 - .3 The step by step process of how to prepare and issue permit.
 - .4 Permit shall be issued by Contractor's site Superintendent, or other authorized person designated by Contractor, granting permission to worker or subcontractor to proceed with hot work.
 - .5 Provision of a designated person to carryout a Fire Safety Watch for a minimum of 60 minutes immediately upon completion of the hot work.

.6 Compliance with fire safety codes and standards specified herein and occupational health and safety regulations specified in Section 01 35 29.

.3 Generic procedures, if used, must be edited and supplemented with pertinent information tailored to reflect specific project conditions. Clearly label as being the Hot Work Procedures applicable to this contract.

.4 Hot Work Procedures shall clearly establish worker instructions and allocate responsibilities of:

- .1 Worker(s),
- .2 Authorized person issuing the Hot Work Permit,
- .3 Fire Safety Watcher,
- .4 Subcontractors and Contractor.

.5 Brief all workers and subcontractors on Hot Work Procedures and Permit system established for project. Stringently enforce compliance.

.1 Failure to comply with the established procedures may result in the issuance of a Non-Compliance Notification at Departmental Representative's discretion with possible disciplinary measures imposed as specified in Section 01 35 29.

1.9 HOT WORK
PERMIT

.1 Hot Work Permit to include, as a minimum, the following data:

- .1 Project name and project number.
- .2 Building name, address and specific room or area where hot work will be performed.
- .3 Date when permit issued.
- .4 Description of hot work type to be performed.
- .5 Special precautions required, including type of fire extinguisher needed.
- .6 Name and signature of person authorized to issue the permit.
- .7 Name of worker (clearly printed) to

which the permit is being issued.

.8 Time Duration that permit is valid (not to exceed 8 hours). Indicate start time and date, and completion time and date.

.9 Worker signature with date and time upon hot work termination.

.10 Specified time period requiring safety watch.

.11 Name and signature of designated Fire Safety Watcher, complete with time and date when safety watch terminated, certifying that surrounding area was under continual surveillance and inspection during the full watch time period specified in Permit and commenced immediately upon completion of Hot Work.

.2 Permit to be typewritten form. Industry Standard forms shall only be used if all data specified above is included on form.

.3 Each Hot Work Permit to be completed in full and signed as follows:

.1 Authorized person issuing Permit before hot work commences.

.2 Worker upon completion of Hot Work.

.3 Fire Safety Watcher upon termination of safety watch.

.4 Returned to Contractor's Site Superintendent for safe keeping.

1.10 DOCUMENTS
ON SITE

.1 Keep Hot Work Permits and Hazard assessment documentation on site for duration of Work.

.2 Upon request, make available to Departmental Representative or to authorized safety representative for inspection.

- 1.1 SECTION INCLUDES .1 Procedures to isolate and lockout electrical facility or other equipment from energy source.
- 1.2 RELATED WORK .1 Section 01 35 24 - Fire Safety Requirements.
.2 Section 01 35 29 - Health and Safety Requirements.
- 1.3 REFERENCES .1 C22.1-06 - Canadian Electrical Code, Part 1, Safety Standard for Electrical Installations.
.2 CAN/CSA C22.3 No. 1-10 - Overhead Systems.
.3 COSH, Canada Occupational Health and Safety Regulations made under Part II of the Canada Labour Code.
- 1.4 DEFINITIONS .1 Electrical Facility: means any system, equipment, device, apparatus, wiring, conductor, assembly or part thereof that is used for the generation, transformation, transmission, distribution, storage, control, measurement or utilization of electrical energy, and that has an amperage and voltage that is dangerous to persons.
.2 Guarantee of Isolation: means a guarantee by a competent person in control or in charge that a particular facility or equipment is isolated.
.3 De-energize: in the electrical sense, that a piece of equipment is isolated and grounded, e.g. if the equipment is not grounded, it cannot be considered de-energized (DEAD).
.4 Guarded: means that an equipment or facility is covered, shielded, fenced, enclosed, inaccessible by location, or otherwise

protected in a manner that, to the extent that is reasonably practicable, will prevent or reduce danger to any person who might touch or go near such item.

- .5 Isolate: means that an electrical facility, mechanical equipment or machinery is separated or disconnected from every source of electrical, mechanical, hydraulic, pneumatic or other kind of energy that is capable of making it dangerous.
- .6 Live/alive: means that an electrical facility produces, contains, stores or is electrically connected to a source of alternating or direct current of an amperage and voltage that is dangerous or contains any hydraulic, pneumatic or other kind of energy that is capable of making the facility dangerous to persons.

1.5 COMPLIANCE REQUIREMENTS

- .1 Perform lockouts in compliance with:
 - .1 Canadian Electrical Code.
 - .2 Federal and Provincial Occupational Health and Safety Acts and Regulations as specified in Section 01 35 29.
 - .3 Regulations and code of practice as applicable to mechanical equipment or other machinery being de-energized.
 - .4 Procedures specified herein.
- .2 In event of conflict between any provisions of above authorities the most stringent provision will apply. Should a dispute arise in determining the most stringent requirement, Departmental Representative will advise on the course of action to be followed.

1.6 SUBMITTALS

- .1 Submit copy of proposed Lockout Procedures and sample form of lockout permit or lockout tags for review.

- .2 Submit documentation within 7 calendar days of acceptance of bid. Do not proceed with work until submittal has been reviewed by Departmental Representative.
- .3 Submit above documents in accordance with the submittal requirements specified in Section 01 33 00.
- .4 Resubmit Lockout Procedures with noted revisions as may result from Departmental Representative's review.

1.7 ISOLATION OF EXISTING SERVICES

- .1 Obtain Departmental Representative's written authorization prior to conducting work on an existing active, energized service or facility required as part of the work and before proceeding with lockout of such services or facility.
- .2 To obtain authorization, submit to Departmental Representative the following documentation:
 - .1 Written Request for Isolation of the service or facility and;
 - .2 Copy of Contractor's Lockout Procedures.
- .3 Make a Request for Isolation for each event, unless directed otherwise by Departmental Representative, and as follows:
 - .1 Fill-out standard forms in current use at the Facility when so directed by Departmental Representative or;
 - .2 Where no form exist at Facility, make request in writing identifying:
 - .1 Identification of system or equipment to be isolated, including it's location;
 - .2 Time duration, indicating Start time and date, and Completion time and date when isolation will be in effect;

- .3 Voltage of service feed to system or equipment being isolated;
- .4 Name of person making the request.
- .3 Document to be in typewritten format.

- .4 Do not proceed until receipt of written notification from Departmental Representative granting the Isolation Request and authorization to proceed with the isolation of designated equipment or facility. Departmental Representative may designate other individual at the Facility as the person authorized to grant the Isolation Request.
- .5 Conduct safe, orderly shut down of equipment or facilities, de-energize and isolate power and other sources of energy and lockout items in accordance with requirement of clause 1.8 below.
- .6 Plan and schedule shut down of existing services in consultation with the Departmental Representative and the Facility Manager. Minimize impact and downtime of facility operations.
- .7 Determine in advance, as much as possible, in cooperation with the Departmental Representative, the type and frequency of situations which will require a Request for Isolation. Follow Departmental Representative's directives in this regard.
- .8 Conduct hazard assessment as part of the planning process of isolating existing equipment and facilities. Hazard Assessments to conform with requirements of Health and Safety Section 01 35 29.

1.8 LOCKOUTS

- .1 Isolate and lockout electrical facilities, mechanical equipment and machinery from all potential energy sources prior to starting

work on such items.

- .2 Develop and implement lockout procedures to be followed on site as an integral part of the Work.
- .3 Use energy isolation lockout devices specifically designed and appropriate for type of facility or equipment being locked out.
- .4 Use industry standard lockout tags.
- .5 Provide appropriate safety grounding and guards as required.
- .6 Prepare Lockout Procedures in writing. Describe safe work practices, work functions and sequence of activities to be followed on site to safely isolate all potential energy sources and lockout/tagout facilities and equipment.
- .7 Include within procedures a system of worker request and issuance of individual lockout permit by a person, employed by Contractor, designated to be "in-charge" and being responsible for:
 - .1 Controlling issuance of permits or tags to workers.
 - .2 Determining permit duration.
 - .3 Maintaining record of permits and tags issued.
 - .4 Submitting a Request for Isolation to Departmental Representative when required in accordance with Clause 1.7 above.
 - .5 Designating a Safety Watcher, when one is required based on type of work.
 - .6 Ensuring equipment or facility has been properly isolated, providing a Guarantee of Isolation to worker(s) prior to proceeding with work.
 - .7 Collecting and safekeeping lockout

tags, returned by workers, as a record of the event.

- .8 Clearly establish, describe and allocate, within procedures, the responsibilities of:
 - .1 Workers.
 - .2 Designated person controlling issuance of lockout tags/permits.
 - .3 Safety Watcher.
 - .4 Subcontractors and General Contractor.
- .9 Procedures shall meet the requirements of Codes and Regulations specified in clause 1.5 above.
- .10 Generic procedures, if used, must be edited, supplemented with pertinent information and tailored to reflect specific project conditions. Clearly label as being the procedures applicable to this contract.
 - .1 Incorporate site specific rules and procedures established by Facility Manager and in force at site. Obtain such procedures through Departmental Representative.
- .11 Procedures to be in typewritten format.
- .12 Submit copy of Lockout Procedures to Departmental Representative, in accordance with submittal requirements of clause 1.6 herein, prior to commencement of work.

1.9 CONFORMANCE

- .1 Ensure that lockout procedures, as established for project on site, are stringently followed. Enforce use and compliance by all workers.
- .2 Brief all persons working on electrical facilities, mechanical and other equipment fed by an energy source on requirements of this section.

- .3 Failure to perform lockouts in accordance with regulatory requirements or follow procedures specified herein may result in the issuance of a Non-Compliance Notification at Departmental Representative's discretion with possible disciplinary measures imposed as specified in Section 01 35 29.

1.10 DOCUMENTS
ON SITE

- .1 Post Lockout Procedures on site in common location for viewing by workers.
- .2 Keep copies of Request for Isolation submitted to Departmental Representative and lockout permits or tags issued to workers during the course of work for full project duration.
- .3 Upon request, make such data available to Departmental Representative or to authorized safety representative for inspection.

- 1.1 RELATED WORK .1 Section 01 35 24 - Special Procedures on Fire Safety Requirements.
- 1.2 DEFINITIONS .1 COSH: Canada Occupational Health and Safety Regulations made under Part II of the Canada Labour Code.
- .2 Competent Person: means a person who is:
- .1 Qualified by virtue of personal knowledge, training and experience to perform assigned work in a manner that will ensure the health and safety of persons in the workplace, and;
- .2 Knowledgeable about the provisions of occupational health and safety statutes and regulations that apply to the Work and;
- .3 Knowledgeable about potential or actual danger to health or safety associated with the Work.
- .3 Medical Aid Injury: any minor injury for which medical treatment was provided and the cost of which is covered by Workers' Compensation Board of the province in which the injury was incurred.
- .4 PPE: personal protective equipment.
- .5 Work Site: where used in this section shall mean areas, located at the premises where Work is undertaken, used by Contractor to perform all of the activities associated with the performance of the Work.
- 1.3 SUBMITTALS .1 Make submittals in accordance with Section 01 33 00.
- .2 Submit to Departmental Representative, copies of the following documents including updates.
- .1 Site specific Health and Safety Plan.

- .2 Building permit, compliance certification and other permits obtained.
- .3 Reports or directives issued by Federal and Provincial Inspectors and other Authorities having jurisdiction.
- .4 Accident or incident reports.
- .5 WHMIS - MSDS data sheets.
- .6 Name of Contractor's Representative designated to perform health and safety supervision in site.
- .7 Certificate of clearance from Workplace Health Safety and Compensation Commission (Assessment Services Department) of Newfoundland and Labrador.

- .3 Submit within five (5) work days of notification of Bid Acceptance. Provide one (1) copy.
- .4 Departmental Representative will review Health and Safety Plan and provide comments.
- .5 The Contractor will revise the Plan as appropriate and resubmit within five (5) work days after receipt of comments.
- .6 Departmental Representative's review and comments made of the Plan shall not be construed as an endorsement, approval or implied warranty of any kind by Canada and does not reduce Contractor's overall responsibility for Occupational Health and Safety of the Work.
- .7 Submit revisions and updates made to the Plan during the course of Work.

1.4 COMPLIANCE REQUIREMENTS

- .1 Comply with the Occupational Health and Safety Act for the Province of Newfoundland and Labrador, and the Occupational Health and Safety Regulations

made pursuant to the Act.

- .2 Comply with Canada Labour Code Part II, (entitled Occupational Health and Safety) and the Canada Occupational Health and Safety Regulations (COSH) as well as any other regulations made pursuant to the Act.

- .1 The Canada Labour Code can be viewed at:
[www.http://laws.justice.gc.ca/en/L-2/](http://laws.justice.gc.ca/en/L-2/)

- .2 COSH can be viewed at:
[www.http://laws.justice.gc.ca/eng/SOR-86-304/ne.html](http://laws.justice.gc.ca/eng/SOR-86-304/ne.html).

- .3 A copy may be obtained at: Canadian Government Publishing Public Works & Government Services Canada Ottawa, Ontario, K1A 0S9 Tel: (819) 956-4800 (1-800-635-7943) Publication No. L31-85/2000 E or F).

- .3 Observe construction safety measures of:
 - .1 Part 8 of National Building Code.
 - .2 Municipal by-laws and ordinances.

- .4 In case of conflict or discrepancy between any specified requirements, the more stringent shall apply.

- .6 Maintain Workers Compensation Coverage in good standing for duration of Contract. Provide proof through submission of Certificate of Clearance from Workplace Health, Safety and Compensation Commission (Assessment Services Department) of Newfoundland and Labrador.

- .7 Obtain and maintain worker medical surveillance documentation where prescribed by legislation or regulation.

1.5 RESPONSIBILITY

- .1 Be responsible for health and safety of persons on site, safety of property and for protection of persons and environment

adjacent to the site to extent that they may be affected by conduct of Work.

- .2 Comply with and enforce compliance by all workers, sub-contractors and other persons granted access to work site with safety requirements of Contract Documents, applicable Federal, Provincial, and local by-laws, regulations, and ordinances, and with site specific Health and Safety Plan.

1.6 SITE CONTROL
AND ACCESS

- .1 Control the Work and entry points to Work Site. Approve and grant access only to workers and authorized persons. Immediately stop and remove non-authorized persons.

- .1 Departmental Representative will provide names of those persons authorized by Departmental Representative to enter onto Work Site and will ensure that such authorized persons have the required knowledge and training on Health and Safety pertinent to their reason for being at the site, however, Contractor remains responsible for the health and safety of authorized persons while at the Work Site.

- .2 Isolate Work Site from other areas of the premises by use of appropriate means.

- .1 Erect fences, hoarding, barricades and temporary lighting as required to effectively delineate the Work Site, stop non-authorized entry, and to protect pedestrians and vehicular traffic around and adjacent to the Work and create a safe environment.

- .2 Post signage at entry points and other strategic locations indicating restricted access and conditions for access.

- .3 Provide safety orientation session to

persons granted access to Work Site.
Advise of hazards and safety rules to be observed while on site.

- .4 Ensure persons granted site access wear appropriate PPE. Supply PPE to inspection authorities who require access to conduct tests or perform inspections.
- .5 Secure Work Site against entry when inactive or unoccupied and to protect persons against harm. Provide security guard where adequate protection cannot be achieved by other means.

1.7 PROTECTION

- .1 Give precedence to safety and health of persons and protection of environment over cost and schedule considerations for Work.
- .2 Should unforeseen or peculiar safety related hazard or condition become evident during performance of Work, immediately take measures to rectify situation and prevent damage or harm. Advise Departmental Representative verbally and in writing.

1.8 FILING OF NOTICE

- .1 File Notice of Project with pertinent provincial health and safety authorities prior to beginning of Work.

1.9 PERMITS

- .1 Post permits, licenses and compliance Certificates at Work Site.
- .2 Where a particular permit or compliance certificate cannot be obtained, notify Departmental Representative in writing and obtain approval to proceed before carrying out applicable portion of work.

1.10 HAZARD ASSESSMENTS

- .1 Perform site specific health and safety hazard assessment of the Work and its site.

- .2 Carryout initial assessment prior to commencement of Work with further assessments as needed during progress of work, including when new trades and subcontractors arrive on site.
- .3 Record results and address in Health and Safety Plan.
- .4 Keep documentation on site for entire duration of the Work.

1.11 PROJECT/SITE
CONDITIONS

- .1 The following are known or potential project related safety hazards at site:
 - .1 Heavy lifting.
 - .2 Working at heights.
 - .3 Cutting tools and other construction power tools.
 - .4 Sharp objects (construction debris).
- .2 Above items shall not be construed as being complete and inclusive of potential health, and safety hazards encountered during work.
- .3 Include above items into hazard assessment process.

1.12 MEETINGS

- .1 Contractor to hold pre-construction health and safety meeting prior to commencement of Work. Ensure attendance of:
 - .1 Superintendent of Work.
 - .2 Contractor's designated Health & Safety Site Representative.
 - .3 Subcontractor's Health and Safety Site Representative.
 - .4 Health and Safety Site Coordinator.
- .2 Conduct regularly scheduled tool box and safety meetings during the Work in

conformance with Occupational Health and Safety regulations.

.3 Keep documents on site.

1.13 HEALTH AND SAFETY PLAN

.1 Prior to commencement of Work, develop written Health and Safety Plan specific to the work. Implement, maintain, and enforce Plan for entire duration of Work and until final demobilization from site.

.2 Health and Safety Plan shall include the following components:

.1 List of health risks and safety hazards identified by hazard assessment.

.2 Control measures used to mitigate risks and hazards identified.

.3 On-site Contingency and Emergency Response Plan as specified below.

.4 On-site Communication Plan as specified below.

.5 Name of Contractor's designated Health & Safety Site Representative and information showing proof of his/her competence and reporting relationship in Contractor's company.

.6 Names, competence and reporting relationship of other supervisory personnel used in the Work for occupational health and safety purposes.

.3 On-site Contingency and Emergency Response Plan shall include:

.1 Operational procedures, evacuation measures and communication process to be implemented in the event of an emergency.

.2 Evacuation Plan: site and floor plan layouts showing escape routes, marshaling areas. Details on alarm notification methods, fire drills,

location of fire fighting equipment and other related data.

- .3 Name, duties and responsibilities of persons designated as Emergency Warden(s) and deputies.
- .4 Emergency Contacts: name and telephone number of officials from:
 - .1 General Contractor and subcontractors.
 - .2 Pertinent Federal and Provincial Departments and Authorities having jurisdiction.
 - .3 Local emergency resource organizations.
- .4 On-site Communication Plan:
 - .1 Procedures for sharing of work related safety information to workers and subcontractors, including emergency and evacuation measures.
- .5 Address all activities of the Work including those of subcontractors.
- .6 Review Health and Safety Plan regularly during the Work. Update as conditions warrant to address emerging risks and hazards, such as whenever new trade or subcontractor arrive at Work Site.
- .7 Departmental Representative will respond in writing, where deficiencies or concerns are noted and may request re-submission of the Plan with correction of deficiencies or concerns.
- .8 Post copy of the Plan, and updates, prominently on Work Site.

1.14 SAFETY
SUPERVISION

- .1 Employ Health & Safety Site Representative responsible for daily supervision of health and safety of the Work.
- .2 Health & Safety Site Representative may be

the Superintendent of the Work or other person designated by Contractor and shall be assigned the responsibility and authority to:

- .1 Implement, monitor and enforce daily compliance with health and safety requirements of the Work
 - .2 Monitor and enforce Contractor's site-specific Health and Safety Plan.
 - .3 Conduct site safety orientation session to persons granted access to Work Site.
 - .4 Ensure that persons allowed site access are knowledgeable and trained in health and safety pertinent to their activities at the site or are escorted by a competent person while on the Work Site.
 - .5 Stop the Work as deemed necessary for reasons of health and safety.
- .3 Health & Safety Site Representative must:
- .1 Be qualified and competent person in occupational health and safety.
 - .2 Have site-related working experience specific to activities of the Work.
 - .3 Be on Work Site at all times during execution of the Work.
 - .4 All supervisory personnel assigned to the Work shall also be competent persons.
 - .5 Inspections:
 - .1 Conduct regularly scheduled safety inspections of the Work on a minimum daily basis. Record deficiencies and remedial action taken.
 - .2 Conduct Formal Inspections on a minimum monthly basis. Use standardized safety inspection forms. Distribute to subcontractors.
 - .3 Follow-up and ensure corrective measures are taken.
 - .6 Keep inspection reports and

supervision related documentation on site.

1.15 TRAINING

- .1 Use only skilled workers on Work Site who are effectively trained in occupational health and safety procedures and practices pertinent to their assigned task.
- .2 Maintain employee records and evidence of training received. Make data available to Departmental Representative upon request.
- .3 When unforeseen or peculiar safety-related hazard, or condition occur during performance of Work, follow procedures in place for Employee's Right to Refuse Work in accordance with Acts and Regulations of Province having jurisdiction and advise Departmental Representative verbally and in writing.
- .4 All workers dealing with hazardous materials are required to provide evidence of training, in accordance with Provincial regulations.

1.16 MINIMUM
SITE SAFETY RULES

- .1 Notwithstanding requirement to abide by federal and provincial health and safety regulations; ensure the following minimum safety rules are obeyed by persons granted access to Work Site:
 - .1 Wear appropriate PPE pertinent to the Work or assigned task; minimum being hard hat, safety footwear, safety glasses and safety vest.
 - .2 Immediately report unsafe condition at site, near-miss accident, injury and damage.
 - .3 Maintain site and storage areas in a tidy condition free of hazards causing injury.
 - .4 Obey warning signs and safety tags.
- .2 Brief persons of disciplinary protocols to

be taken for non compliance. Post rules on site.

1.17 CORRECTION OF
NON-COMPLIANCE

- .1 Immediately address health and safety non-compliance issues identified by authority having jurisdiction or by Departmental Representative.
- .2 Provide Departmental Representative with written report of action taken to correct non-compliance of health and safety issues identified.
- .3 Departmental Representative will stop Work if non-compliance of health and safety regulations is not corrected in a timely manner.

1.18 INCIDENT
REPORTING

- .1 Investigate and report the following incidents to Departmental Representative:
 - .1 Incidents requiring notification to Provincial Department of Occupational Safety and Health, Workers Compensation Board or to other regulatory Agency.
 - .2 Medical aid injuries.
 - .3 Property damage in excess of \$10,000.00.
- .2 Submit report in writing.

1.19 HAZARDOUS
PRODUCTS

- .1 Comply with requirements of Workplace Hazardous Materials Information System (WHMIS).
- .2 Keep MSDS data sheets for all products delivered to site.
 - .1 Post on site.
 - .2 Submit copy to Departmental Representative.

1.20 SITE RECORDS

- .1 Maintain on Work Site copy of safety related documentation and reports stipulated to be produced in compliance

with Acts and Regulations of authorities having jurisdiction and of those documents specified herein.

- .2 Upon request, make available to Departmental Representative or authorized Safety Officer for inspection.

1.21 POSTING OF DOCUMENTS

- .1 Ensure applicable items, articles, notices and orders are posted in conspicuous location on Work Site in accordance with Acts and Regulations of Province having jurisdiction.
- .2 Post other documents as specified herein, including:
 - .1 Site specific Health and Safety Plan.
 - .2 WHMIS data sheets.

1.1 DEFINITIONS

- .1 Hazardous Material: Product, substance, or organism that is used for its original purpose; and that is either dangerous goods or a material that may cause adverse impact to the environment or adversely affect health of persons, animals, or plant life when released into the environment.

1.2 DISPOSAL OF WASTES AND HAZARDOUS MATERIALS

- .1 Do not bury rubbish and waste materials on site.
- .2 Do not dispose of hazardous waste or volatile materials, such as mineral spirits, paints, thinners, oil or fuel into waterways, storm or sanitary sewers or waste landfill sites.
- .3 Store, handle and dispose of hazardous materials and hazardous waste in accordance with applicable federal and provincial laws, regulations, codes and guidelines.
- .4 Dispose of construction waste materials and demolition debris, resulting from work, at approved landfill sites only. Carryout such disposal in strict accordance with provincial and municipal rules and regulations. Separate out and prevent improper disposal of items banned from landfills.
- .5 Establish methods and undertake construction practices which will minimize waste and optimize use of construction materials. Separate at source all construction waste materials, demolition debris and product packaging and delivery containers into various waste categories in order to maximize recycling abilities of various materials and avoid disposal of debris at landfill site(s) in a "mixed state". Where recycling firms, specializing in recycling of specific materials exist, transport such materials to the recycling facility and avoid disposal at landfill sites.

- .6 Communicate with landfill operator prior to commencement of work, to determine what specific construction, demolition and renovation waste materials have been banned from disposal at the landfill and at transfer stations.

1.3 POLLUTION
CONTROL

- .1 Control emissions from equipment and plant to local authorities emission requirements.
- .3 Cover or wet down dry materials and rubbish to prevent blowing dust and debris.
- .4 Have emergency spill response equipment and rapid clean-up kit, appropriate to work, at site. Locate adjacent to work and where hazardous materials are stored. Provide personal protective equipment as required for clean-up.
- .5 Report, to Federal and Provincial Department of the Environment, spills of petroleum and other hazardous materials as well as accidents having potential of polluting the environment. Also notify Departmental Representative and submit a written spill report to Departmental Representative within 24 hours of occurrence.

1.1 SANITARY FACILITIES

- .1 Provide sanitary facilities for work force in accordance with governing regulations and ordinances.
- .2 Post notices and take such precautions as required by local health authorities. Keep area and premises in sanitary condition.

1.2 WATER SUPPLY

- .1 Arrange, pay for and maintain temporary water supply in accordance with governing regulations and ordinances.

1.3 CONSTRUCTION SIGN AND NOTICES

- .1 Contractor or subcontractor advertisement signboards are not permitted on site.
- .2 Only notices of safety or instructions are permitted on site.
- .3 Maintenance and Disposal of Site Signs:
 - .1 Maintain approved signs and notices in good condition for duration of project and dispose of off site on completion of project or earlier if directed by Departmental Representative.

1.4 REMOVAL OF TEMPORARY FACILITIES

- .1 Remove temporary facilities from site when directed by Departmental Representative.

PART 1 - GENERAL

1.1 GENERAL

- .1 Conduct cleaning and disposal operations to comply with local ordinances and anti-pollution laws.
- .2 Store volatile waste in covered metal containers, and remove from premises at end of each working day.
- .3 Prevent accumulation of wastes which create hazardous conditions.
- .4 Provide adequate ventilation during use of volatile or noxious substances.

1.2 CLEANING DURING CONSTRUCTION

- .1 Maintain project grounds and public properties in a tidy condition, free from accumulations of waste material and debris. Clean areas on a daily basis.
- .2 Provide on-site garbage containers for collection of waste materials and debris.
- .3 Remove waste materials and debris from site on a daily basis.

1.3 FINAL CLEANING

- .1 In preparation for acceptance of the Work perform final cleaning.

1.1 PROJECT RECORD
DOCUMENTS

- .1 Departmental Representative will provide two white print sets of contract drawings and two copies of Specifications.
- .2 Maintain at site one set of the contract drawings and specifications to record actual "As-Built" site conditions.
- .3 At project completion, submit full manual of products used in new work (complete with manufacturer's data sheets, appliance warranty data, user manuals, etc.).

PART 1 - GENERAL

- 1.1 RELATED WORK .1 Section 01 33 00 - Submittal Procedures.
- 1.2 SUBMITTALS .1 Submit samples in accordance with
Section 01 33 00 - Submittal Procedures.
- .2 Submit:
.1 Sod for each type specified.
- .3 Obtain approval of samples by Departmental
Representative.
- 1.3 QUALITY ASSURANCE .1 Test Reports: certified test reports showing
compliance with specified performance
characteristics and physical properties.
- .2 Certificates: product certificates signed by
manufacturer certifying materials comply
with specified performance characteristics
and criteria and physical requirements.
- .3 Pre-Installation Meetings: conduct
pre-installation meeting to verify project
requirements, installation instructions and
warranty requirements.
- 1.4 SCHEDULING .1 Schedule sod installation when frost has left
ground.
- .2 Schedule sod laying to coincide with
preparation of soil surface.

Part 2 - PRODUCTS

- 2.1 MATERIALS .1 Number One Turf Grass Nursery Sod: sod that
has been especially sown and cultivated in
nursery fields as turf grass crop.

- .1 Number one named cultivars: Nursery sod grown from certified seed.
- .2 Turf Grass Nursery Sod Quality:
 - .1 Not more than 2 broadleaf weeds on 10 other weeds per 40 square metres.
 - .2 Density of sod sufficient so that no soil is visible from height of 1500mm when mown to height of 50 mm.
 - .3 Mowing height limit: 35 to 65 mm.
 - .4 Soil portion of sod: 15 mm in thickness.

.2 Water:

- .1 Potable, free of impurities.

.3 Fertilizer:

- .1 To Canada "Fertilizers Act" and "Fertilizers Regulations".
- .2 Complete, synthetic, slow release with 65% of nitrogen content in waterinsoluble form.

.4 Topsoil: mixture of mineral particulates, micro organisms and organic matter which provides suitable medium for supporting intended plant growth.

- .1 Soil texture based on The Canadian System of Soil Classification, to consist of 20% to 70% sand, minimum 7% clay, and contain 2 to 10 % organic matter by weight.
- .2 Contain no toxic elements or growth inhibiting materials.
- .3 Free from:
 - .1 Debris and stones over 50 mm diameter.
 - .2 Course vegetative material, 10 mm diameter and 100 mm length, occupying more than 2% of soil volume.
- .4 Consistence: friable when moist.

2.2 SOURCE QUALITY CONTROL

- .1 Obtain approval from Departmental Representative of sod at source.
- .2 When proposed source of sod is approved, use no other source without written

Authorization from the Departmental Representative.

Part 3 - EXECUTION

3.1 PREPARATION

- .1 Contractor is responsible for grading plan. The intent is to fill depressions/low points providing positive site drainage, with no low points that could create water ponding.
- .2 Do not perform work under adverse field conditions such as frozen soil, excessively wet soil or soil covered with snow, ice, or standing water.
- .3 Fine grade surface free of humps and hollows to smooth, even grade, surface to drain naturally.
- .4 Remove and dispose of weeds; debris; stones 50 mm in diameter and larger; and other deleterious materials; off site.
- .5 Cultivate fine grade approved by Departmental Representative to 25mm depth immediately prior to sodding.
- .6 Spread topsoil in uniform layers not exceeding 150 mm, over unfrozen subgrade free of standing water.

3.2 SOD PLACEMENT

- .1 Lay sod within 24 hours of being lifted.
- .2 Lay sod sections in rows, longitudinally, along contours of slopes, joints staggered. Butt sections closely without overlapping or leaving gaps between sections. Cut out irregular or thin sections with sharp implements.
- .3 Roll sod as directed by Departmental Representative. Provide close contact

between sod and soil by light rolling. Use of heavy roller to correct irregularities in grade is not permitted.

- .4 The first 3 sod rows parallel to the apron, are to be staked, to prevent potential lifting due to proximity to apron area.

3.3 FERTILIZING PROGRAM

- .1 Fertilize during establishment and warranty periods to program agreed to by Departmental Representative.

3.4 ACCEPTANCE

- .1 Turfgrass Nursery Sod areas will be accepted by Departmental Representative provided that:
 - .1 Sodded areas are properly established.
 - .2 Sod is free of bare and dead spots, and without weeds.
 - .3 No surface soil is visible from height of 1500 mm when grass has been cut to height of 50 mm.
 - .4 Sodded areas have been cut minimum 2 times, and within 24 hours prior to acceptance.
 - .5 Fertilizing in accordance with fertilizer program has been carried out at least once.

3.5 WARRANTY

- .1 Perform following operations from time of acceptance until end of warranty period:
 - .1 Water sodded Turfgrass Nursery Sod at weekly intervals to obtain optimum soil moisture conditions to depth of 100 mm.
 - .2 Repair and resod dead or bare spots to satisfaction of Departmental Representative.
 - .3 Cut grass and remove clippings as directed by Departmental Representative.
 - .1 Turf Grass Nursery Sod:
 - .1 50 mm during normal growing conditions.
 - .4 Fertilize areas in accordance with fertilizing program. Spread half of required amount of fertilizer in one

direction and remainder at right angles.
.5 Eliminate weeds by mechanical means to extent acceptable to Departmental Representative.

3.6 CLEANING

- .1 Upon completion of installation, remove surplus materials, rubbish, tools and equipment barriers.

1.1 SCOPE

- .1 This section specifies supply, placement and compaction of rock and gravel fill as required to bring the grade to the underside of the granular base courses as noted on the drawings or as directed by Departmental Representative.
- .2 Contractor to review drawings and visit site prior to tender close to determine the required rock and gravel fill quantities to suit the work. Existing material excavated as part of the work may be re-used, only if meeting these specifications to the approval of the Departmental Representative. Where fill is referred to as Type 1, Type 2 or Type 3 fill, the standard of acceptance will be as defined in the NL Municipal Water and Sewer Master Specifications.

1.2 ROCK FILL

- .1 Rock fill will be of hard, durable, evenly graded blasted stone having a maximum diameter of 300 mm in major portion of fill and a maximum diameter of 150 mm in upper 600 mm of rock fill. Fill material will contain not more than 6 percent by weight passing the 25 mm sieve. Rock fill to be evenly graded within the limits specified.
- .2 Use of shale rock or slate will not be permitted.
- .3 Only rock fill material approved by Departmental Representative will be placed. Material will be placed uniformly across full cross-section in layers not exceeding 300 mm loose depth. Use suitable earth moving and surface grading equipment to place and spread rock fill in continuous and uniform horizontal layers.

Compact rock fill after each 300 mm lift.

1.3 GRAVEL FILL

- .1 Gravel fill will consist of hard, durable, particles of stone mixed with suitable binding material. It shall be free from flat, elongated particles and shall be well graded. Top 300 mm of fill will consist of gravel fill as specified. Place gravel fill in two (2) equal lifts to minimum 95% standard proctor density. When tested by means of laboratory sieves it shall fulfill requirements as follows:

Sieve Size	% by Weight Passing
56 mm	100
16 mm	45-80
4.75mm	25-55
1.25mm	10-35
0.300 mm	5-15
0.075 mm	3-8

PART 1 GENERAL

1.1 SHOP DRAWINGS

- .1 Submit shop drawings in accordance with Section 01 33 00.
- .2 Drawings to indicate:
 - .1 Exact location of and number of line posts, corner posts, strainer posts and end posts.
 - .2 Height of posts and extension below surface.

PART 2 PRODUCTS

2.1 MATERIALS

- .1 Chain-link fence fabric: to CAN/CGSB-138.1.
 - .1 3.7mm diameter, steel wire, woven in a 50mm mesh, hot dipped galvanized (to an average of 610 g/m² after weaving).
 - .2 Height of fabric: 2.44m high.
 - .3 Top security barbed wire to manufacturer's recommendations.
- .2 Posts, braces and rails: to CAN/CGSB 138.2 galvanized steel pipe.
 - .1 Dimensions are:
 - .1 End posts - 114mm O.D. and 1.067m longer than the height of fabric.
 - .2 Line posts - 60mm O.D. and 0.838m longer than height of fabric and spaced at 2.4m.
 - .3 Bracing - 48mm O.D.
 - .4 Railing - 48mm O.D.
 - .2 Acceptable material: schedule 40 steel pipe, galvanized.
 - .3 Bottom tension wire: 610 g/m² single strand, galvanized steel wire, 5mm diameter.
 - .4 Tie wire fasteners: 3.7mm diameter aluminum.
 - .5 Fittings:
 - .1 Tension bars, tension bands, brace bands, rail ends to be fabricated from hot dipped galvanized pressed steel.
 - .6 Gate: as shown on the drawings.

PART 3 EXECUTION

3.1 PREPARATION

- .1 Inspect area for fence location to determine appropriate attachment methods.
- .2 Remove trees, vegetation, overburden and/or rock material, as required for installation of concrete footings.

3.2 ERECTION

- .1 Erect fence along lines as directed by Departmental Representative and in accordance with CAN/CGSB-138.3.
- .2 Install line and end posts as indicated on drawings.
- .3 Space line posts to accommodate a spacing of 3.3m C.C, measured parallel to the ground surface.
- .4 Install brace between end and nearest line post, placed in centre of panel and parallel to ground surface. Install braces on both sides of line posts in similar manner.
- .5 Install overhang top and caps.
- .6 Install top rail between posts and fasten securely to posts and secure waterproof caps and overhang tops.
- .7 Install bottom tension wire, stretch tightly and fasten securely to end line posts with turnbuckles and tension bar bands.
- .8 Lay out fence fabric. Stretch tightly to tension recommended by manufacturer and fasten to end and line posts with tension bar secured to post with tension bar bands spaced at 300mm intervals. Knuckled selvage at bottom. Twisted selvage at top.
- .9 Secure fabric to top rails, line posts and bottom tension wire with tie wires at 450mm intervals. Give tie wires minimum of two twists.
- .10 Install gate and barbed wire as shown on the drawings and as acceptable by manufacturer and Departmental Representative.

3.3 TOUCH-UP

- .1 Clean damaged surfaces with wire brush removing loose and cracked coatings. Apply two coats of organic zinc-rich paint to damaged areas. Pre-treat damaged surfaces according to manufacturers' instructions for zinc-rich paint.

3.4 CONCRETE

- .1 Set posts in concrete having minimum compressive strength of 35MPa at 28 days. Assume a C-1 class of exposure in the mix design.

3.5 CLEANING

- .1 Clean and trim areas distributed by operations. Dispose of surplus material as directed by Departmental Representative.

END OF SECTION