
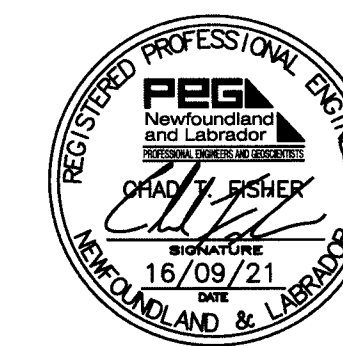


GENERAL NOTES:

1. ALL DIMENSIONS IN MILLIMETRES UNLESS SPECIFIED OTHERWISE.
2. ALL ELEVATIONS IN METRES.
3. DO NOT SCALE FROM DRAWINGS, USE DIMENSIONS AS SHOWN.
4. REFER TO ELECTRICAL DRAWINGS FOR ALL ELECTRICAL DETAILS.
5. LOCATION OF ELECTRICAL EQUIPMENT AND UNDERGROUND ELECTRICAL CONDUIT FEED TO BE CONFIRMED ON ELECTRICAL DRAWINGS. INSTALL PENETRATION IN FLOOR SLAB, EXISTING FLOOR BOARDS AND EXTERIOR TO ACCOMMODATE ELECTRICAL CONDUITS. ALL PENETRATIONS TO BE SEALED AND WEATHER TIGHT.
6. UNDERSIDE OF ALL FOOTINGS AND FLOOR SLAB TO BE PLACED ON COMPACTED GRANULAR MATERIAL WITH A MINIMUM ALLOWABLE BEARING CAPACITY OF 150 kPa.
7. DO NOT PLACE FOOTINGS ON FROZEN GROUND.
8. PLACE 6 MIL POLYETHYLENE VAPOR BARRIER UNDER ALL SLABS AND FOOTINGS PLACED ON GRADE.
9. REMOVE ALL LOOSE MATERIAL UNDER SLAB, DOWN TO UNDISTURBED COMPETENT MATERIAL AS DIRECTED BY THE DEPARTMENTAL REPRESENTATIVE. GRANULAR FILL UNDER SLAB AND THICKENED FOOTING TO BE COMPACTED TO 98% STANDARD PROCTOR DENSITY.
10. INSTALL CONTROL JOINTS IN FLOOR SLAB TO APPROVAL OF DEPARTMENTAL REPRESENTATIVE. DO NOT CUT REINFORCING STEEL AND SEAL JOINT TO APPROVAL OF DEPARTMENTAL REPRESENTATIVE.
11. CONTRACTOR SHALL CONFIRM EXISTING SHED DIMENSIONS PRIOR TO POURING NEW SLAB FOUNDATION.
12. CONTRACTOR TO PROVIDE LIFTING PLAN TO RELOCATE EXISTING SHED AND SUBMIT TO DEPARTMENTAL REPRESENTATIVE FOR APPROVAL. CONTRACTOR SHALL REPAIR ANY DAMAGES AT THEIR OWN COST.
13. PROVIDE PENETRATIONS IN NEW CONCRETE FOUNDATION TO ACCOMMODATE ELECTRICAL CONDUIT FEEDS.

SMALL CRAFT HARBOURS



E	ISSUED FOR TENDER	16/09/21
D	ISSUED FOR FINAL REVIEW	16/09/21
C	ISSUED FOR 99% REVIEW	16/09/21
revisions		date

project

WHARF CONSTRUCTION FERMEUSE, NL

drawing

SECTION AND DETAILS

designed C. FISHER

date APRIL, 2016

drawn R. SNOW

date APRIL, 2016

approved

date

Tender

DFO Project Manager

project number

721920

drawing no.

C10 OF 11