


ELECTRICAL LEGEND

	CEILING MOUNTED FIXTURE
	TRACK LIGHT HEAD
	WALL MOUNTED FIXTURE
	RECESSED FIXTURE
	FLUORESCENT FIXTURE
	CEILING OR SUSPENDED MOUNT FLUORESCENT FIXTURE
	1-BAR CEILING JUNCTION BOX
	SINGLE GANG SWITCH
	3-WAY SWITCH
	LOW VOLTAGE SWITCH
	120V KEY SWITCH
	DIMMER SWITCH
	SINGLE OUTLET RECEPTACLE
	DUPLEX RECEPTACLE
	CH = COUNTER HEIGHT DUPLEX RECEPTACLE
	WP = WEATHER PROOF DUPLEX RECEPTACLE
	SINGLE OUTLET RECEPTACLE
	DUPLEX RECEPTACLE
	CH = COUNTER HEIGHT DUPLEX RECEPTACLE
	WP = WEATHER PROOF DUPLEX RECEPTACLE
	BASEBOARD HEATER
	HEAT TRACE LINE
	FIRE ALARM MINI SOUNDER/STROBE
	FIRE ALARM HORN
	FIRE ALARM STROBE
	FIRE ALARM BELL
	FIRE ALARM HORN/STROBE COMBINATION
	FIRE ALARM BELL/STROBE COMBINATION
	FIRE ALARM PULL STATION & ZONE
	HEAT DETECTOR & ZONE
	SMOKE DETECTOR AND ZONE
	END OF LINE DEVICE
	MAGNETIC DOOR HOLDER
	MAGNETIC MOTOR STARTER
	COMBINATION MOTOR STARTER
	MANUAL MOTOR STARTER
	ELECTRICAL FUSED DISCONNECT
	ELECTRICAL UNFUSED DISCONNECT
	ELECTRICAL FUSED DISCONNECT 60A FUSE 100A SWITCH
	ELECTRICAL PANEL
	RECESSED ELECTRICAL PANEL
	SURFACE ELECTRICAL PANEL
	OTHER PANEL
	RECESSED OTHER PANEL
	SURFACE OTHER PANEL
	UTILITY METER SOCKET
	FLOOR BOX RECEPTACLE


ACTION LEGEND	
SYMBOL	REQUIRED ACTION
E	EXISTING TO REMAIN. IF DEVICE IS A FIXTURE REPLACE BURNT OUT LAMPS AND BALLASTS.
X	REMOVE ALL CONDUIT WHERE POSSIBLE TO APPROVAL OF ENGINEER. PROVIDE BLANK COVER TO MATCH FINISHES FOR RECESSED BOXES.
R	REPLACE WITH NEW IN EXISTING LOCATION.
N	NEW DEVICE AND WIRING. FOLLOW ALL REQUIREMENTS REGARDING BUILDING FINISHES.
NO SYMBOL/TYPE	WHERE NO SYMBOL OR TYPE IS PROVIDED, FIXTURE IS TO REMAIN AS EXISTING. NO ACTION.

3 ACTION LEGEND
E1 SCALE: NTS

4 KEY PLAN
E1 SCALE: NTS

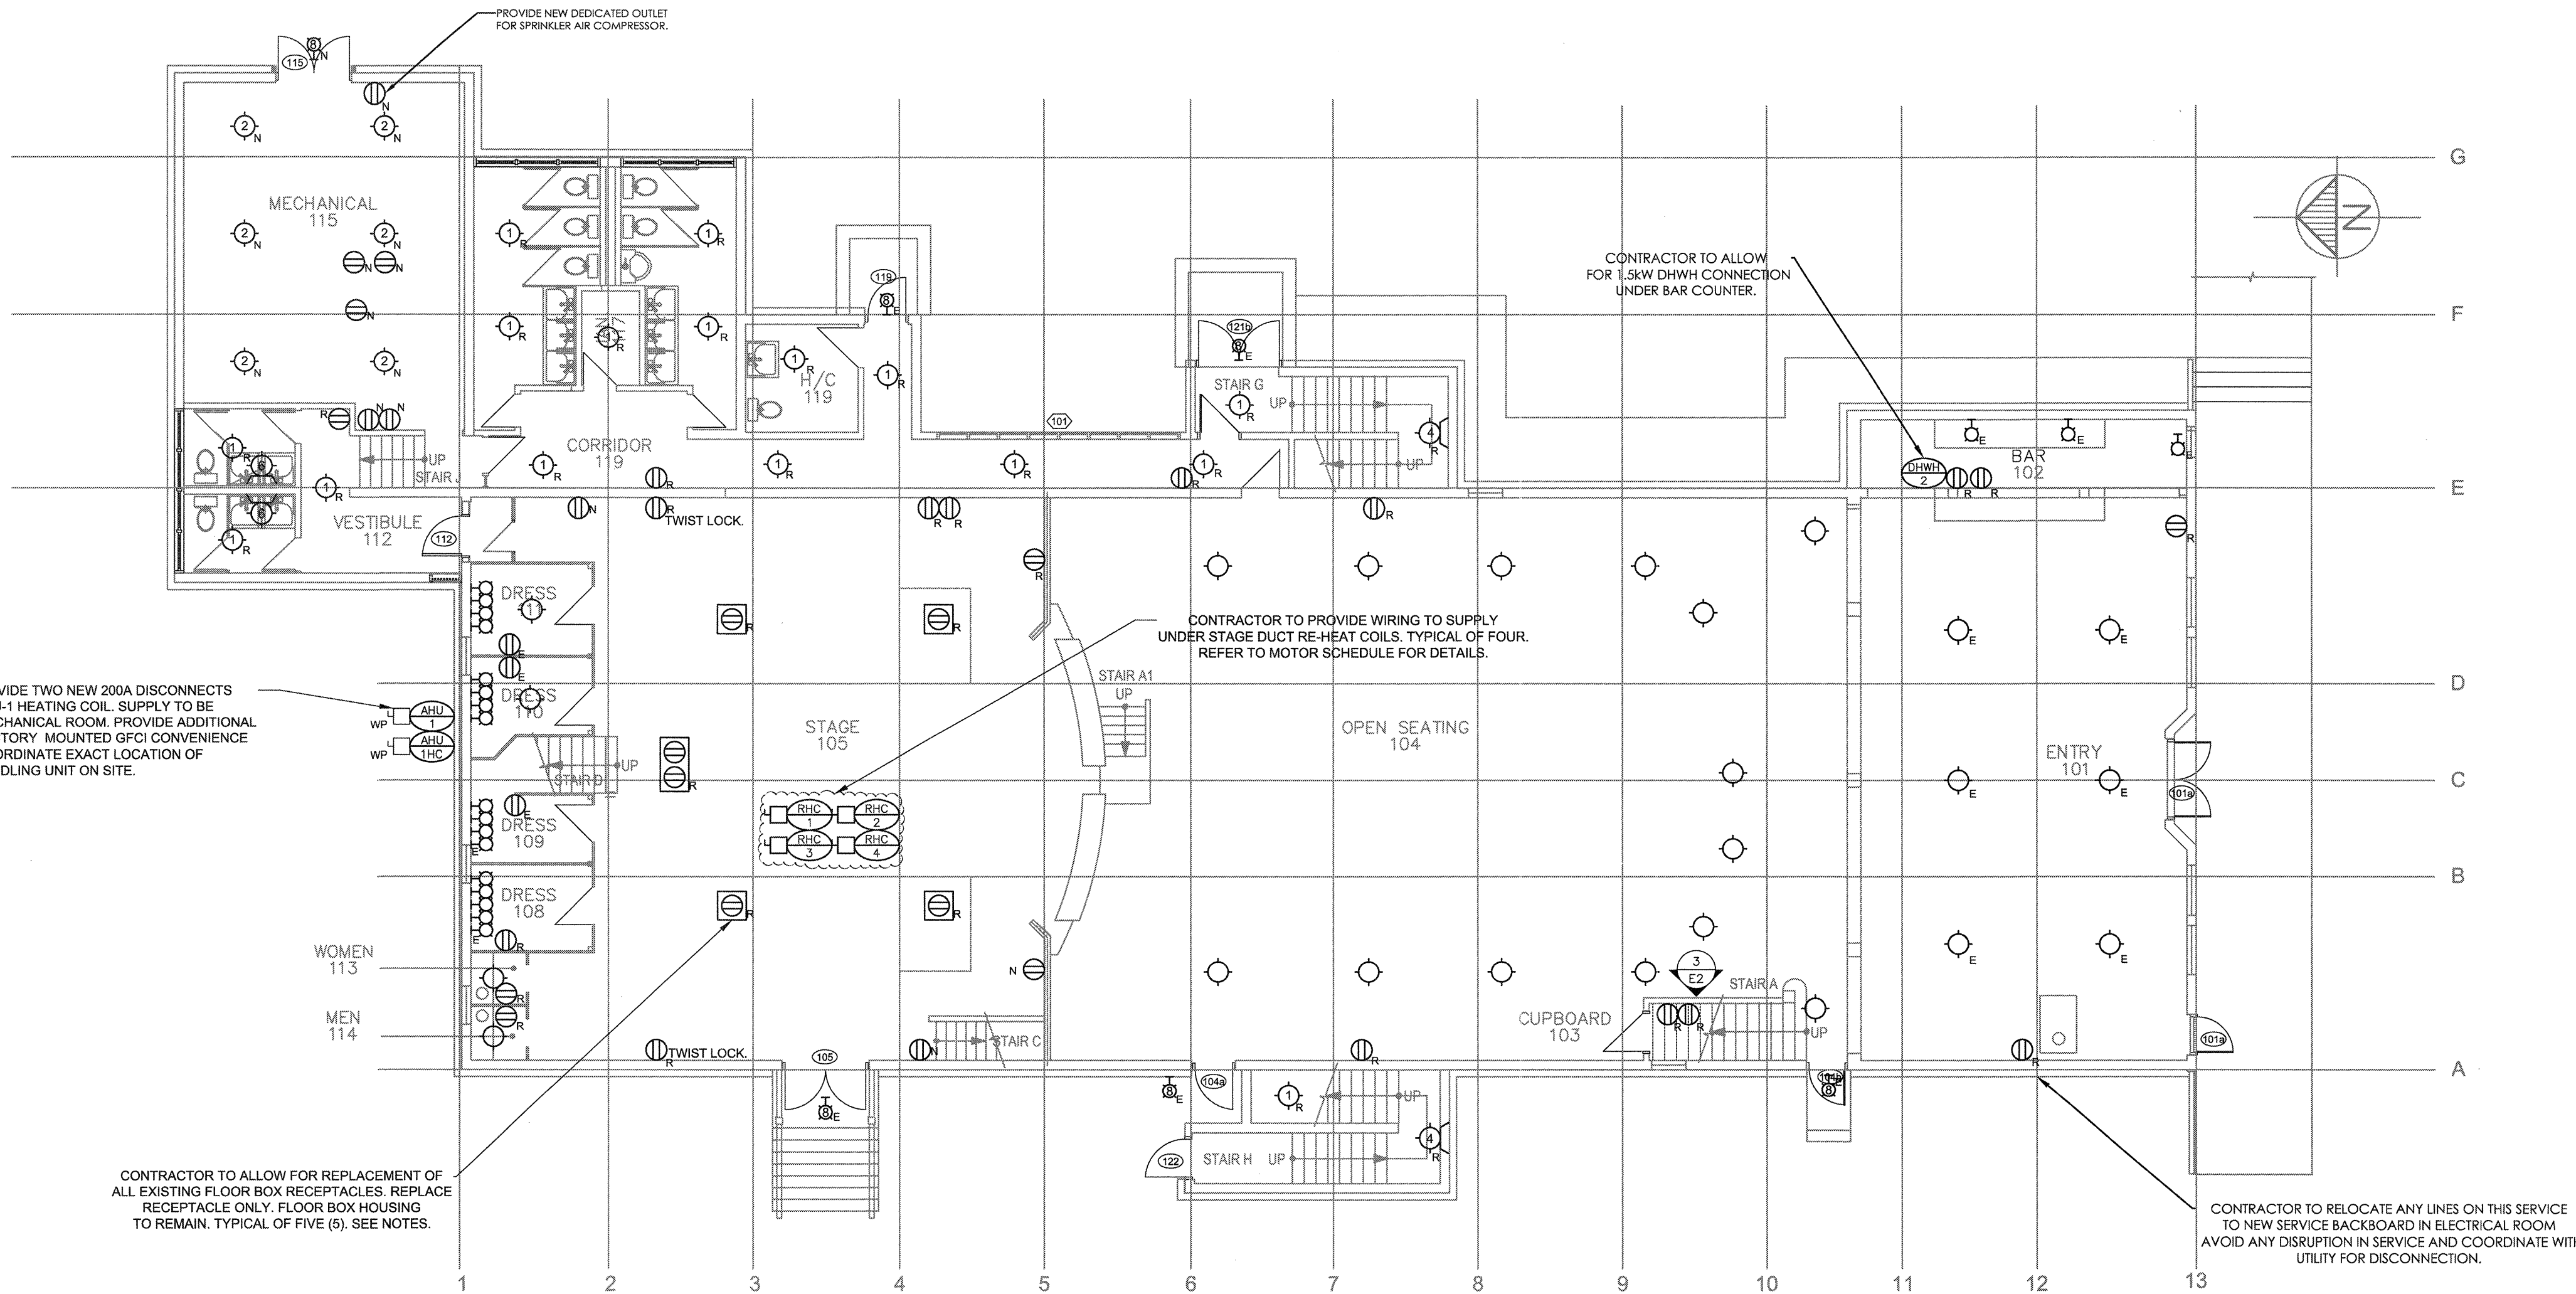


1 MAIN FLOOR LIGHTING & POWER LAYOUTS
E1 SCALE: 1:100

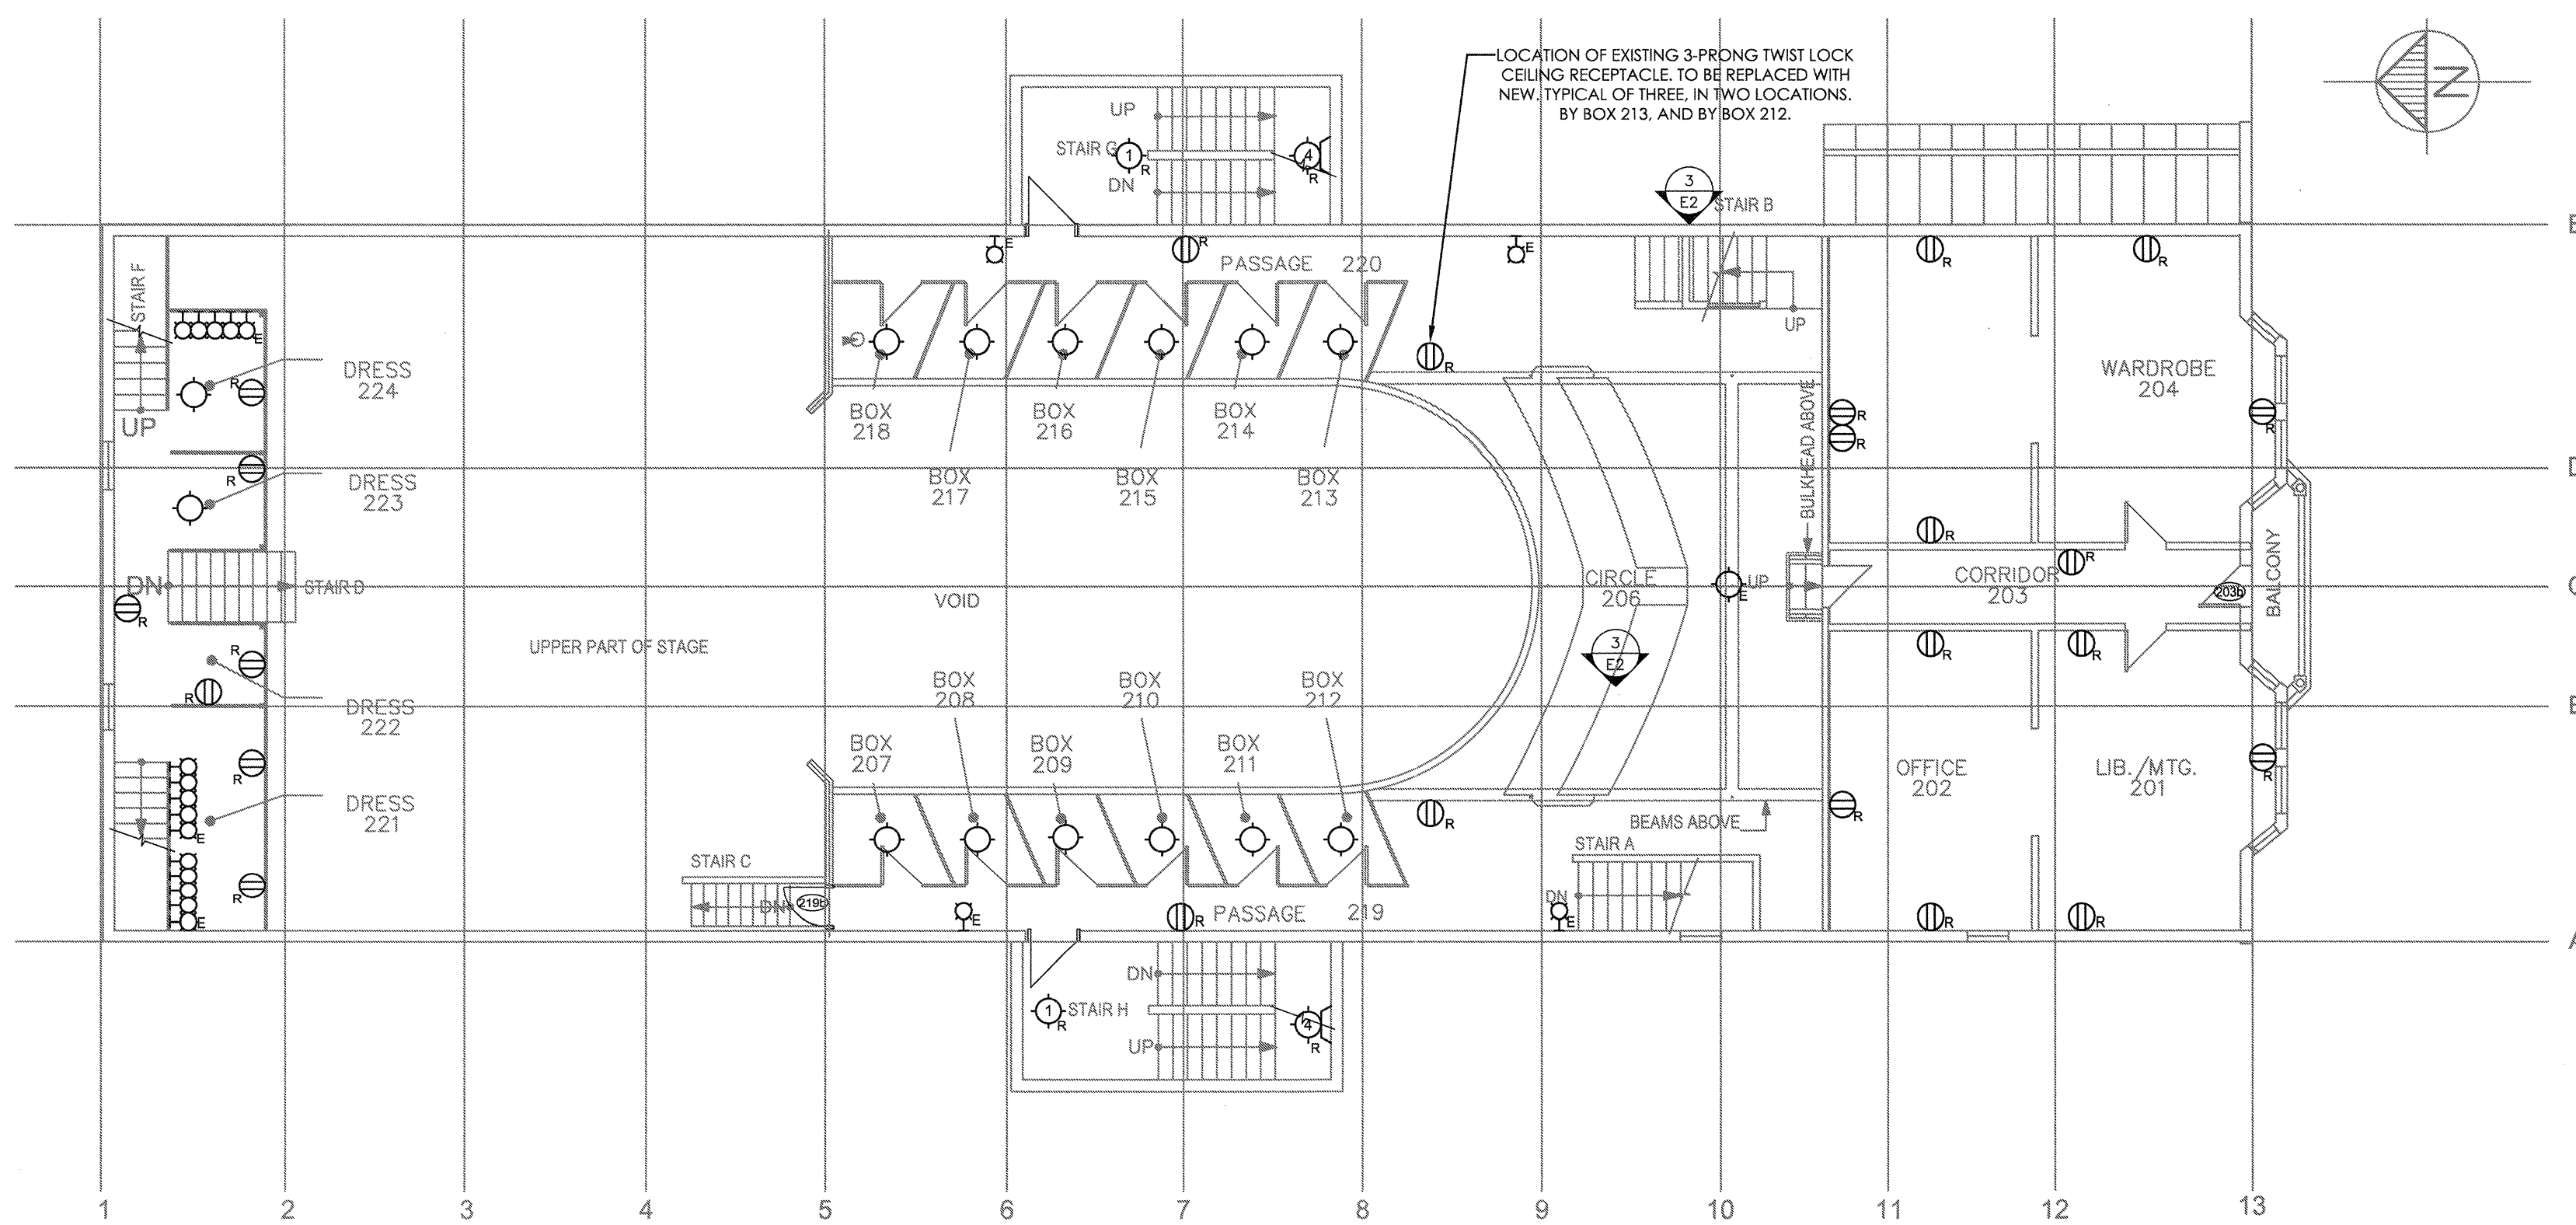

2 SECOND FLOOR LIGHTING & POWER LAYOUTS
E1 SCALE: 1:100

- NOTES:
- CONTRACTOR TO REPLACE ALL FLOOR BOX RECEPTACLES WITH NEW.
 - PROVIDE DEDICATED CIRCUIT FOR EACH FLOOR BOX.
 - CONTRACTOR TO REWIRE (5) EXISTING STAGE RECEPTACLES SO THAT NO MORE THAN THREE (3) RECEPTACLES ARE SUPPLIED FROM A SINGLE CIRCUIT. PROVIDE ADDITIONAL CIRCUITS AND WIRING AS REQUIRED.
 - ADD NEW RECEPTACLES WHERE SHOWN.
 - SHOW ALL CHANGES ON AS BUILT DRAWINGS.

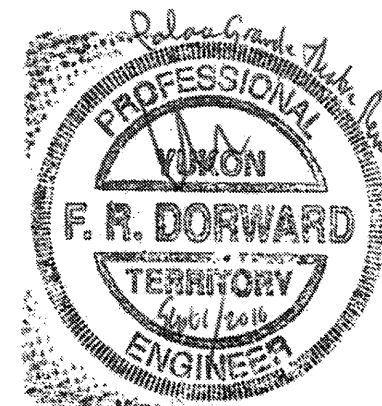

Palace Grand Theatre Renovation
PERMIT TO PRACTICE
Signature: [Signature]
Date: Sept 1/2016
PERMIT NUMBER: PP001
Association of Professional Engineers of Yukon

8	ISSUE FOR TENDER	31 AUG 2016
7	ISSUED FOR 95% REVIEW	5 AUG 2016
Revision/	Description/Description	Date/Date
A	A detail number	A
B	B source drawing no.	B/C
C	C detail on drawing no.	

Client/client
PARK CANADA AGENCY
WESTERN AND NORTHERN REGION

Project title/Titre du projet
**DAWSON CITY
YUKON TERRITORY**
**PALACE GRAND THEATRE
FOUNDATION/ MECHANICAL
/ELECTRICAL RENOVATION
AND GENERAL UPGRADE**

Consultant Signature Only
Designed by/Concept par
MS
Drawn by/Dessiné par
MS
PWGSC Project Manager/Administrateur de Projets TPSGC
TOM DUNPHY
Regional Manager, Architectural and Engineering Services
Gestionnaire régionale, Services d'architectural et de génie, TPSGC

Drawing title/Titre du dessin
**MAIN FLOOR AND SECOND FLOOR
LIGHTING AND POWER LAYOUT**