


1	ISSUED FOR TENDER	SEP 13 2016
revisions		date

project
**POINT WOLFE
SERVICE BUILDINGS
FUNDY NATIONAL PARK
ALMA, NB**
ALBERT COUNTY, NB


drawing
**ELECTRICAL
EXISTING FLOOR PLANS**

designed	M. MELANSON	conçu
date	JULY 2016	
drawn	M. MELANSON	dessiné
date	JULY 2016	
approved		approuvé
date		
Tender		Soumission
PWSC Project Manager	Administrateur de projets TPSDC	
project number	R.075852.001	no. du projet
drawing no.	E-1.0	no. du dessin

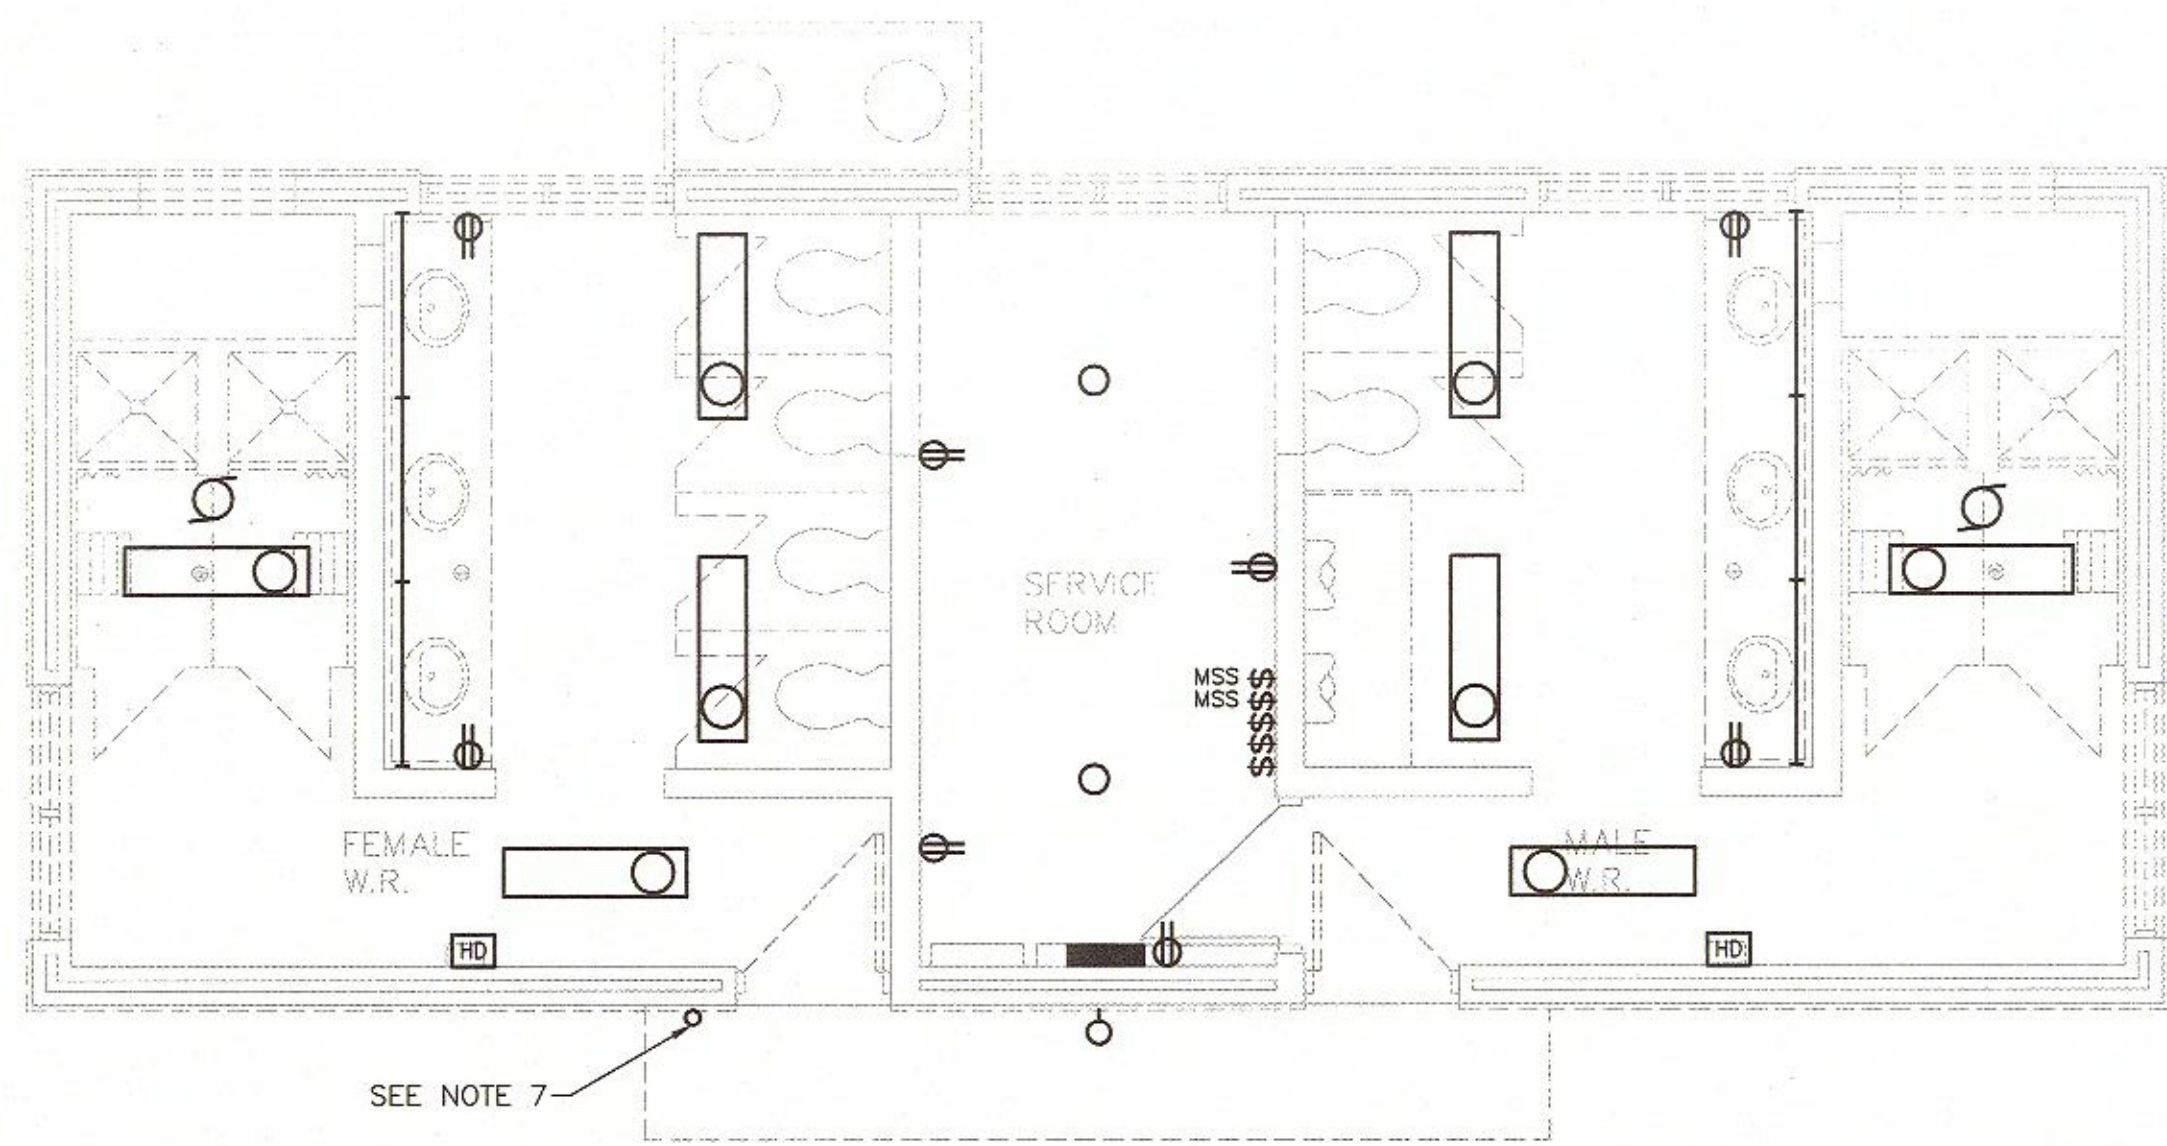


TYPICAL DEMOLITION FLOOR PLAN - W.R. #2.4.7.11

SCALE: 1:50
0m 1m 2m 3m 4m 5m

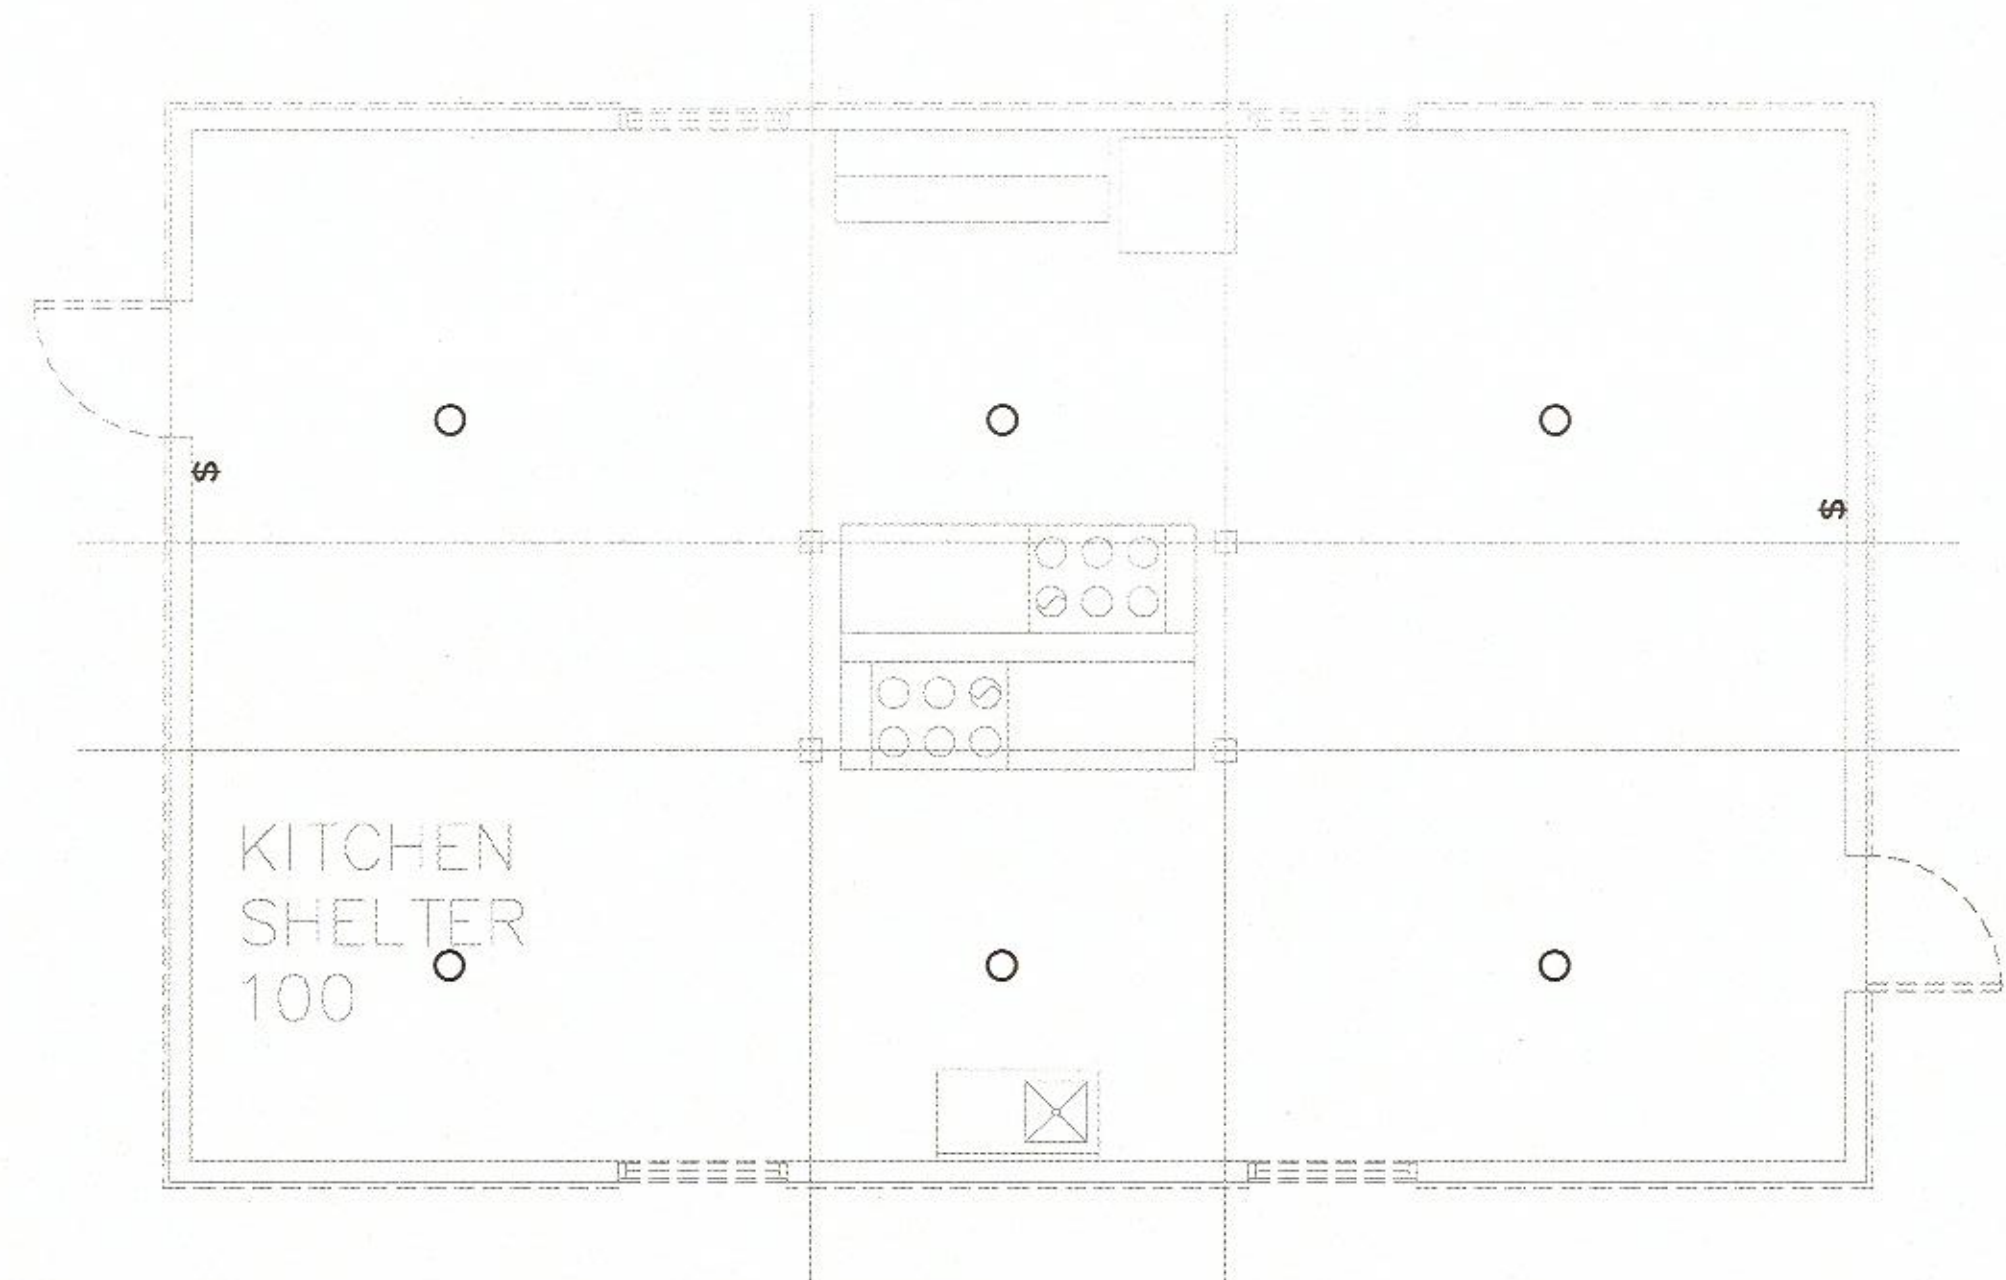


DEMOLITION FLOOR PLAN - KITCHEN SHELTER #3

SCALE: 1:50
0m 1m 2m 3m 4m 5m

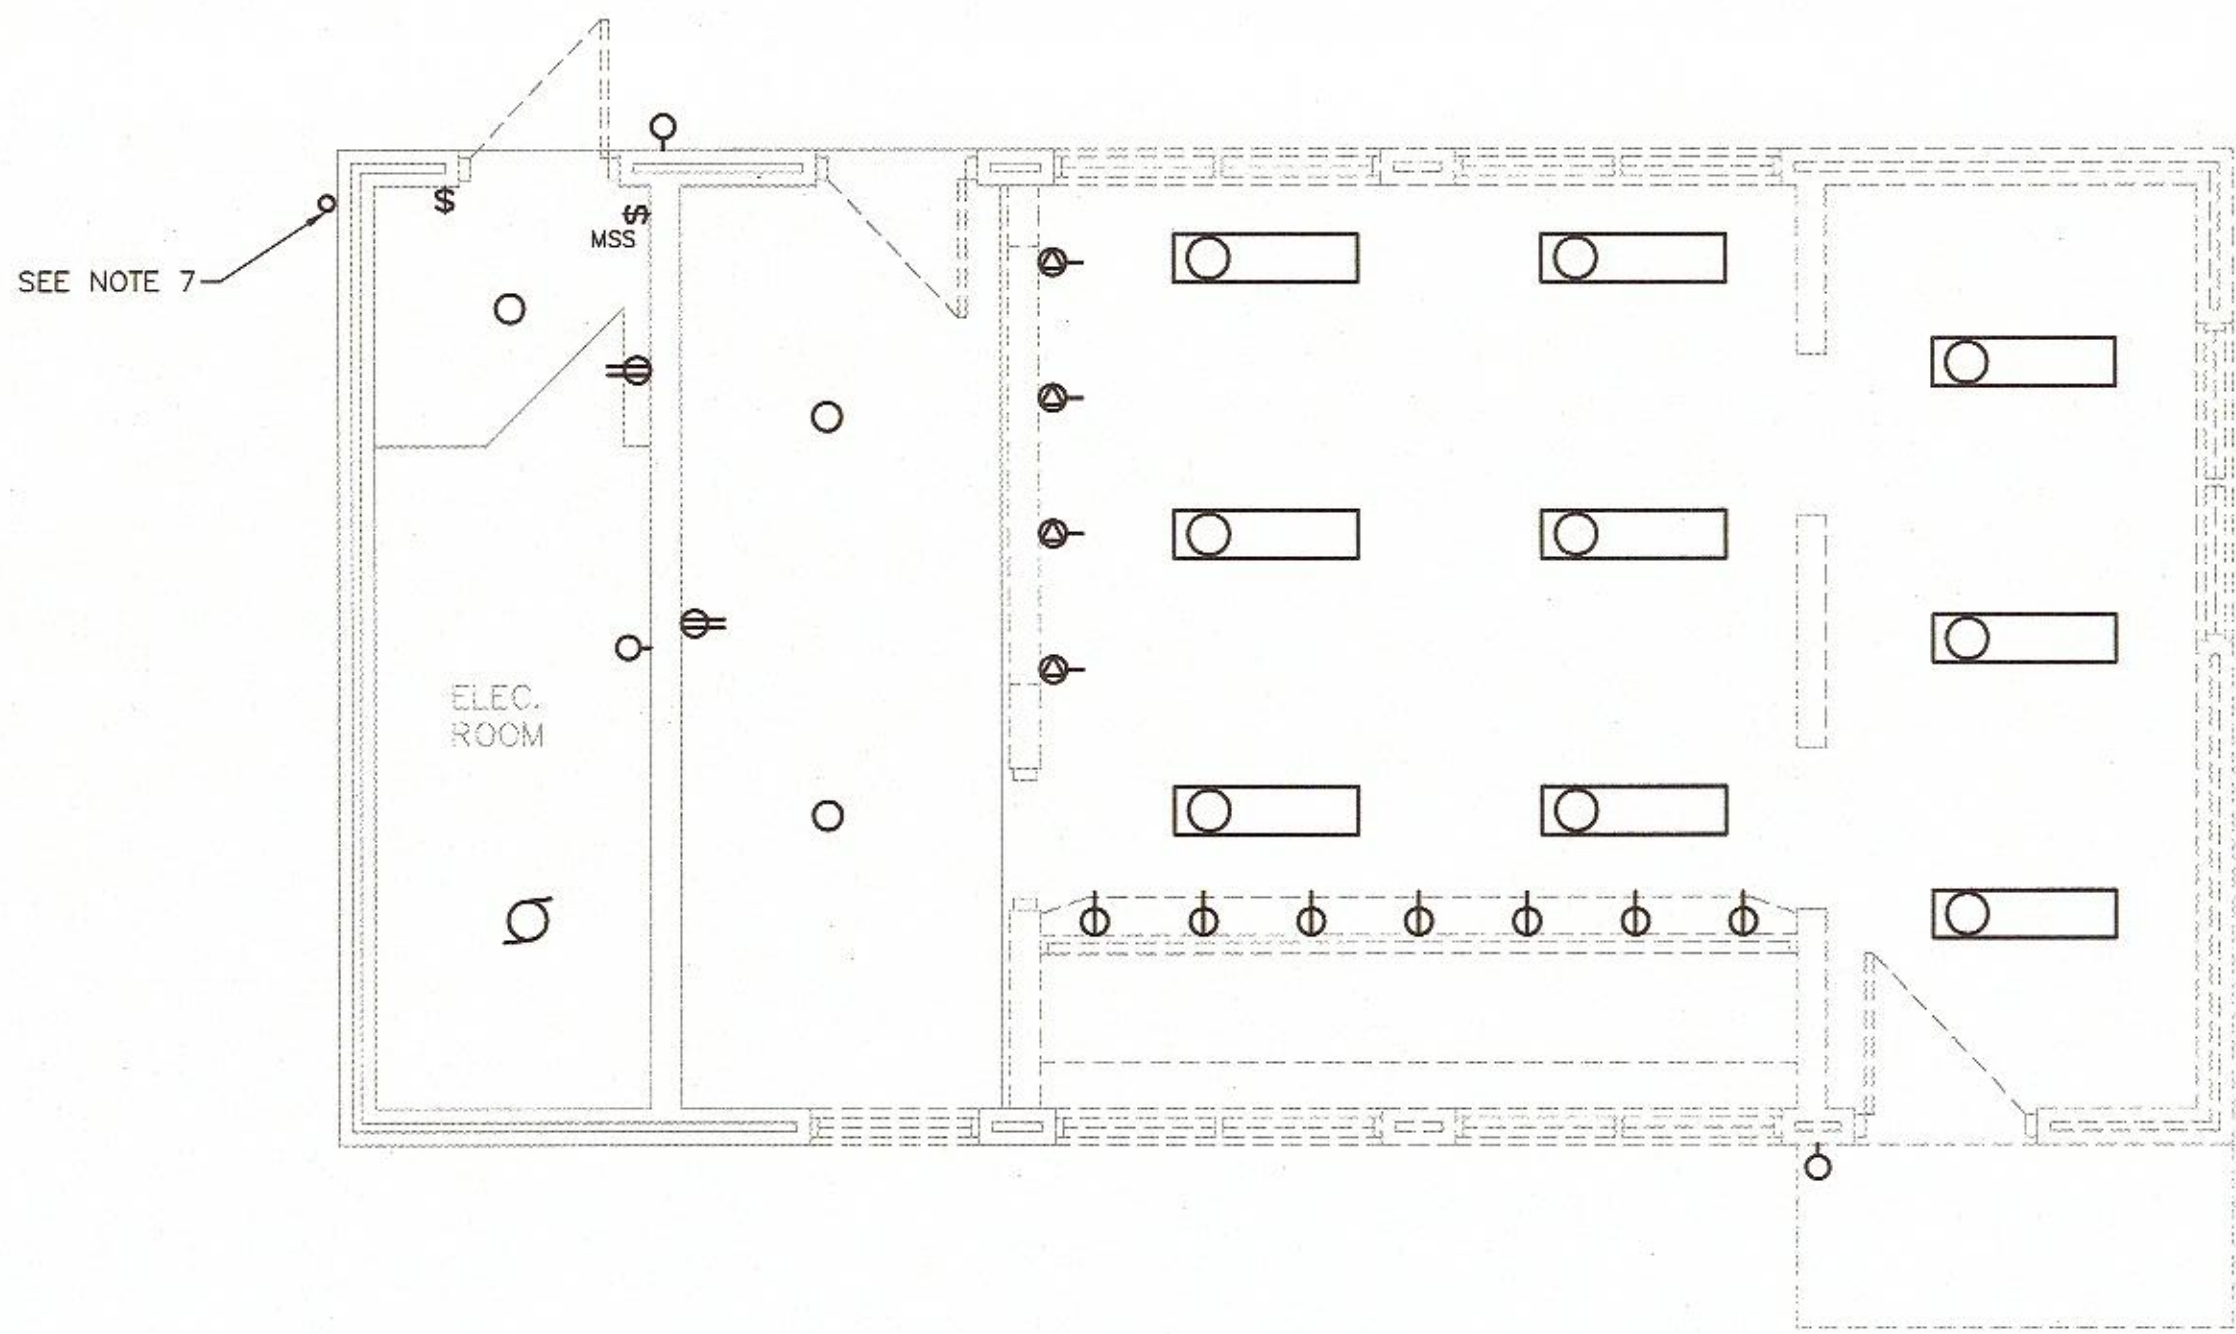

DEMOLITION FLOOR PLAN - LAUNDRY

SCALE: 1:50
0m 1m 2m 3m 4m 5m

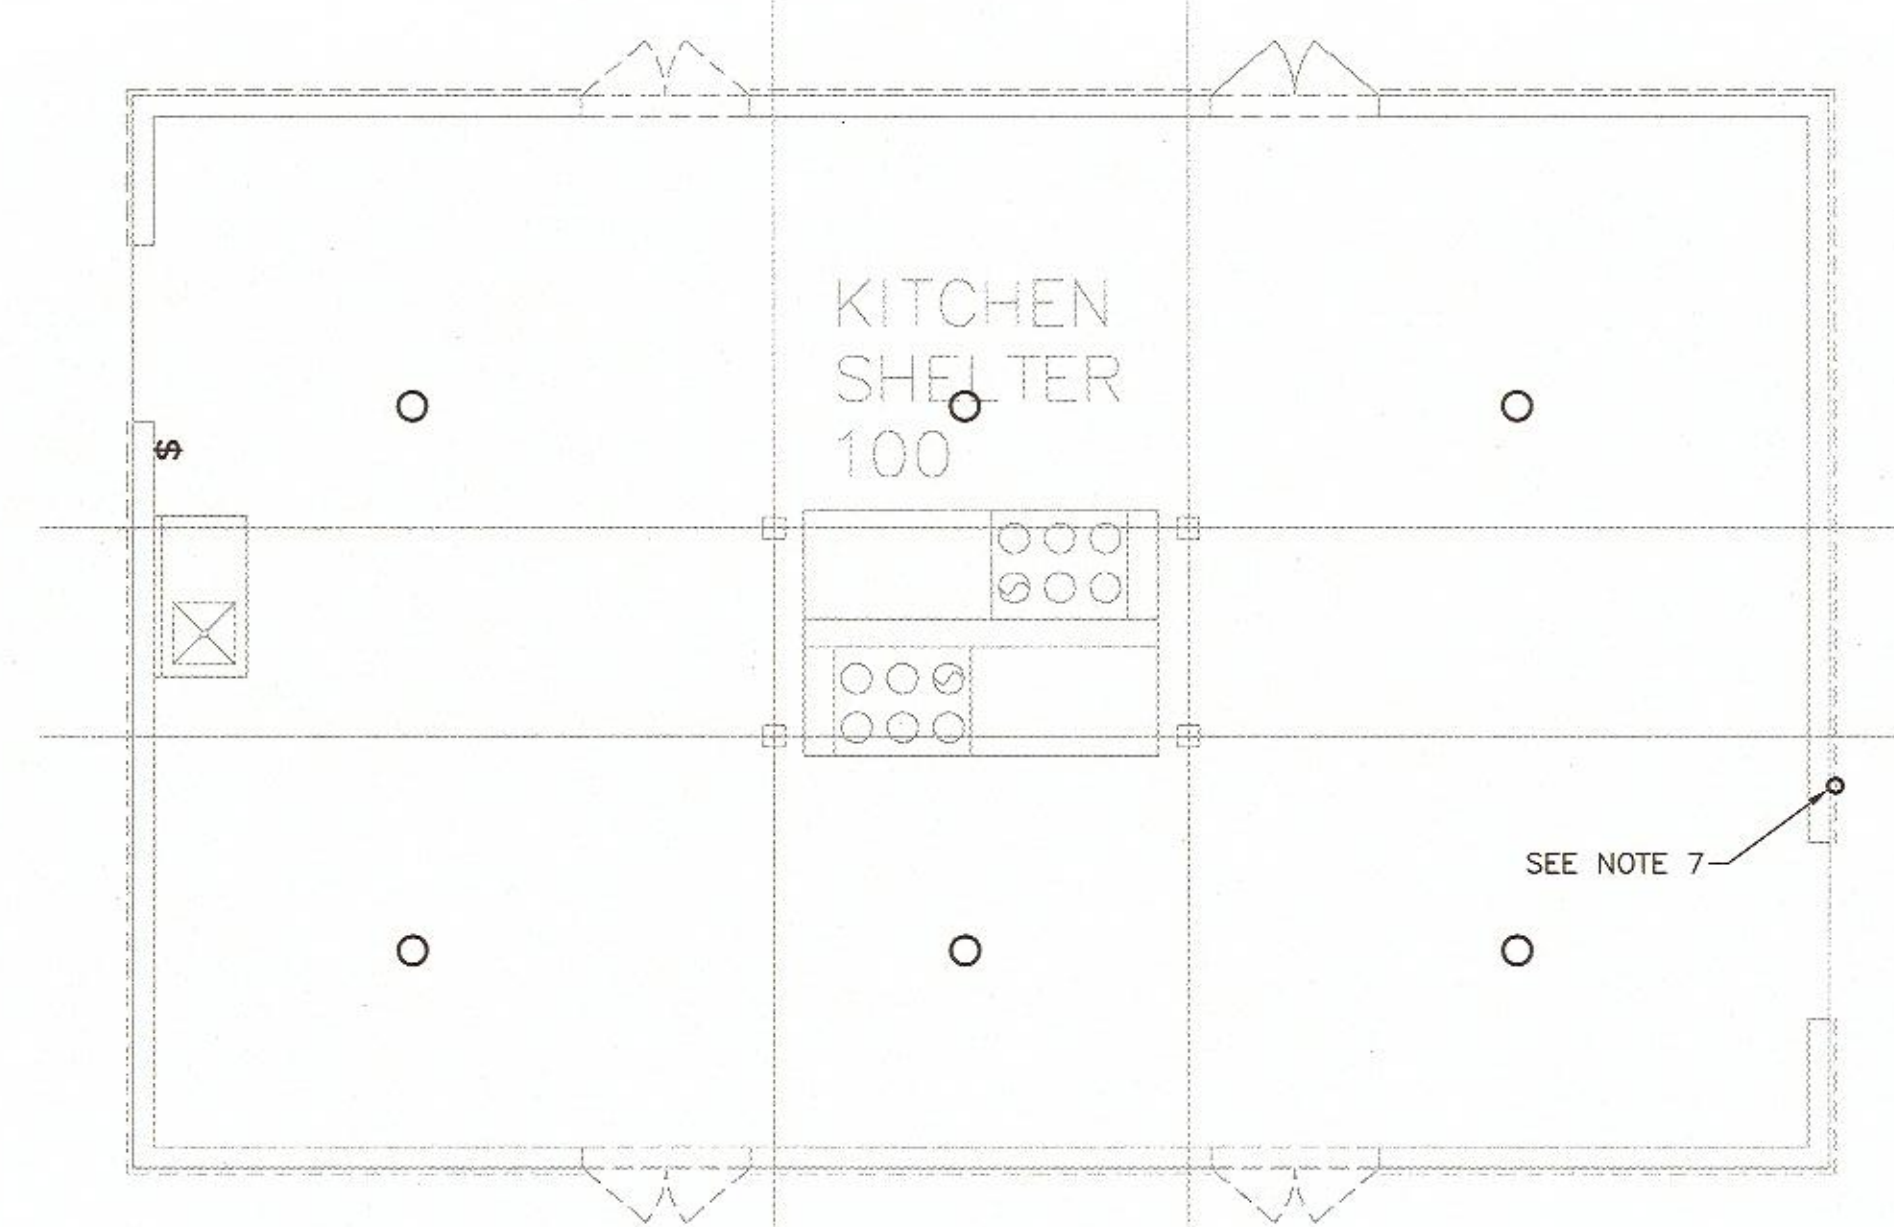

DEMOLITION FLOOR PLAN - KITCHEN SHELTER #5 & 6

SCALE: 1:50
0m 1m 2m 3m 4m 5m

NOTES:

- EXISTING DEVICE AND EQUIPMENT LOCATIONS ARE SHOWN FOR DEMOLITION SCOPING PURPOSES ONLY, NOT ALL EQUIPMENT MAY BE SHOWN.
- DE-ENERGIZE AND LOCK/TAG-OUT ALL APPLICABLE CIRCUITS PRIOR TO COMMENCING DEMOLITION.
- DEMOLITION IN WASHROOM BUILDINGS TO CONSIST OF THE REMOVAL OF EXISTING BRANCH CIRCUIT PANELBOARDS, BRANCH CIRCUIT WIRING AND CONDUIT, WIRING DEVICES, INTERIOR AND EXTERIOR LIGHT FIXTURES AND HAND DRYERS. IN ADDITION TO THIS, ALL REDUNDANT EQUIPMENT AND DEVICES ARE ALSO TO BE REMOVED ALONG WITH ASSOCIATED WIRING AND CONDUIT. EXISTING DISTRIBUTION EQUIPMENT UPSTREAM OF THE PANELBOARDS AS WELL AS BRANCH CIRCUITS FEEDING EQUIPMENT LOCATED OUTSIDE THE WASHROOM BUILDINGS ARE TO REMAIN AND BE RECONNECTED AS REQUIRED.
- DEMOLITION IN KITCHEN SHELTERS TO CONSIST OF THE REMOVAL OF EXISTING BRANCH CIRCUIT WIRING AND CONDUIT, WIRING DEVICES AND LIGHT FIXTURES. IN ADDITION TO THIS, ALL REDUNDANT EQUIPMENT AND DEVICES ARE ALSO TO BE REMOVED ALONG WITH ASSOCIATED WIRING AND CONDUIT. EXISTING DISTRIBUTION EQUIPMENT AS WELL AS BRANCH CIRCUITS FEEDING EQUIPMENT LOCATED OUTSIDE THE KITCHEN SHELTERS ARE TO REMAIN.
- DEMOLITION IN LAUNDRY BUILDING TO CONSIST OF THE REMOVAL OF EXISTING BRANCH CIRCUIT WIRING AND CONDUIT, WIRING DEVICES AND LIGHT FIXTURES. EXISTING DISTRIBUTION EQUIPMENT AS WELL AS BRANCH CIRCUITS FEEDING EQUIPMENT LOCATED OUTSIDE THE LAUNDRY BUILDING ARE TO REMAIN. ENSURE SERVICE FEEDER TO THE LAUNDRY BUILDING IS DE-ENERGIZED AND LOCKED/TAGGED OUT WHEN WORKING ADJACENT EXPOSED ELECTRICAL EQUIPMENT.
- REPAIR ANY DAMAGE DONE TO EXISTING FINISHES THAT ARE TO REMAIN AS A RESULT OF ELECTRICAL WORK.
- REMOVE AND REINSTALL EXISTING EXTERIOR SURFACE MOUNTED CONDUIT AS REQUIRED TO FACILITATE CONSTRUCTION OF NEW WALLS.

LEGEND:

- CEILING SURFACE MOUNTED LINEAR LUMINAIRE
- CEILING SURFACE MOUNTED ROUND LUMINAIRE
- WALL SURFACE MOUNTED LUMINAIRE
- CEILING SURFACE MOUNTED LINEAR STRIP
- SINGLE RECEPTACLE
- DUPLEX RECEPTACLE
- SPECIAL RECEPTACLE
- DIRECT CONNECTION TO EQUIPMENT
- DOOR OPERATOR
- PUSHBUTTON
- ASTRONOMIC ELECTRONIC TIME CLOCK
- PANELBOARD
- ELECTRIC HAND DRYER
- 20A, 120V TOGGLE-TYPE LIGHT SWITCH
- EXISTING EQUIPMENT TO BE REMOVED
- EXISTING EQUIPMENT TO REMAIN
- EXISTING EQUIPMENT TO BE REPLACED
- GROUND FAULT CIRCUIT INTERRUPTER
- ABOVE FINISHED GRADE