



BOAT DECK


LEGEND		
SYMBOL	DESCRIPTION	QTY
①	SMOKE DETECTOR ACCOMMODATION SPACE	79
②	TEMPERATURE DETECTOR MACHINERY SPACE	35
③	TEMPERATURE DETECTOR ACCOMMODATION SPACE	8
④	TEMPERATURE DETECTOR MACHINERY SPACE	4
⑤	PULL STATION ACCOMMODATION SPACE	16
⑥	PULL STATION MACHINERY SPACE	13
⑦	END OF LINE RESISTOR	11
⑧	RED ROTATING LIGHT	2
⑨	ALARM SIREN	1
⑩	6" ALARM BELL ACCOMMODATION SPACE	13
⑪	6" ALARM BELL MACHINERY SPACE	6
⑫	10" ALARM BELL MACHINERY SPACE	1

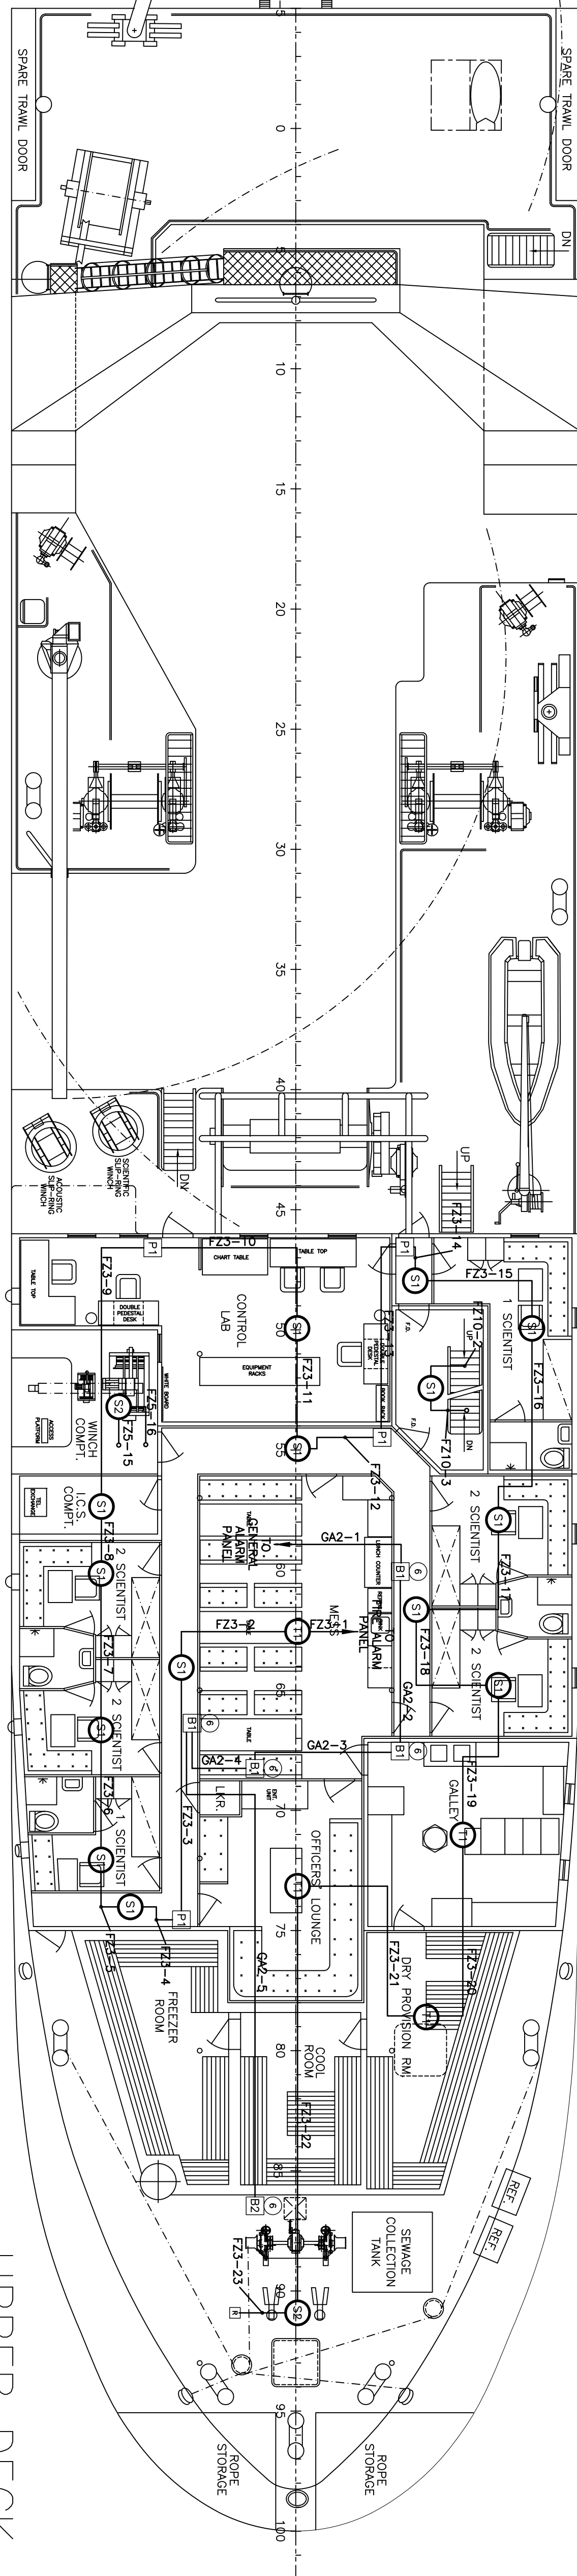


UPPER DECK

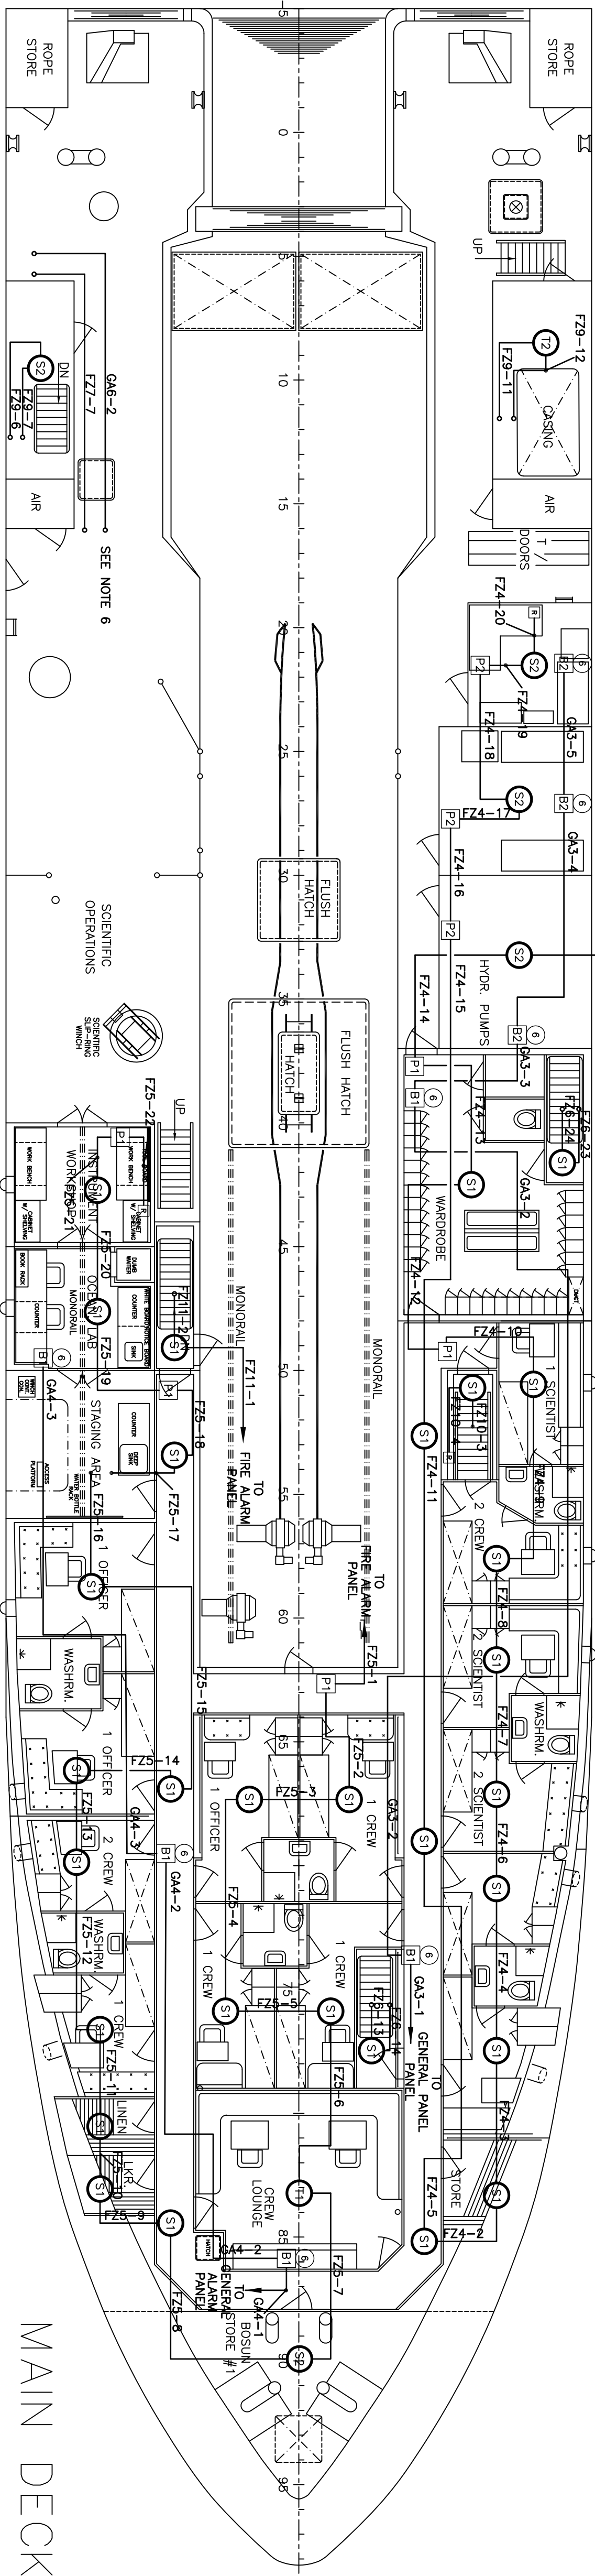

MAIN DECK

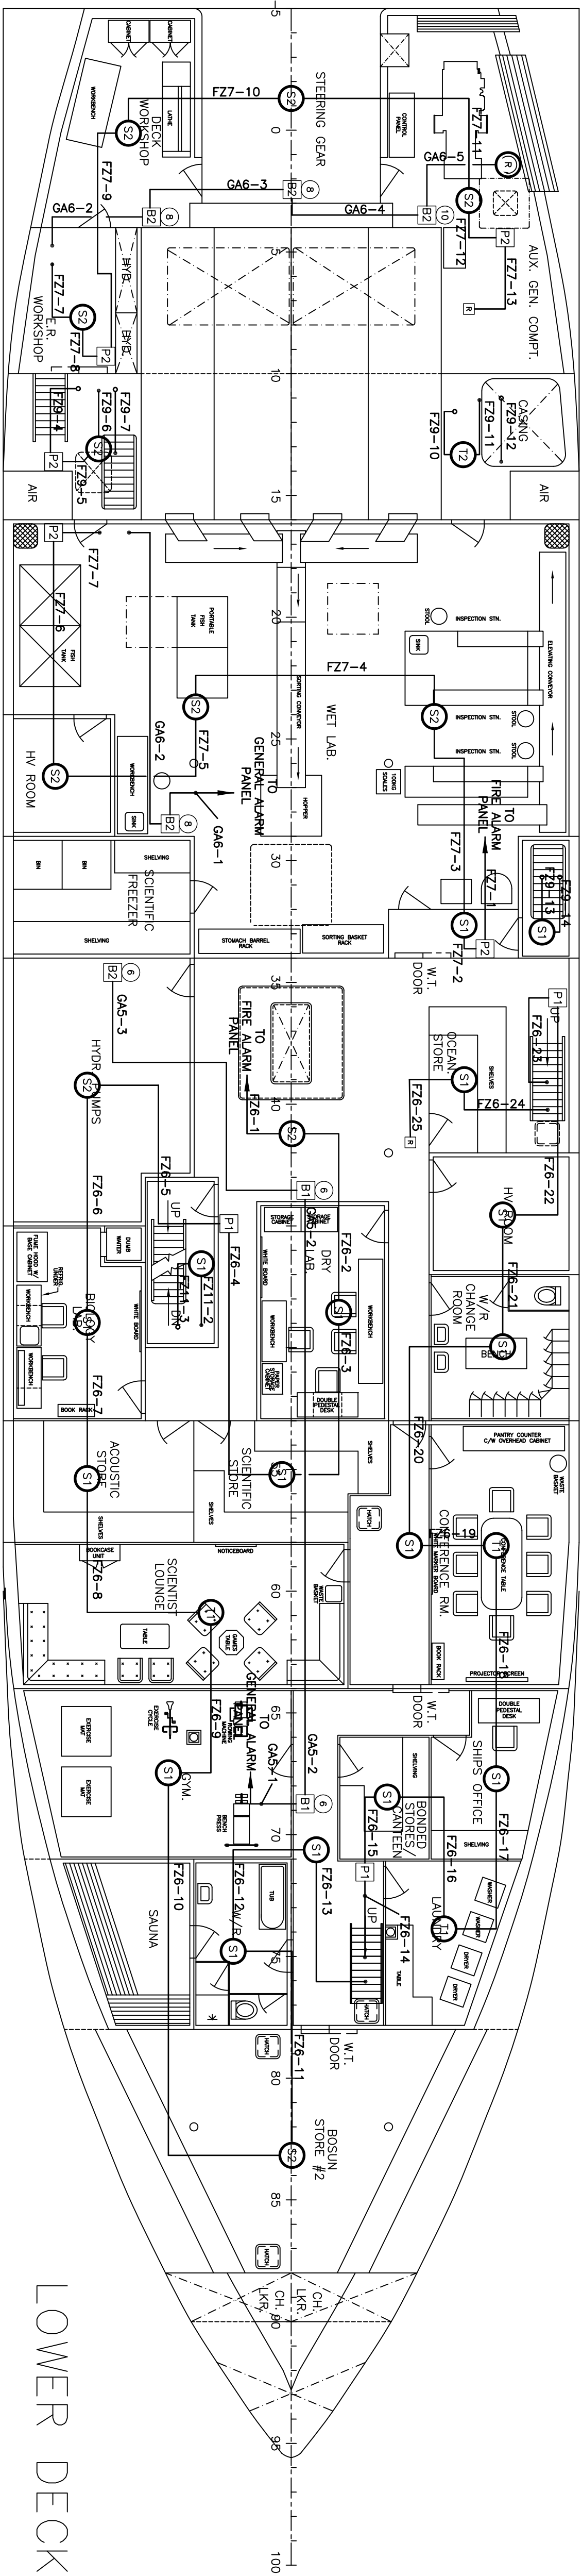

LOWER DECK

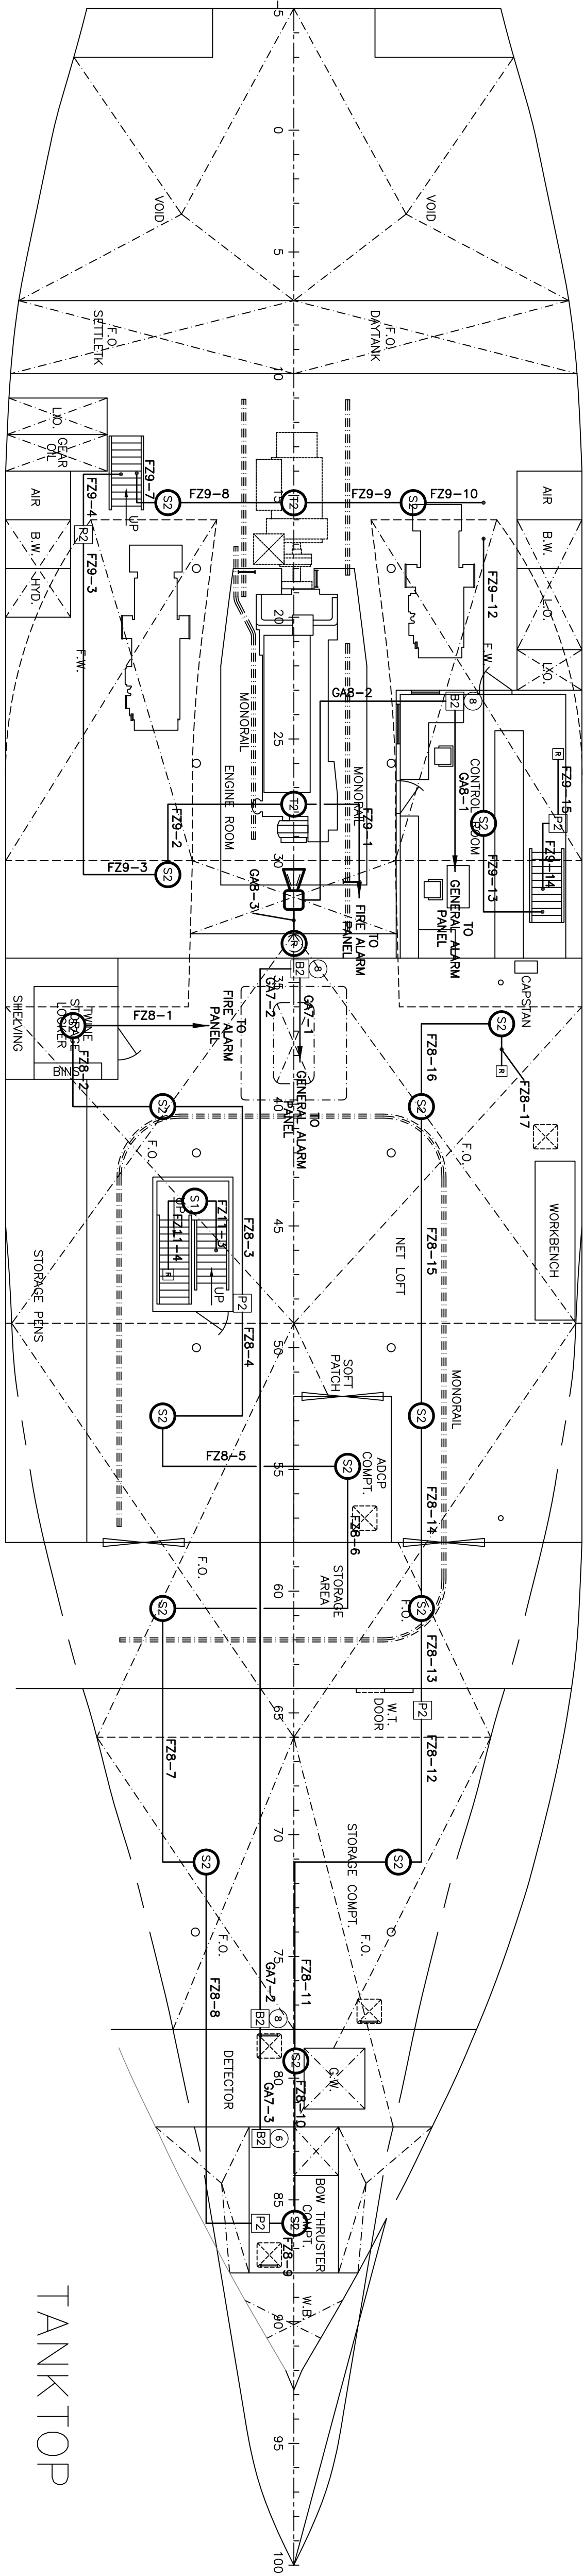

TANKTOP

NOTES

- 1) ALL FIRE DETECTION CABLING TO BE 2 X 16 AWG UNLESS OTHERWISE SPECIFIED.
- 2) ALL GENERAL ALARM CABLING TO BE 2 X 12 AWG UNLESS OTHERWISE SPECIFIED.
- 3) THE FIRE ALARM TO BE FITTED WITH INTERNAL BATTERIES, I.E. POWER SUPPLIES WILL BE FLOATING BATTERY WITH MAIN FEEDER FROM 220V PANEL TYPE.
- 4) ALL CABLES SHOWN TO BE FITTED WITH LOCKING DEVICES TO ALLOW REMOVAL OF CABLES TO BE DISCONNECTED.
- 5) THE GENERAL ALARM BELL TO BE DISCONNECTED TO A SYSTEM SO THAT BELLS WERE SELECTED DURING PA ANNOUNCEMENTS.
- 6) CABLES ARE TO BE ROUTED AS SHOWN ACCORDING TO 11/27/21 - SECTION 210 (100)

REVISION	DATE	BY	DESCRIPTION
1	6/8/2020	NON	DWG. ISSUE
2	1/1/2021	NON	D.O.
3	4/1/2021	NON	OWNERS REP.
4	4/1/2021	NON	CLASS SOCIETY
5	4/1/2021	NON	SURVEYORS
6	4/1/2021	NON	NAT AUTHORITY
7	4/1/2021	NON	O. CONTROL
8	4/1/2021	NON	BOATMAN
9	4/1/2021	NON	PRODUCER
10	4/1/2021	NON	SHIP MGR
11	4/1/2021	NON	PIPE SUPPLY
12	4/1/2021	NON	STEEL SUPPLY
13	4/1/2021	NON	ENG. SUPPLY
14	4/1/2021	NON	OUTFIT SUPPLY
15	4/1/2021	NON	ELECT. SUPPLY
16	4/1/2021	NON	PURCHASING

NO	LOC	REVISIONS	DESCRIPTION	APPL	DATE
1					
2					
3					
4					
5					
6					
7					
8					
9					
10					
11					
12					
13					
14					
15					
16					
17					
18					
19					
20					
21					
22					
23					
24					
25					
26					
27					
28					
29					
30					
31					
32					
33					
34					
35					
36					
37					
38					
39					
40					
41					
42					
43					
44					
45					
46					
47					
48					
49					
50					
51					
52					
53					
54					
55					
56					
57					
58					
59					
60					
61					
62					
63					
64					
65					
66					
67					
68					
69					
70					
71					
72					
73					
74					
75					
76					
77					
78					
79					
80					
81					
82					
83					
84					
85					
86					
87					
88					
89					
90					
91					
92					
93					
94					
95					
96					
97					
98					
99					
100					

“AS FITTED”

FIRE DETECTION SYSTEM LAYOUT

APPROVALS	SCALE	1:100	DRAWING NO.
OWNERS	10/03/94	DRAWN	4192-3211
NAT AUTH	10/03/94	DATE	02/15/94
CLASS	10/03/94	CHK	D
OTHER	10/03/94	DATE	23/11/94
		SHT	1 OF 1
		REV	AF



MARYSTOWN SHIPYARD LIMITED
MARYSTOWN NEWFOUNDLAND
TEL: 709-753-1000 FAX: 709-753-1008