


BROKEN LINE INDICATES
EXISTING DEVICE. SOLID
LINE INDICATES NEW.

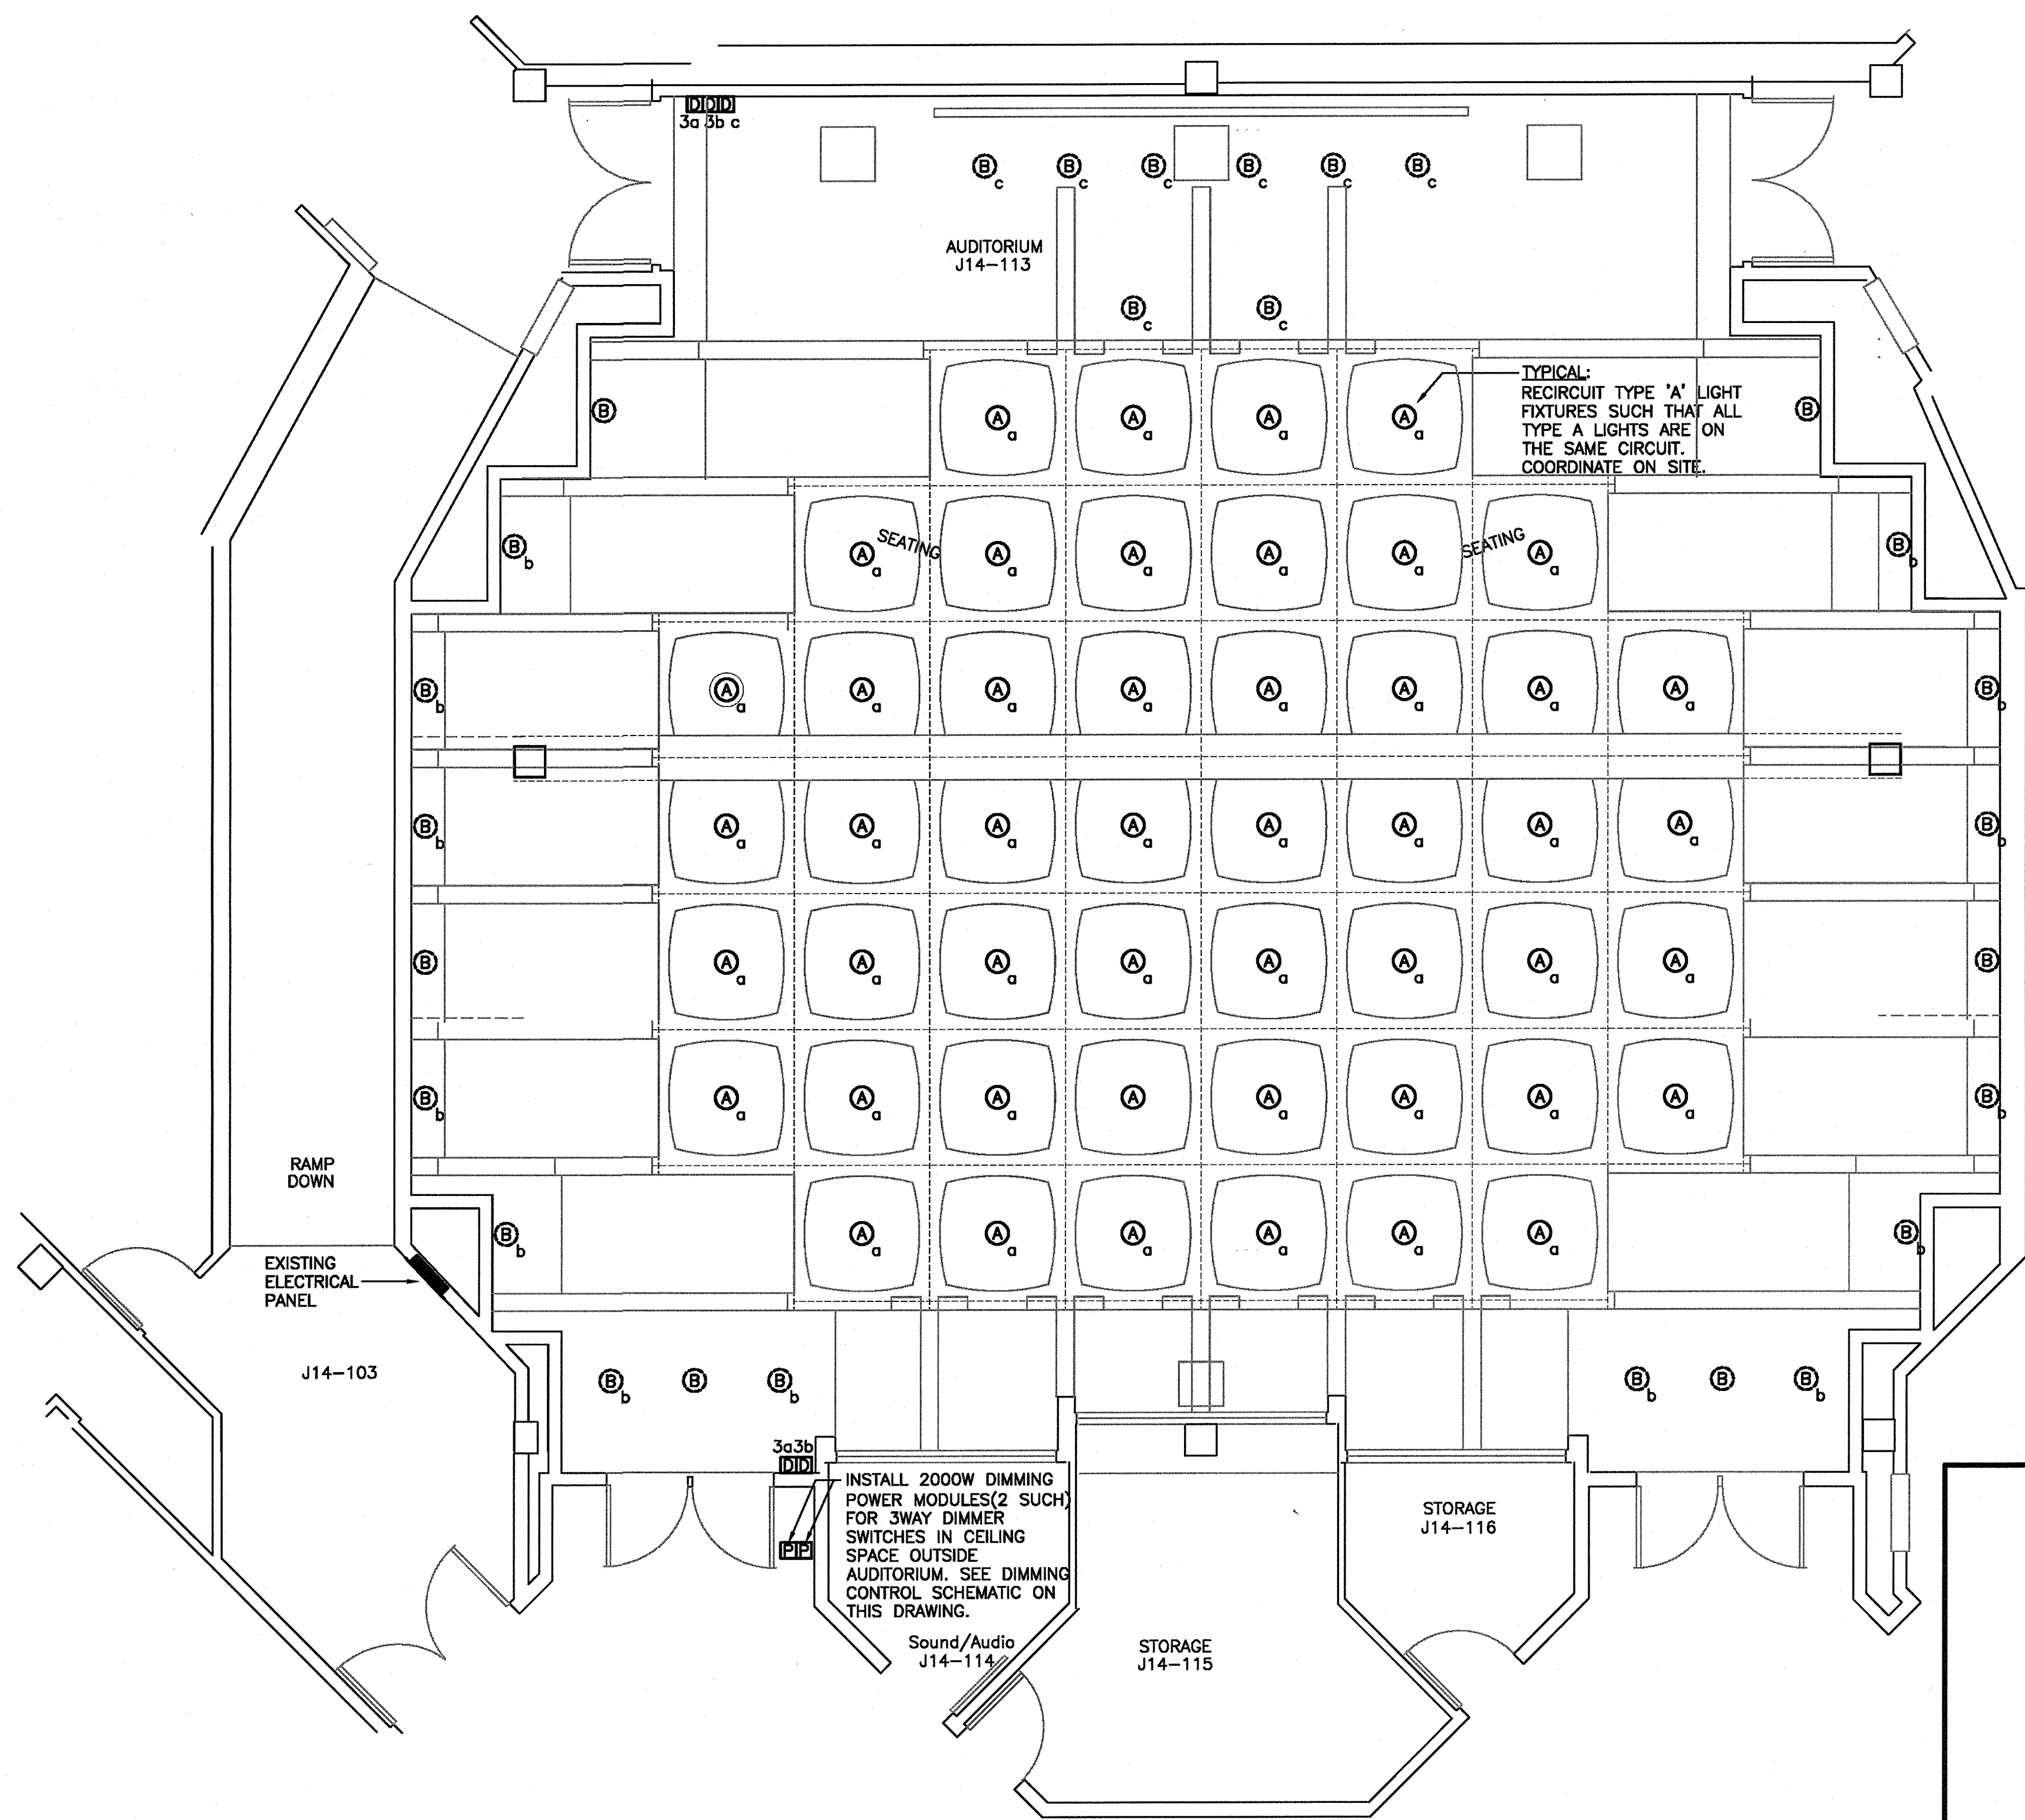


INSTALL 2000W DIMMING
POWER MODULES(2 SUCH
FOR 3WAY DIMMER
SWITCHES IN CEILING
SPACE OUTSIDE
AUDITORIUM. SEE DIMMING
CONTROL SCHEMATIC ON
THIS DRAWING.

Sound/Audio
J14-114

STORAGE
J14-116



LIGHTING PLAN

SCALE: 1:50

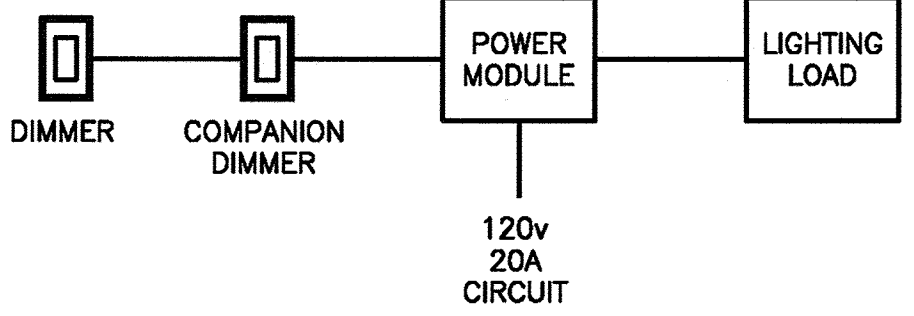

SUPPLY AND INSTALL NEW 20A, 120V BRANCH CIRCUIT AND NEW 20A 1P
CIRCUIT BREAKER FROM NEAREST PANEL WITH SPARE CAPACITY. IC RATIO
TO MATCH. 2#12RW90 +1#12 TW GROUND IN 27MM EMT CONDUIT

DIMMING CONTROL SCHEMATIC
N.T.S.

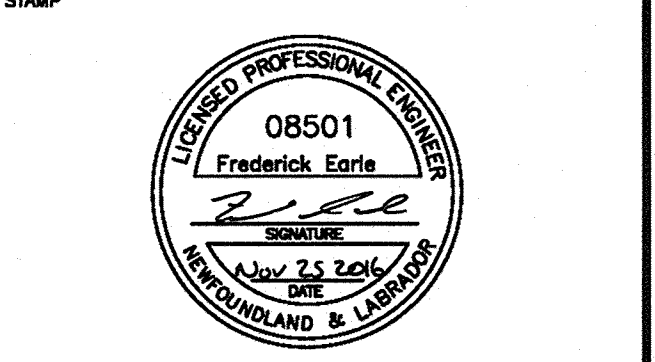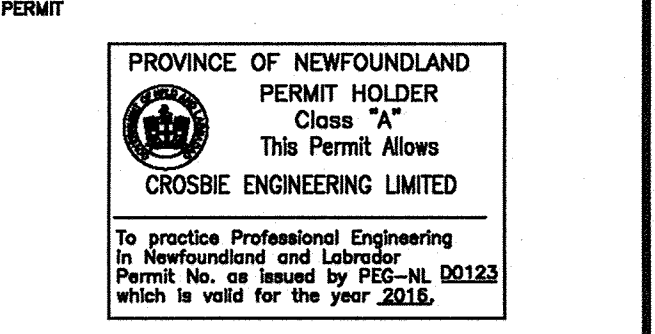

0	ISSUED FOR TENDER	11/18 2016
B	ISSUED FOR PRE-TENDER REVIEW	11/01 2016
A	ISSUED FOR REVIEW	10/28 2016
revisions		date

NORTHWEST ATLANTIC
FISHERIES CENTRE
ST. JOHN'S, NL
AUDITORIUM UPGRADES

LIGHTING PLAN
& DETAILS

designed	F.E.	conçu
date	November 2016	
drawn	B.C.	dessiné
date	November 2016	
approved	F.E.	approuvé
date	November 2016	
Tender	2016-11-30	Soumission
PWGC/Project Manager	Administrateur de projets TPSC	
project number		no. du projet
	R.081909.001	
drawing no.		no. du dessin
	E3	