


# NATIONAL RESEARCH COUNCIL FACTORY OF THE FUTURE


800 Collip Cir, London, Ontario

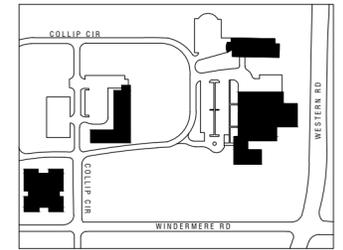

ISSUED:  
No. Date Description  
1 2016-12-16 ISSUED FOR TENDER

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
SIGNALLING DEVICES			
	HORN		CEILING MOUNTED FIRE ALARM STROBE. STROBE INTENSITY TO BE MIN. 15CD UNLESS OTHERWISE NOTED.
	DOUBLE SIDED HORN		WALL MOUNTED FIRE ALARM STROBE. STROBE INTENSITY TO BE MIN. 15CD UNLESS OTHERWISE NOTED.
	HORN+STROBE COMBINATION. STROBE INTENSITY TO BE MIN. 15CD UNLESS OTHERWISE NOTED.		CEILING MOUNTED SMOKE DETECTOR
	DOUBLE SIDED HORN+STROBE COMBINATION. STROBE INTENSITY TO BE MIN. 15CD UNLESS OTHERWISE NOTED.		CEILING MOUNTED HEAT DETECTOR
	MINI HORN		END-OF-LINE RESISTOR TERMINATION
	SPEAKER HORN		
	FIRE ALARM BELL. 103mm(*) UNLESS OTHERWISE NOTED.		
	10 MINUTES SILENCE SWITCH FOR SPEAKERS IN SUITES		
NOTE: NOT ALL SYMBOLS APPLY, REFER TO FLOOR PLANS AND DRAWINGS			

7 FIRE ALARM LEGEND  
E000

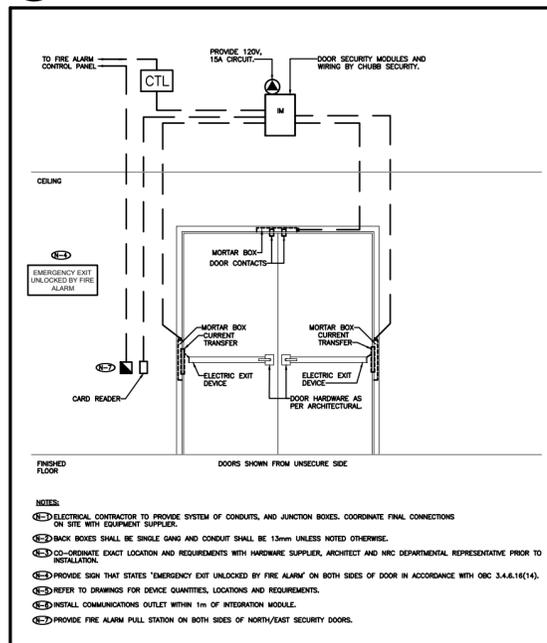

8 DOOR DETAIL  
E000

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	CEILING MOUNTED LINEAR LUMINAIRE. DIMENSIONS AS SHOWN. REFER TO SCHEDULE FOR TYPE.		CEILING MOUNTED WALL WASHER LUMINAIRE. ILLUMINATION DIRECTION DENOTED BY HATCHED SIDE.
	DENOTES FIXTURE ON EMERGENCY/NIGHT LIGHT CIRCUIT.		CEILING MOUNTED TRACK LIGHTING C/W NUMBER OF FIXTURES.
	WALL MOUNTED LINEAR LUMINAIRE. DIMENSIONS AS SHOWN. REFER TO SCHEDULE FOR TYPE.		WALL MOUNTED LUMINAIRE
	CEILING MTD. LUMINAIRE OR BASKET LUMINAIRE. LAMP ORIENTATION AS SHOWN. REFER TO SCHEDULE FOR TYPE.		PENDANT FIXTURE
	EXISTING LUMINAIRE TO BE REMOVED		CEILING MOUNTED LUMINAIRE
	EXISTING LUMINAIRE TO REMAIN		FLOOR MOUNTED LUMINAIRE
	POLE MOUNTED LUMINAIRE. NUMBER OF HEADS SHOWN. REFER TO SCHEDULE FOR FIXTURE AND POLE TYPE.		TRACK LIGHT WITH PENDANT LUMINAIRE AS INDICATED
	CEILING MOUNTED LUMINAIRE WITH GIMBALLED HEADS. REFER TO SCHEDULE FOR TYPE AND NUMBER OF HEADS.		BOLLARD LUMINAIRE
	VERTICAL WALL MOUNTED FLUORESCENT LUMINAIRE		EXIT LIGHT CEILING MOUNTED C/W FACES AND ARROWS AS INDICATED
	CONTINUOUS STRIP LIGHT. REFER TO SCHEDULE FOR FIXTURE TYPE.		EXIT LIGHT WALL MOUNTED C/W FACES AND ARROWS AS INDICATED
	STAGGERED COVE LIGHT. DIMENSIONS AND NUMBER OF FIXTURES SHOWN. REFER TO SCHEDULE FOR FIXTURE TYPE.		SINGLE POLE LINE VOLTAGE LIGHT SWITCH
NOTE: NOT ALL SYMBOLS APPLY, REFER TO FLOOR PLANS AND DRAWINGS			

5 LIGHTING LEGEND  
E000

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	AUTOMATIC DOOR OPENER		REMOTE DISPLAY UNIT
	SECURITY CAMERA		REMOTE RELEASE
	CARD READER		REQUEST TO EXIT
	DOOR ALARM		RF ETHERNET READER
	DOOR LOCK		RF READER
	DOOR CONTACT		RF READER MASTER
	DURESS ALARM		SECURITY HANDSET
	ELECTRIFIED LOCK (ELECTRIC STRIKE, ELECTRIC LATCH RETRACTION, ELECTRIC MORTISE LOCK AND MAGNETIC LOCK)		SECURITY KEYPAD
	ELECTRIC STRIKE		SECURITY PROXIMITY READER
	ENTRY PHONE DISPLAY PANEL		SECURITY REMOTE PANEL
	EXIT DEVICE PUSH BUTTON		STAFF PANIC ALARM STATION
	ELECTRIC MORTISE LOCK		WALL MOUNTED BREAK GLASS SENSOR
	INTERROOM		SUITE SECURITY PANEL
	KEYPAD		MASTER INTERCOM
	MAGLOCK KEY RESET SWITCH		EMERGENCY PHONE STATION
	MAGLOCK		EMERGENCY ASSISTANCE PHONE
	MOTION SENSOR		LOCAL AREA RECEIVER
	PANIC ALARM		SIREN
NOTE: NOT ALL SYMBOLS APPLY, REFER TO FLOOR PLANS AND DRAWINGS			

6 SECURITY LEGEND  
E000

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	WALL MOUNTED DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R		WALL MOUNTED COMBINATION COMMUNICATION / DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R. REFER TO CORRESPONDING DETAIL.
	WALL MOUNTED ABOVE COUNTER DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R		FLOOR OR CEILING MOUNTED (AS SHOWN) COMBINATION COMMUNICATION / DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R. REFER TO CORRESPONDING DETAIL.
	WALL MOUNTED DUPLEX RECEPTACLE 120 VOLT, 20 AMP, CSA 5-20R (T-SLOT)		FLOOR POKE THROUGH COMBINATION COMMUNICATION / DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R. REFER TO CORRESPONDING DETAIL.
	WALL MOUNTED ABOVE COUNTER DUPLEX RECEPTACLE 120 VOLT, 20 AMP, CSA 5-20R (T-SLOT)		WALL MOUNTED COMBINATION COMMUNICATION / DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R. REFER TO CORRESPONDING DETAIL.
	WALL MOUNTED DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R, DEDICATED CIRCUIT		FLOOR OR CEILING MOUNTED (AS SHOWN) COMBINATION COMMUNICATION / DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R. REFER TO CORRESPONDING DETAIL.
	WALL MOUNTED DUPLEX RECEPTACLE 120 VOLT, 20 AMP, CSA 5-20R, DEDICATED CIRCUIT		WALL MOUNTED COMBINATION COMMUNICATION / DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R. REFER TO CORRESPONDING DETAIL.
	WALL MOUNTED DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R, CONTROLLED DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R		FLOOR OR CEILING MOUNTED (AS SHOWN) COMBINATION COMMUNICATION / DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R. REFER TO CORRESPONDING DETAIL.
	WALL MOUNTED DUPLEX GROUND FAULT RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R		FLOOR POKE THROUGH COMBINATION COMMUNICATION / DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R. REFER TO CORRESPONDING DETAIL.
	WALL MOUNTED ABOVE COUNTER DUPLEX GROUND FAULT RECEPTACLE 120 VOLT, 20 AMP, CSA 5-20R		FEED POINT FOR COMMUNICATIONS CABLING. LETTER DENOTES FEED LOCATION: W= WALL, F= FLOOR, P= PAC POLE, WM = WIREMOLD
	WALL MOUNTED DUPLEX GROUND FAULT RECEPTACLE 120 VOLT, 20 AMP, CSA 5-20R		CEILING MOUNTED DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R
	WALL MOUNTED DUPLEX RECEPTACLE 120 VOLT, 15 AMP, 2 POLE, SPLIT CIRCUIT		CEILING MOUNTED SIMPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R
	WALL MOUNTED SIMPLEX RECEPTACLE 250 VOLT, 15 AMP, 3P, CSA 15-15R		CEILING MOUNTED DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R
	WALL MOUNTED SIMPLEX RECEPTACLE 120 VOLT, 20 AMP, CSA 5-20R		CEILING MOUNTED SIMPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R
	WALL MOUNTED SIMPLEX RECEPTACLE 250 VOLT, 30 AMP, CSA 14-30R		CEILING MOUNTED DUPLEX RECEPTACLE 120 VOLT, 15 AMP, CSA 5-15R
	WALL MOUNTED SIMPLEX RECEPTACLE 120 VOLT, 30 AMP, CSA 5-30R		
NOTE: NOT ALL SYMBOLS APPLY, REFER TO FLOOR PLANS AND DRAWINGS			

3 POWER LEGEND 1 OF 2  
E000

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	FLUSH MOUNTED SINGLE TUB PANEL. RATING AS NOTED ON SINGLE LINE/PANEL SCHEDULE		CONTACTOR
	FLUSH MOUNTED DOUBLE TUB PANEL. RATING AS NOTED ON SINGLE LINE/PANEL SCHEDULE		GROUND ROD WITH INSPECTION PIT
	SURFACE MOUNTED SINGLE TUB PANEL. RATING AS NOTED ON SINGLE LINE/PANEL SCHEDULE		JUNCTION BOX (SIZE SPECIFIED ON DRAWING)
	SURFACE MOUNTED DOUBLE TUB PANEL. RATING AS NOTED ON SINGLE LINE/PANEL SCHEDULE		ELECTRIC UNIT HEATER
	TRANSFORMER (SIZE NOTED ON SINGLE LINE DIAGRAM)		ELECTRIC BASEBOARD HEATER. 'X' DENOTES TYPE. REFER TO BASEBOARD HEATER SCHEDULE.
	DISCONNECT		GROUND BAR
	COMBINATION MANUAL STARTER WITH INTEGRAL DISCONNECT		METER
	COMBINATION STARTER WITH INTEGRAL DISCONNECT		GROUND BUS
	DIRECT CONNECTION		DENOTES RECEPTACLE TYPE. REFER TO RECEPTACLE SCHEDULE.
	DIRECT CONNECTION C/W DISCONNECT		UTILITY METERING CABINET
	MOTOR C/W DISCONNECT		DOOR BELL/CHIME
	MOTOR C/W RELAY DISCONNECT		CLOCK WALL MOUNTED
	MOTOR C/W COMBINATION STARTER WITH INTEGRAL DISCONNECT		CLOCK CEILING MOUNTED
	PUSH BUTTON		
	MOTOR		
NOTE: NOT ALL SYMBOLS APPLY, REFER TO FLOOR PLANS AND DRAWINGS			

4 POWER LEGEND 2 OF 2  
E000


ELECTRICAL DRAWING LIST	
Drawing Number	Drawing Title
GENERAL	
IMC0200-E000	ELECTRICAL COVER PAGE
DEMOLITION	
IMC0200-E100	LEVEL 1 DEMOLITION
IMC0200-E101	LEVEL 1 DEMOLITION AND NEW
IMC0200-E102	RECEPTION AREA REVISIONS
POWER AND LIGHTING	
IMC0200-E200	LEVEL 1 POWER AND LIGHTING

1 ELECTRICAL DRAWING LIST  
E000

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	DETAIL NUMBER		SECTION NUMBER
	DRAWING NUMBER		REVISION BUBBLE
	REVISION NUMBER		MOTOR OPERATED
	Amps		NEW
	ACCESS DOOR		NORMALLY CLOSED
	ARC FAULT CIRCUIT INTERRUPTER		NOT IN CONTRACT
	ABOVE FINISHED FLOOR		NIGHT LIGHT
	BASEBOARD HEATER		NORMALLY OPEN
	CONDUIT		OVER COUNTER
	CEILING MOUNTED		OBSTRUCTION LIGHT
	LAUNDRY DRYER		RELOCATE
	DISHWASHER		RANGE
	EXISTING TO REMAIN		REVISE EXISTING CIRCUIT
	EXHAUST FAN		RANGE HOOD
	EMERGENCY CIRCUIT		REMOVE AND REINSTALL
	ELECTRICAL SUITE PANEL		TYPICAL
	EXISTING TO BE REMOVED		UNDER CABINET MOUNTED
	REFRIGERATOR		VOLTS
	DOOR FLOW HEATER		WATTS
	FLOOR MOUNTED		WALL FEED
	GROUND FAULT CIRCUIT INTERRUPTER		WEATHERPROOF
	GROUND FAULT INTERRUPTER		EXPLOSION PROOF DEVICE + BACK BOX
	GROUND		ZERO SEQUENCE CURRENT TRANSFORMER
	HOUSE KEEPING		
	HARMONIC MITIGATING TRANSFORMER		
	ICE MACHINE		
	ISOLATED GROUND		
	JUNCTION BOX		
	LOW VOLTAGE		
NOTE: NOT ALL SYMBOLS APPLY, REFER TO FLOOR PLANS AND DRAWINGS			

2 ABBREVIATIONS  
E000

**Smith + Andersen**  
148 Fullarton St. Suite 1400 London Ontario N6A 5P3  
519 963 8888 www.smithandandersen.com



NRC Factory of the Future  
Demolition Package 2  
800 Collip Cir, London, ON N6G 4X8  
drawing dessin

ELECTRICAL COVER PAGE			
designed	conçu	date	date
MN		2016-12-13	
drawn	dessiné	scale:	échelle
MN		AS NOTED	
checked	vérifié	sheet	feuille
AS			
approved	approuvé	W.O. no	D.T. no
AS			
dwg.no.			dessin no.

IMC0200-E000



**DEMOLITION AND RENOVATION NOTES**

- THESE DRAWINGS ARE BASED ON EXISTING "AS-BUILT" DRAWINGS AND MAY NOT SHOW THE FULL EXTENT OF DEMOLITION. REFER TO ARCHITECTURAL AND MECHANICAL DRAWINGS AND VISIT THE SITE AND BECOME THOROUGHLY FAMILIAR WITH THE EXISTING BUILDING, EQUIPMENT AND SYSTEMS TO DETERMINE THE FULL EXTENT OF DEMOLITION AND RENOVATION WORK.
- MAINTAIN SERVICES THAT ARE VITAL FOR THE FACILITY OPERATION. TO OBTAIN PERMISSION FOR AN INTERRUPTION, SUBMIT A REQUEST AT LEAST TWO WEEKS BEFORE, STATING THE TIME THE INTERRUPTION IS TO BEGIN, EXPECTED DURATION AND THE SERVICES AND AREA AFFECTED. WHERE IN THE OPINION OF THE NRC DEPARTMENTAL REPRESENTATIVE OR THE ENGINEER IT IS ADVISABLE OR DESIRABLE TO MAINTAIN SERVICE IN THE AREA OR ANY PART OF THE AREA INVOLVED DURING THE INTERRUPTION, PROVIDE SUCH TEMPORARY WIRING, EQUIPMENT, ETC., AS REQUIRED OR AS MAY BE DEEMED NECESSARY BY THE ENGINEER TO MAINTAIN SERVICES. NO ADDITIONAL PAYMENTS WILL BE MADE FOR ANY ADDITIONAL COST OR INCONVENIENCES WHICH MAY INCUR.
- IN GENERAL IN THE WORK AREA OF EXISTING BUILDING SHOWN HERE REMOVE AND OR RELOCATE:
  - ALL DEVICES/EQUIPMENT SHOWN ON WALLS BEING REMOVED (DASHED)
  - EXISTING DEVICES SERVING REDUNDANT AND/OR TENANT EQUIPMENT.
  - REDUNDANT; OUTLET BOXES, WIRING AND REDUNDANT CONDUIT BACK TO THE SOURCE.
  - REDUNDANT VERTICAL PORTION OF CONDUITS FROM BASE BUILDING ELECTRICAL PANELS THAT REMAIN SHALL REMAIN, CAP.
  - SURFACE MOUNTED OUTLETS AND RACEWAYS SHALL REMAIN IF SHOWN ON DWG E200.


BASE BUILDING DEVICES/EQUIPMENT (LUMINAIRES, BREAKER PANELS, FIRE ALARM

DEVICES, RECEPTACLES AND OTHER COMPONENTS THAT ARE REQUIRED AND/OR MAYBE USEFUL FOR FUTURE TENANT IN THE OPINION OF THE NRC DEPARTMENTAL REPRESENTATIVE; I.E. WIREMOLD RACEWAY, BELL CCT. ETC SHALL REMAIN. PROVIDE TEMPORARY SUPPORT WHERE NECESSARY.


- DISCONNECT POWER TO MECHANICAL EQUIPMENT BEING REMOVED, ACCORDING TO MECHANICAL CONTRACTOR REMOVAL SCHEDULE.
- ALL EXISTING COMMUNICATION WIRING THAT IS NOT REDUNDANT, SHALL REMAIN AND BE PROPERLY SUPPORTED USING J-HOOKS SPACED NO MORE THAN 4 FT APART. PROTECT AND PRESERVE ALL TELEPHONE/DATA WIRING PASSING THROUGH RENOVATED AREA.
- SHUT DOWN OF THE FIRE ALARM SYSTEM OR ANY PART OF THE SYSTEM WILL BE ALLOWED ONLY WHILE WORKING ON THE SYSTEM. WHEN CALLED AWAY FROM THE JOB SITE OR AT THE END OF EACH DAY THE SYSTEM WILL BE LEFT OPERATIONAL. RELOCATE OR REMOVE AND REINSTALL EXISTING DEVICES AS SHOWN. PROVIDE CERTIFICATE OF VERIFICATION.
- ELECTRICAL TRADE WILL BE RESPONSIBLE FOR ALL CUTTING AND PATCHING REQUIRED FOR ELECTRICAL WORK. ALL PATCHING AND REPAIRS MUST BE DONE BY MEANS ACCEPTABLE TO THE NRC DEPARTMENTAL REPRESENTATIVE AND/OR ARCHITECT. MAINTAIN WALLS AND FLOORS SMOKE/FIRE/SOUND RATING.
- PROVIDE FOR THE PROTECTION, RELOCATION OR RE-ROUTING OF EXISTING CONDUITS AND OTHER ELECTRICAL EQUIPMENT (PASSING THROUGH RENOVATED AREA) WHICH SERVE PANELS AND/OR MECHANICAL EQUIPMENT BEYOND THE AREA OF THE RENOVATION. SUPPLY AND INSTALL ALL CONDUCTORS REQUIRED TO RECONNECT EXISTING CIRCUITS THAT MAY BE DISRUPTED DUE TO RENOVATIONS. NEW CONDUCTORS SHALL BE INSTALLED TO THE NEAREST OUTLET. INSTALLATION OF JUNCTION BOXES FOR SPLICING PURPOSES SHALL NOT BE PERMITTED ON WIRING THAT WILL REMAIN IN PLACE AFTER COMPLETION OF WORK.

**DRAWING NOTES**

- RELOCATE PULL STATION, FIRE ALARM LED CIRCUIT. MAINTAIN FUNCTIONALITY (MAGLOCK RELEASE). SEE E-200.
- DISCONNECT AND REMOVE EXISTING UPS, DISCONNECTS, UPS DISTRIBUTION PANEL, V.E.T PANEL CONTACTOR AND AIR COOLING UNIT.
  - DISCONNECT AND REMOVE INCOMING 200A FEEDER BACK TO THE DISTRIBUTION PANEL 'DSB1'.
  - DISCONNECT AND REMOVE COOLING UNIT FEEDER BACK TO EXISTING PANEL 'P1B'.
  - DISCONNECT CONDENSER ON ROOF, ASSOCIATED WITH COOLING UNIT, AND REMOVE FEEDER BACK TO EXISTING PANEL 'P1B'. UPS WILL BE REMOVED FROM THE SITE BY THE NRC DEPARTMENTAL REPRESENTATIVE.
  - DISCONNECT AND REMOVE V.E.T PANEL CONTACTOR BACK TO EXISTING PANEL 'L1CC'. ALSO DISCONNECT THIS CONTACTOR FROM FIRE ALARM CONTROL PANEL.
  - DISCONNECT AND REMOVE UPS DISTRIBUTION PANEL AND ALL DEVICES, CONDUITS AND WIRING CONNECTED TO IT.
  - REMOVE EXISTING CHUBB SECURITY PANEL FROM WALL AND PROVIDE TEMPORARY SUPPORT WALL TO MAINTAIN PANEL. REMOVE EXISTING TEMPERATURE SENSOR AND ASSOCIATED LOW VOLTAGE WIRING BACK TO SECURITY PANEL. REMOVE EXISTING CARD READERS AND TURN OVER TO THE NRC DEPARTMENTAL REPRESENTATIVE. ALL WORK ASSOCIATED WITH REMOVING THE CARD READERS SHALL BE PERFORMED BY THE BUILDING SECURITY VENDOR. ALL COSTS ASSOCIATED WITH THIS WORK SHALL BE CARRIED BY THIS DIVISION.
- EXISTING TENANT COMMUNICATION RACK AND BACKBOARD. REMOVE RACK AND ALL DEVICES, CONDUITS AND SUPPORTING HARDWARE (TRAYS/HOOKS). COMMUNICATION WIRING WILL BE DISCONNECTED AND REMOVED BY NRC.
- REMOVE AND HAND OVER TO THE NRC DEPARTMENTAL REPRESENTATIVE ALL SECURITY CAMERAS. REMOVE ASSOCIATED WIRING.
- REUSE EXISTING LUMINAIRES TO PROVIDE TEMPORARY LIGHTING IN THE AREA OF DEMOLITION. RECIRCUIT LIGHTING TO AN EXISTING PANELBOARD SHOWN TO REMAIN. SEE E200 FOR LIGHTING LAYOUT.
- ALL ELECTRICAL EQUIPMENT SHALL BE REMOVED UNLESS OTHERWISE NOTED.
- MAINTAIN EXISTING FIRE ALARM SIGNAL DEVICES. PROVIDE TEMPORARY SUPPORT WHERE NECESSARY OR RELOCATE TO THE CEILING IF POSSIBLE.

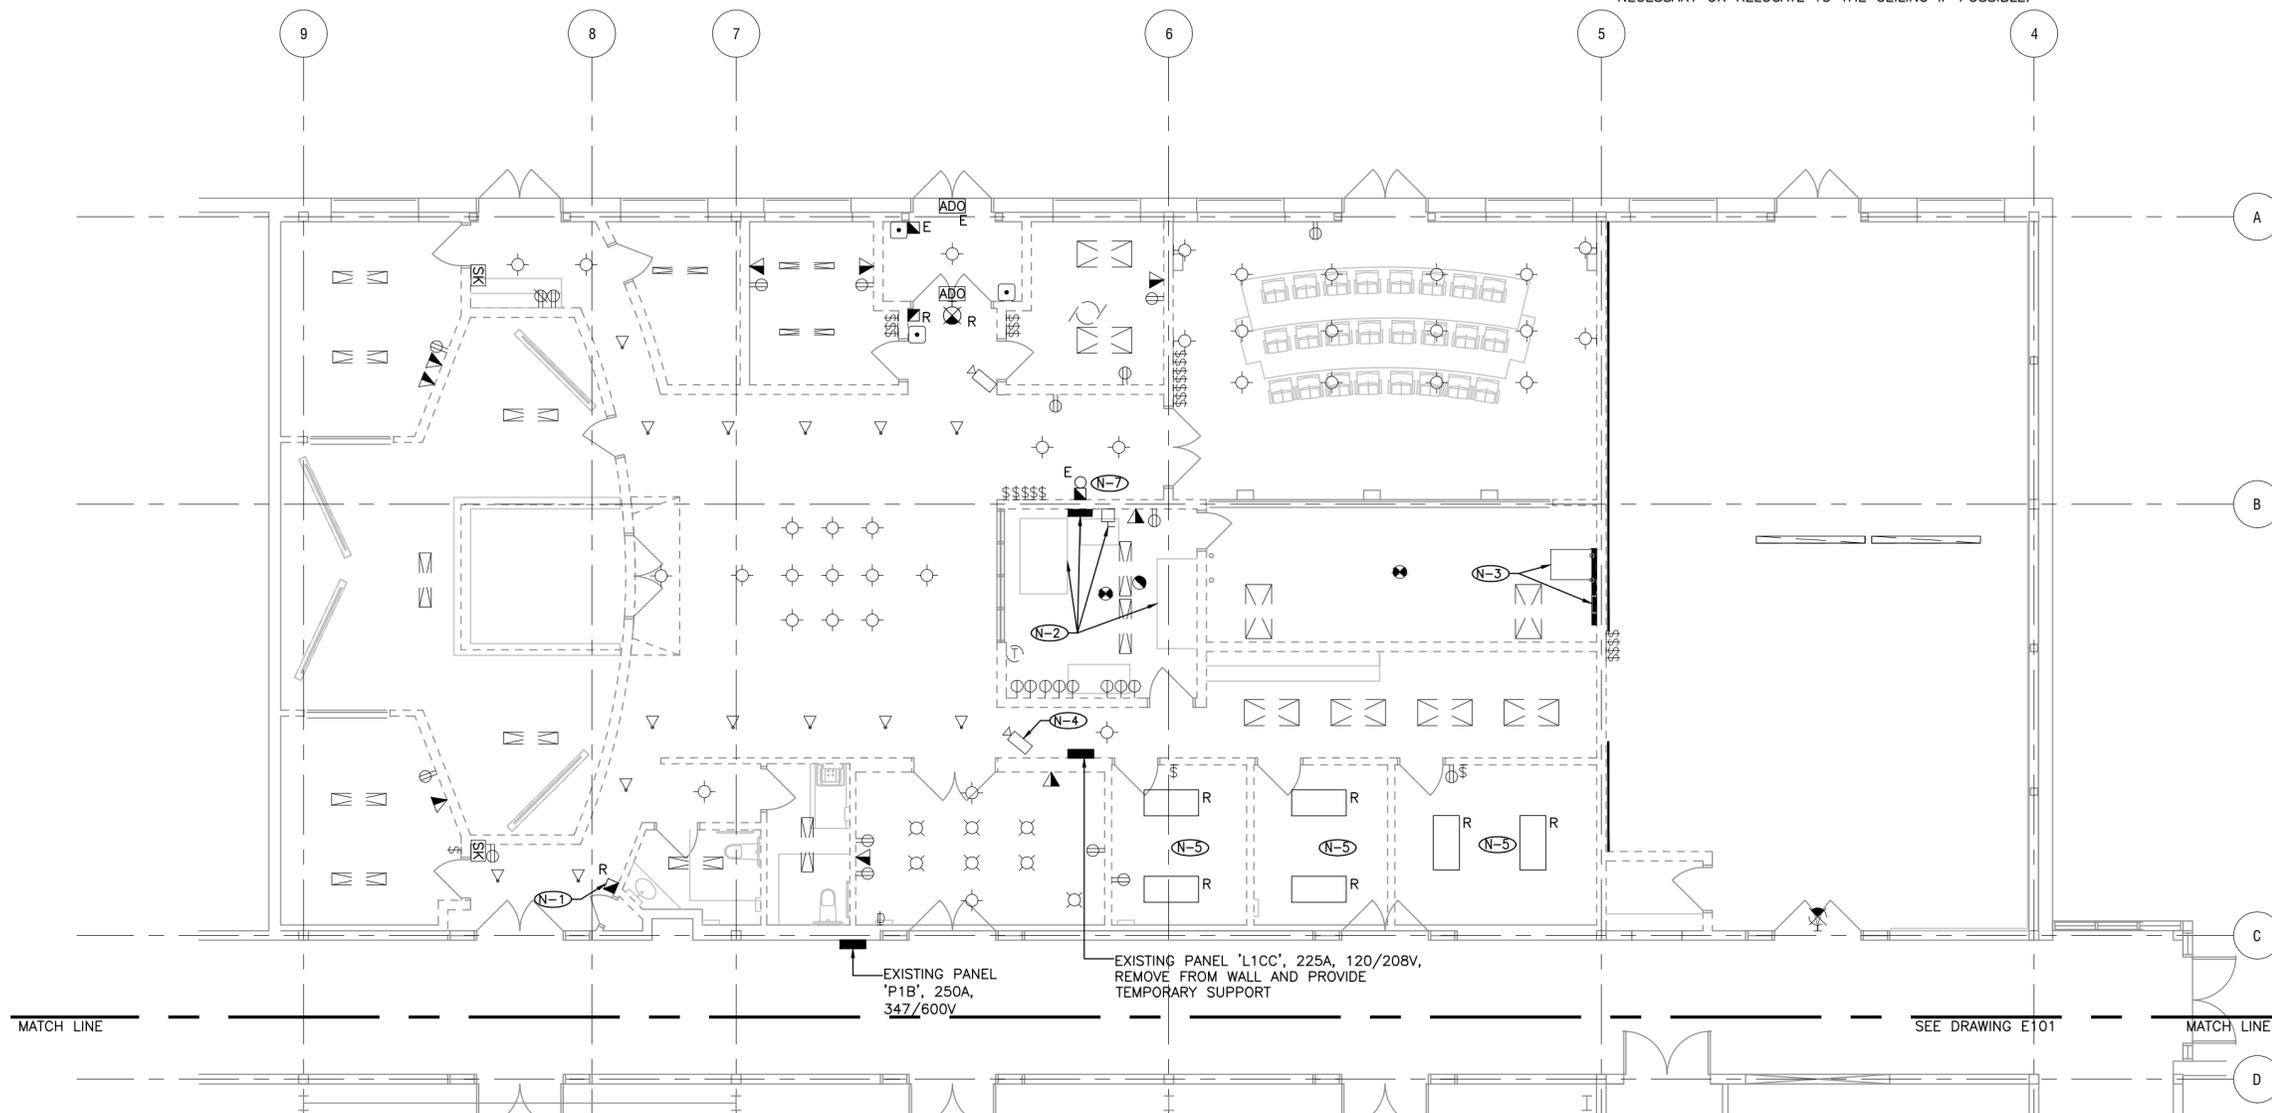

1 LEVEL 1 DEMOLITION  
E200 1:100

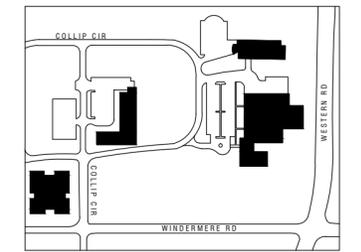

**ISSUED:**

No.	Date	Description
1	2016-12-16	ISSUED FOR TENDER



Smith + Andersen  
148 Fullarton St. Suite 1400 London Ontario N6A 5P3  
519 963 8888 www.smithandandersen.com



**NRC Factory of the Future Demolition Package 2**


800 Collip Cir, London, ON N6G 4X8

drawing dessin

LEVEL 1 DEMOLITION			
designed	conçu	date	date
MN		2016-12-13	
drawn	dessiné	scale:	échelle
MN		AS NOTED	
checked	vérifié	sheet	feuille
AS			
approved	approuvé	W.O. no	D.T. no
AS			

dwg.no. dessin no.

IMC0200-E200

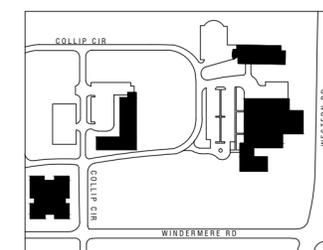

ISSUED:

No.	Date	Description
1	2016-12-16	ISSUED FOR TENDER



Smith + Andersen

148 Fullarton St. Suite 1400 London Ontario N6A 5P3  
519 963 8888 www.smithandandersen.com



**NRC Factory of the Future  
Demolition Package 2**

800 Collip Cir, London, ON N6G 4X8


drawing dessin

**LEVEL 1 DEMOLITION AND NEW**


designed	conçu	date	date
MN		2016-12-13	
drawn	dessiné	scale:	échelle
MN		AS NOTED	
checked	vérifié	sheet	feuille
AS			
approved	approuvé	W.O. no	D.T. no
AS			

dwg. no. dessin no.

**IMC0200-E201**

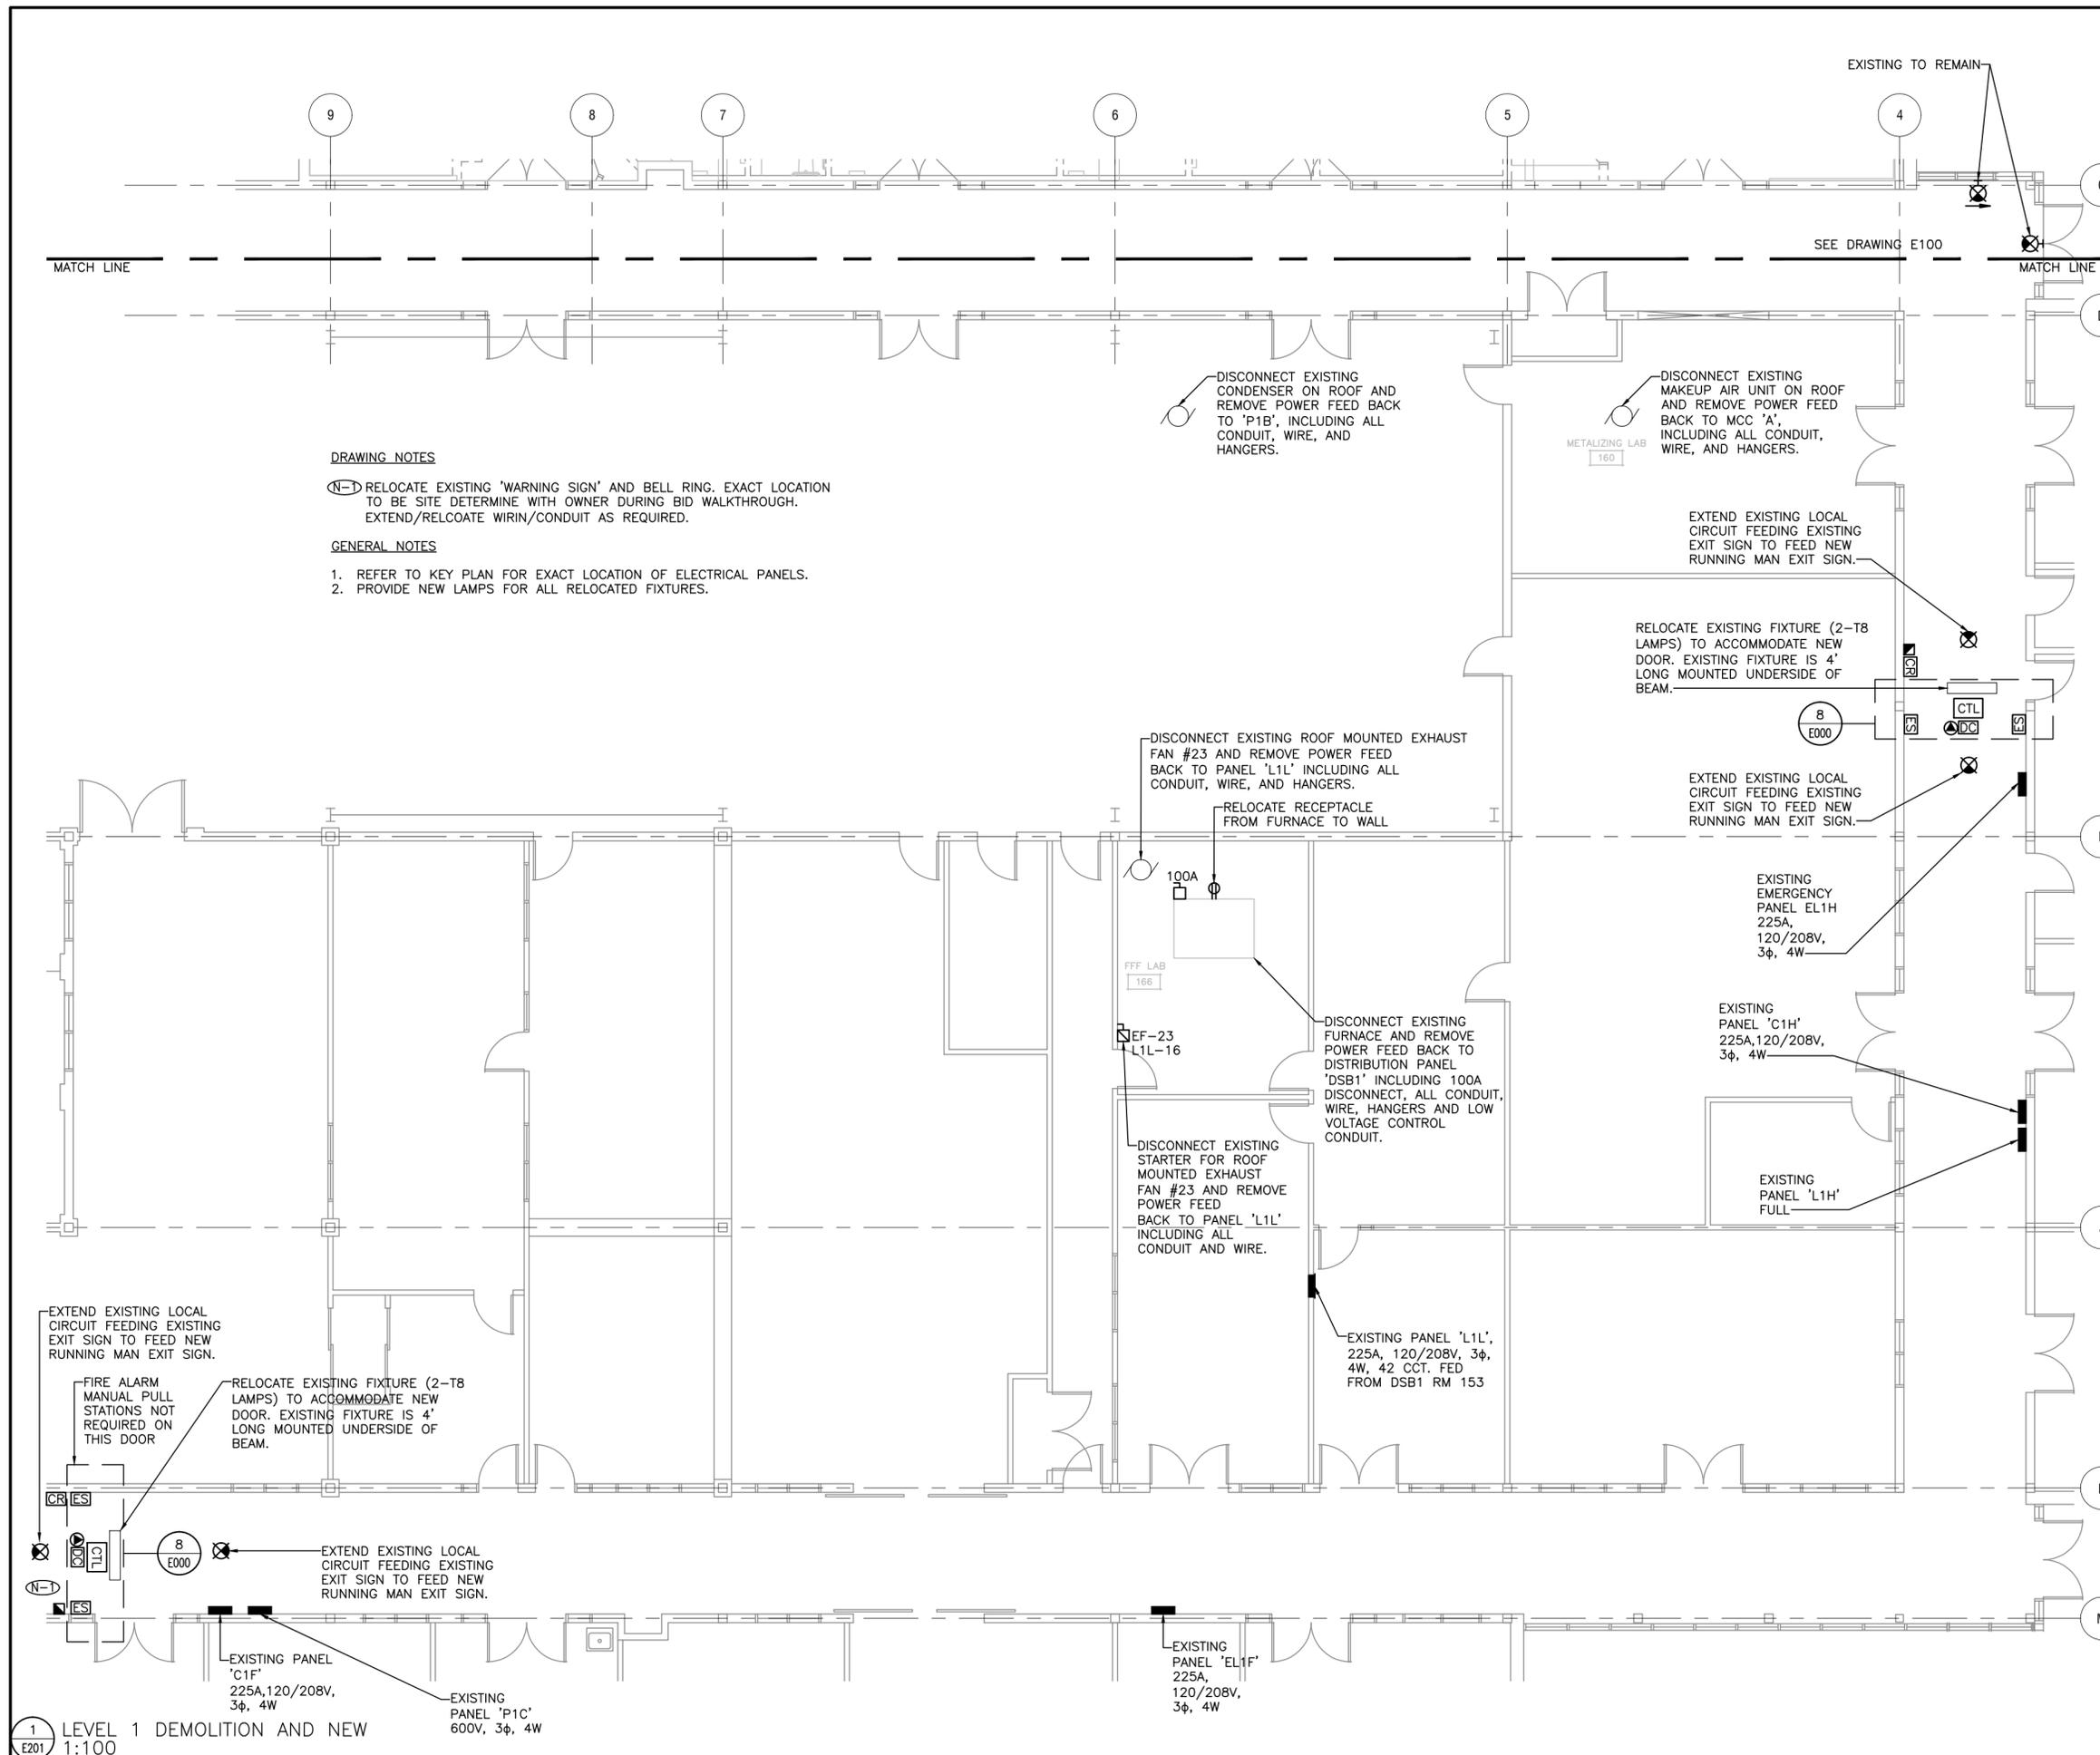


1 LEVEL 1 DEMOLITION AND NEW  
E201 1:100

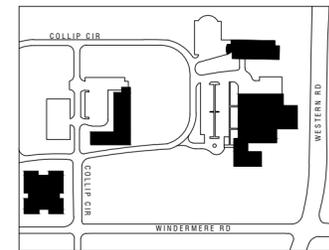

**DRAWING NOTES:**

- (N-1) REMOVE LIGHT FIXTURE FROM EXISTING CEILING TO FACILITATE REMOVAL OF EXISTING CEILING. SUSPEND LIGHT FIXTURE FROM DECK AFTER CEILING REMOVAL.
- (N-2) RELOCATE EXISTING CLOCK AS INDICATED.

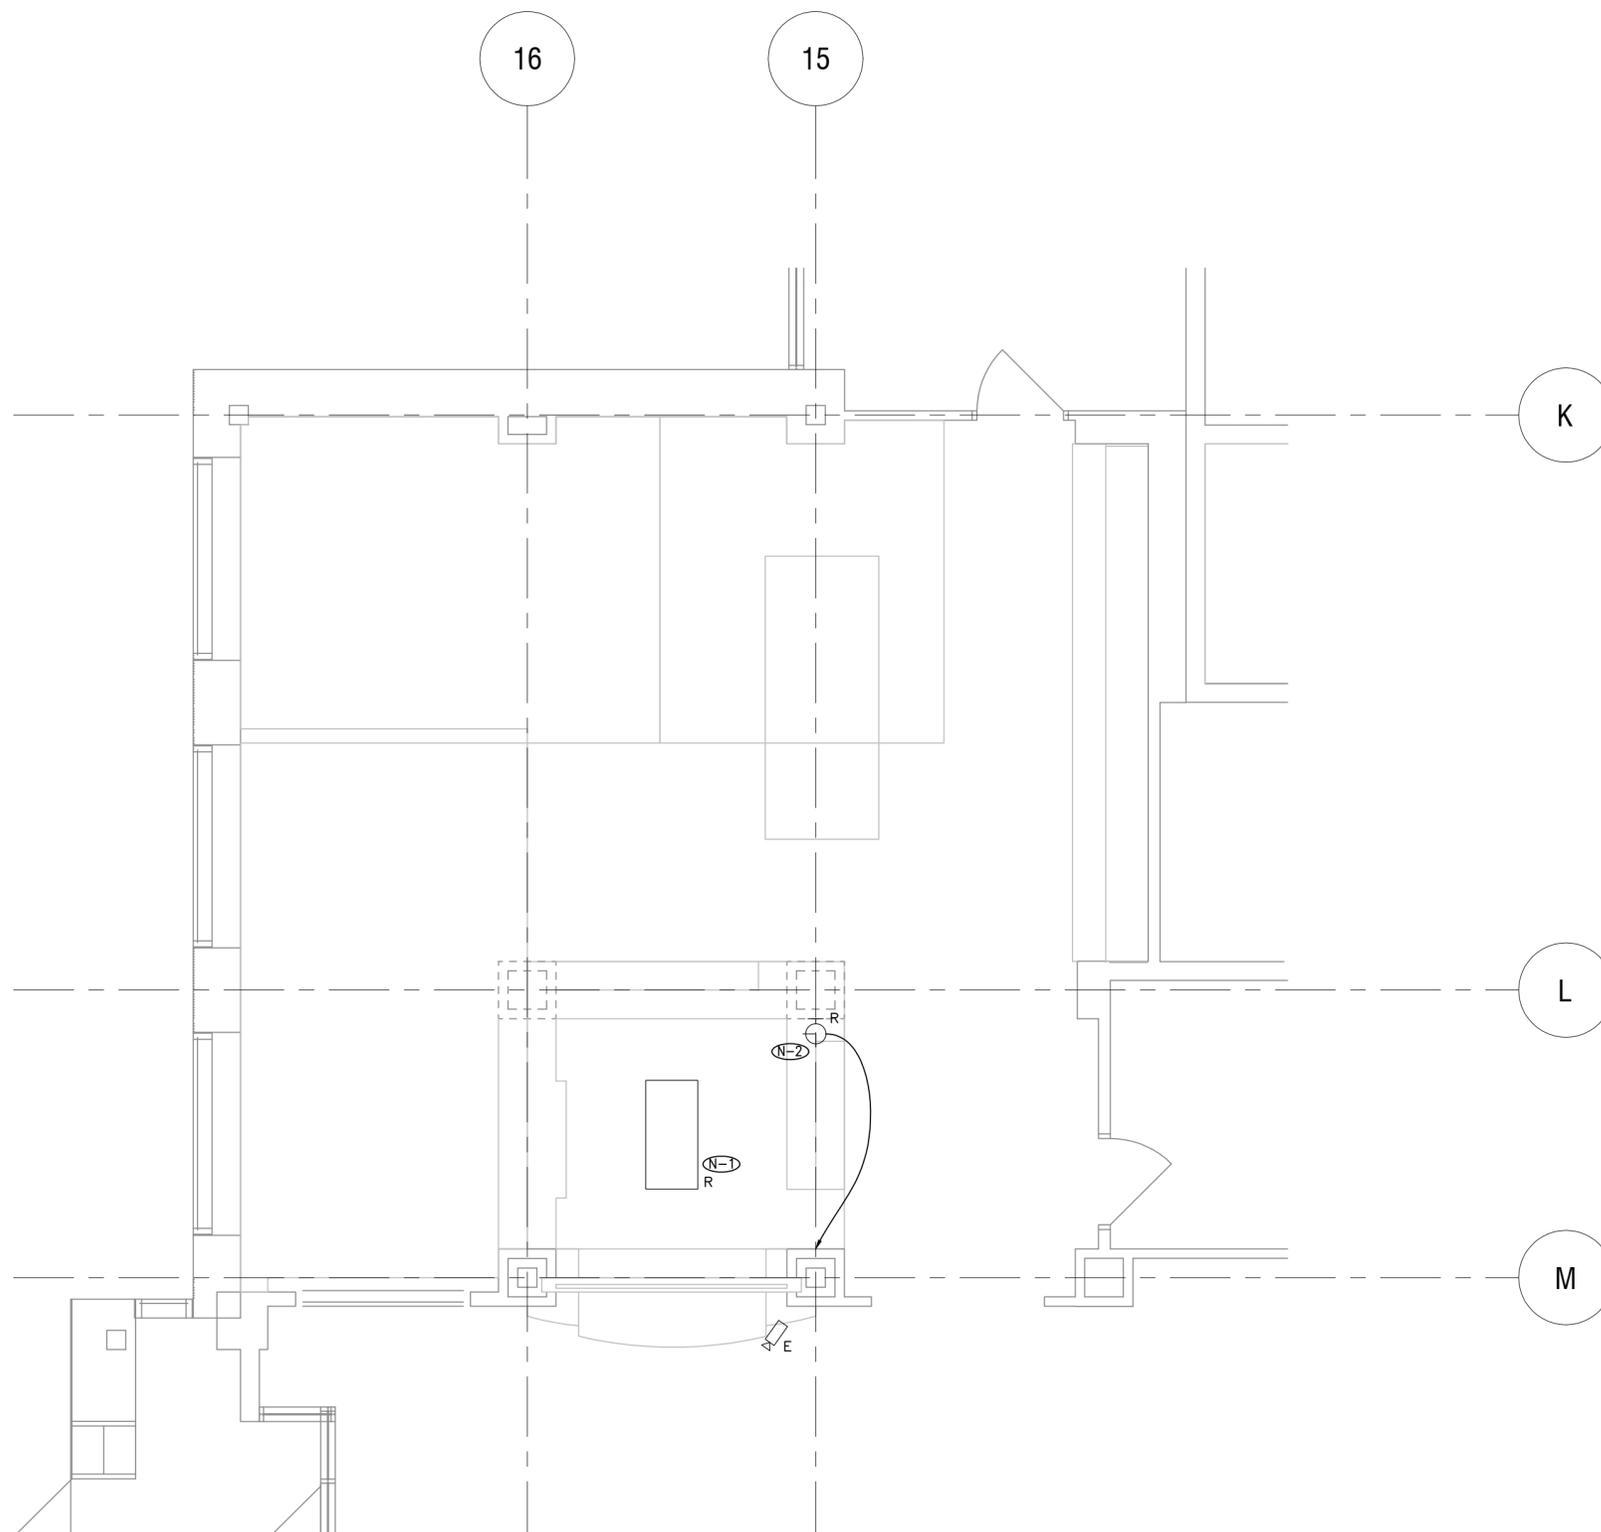

**ISSUED:**

No.	Date	Description
1	2016-12-16	ISSUED FOR TENDER



**Smith + Andersen**  
 148 Fullarton St. Suite 1400 London Ontario N6A 5P3  
 519 963 8888 www.smithandandersen.com



**NRC Factory of the Future  
Demolition Package 2**


800 Collip Cir, London, ON N6G 4X8

**RECEPTION AREA REVISIONS**

designed	conçu	date	date
MN		2016-12-13	
drawn	dessiné	scale:	échelle
MN		AS NOTED	
checked	vérifié	sheet	feuille
AS			
approved	approuvé	W.O. no	D.T. no
AS			

dwg.no. dessin no.

**IMC0200-E202**

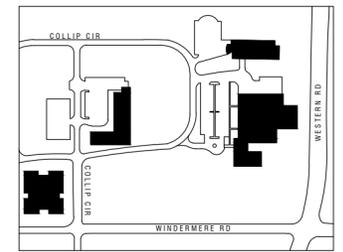

ISSUED:

No.	Date	Description
1	2016-12-16	ISSUED FOR TENDER



Smith + Andersen  
 148 Fullarton St. Suite 1400 London Ontario N6A 5P3  
 519 963 8888 www.smithandandersen.com



NRC Factory of the Future  
 Demolition Package 2

800 Collip Cir, London, ON N6G 4X8

LEVEL 1 POWER AND LIGHTING


designed	conçu	date	date
MN		2016-12-13	
drawn	dessiné	scale:	échelle
MN		AS NOTED	
checked	vérifié	sheet	feuille
AS			
approved	approuvé	W.O. no	D.T. no
AS			

dwg.no. dessin no.

**IMC0200-E300**

GENERAL NOTES:

- THESE DRAWINGS SHOW EXISTING EQUIPMENT THAT SHALL REMAIN AFTER DEMOLITION.
- VERIFY OPERATION OF ALL LIFE SAFETY DEVICES AND SYSTEMS THAT MAY HAVE BEEN DISRUPTED AS A RESULT OF DEMOLITION WORK AND PROVIDE:
  - FIRE ALARM VERIFICATION CERTIFICATE FOR ALL FIRE ALARM SYSTEM DEVICES LOCATED IN THE AREA.
  - LETTER STATING THAT ALL EXIT SIGNS ARE OPERATIONAL.
  - LETTER STATING THAT ALL EXISTING LIGHTING CIRCUITS ARE OPERATIONAL.
- TRACE ALL REMAINING RECEPTACLES AND SWITCHES LABEL WITH CIRCUIT NUMBERS AND UPDATE ALL PANELS DIRECTORIES.

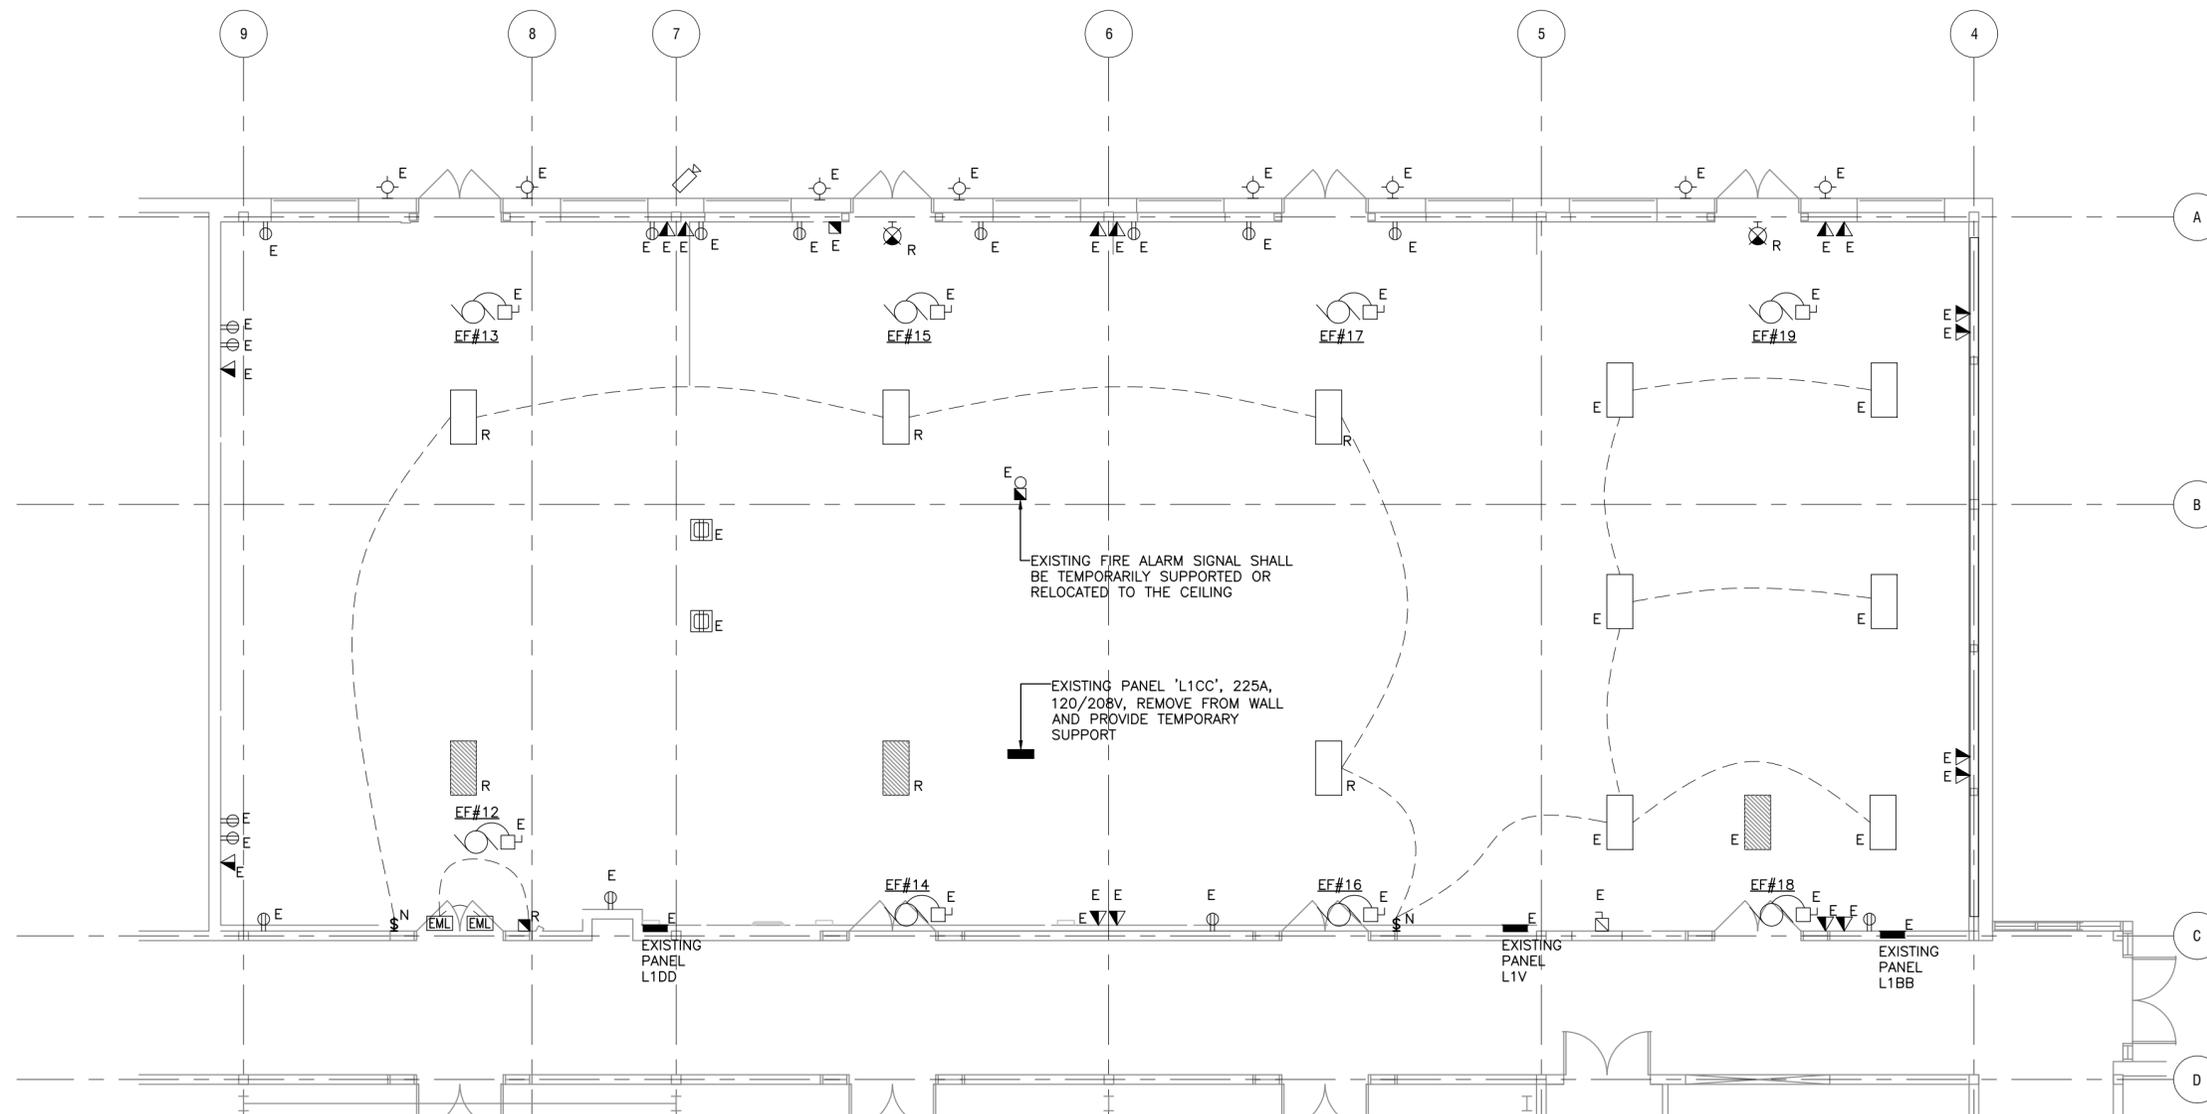

1 LEVEL 1 POWER AND LIGHTING  
 E300 1:100