

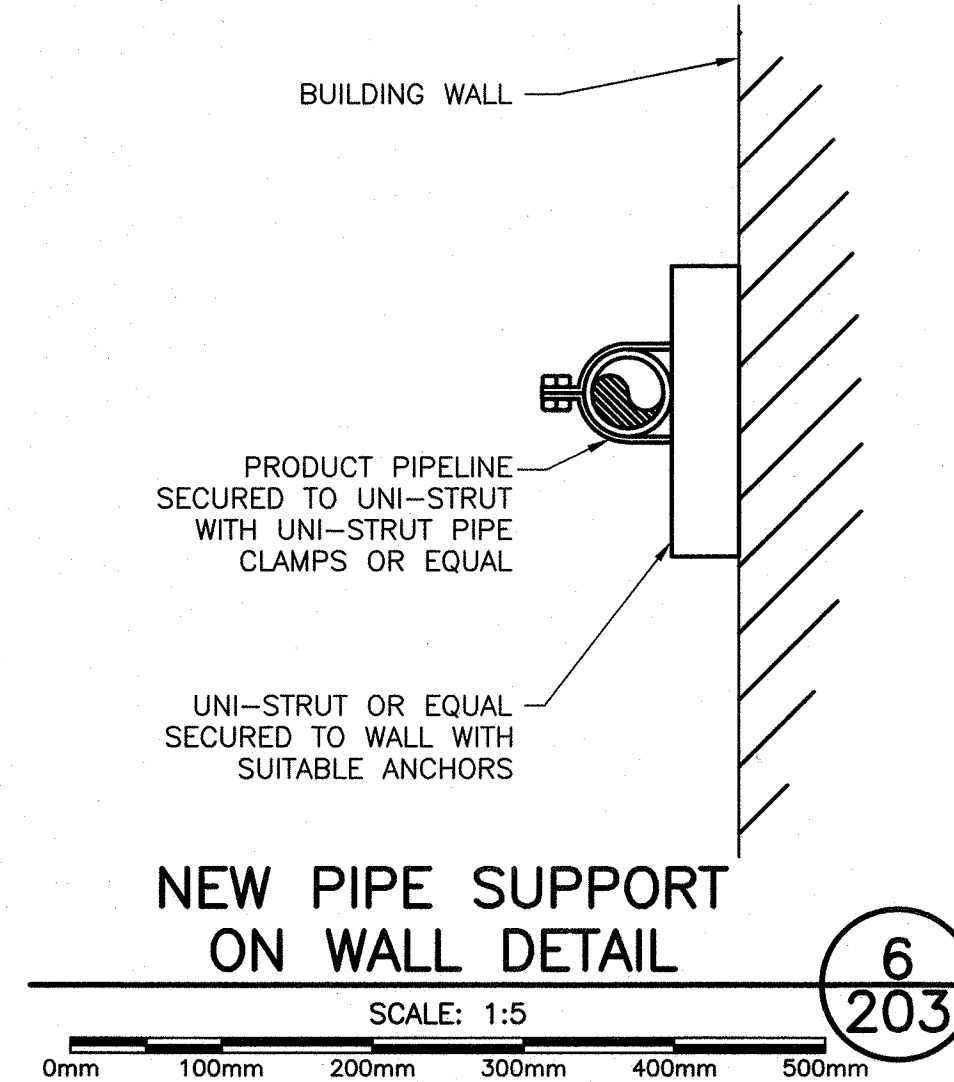
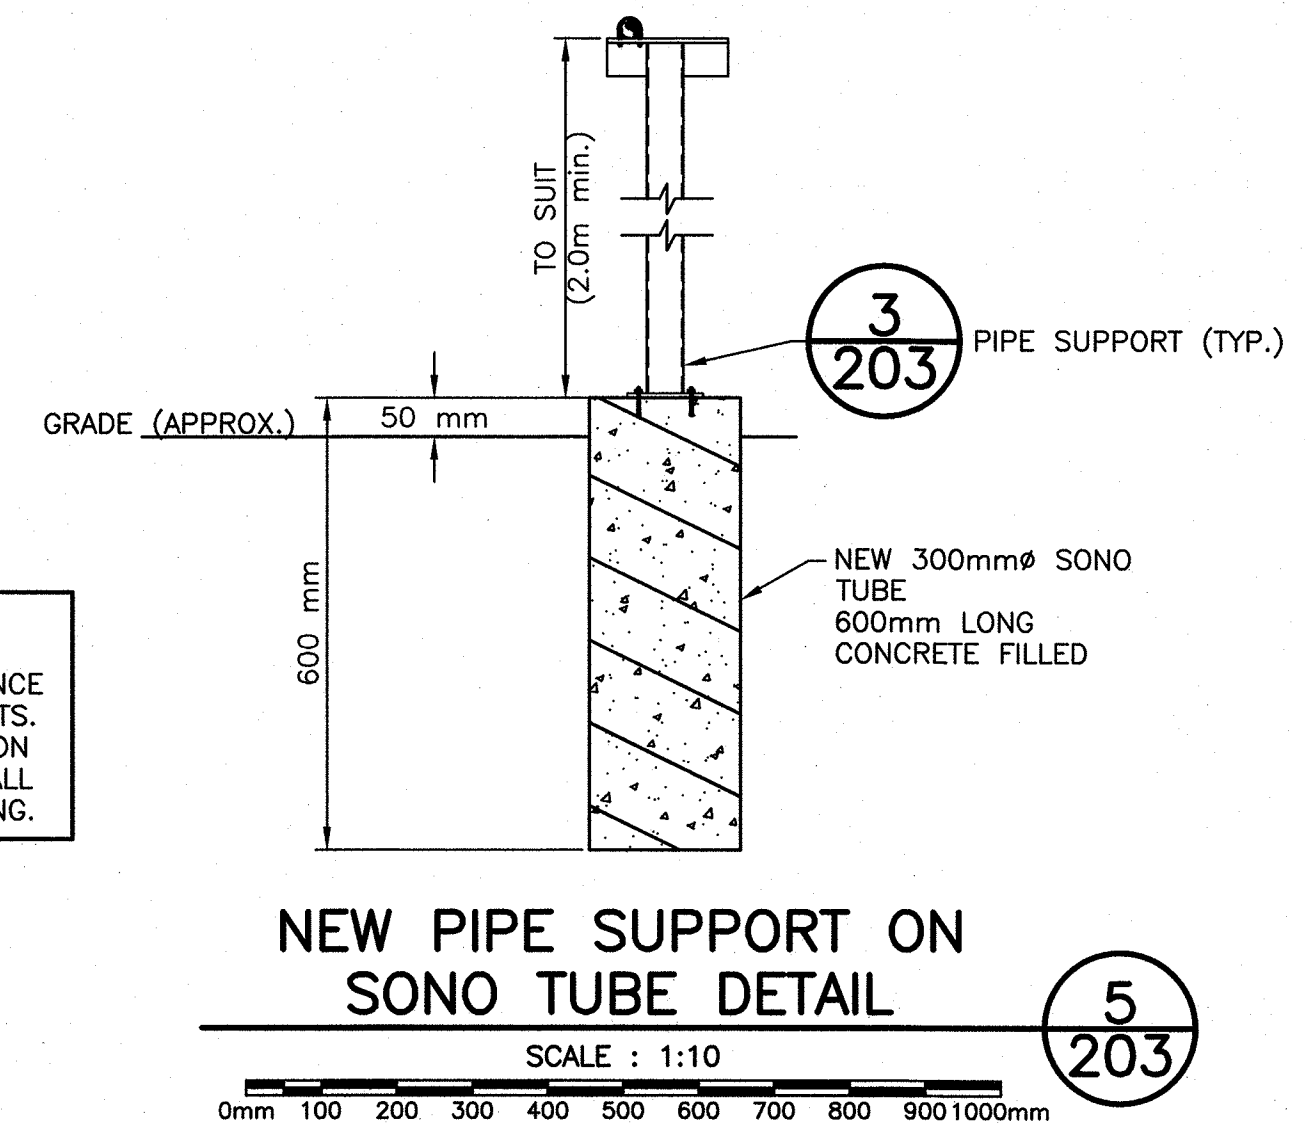
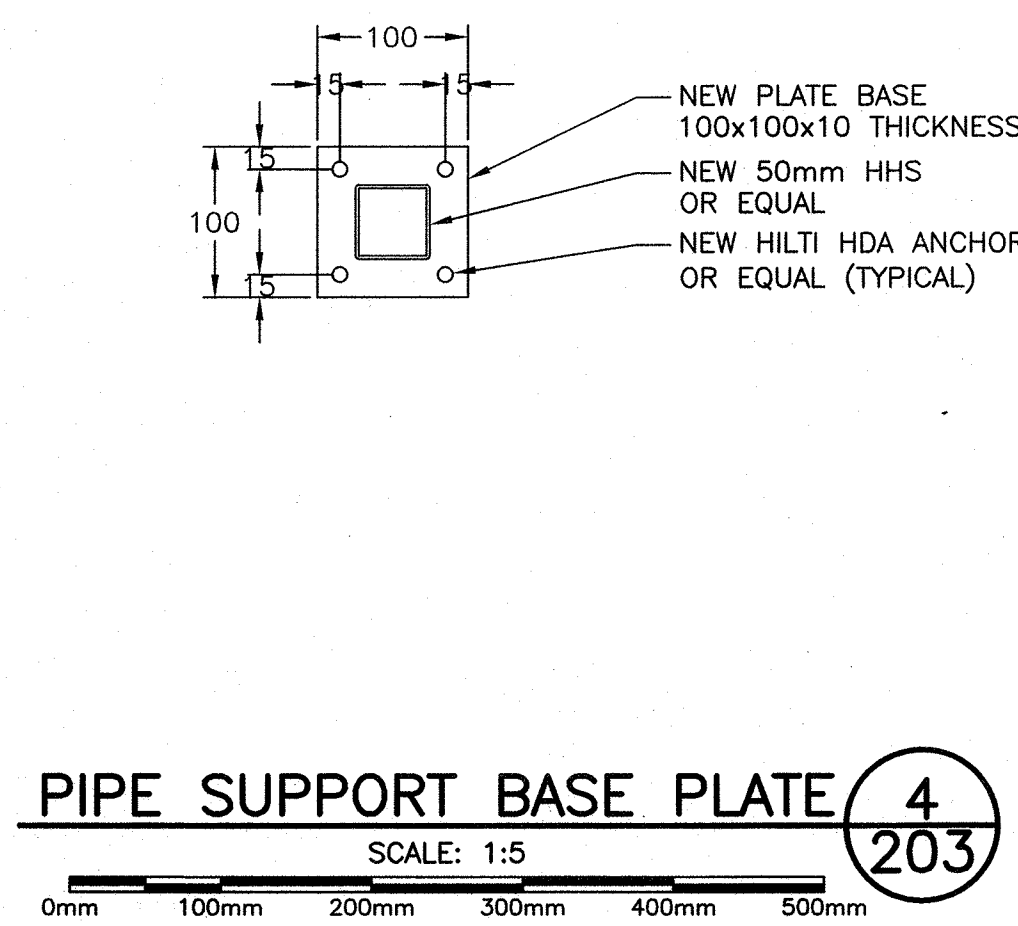
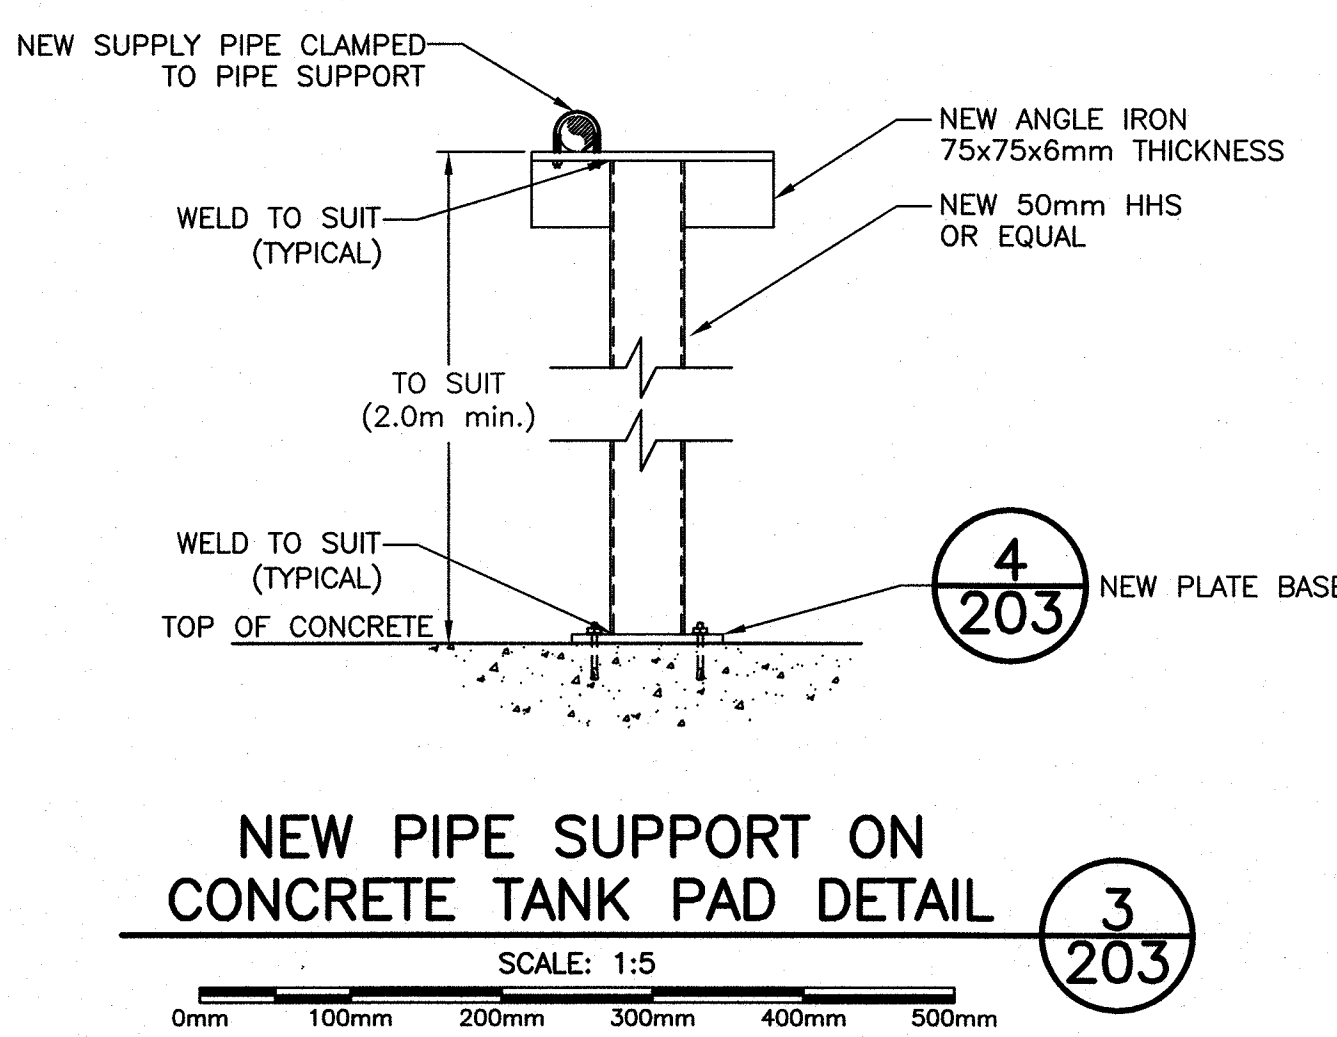
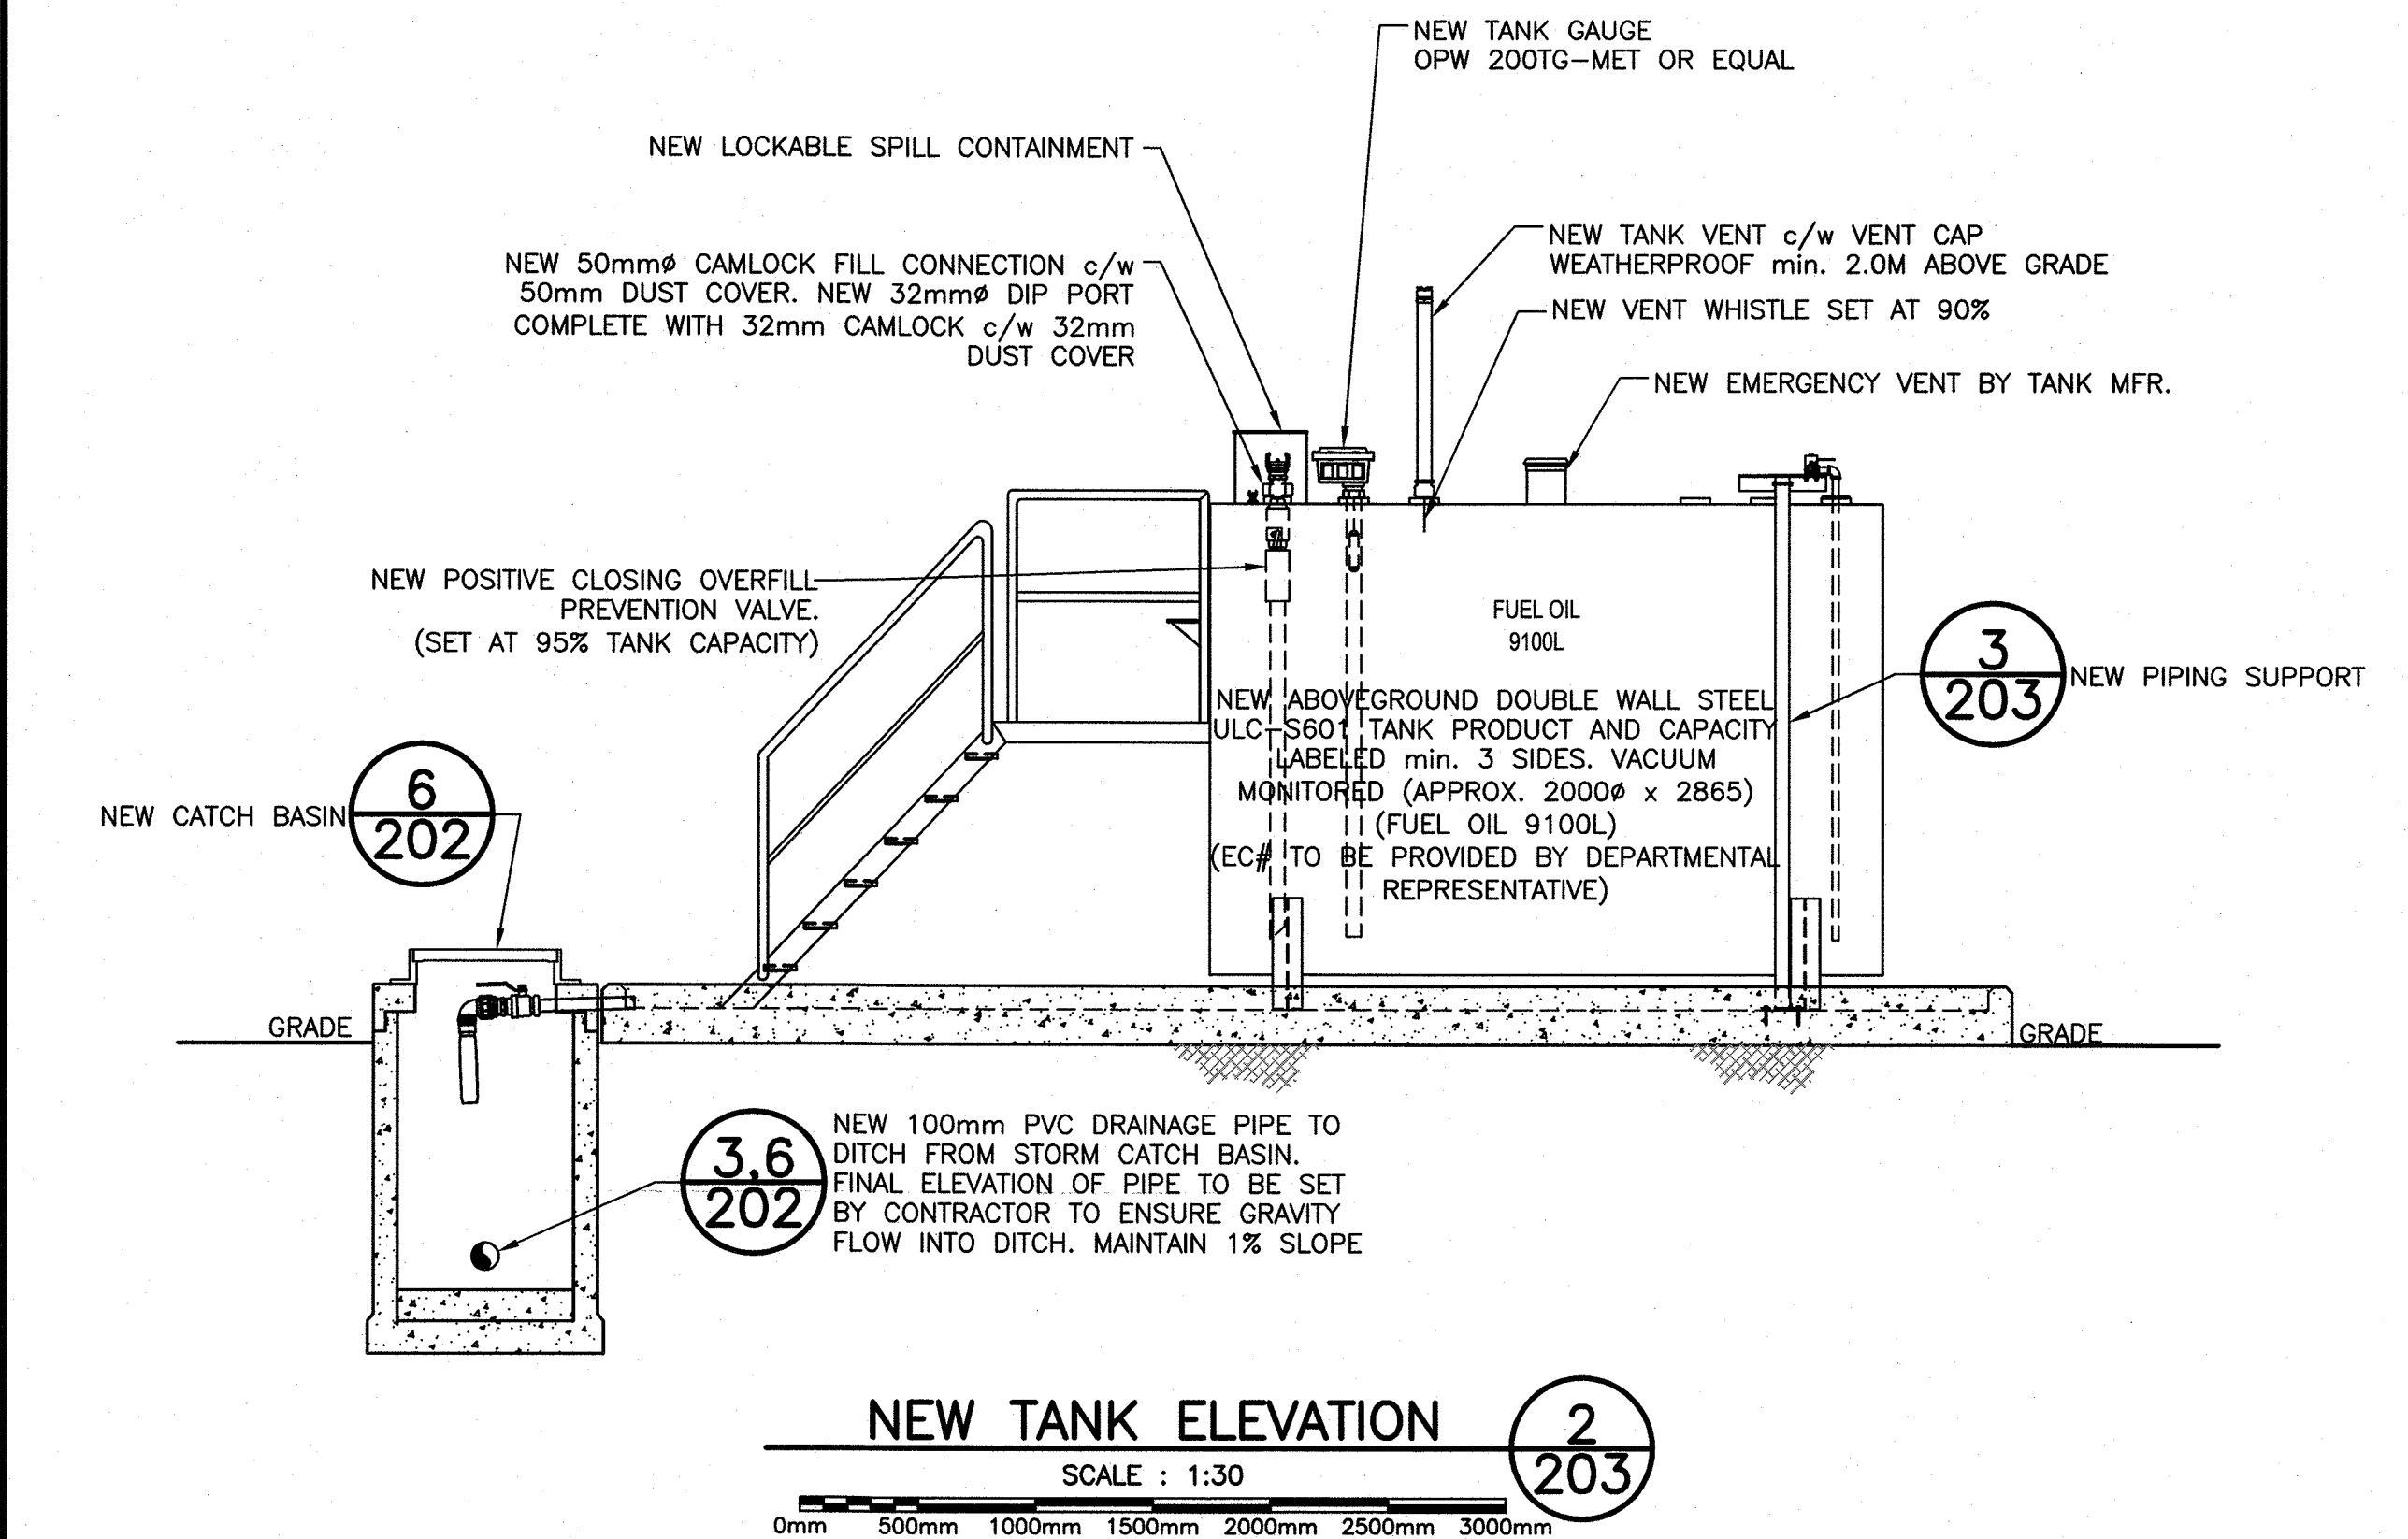


NOTE:
ALL PRODUCT PIPING IS TO BE PRIMED AND PAINTED IN ACCORDANCE WITH THE SPECIFICATION DOCUMENTS. PRODUCT TYPE AND FLOW DIRECTION ARROWS ARE TO BE APPLIED TO ALL SUPPLY, RETURN AND RELIEF PIPING.

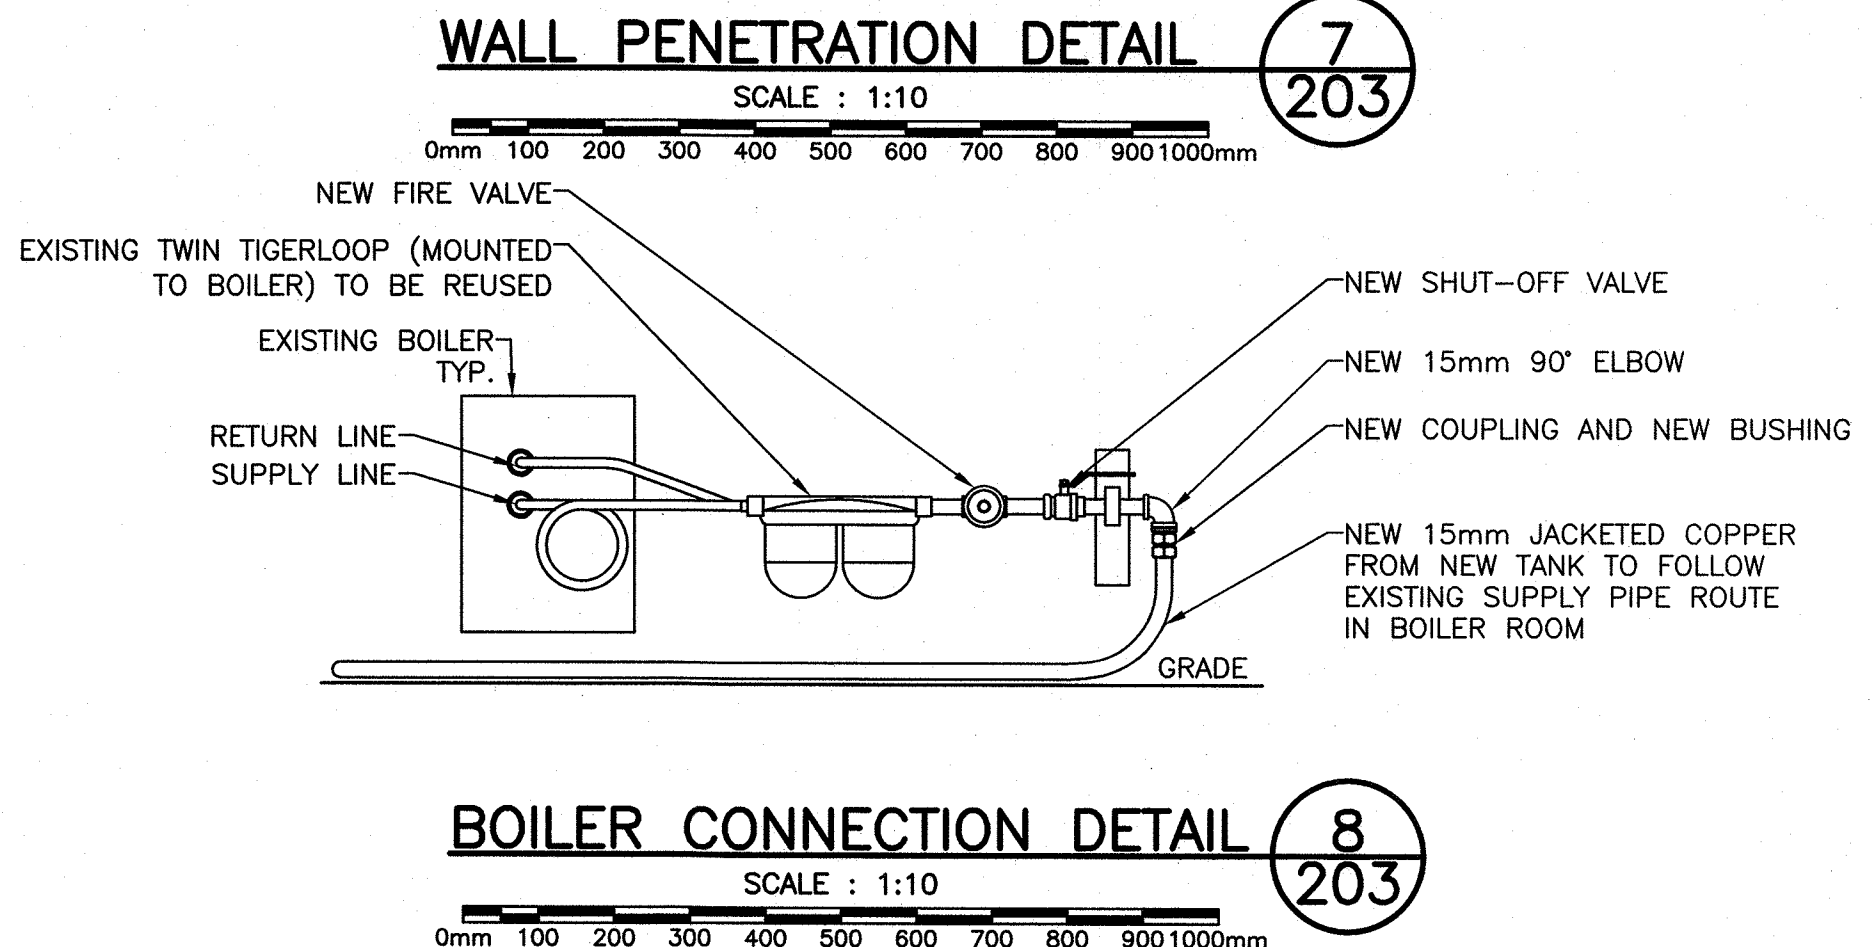

- NOTES:
- SUPPORTS TO BE SPACED SUFFICIENTLY FROM PARTITION LINE TO ALLOW ACCESS FOR INSTALLATION/SEALING.
 - FOR STUD WALLS MILD STEEL SLEEVE BEDDED IN SEALANT TO SEAL OFF STUDWORK.
 - FOR BLOCK WALLS THICKNESS OF STEEL SLEEVE TO BE SUFFICIENT TO SUPPORT MORTAR ABOVE, MINIMUM THICKNESS 1/16 INCH.
 - UNTHREADED PORTION OF ALL PIPING TO EXTEND A MINIMUM OF 25mm (1") THROUGH EACH SIDE OF THE WALL.

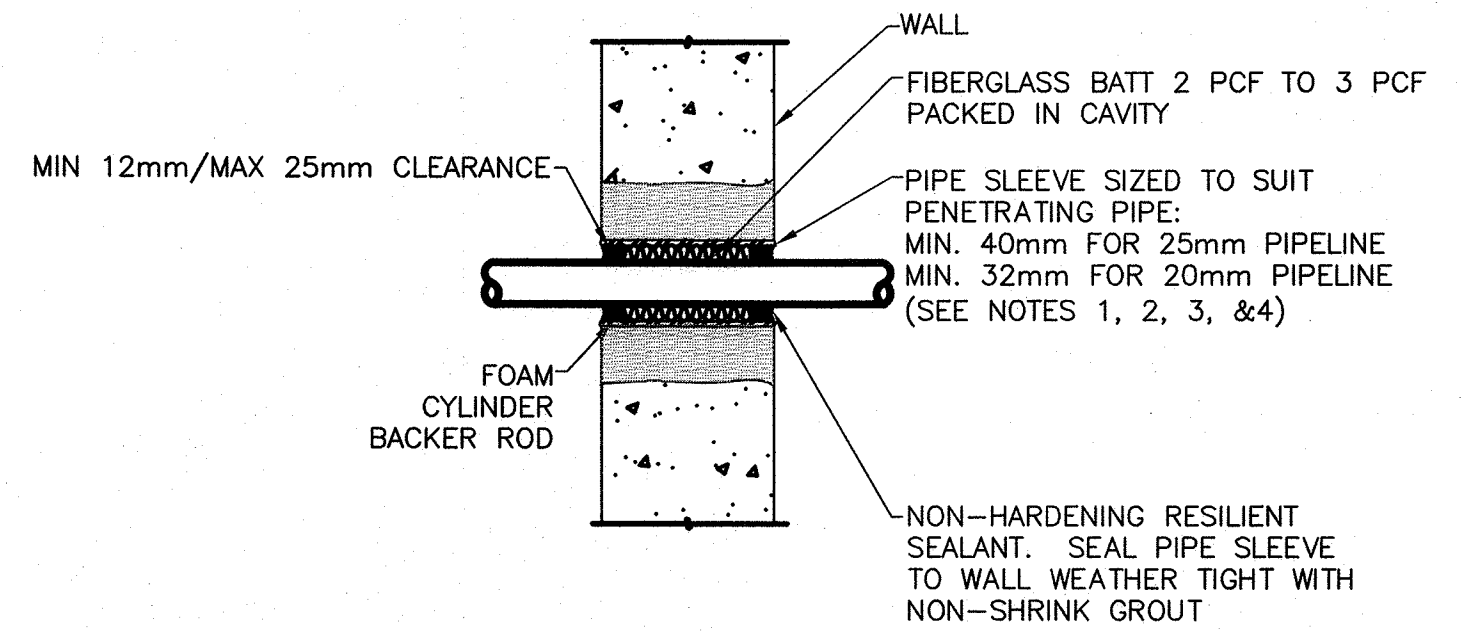

C	ISSUED FOR TENDER	1/03/2017
B	ISSUED FOR 99% REVIEW	11/16/2016
A	ISSUED FOR 66% REVIEW	10/21/2016
revisions		date

project

**PETROLEUM STORAGE SYSTEM UPGRADES
ST. ANDREWS
BIOLOGICAL STATION
ST. ANDREWS, NB**

dessin

drawing

**LAUZIER BUILDING
NEW FURNACE OIL
TANK MECHANICAL
PLANS, SECTIONS AND
DETAILS**

conçu

designed	ERF	conçu
date		
drawn	JCB	dessiné
date		
approved	ERF	approuvé
date		
Tender	2017-01-26	Soumission
Project Manager	Administrateur de projets IPSoc	
project number	R.070007.021	no. du projet
drawing no.	203	no. du dessin

E-DRM/GDD-E: 548139