


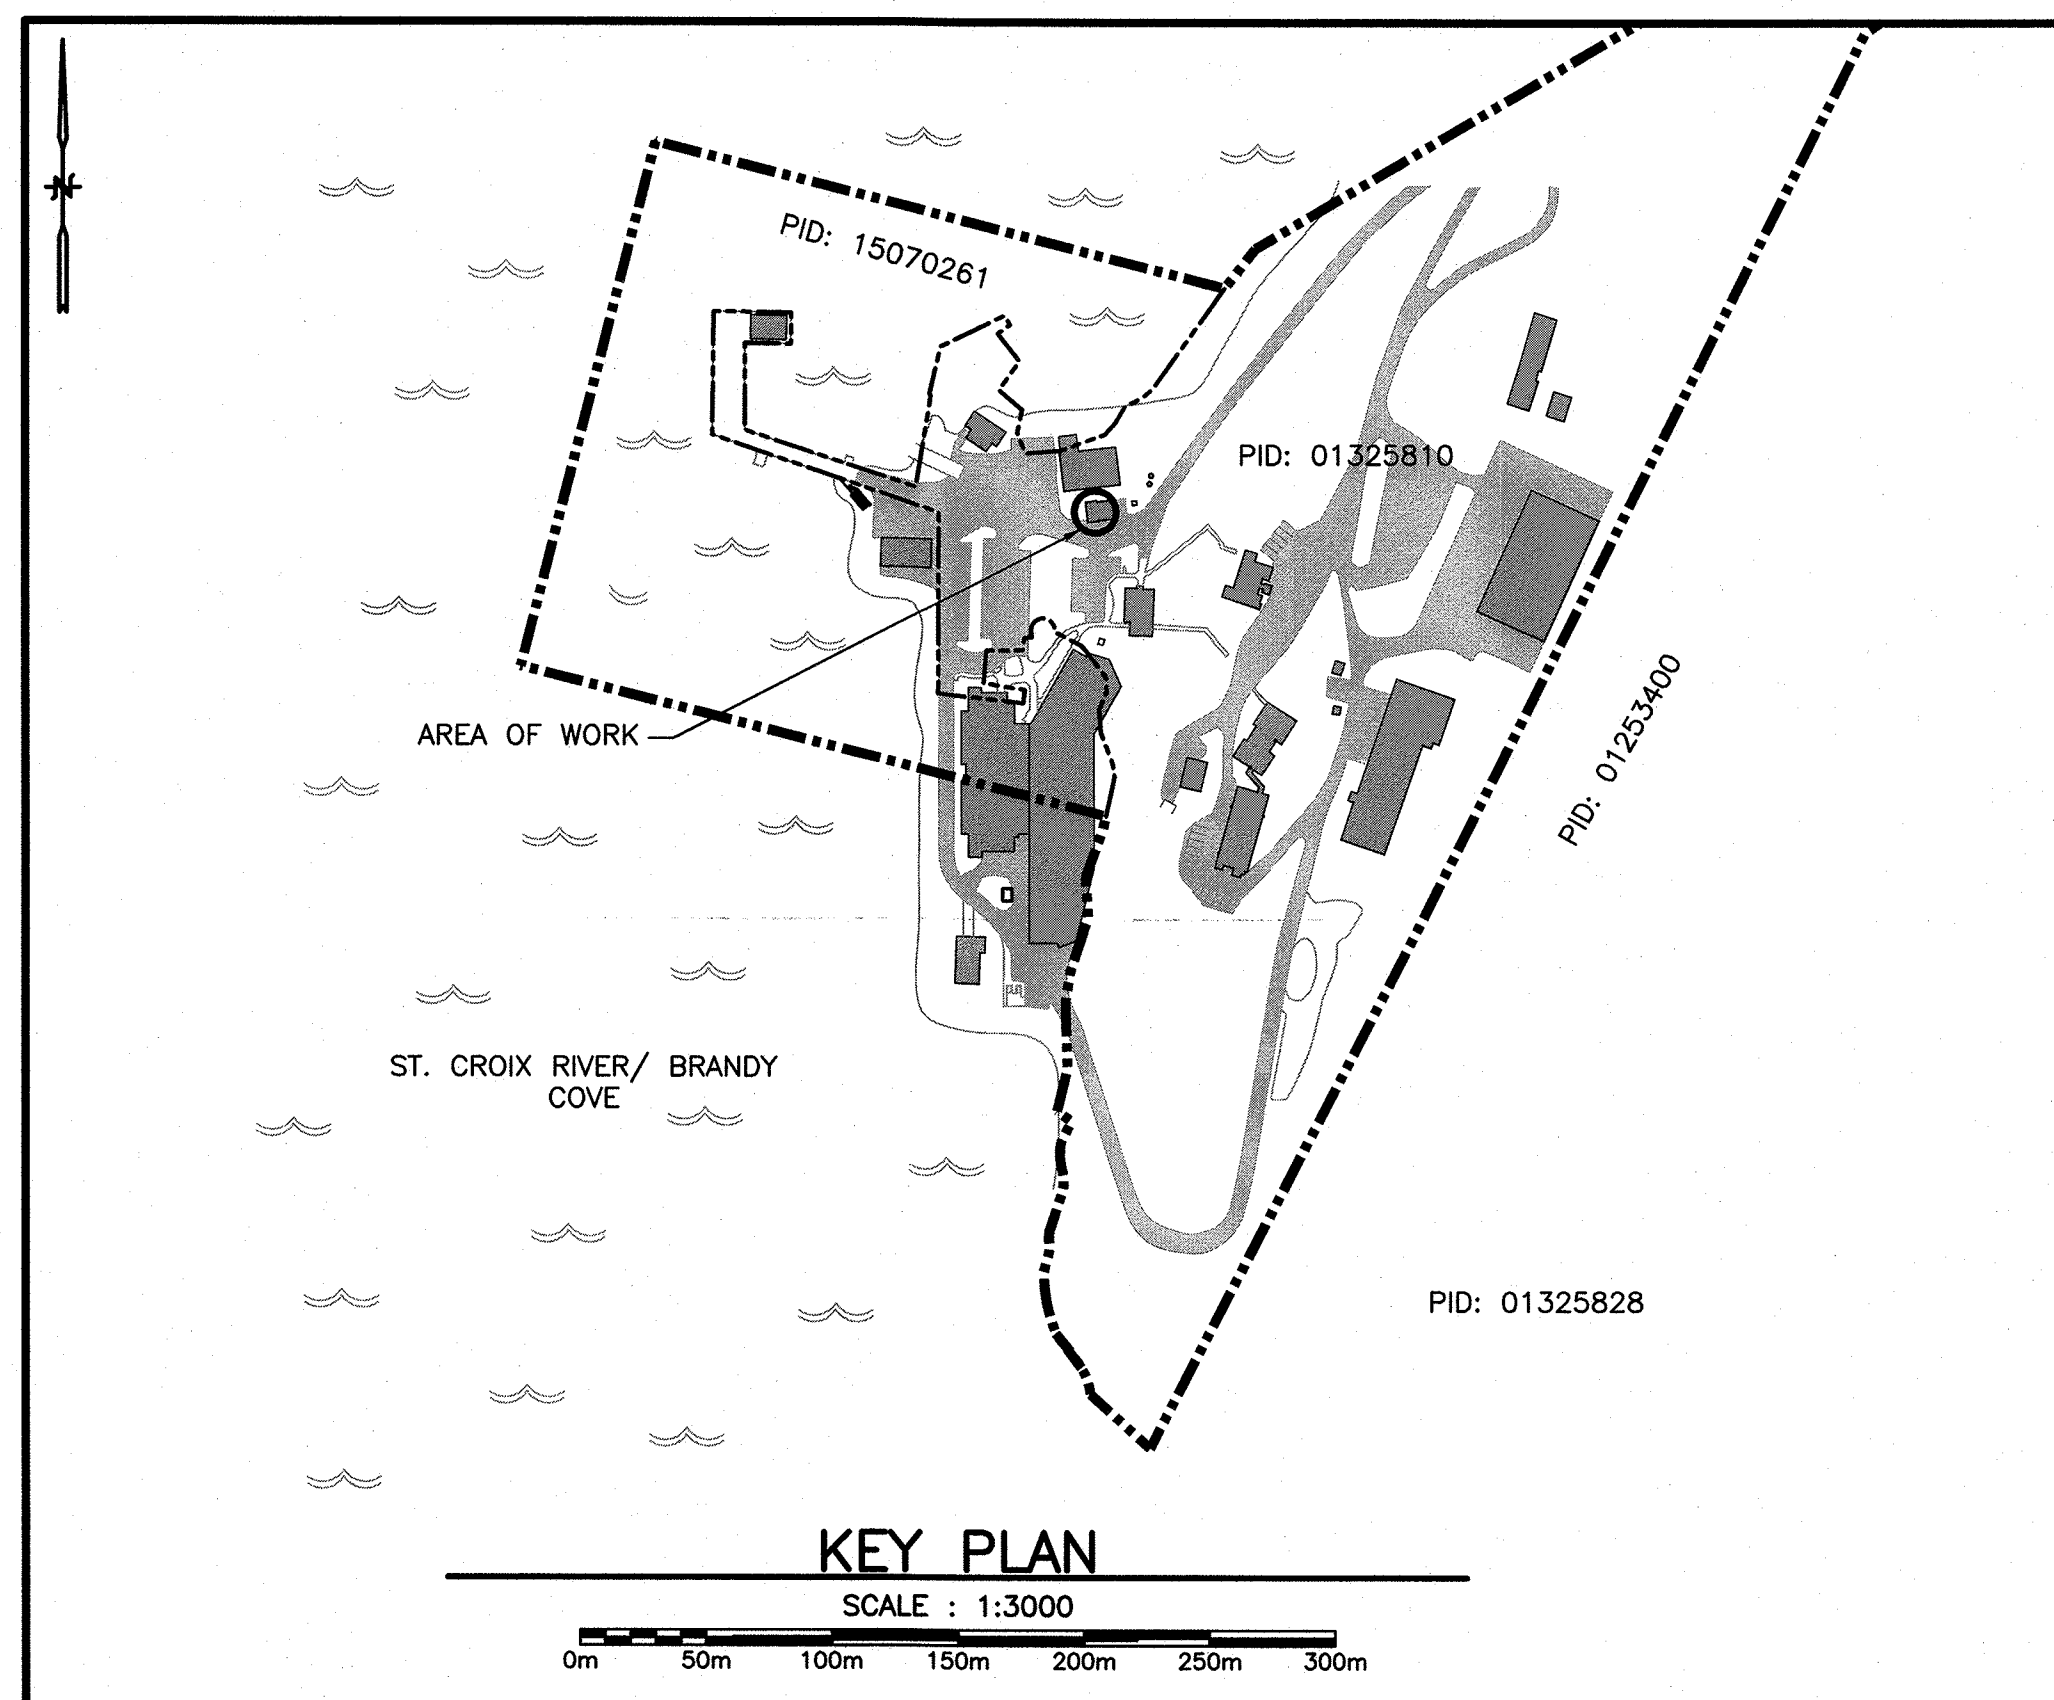
C	ISSUED FOR TENDER	1/03/2017
B	ISSUED FOR 99% REVIEW	11/16/2016
A	ISSUED FOR 66% REVIEW	10/21/2016
revisions		date

project
PETROLEUM STORAGE SYSTEM UPGRADES
ST. ANDREWS BIOLOGICAL STATION
ST. ANDREWS, NB

drawing
dessein

LAUZIER BUILDING
EXISTING SITE PLAN

designed	ERF	conçu
date		
drawn	JCB	dessiné
date		
approved	ERF	approuvé
date		
Tender	Soumission	
 2017-01-26		
PWSC Project Manager	Administrateur de projets TPSGC	
project number	no. du projet	
R.070007.021		
drawing no.	no. du dessin	



NOTE:
A TEMPORARY FUEL SUPPLY SYSTEM MUST BE PROVIDED FOR THE LAUZIER BUILDING BOILER FOR THE DURATION OF THE PROJECT. THE TEMPORARY FUEL SUPPLY SHALL, AT MINIMUM, CONSIST OF AN ABOVEGROUND STEEL S601/S602 SECONDARILY CONTAINED SUPPLY TANK (SYSTEM CAPACITY NOT TO EXCEED 2500L) TO BE INSTALLED AT A LOCATION TO BE DETERMINED WITH THE DEPARTMENTAL REPRESENTATIVE. THE SYSTEM IS TO BE EQUIPPED WITH AN APPROPRIATE OVERFILL PREVENTION DEVICE, SPILL CONTAINER, TANK GAUGE, ANTI-SYPHON DEVICE, AND PHYSICAL PROTECTION FROM VEHICLE DAMAGE/IMPACT.

