

3	ISSUED FOR TENDER	JAN 30 2017
2	99% DRAWINGS	MAR 27 2015
1	66% DRAWINGS	MAR 06 2015
revisions		date

project

**DESIGNATED SUPPORT
SPACE – FIRST FLOOR
JEAN CANFIELD G.O.C.B.
CHARLOTTETOWN
QUEENS CO., PEI**

drawing

**DEMOLITION & KEY
PLANS**

designed RAL93

date 2017-01-30

drawn JH

date 2017-01-30

approved RLS

date 2017-01-30

Tender


PWGSC Project Manager / Administrateur de projets TPSGC

project number

R.086261.003

drawing no.

E1 of E5

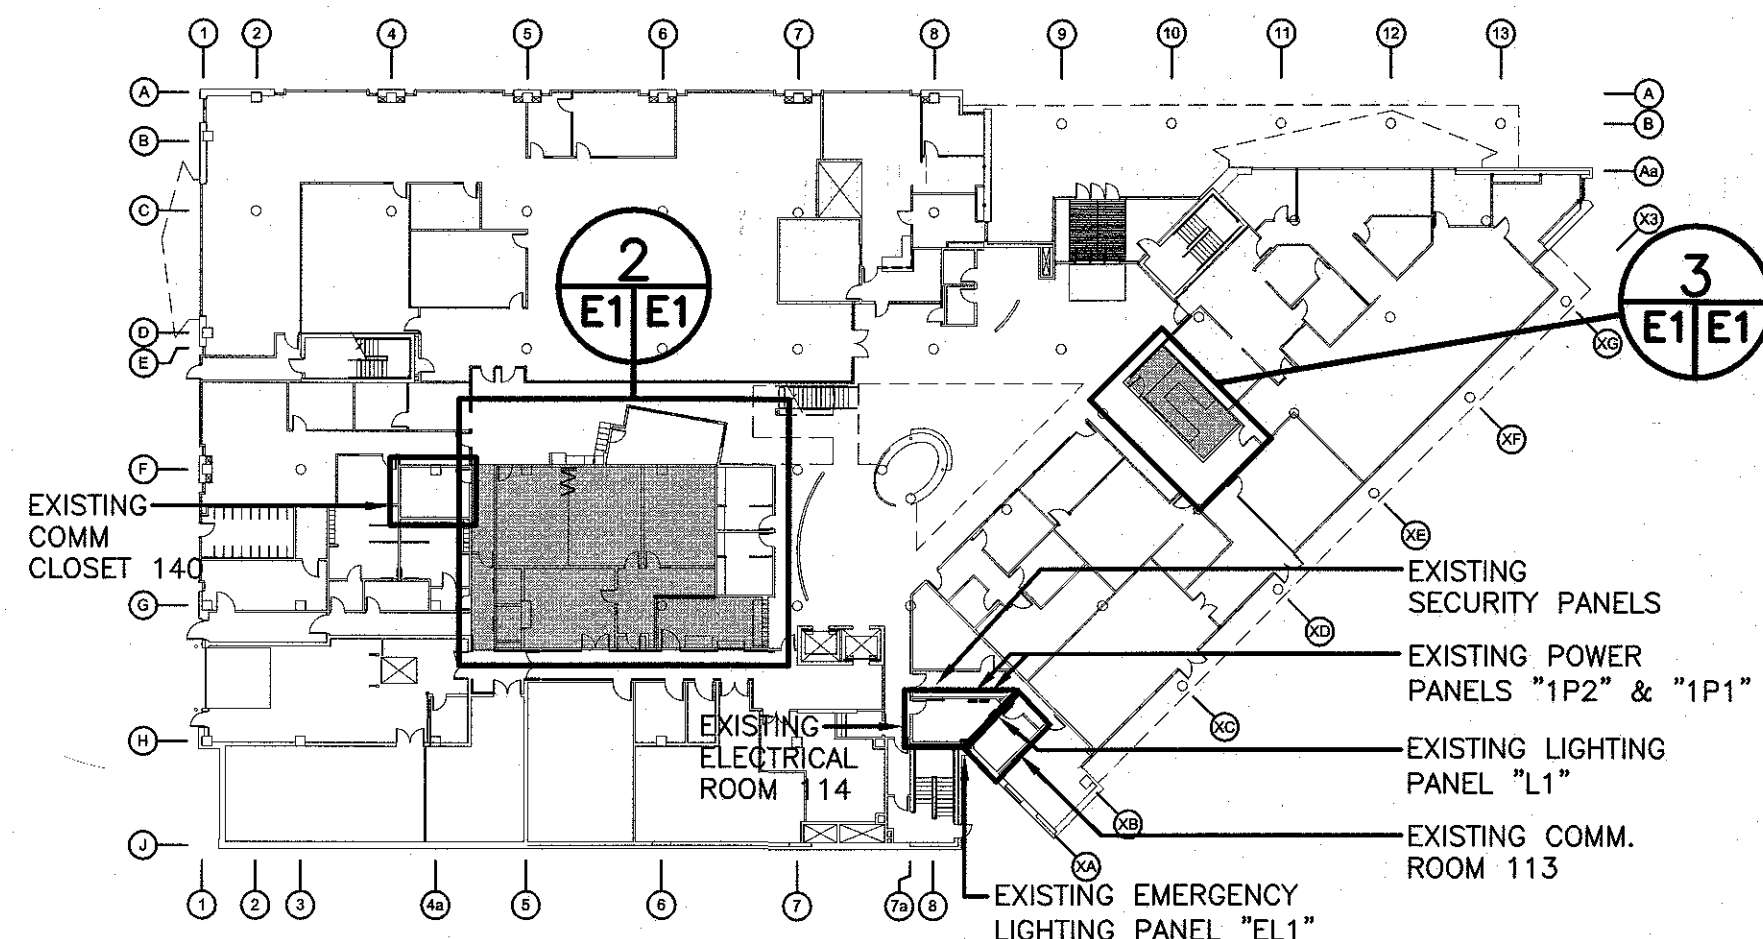

KEY PLAN: PWGSC MTG AND SUPPORT ROOMS


SCALE/ÉCHELLE: 1:500

0m 10m 20m 30m 40m 50m

DEMOLITION: PWGSC MTG AND SUPPORT ROOMS

SCALE/ÉCHELLE: 1:500

0m 10m 20m 30m 40m 50m

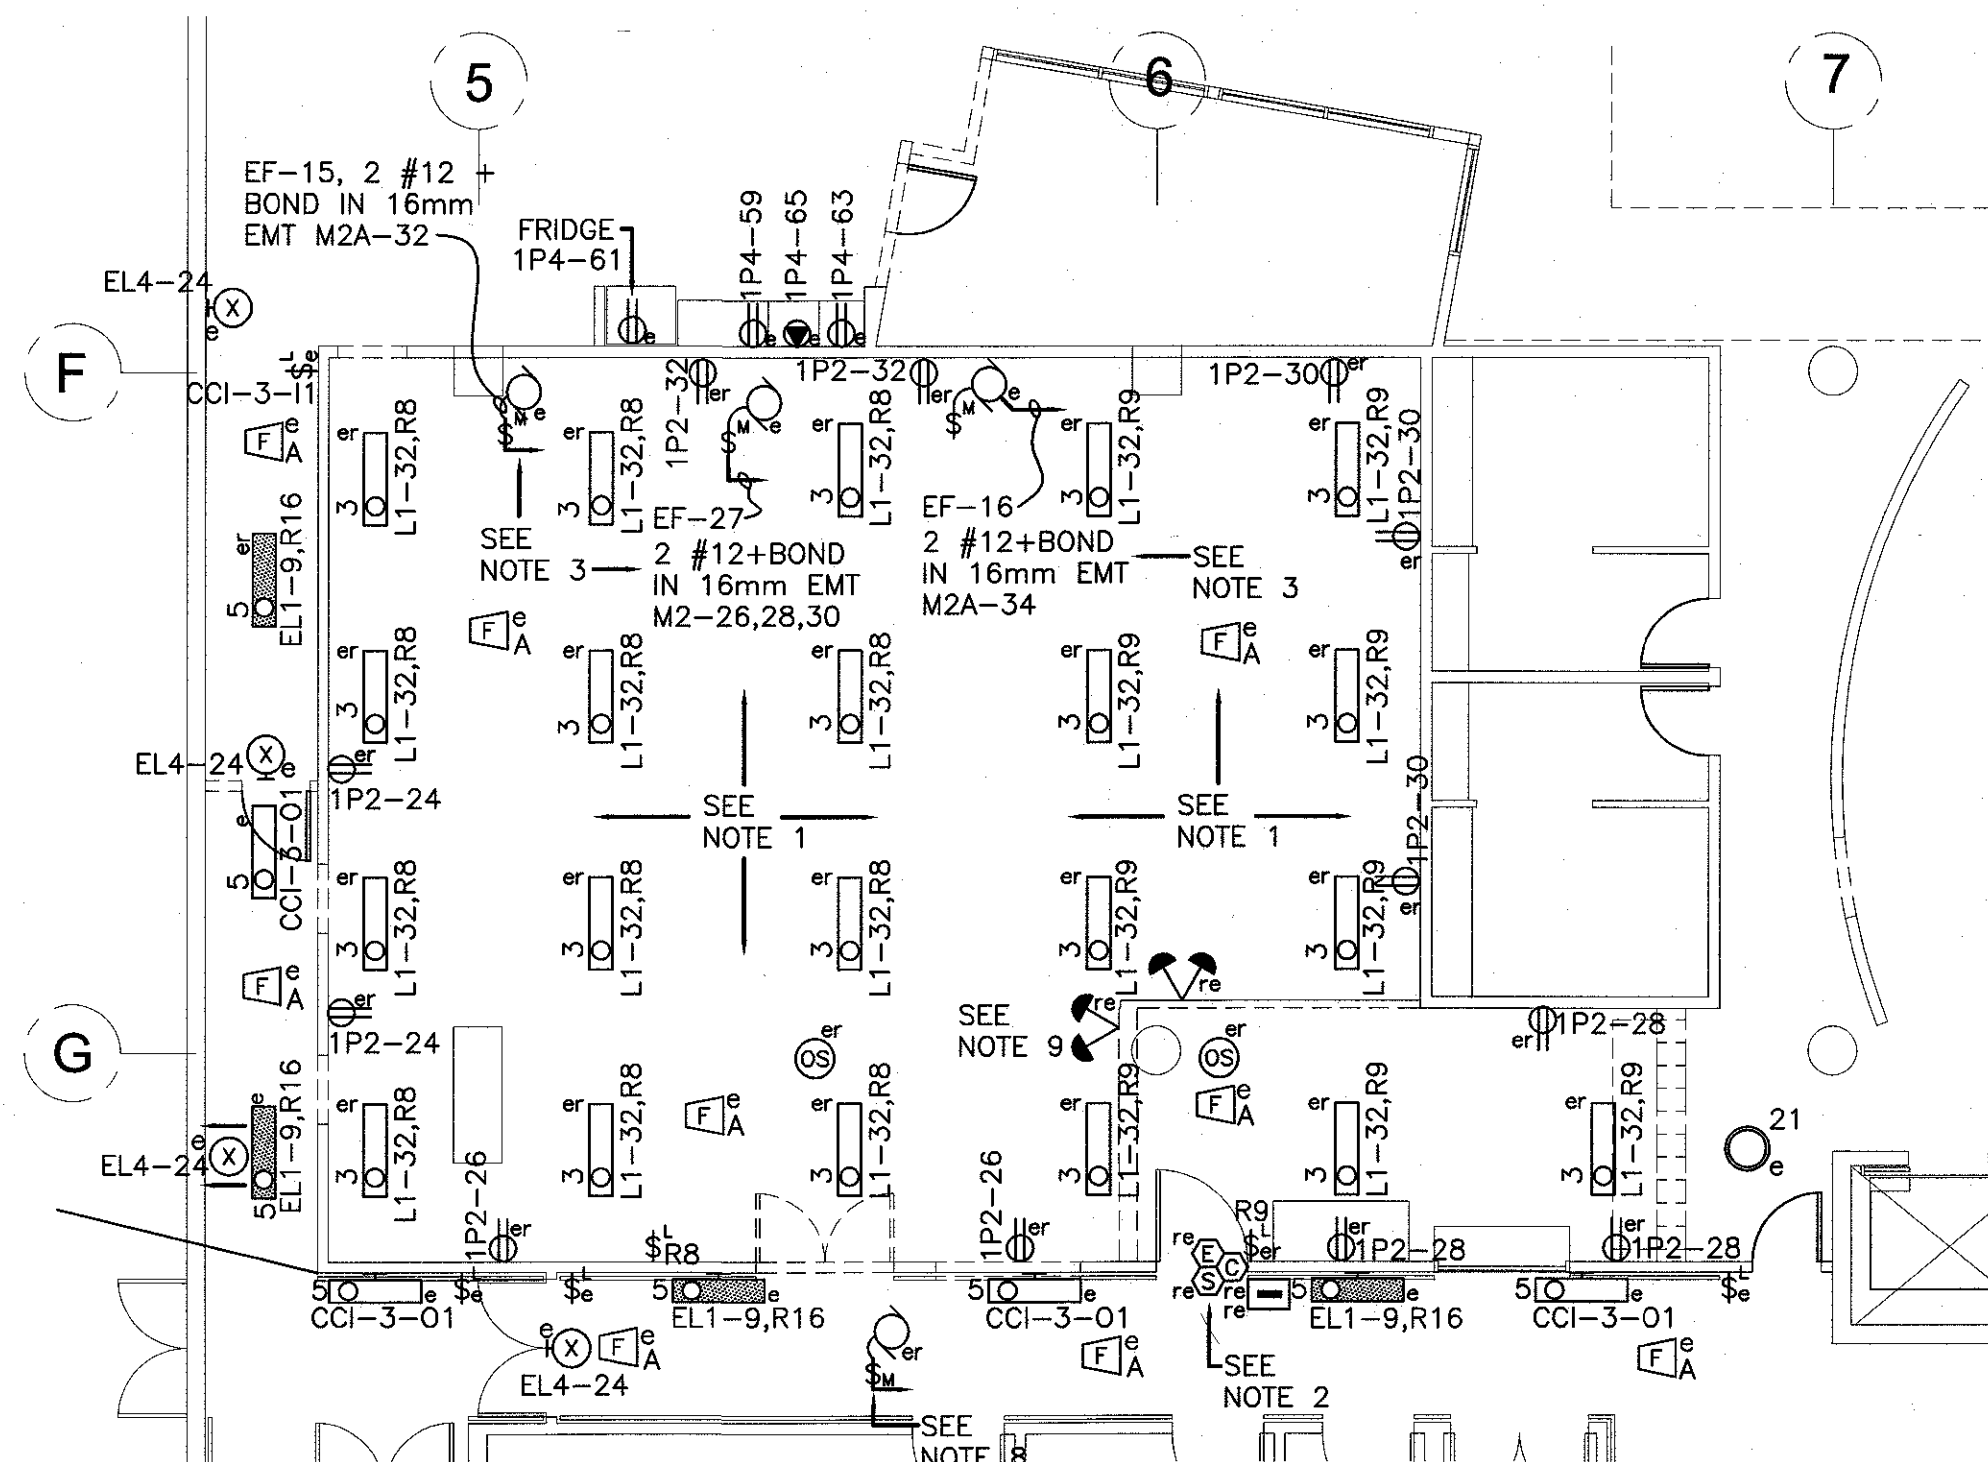

DEMOLITION: PWGSC MTG AND SUPPORT ROOMS

SCALE/ÉCHELLE: 1:100

0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m

1.) DISCONNECT AND REMOVE ALL EXISTING TYPE "3" FIXTURES, EXISTING OCCUPANCY SENSORS AND ASSOCIATED BRANCH CIRCUIT WIRING IN THE FORMER STORAGE ROOMS AND MAIL ROOM. TURN OVER ALL REMOVED LUMINAIRES TO THE OWNER.

2.) DISCONNECT AND REMOVE EXISTING DOOR ACCESS CONTROL EQUIPMENT AND TURN OVER TO THE OWNER. SECURITY EQUIPMENT WILL BE RELOCATED TO NEW MEETING ROOM 107. REFER TO DRAWING E3 FOR LOCATION OF RELOCATED DOOR ACCESS EQUIPMENT.

3.) EXISTING EXHAUST FANS EF-15, EF-16 AND EF-27 WILL REMAIN. EXISTING CIRCUIT NUMBER AND WIRING IS IDENTIFIED ON THE DRAWINGS.

4.) DISCONNECT AND REMOVE EXISTING TYPE "2" RECESSED POTLIGHTS AND TYPE "38" PENDANT MOUNTED LUMINAIRES OVER FORMER CANTEEN. TURN OVER REMOVED LUMINAIRES TO THE OWNER.

5.) DISCONNECT AND REMOVE EXISTING TOGGLE SWITCHES AND ASSOCIATED BRANCH CIRCUIT WIRING FOR TYPE "2" AND TYPE "38" FIXTURES THAT ARE BEING REMOVED.

6.) DISCONNECT AND REMOVE EXISTING CANTEEN PANEL "C". DISCONNECT AND REMOVE ALSO THE EXISTING PANEL FEEDER FROM ELECTRICAL ROOM 114 AND ITS ASSOCIATED CONDUIT. RE-LABEL BRANCH BREAKER IN ELECTRICAL ROOM 114 AS "SPARE"

7.) THERE ARE APPROXIMATELY 12 EXISTING RECEPTACLES LOCATED WITHIN THE FORMER CANTEEN AREA THAT ARE TO BE DISCONNECTED AND REMOVED. ALL RECEPTACLES ARE WIRED FROM THE OLD CANTEEN PANEL "C" THAT IS BEING REMOVED. REMOVE ALL ASSOCIATED BRANCH CIRCUIT WIRING AND CONDUIT.

8.) DISCONNECT AND REMOVE WIRING, CONDUIT, ETC. TO EXISTING FANCOIL UNIT FU-1-12. RE-LABEL EXISTING CIRCUIT "M2A-30" TO SHOW REMOVAL. ACTUAL REMOVAL OF FANCOIL UNIT WILL BE BY OTHERS.

DISCONNECT AND REMOVE THE EXISTING TWO REMOTE EMERGENCY HEADS AND SET THEM ASIDE FOR RE-INSTALLATION IN THE NEW CEILING. REFER TO DRAWING E2 FOR LOCATION OF RELOCATED REMOTE HEADS.