



**RETURN BIDS TO:**  
**RETOURNER LES SOUMISSIONS À:**  
Public Works and Government Services Canada  
ATB Place North Tower  
10025 Jasper Ave./10025 ave. Jasper  
5th floor/5e étage  
Edmonton  
Alberta  
T5J 1S6  
Bid Fax: (780) 497-3510

## SOLICITATION AMENDMENT MODIFICATION DE L'INVITATION

The referenced document is hereby revised; unless otherwise indicated, all other terms and conditions of the Solicitation remain the same.

Ce document est par la présente révisé; sauf indication contraire, les modalités de l'invitation demeurent les mêmes.

### Comments - Commentaires

Vendor/Firm Name and Address  
Raison sociale et adresse du  
fournisseur/de l'entrepreneur

Issuing Office - Bureau de distribution  
Public Works and Government Services Canada  
ATB Place North Tower  
10025 Jasper Ave./10025 ave Jasper  
5th floor/5e étage  
Edmonton  
Alberta  
T5J 1S6

<b>Title - Sujet</b> Sinclair Canyon Electrical Upgrade	
<b>Solicitation No. - N° de l'invitation</b> EP922-172961/A	<b>Amendment No. - N° modif.</b> 011
<b>Client Reference No. - N° de référence du client</b> Parks EP922-172961	<b>Date</b> 2017-03-13
<b>GETS Reference No. - N° de référence de SEAG</b> PW-\$PWU-183-11007	
<b>File No. - N° de dossier</b> PWU-6-39328 (183)	<b>CCC No./N° CCC - FMS No./N° VME</b>
<b>Solicitation Closes - L'invitation prend fin</b> <b>at - à 02:00 PM</b> <b>on - le 2017-03-16</b>	
<b>Time Zone</b> Fuseau horaire Mountain Daylight Saving Time MDT	
<b>F.O.B. - F.A.B.</b> <b>Plant-Usine:</b> <input type="checkbox"/> <b>Destination:</b> <input type="checkbox"/> <b>Other-Autre:</b> <input type="checkbox"/>	
<b>Address Enquiries to: - Adresser toutes questions à:</b> Tikhonovitch (RPC), Alex	<b>Buyer Id - Id de l'acheteur</b> pwu183
<b>Telephone No. - N° de téléphone</b> (780) 901-7940 ( )	<b>FAX No. - N° de FAX</b> (780) 497-3510
<b>Destination - of Goods, Services, and Construction:</b> <b>Destination - des biens, services et construction:</b>	


Instructions: See Herein

Instructions: Voir aux présentes

<b>Delivery Required - Livraison exigée</b>	<b>Delivery Offered - Livraison proposée</b>
<b>Vendor/Firm Name and Address</b> <b>Raison sociale et adresse du fournisseur/de l'entrepreneur</b>	
<b>Telephone No. - N° de téléphone</b> <b>Facsimile No. - N° de télécopieur</b>	
<b>Name and title of person authorized to sign on behalf of Vendor/Firm</b> <b>(type or print)</b> <b>Nom et titre de la personne autorisée à signer au nom du fournisseur/</b> <b>de l'entrepreneur (taper ou écrire en caractères d'imprimerie)</b>	
<b>Signature</b>	<b>Date</b>

Sinclair Canyon Electrical Upgrade and Site Rehabilitation, BC  
The following outlines responses to requests for information:

#	Question	Response	Date
24	With reference to the attached two page scan of the Project Documents, please clarify the relative responsibilities between the Contractor and the Departmental Representative.	An addenda will be issued to clarify the revisions to specifications 01 45 00 Quality Control and Cast In Place Concrete. Associated costs shall be borne by the contractor.	2017-Mar-13
25	Relative to the metal railing, is it the intention of the Project Specifications to require all the x-ray testing and P.Eng involvement?	There is no requirement for x-ray testing throughout the metal railing.	2017-Mar-13
26	With respect to concrete formwork, is it the intention of the Project Specifications to require all the formwork such as C & G and sidewalk formwork to be designed and inspected by a P.Eng?	The formwork for the curb and gutter installation does not need to be designed or inspected by a P.Eng. The contractor shall arrange for a pre pour inspection by the Department's representative.	2017-Mar-13
27	In the Project Documents there is a requirement for crack sealing, is there any requirement for this work relative to the joint created between replacement & existing asphalt pavement and where the C&G meets the asphalt pavement?	Joint sealer shall be used to seal the joint created between the replacement & existing asphalt pavement.	2017-Mar-13
28	Addendum #4 mentions the requirement to remediate deep utilities, where is this work identified?	The deep utilities scope of work is as identified on the civil drawing package labelled as "C" series. Work included pertains to Catch basin remediation and associated works. Refer to drawings and spec.	2017-Mar-13
29	Question # 20 is confusing, please explain "Widen the section of road"?	Contractor is to remove 0.5m of the existing road from lip of gutter. The initial measurement of the removal was 0.3m from lip of gutter. Please see the attached detail outlining the curb and gutter replacement for further clarification.	2017-Mar-13

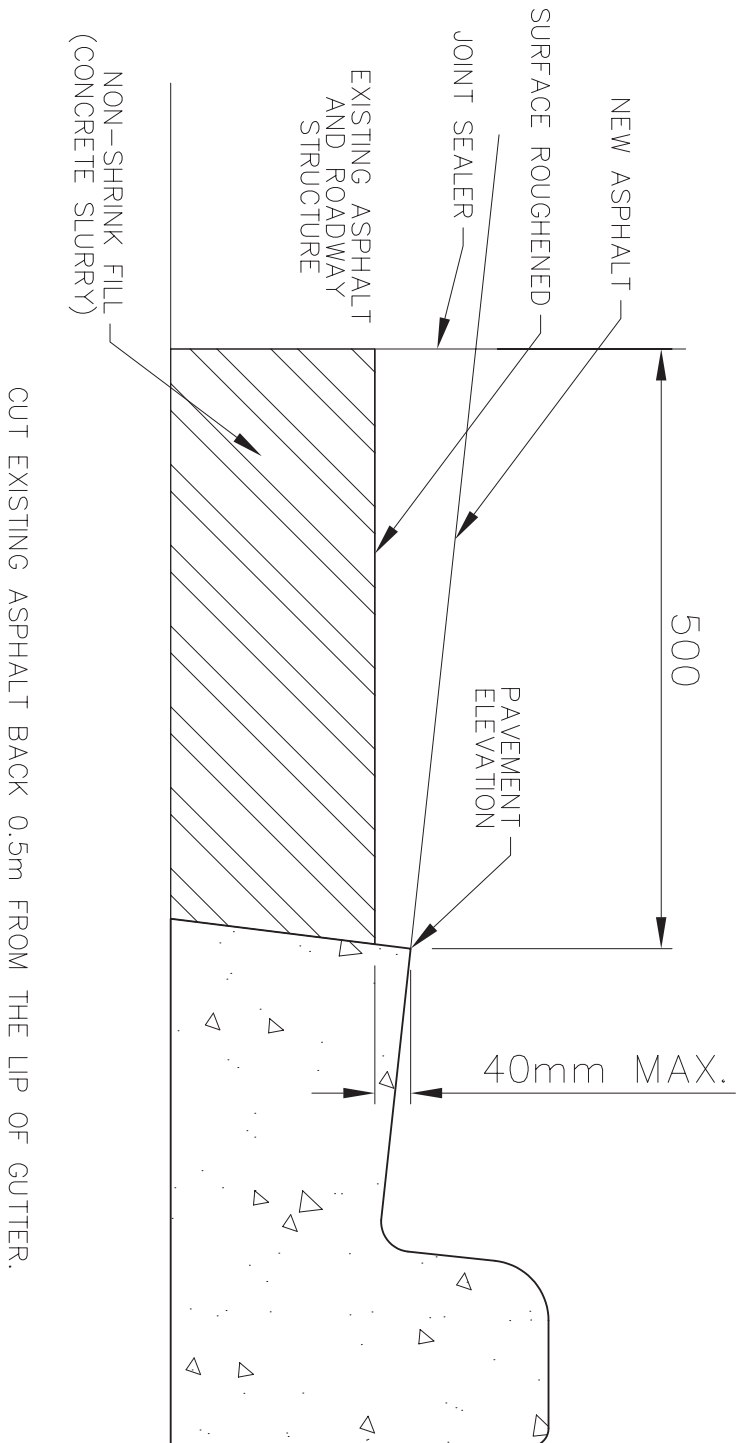

ORIGINAL SHEET - LETTER

MARCH, 2017



200 - 325 25th Street SE  
Calgary, AB T2A 7H8  
www.stantec.com

Client/Project

PUBLIC WORKS AND GOVERNMENT SERVICES CANADA  
SINCLAIR CANYON  
SITE REHABILITATION

Figure No.

2.0

Title

CONCRETE CURB & GUTTER  
REPLACEMENT DETAIL

(page 1 of 01 45 00- quality control)

## **1.2 INDEPENDENT INSPECTION AGENCIES**

- .1 Independent Inspection/Testing Agencies will be engaged by Departmental Representative for purpose of inspecting and/or testing portions of Work. Cost of such services will be borne by Departmental Representative.
- .2 Provide equipment required for executing inspection and testing by appointed agencies.
- .3 Employment of inspection/testing agencies does not relax responsibility to perform Work in accordance with Contract Documents.
- .4 If defects are revealed during inspection and/or testing, appointed agency will request additional inspection and/or testing to ascertain full degree of defect. Correct defect and irregularities as advised by Departmental Representative. Departmental Representative Pay costs for retesting and re-inspection.

(page 13 of cast in place concrete- references 01 45 00 quality control in concrete specs)

## **3.4 FIELD QUALITY CONTROL**

- .1 Site tests: conduct tests as follows in accordance with Section 01 45 00 - Quality Control and submit report as described in PART 1 - ACTION AND INFORMATIONAL SUBMITTALS.
  - .1 Concrete pours.
  - .2 Slump.
  - .3 Air content.
  - .4 Compressive strength at 7 and 56 days for Class S-3 concrete and 7 and 28 days for Class C-2 concrete.
  - .5 Air and concrete temperature.
- .2 Inspection and testing of concrete and concrete materials will be carried out by testing laboratory designated by Departmental Representative for review to CSA A23.1/A23.2.
  - .1 Ensure testing laboratory is certified to CSA A283.
- .3 Ensure test results are distributed for discussion at pre-pouring concrete meeting between testing laboratory and Departmental Representative.
- .4 Departmental Representative will pay for costs of tests as specified in Section 01 29 83 Payment Procedures for Testing Laboratory Services.

(page 4 of cast in place concrete)

**1.10 INSPECTION AND TESTING OF CONCRETE**

- .1 Test all concrete by a testing firm certified in accordance with CSA-A283, retained and paid for by the Contractor and approved by the Departmental Representative.