


LEGEND


--- EXISTING DUCTWORK TO BE REMOVED	--- EXISTING DUCTWORK TO REMAIN
--- NEW DUCTWORK	
☒ SUPPLY DIFFUSER TO BE REMOVED	☒ SUPPLY DIFFUSER TO REMAIN
☒ NEW SUPPLY DIFFUSER	
☒ RETURN GRILLE TO BE REMOVED	☒ RETURN GRILLE TO REMAIN
☒ NEW RETURN GRILLE	
☒ EXISTING COOLING TSTAT TO BE REMOVED	☒ EXISTING TSTAT TO BE REMOVED
☒ EXISTING TSTAT TO REMAIN	
☒ NEW LOW VOLTAGE ZONE CONTROLLER	
☒ NEW LOW VOLTAGE PRINCIPAL CONTROLLER	
☒ IMD INTELLIGENT MOTORIZED DISC DAMPER	
☒ TYPE OF GRILLE OR DIFFUSER (S - EXISTING SUPPLY) (R - EXISTING RETURN)	
200#	200-A
100	100
	AIR FLOW (L/S)

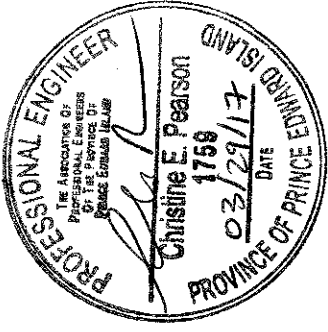

revisions  
project  
date  
project  
ARDGOWAN NATIONAL  
HISTORIC SITE  
HVAC UPGRADE  
CHARLOTTETOWN, PE  
QUEENS CO., PE

drawing  
description  
SECOND FLOOR PLAN  
EXISTING VENTILATION

designed CP	conçu
date	MARCH 29, 2017
drawn	SM
date	MARCH 29, 2017
approved CP	approuvé
date	MARCH 29, 2017
Tender	Submission
Project Manager	Administrateur de projets
Project number	no. du projet
R.080258.002	
drawing no.	no. du dessin
H3 of 7	

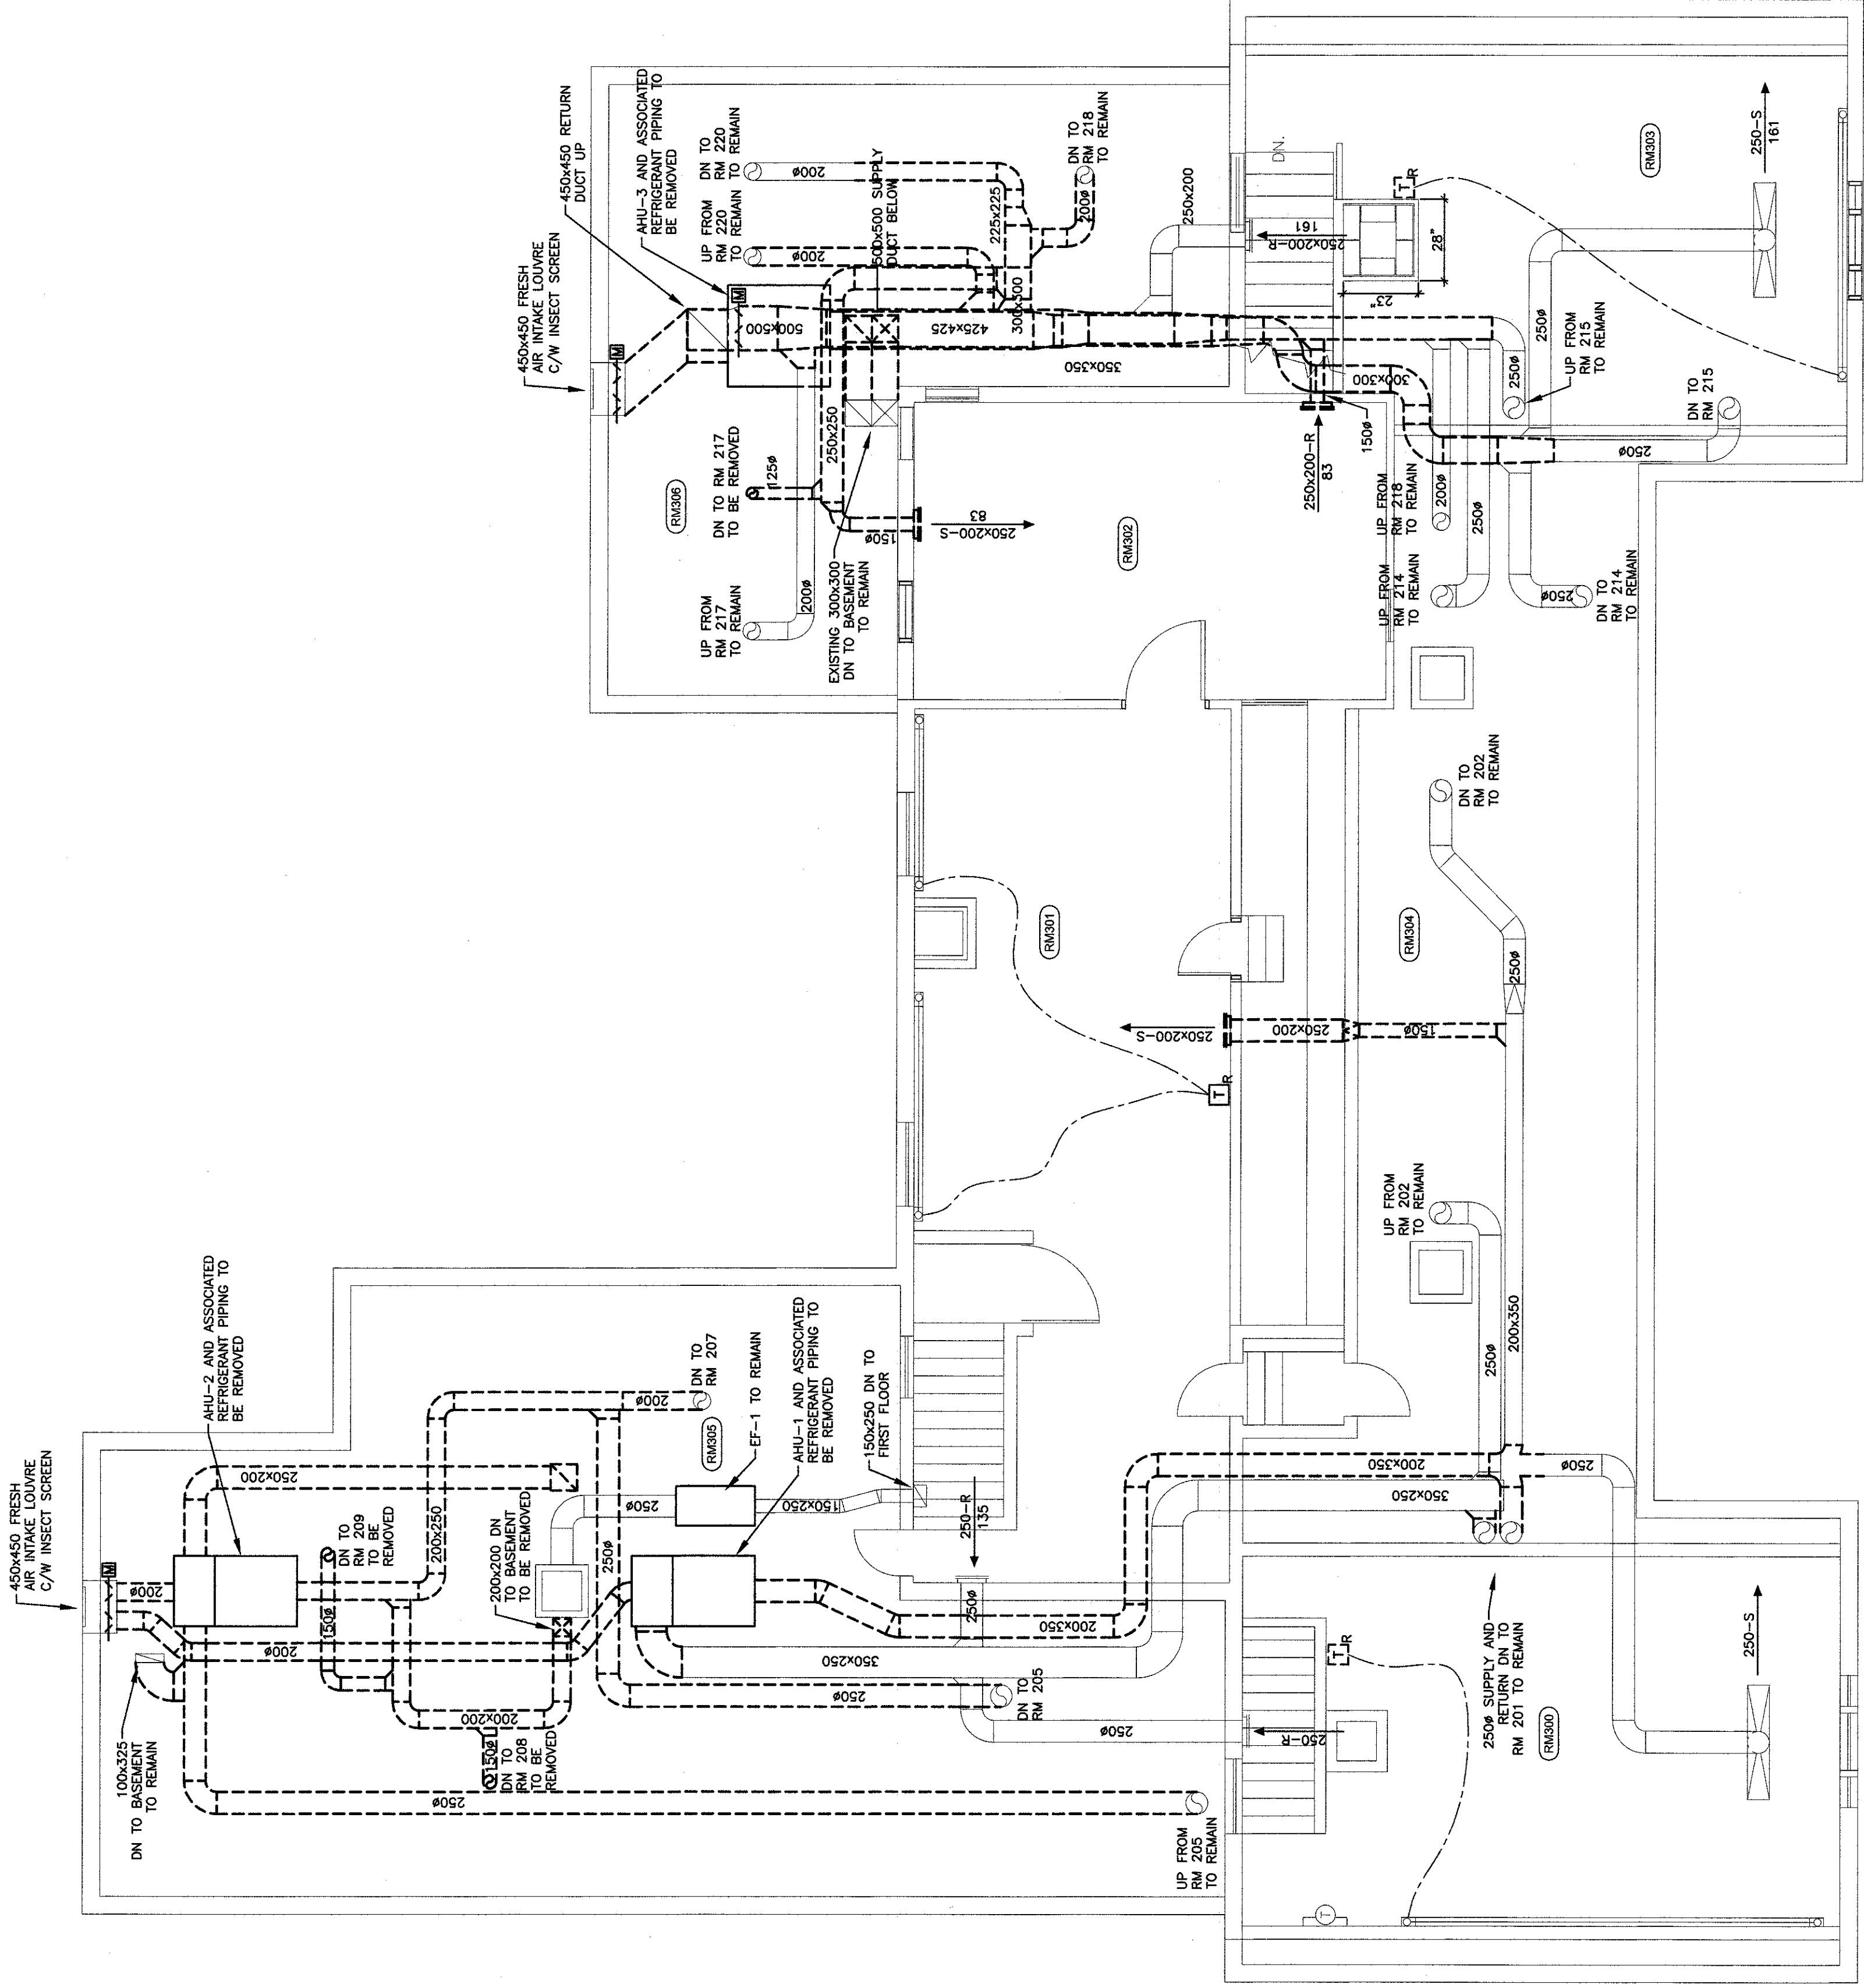

SECOND FLOOR EXISTING VENTILATION  
1  
H3/H3

SCALE: 1:50

0m 1m 2m 3m 4m 5m