


0	ISSUED FOR CONSTRUCTION	2017-04-24
Revision	Description	Date
Client	client	

PUBLIC WORK AND GOVERNMENT SERVICES CANADA

Project title
CRA WINNIPEG TAX-CENTRE FIT-UP
WINNIPEG, MANITOBA

Designed by
SV Conçu par
 Drawn by
SV Dessiné par
 Approved by
MP Approuvé par
 PWGSC Project Manager / Administrateur de Projets TPSGC
Jason Frezza
 Drawing Title / Titre du dessin
SECOND FLOOR - FIT UP AREA AND TRAINING RM #5 - POWER PLAN - DEMO

Project no./No. du projet R.078618	Drawing no./No. du dessin E2.6	Revision no. 8 OF 10
--	--	-------------------------

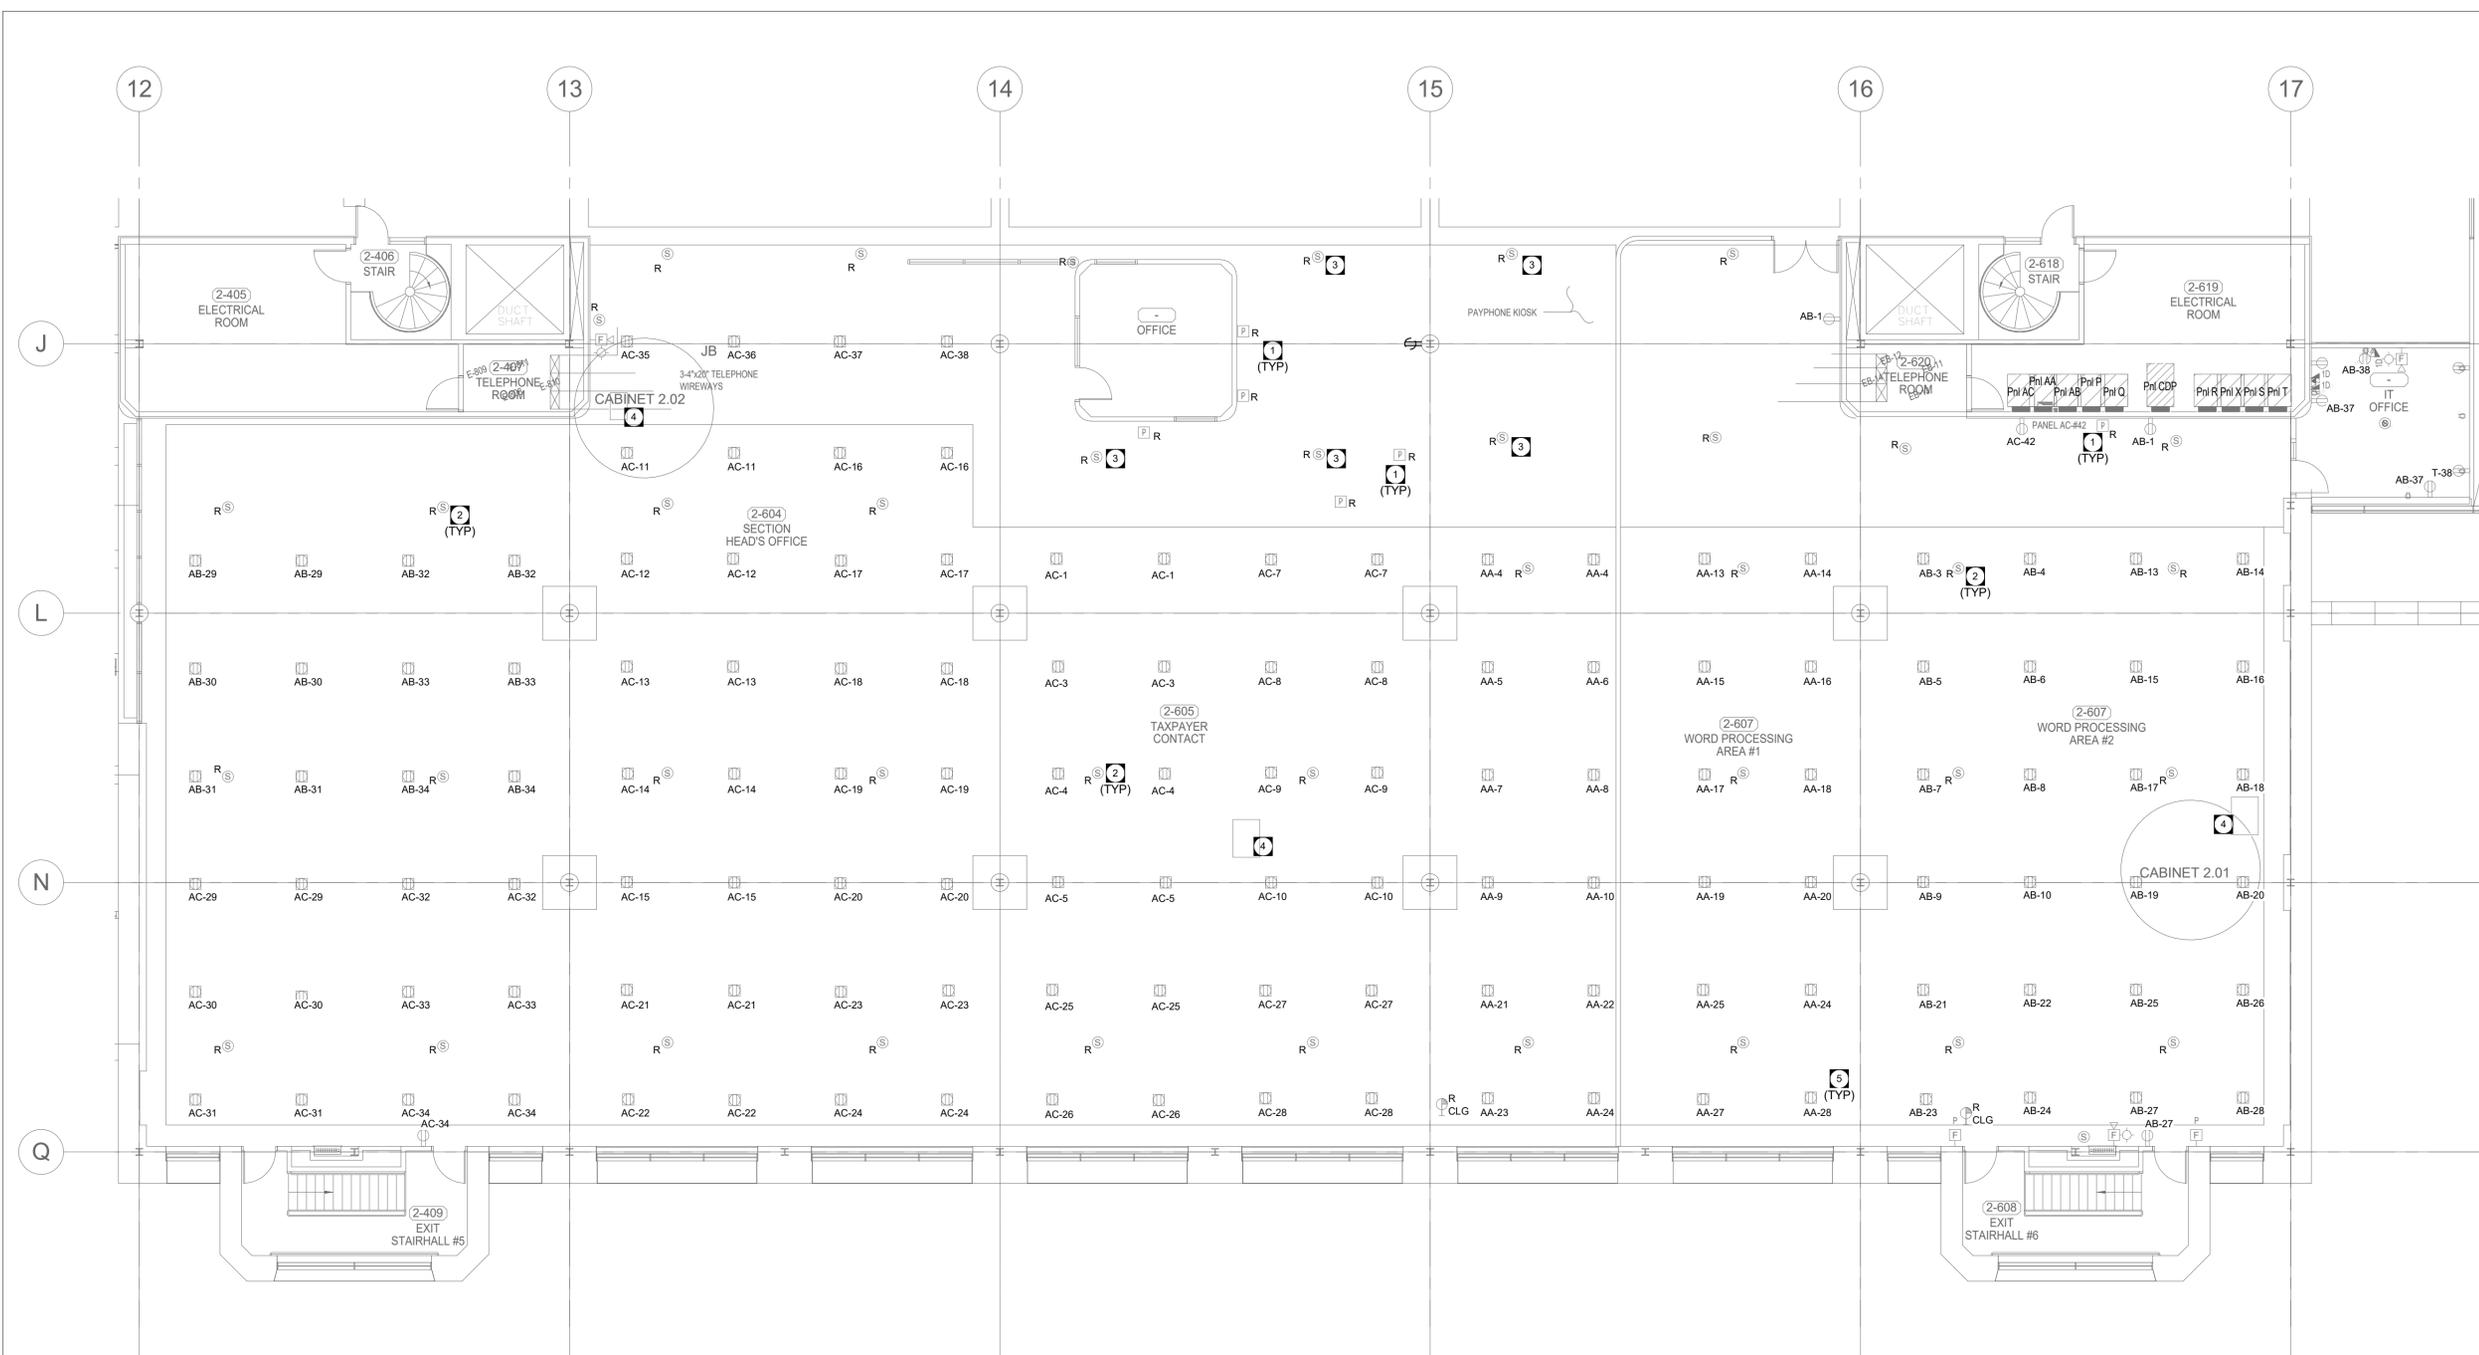

1 TRAINING ROOM 207 & FIT-UP AREA POWER/SYSTEMS DEMOLITION PLAN
E2.6 SCALE: 1 : 100

GENERAL NOTES

- COORDINATE ALL WORK REQUIRING SHUT-DOWN OF EXISTING SYSTEMS THAT COULD AFFECT EXISTING TENANTS WITH THE BUILDING OWNER AT A TIME AND MANNER SUITABLE TO THEM.
- REUSE EXISTING CIRCUITS FOR RELOCATED OR REMOVED POWER LOADS WITHIN THE SPACE. PROVIDE NEW BREAKERS AS REQUIRED. PROVIDE TYPEWRITTEN PANEL DIRECTORIES INDICATING UPDATED CIRCUITING.
- REMOVE ALL EXISTING DATA/VOICE CABLING. WIRING THROUGH CONCEALED SPACES SHALL BE CUT AND LEFT TO BE USED AS PULLCORD FOR NEW COMMUNICATION WIRING. ALL DATA RACKS, CABLING, INSTALLATION AND TERMINATION BY SSC (NIC). ELECTRICAL CONTRACTOR SHALL PROVIDE ALL PATHWAY AND ROUGH-IN REQUIRED FOR COMMUNICATION OUTLETS. COMMUNICATIONS OUTLETS SHOWN FOR COORDINATION ONLY. ALL DATA RACKS, CABLING AND TERMINATION BY SSC (NIC). ELECTRICAL CONTRACTOR SHALL PROVIDE ALL PATHWAY AND ROUGH-IN REQUIRED FOR COMMUNICATION OUTLETS.
- CONTRACTOR SHALL REMOVE ALL EXISTING ABANDONED WIRING IN CEILING SPACE BACK TO SOURCE. SECURE ALL EXISTING UN-SUPPORTED WIRING, CONDUIT AND JUNCTION BOXES TO MEET MINIMUM CODE REQUIREMENTS.
- DISCONNECT AND RECONNECT PA SPEAKERS TO ACCOMMODATE CEILING REPLACEMENT.
- ALL DEVICES INDICATED WITH 'R' SHALL BE RELOCATED. INCLUDE THE COMPLETE RELOCATION OF THE EXISTING ITEM IDENTIFIED IN ITS CURRENT LOCATION ON THE DEMOLITION DRAWINGS, TO THE NEW LOCATION AS INDICATED ON THE RENOVATION DRAWINGS. INCLUDE ALL LABOUR AND MATERIALS TO REROUTE/EXTEND/REFEED THE EXISTING CIRCUITRY AS REQUIRED TO ACCOMMODATE THE RELOCATION.

KEY NOTES

- RELOCATE POWER POLE TO SUIT NEW LAYOUT. REFER TO RENOVATION DRAWING FOR NEW LOCATIONS.
- RELOCATE PA SPEAKERS TO SUIT NEW CEILING LAYOUT. COORDINATE EXACT LOCATION ON SITE.
- RELOCATE PA SPEAKERS OUTSIDE OF NEW TRAINING ROOMS AND OFFICES. CONTRACTOR SHALL MODIFY LINEAR METAL CEILING AS REQUIRED TO ACCOMMODATE RELOCATION.
- EXISTING DATA RACK TO REMAIN.
- EXISTING QUADPLEX RECEPTACLES MOUNTED TO THE UNDERSIDE OF ACCESS FLOOR SHALL REMAIN. EXISTING POWER EXTENSION CORDS SHALL BE RE-USED. ELECTRICAL CONTRACTOR SHALL REMOVE, STORE AND RE-INSTALL ALL POWER EXTENSION CORDS TO SUIT NEW LAYOUT.

