



Epp Siepman Engineering Inc.

No. 4035




GENERAL NOTES


- A. COORDINATE ALL WORK REQUIRING SHUT-DOWN OF EXISTING SYSTEMS THAT COULD AFFECT EXISTING TENANTS WITH THE BUILDING OWNER AT A TIME AND MANNER SUITABLE TO THEM.
- B. CONTRACTOR SHALL DEMOLISH ALL EXISTING LIGHT FIXTURES AND LIGHTING CONTROLS IN RENOVATION AREA COMPLETE WITH WIRING BACK TO SOURCE. REUSE EXISTING 347V CIRCUITS FOR NEW LIGHTING FIXTURES WITHIN THE SPACE. PROVIDE TYPED WRITTEN PANEL DIRECTORIES INDICATING UPDATED CIRCUITING. TURN ALL LIGHTING COMPONENTS OVER TO BUILDING OWNER.
- C. PROVIDE NEW 610MM X1200MM (2'X4') VOLUMETRIC RECESSED LED TROFFER. 347V, 4000LM, 32CRI, 3600K. LIGHT FIXTURE SHALL BE COMPATIBLE WITH DIGITALLY ADDRESSABLE LIGHTING CONTROL SYSTEM. LIGHT FIXTURE SHALL BE RATED TO ALLOW ACOUSTIC BLANKET. CIRCUITING INDICATED IS REPRESENTATIONAL ONLY.
- D. PROVIDE NEW DIGITALLY ADDRESSABLE LIGHTING CONTROL SYSTEM COMPLETE WITH DIMMERS, OCCUPANCY SENSORS, DAYLIGHT SENSORS AS INDICATED & 347V POWER/RELAY PACKS & NETWORK BRIDGE AS REQUIRED. PROVIDE LIGHTING CONTROL GATEWAY & CONTROL IN COMMISSIONAIRS OFFICE (INDICATED IN SITE PLAN) FOR COMPLETE CONTROL OF ALL NEW LIGHT SYSTEM. REFER TO DRAWING E2.8 FOR WIRING DETAIL.
- E. COMMUNICATIONS OUTLETS SHOWN FOR COORDINATION ONLY. ALL DATA RACKS, CABLING AND TERMINATION BY SSC (NIC). ELECTRICAL CONTRACTOR SHALL PROVIDE ALL PATHWAY AND ROUGH-IN REQUIRED FOR COMMUNICATION OUTLETS.
- F. CONTRACTOR SHALL REMOVE ALL EXISTING ABANDONED WIRING IN CEILING SPACE BACK TO SOURCE. SECURE ALL EXISTING UN-SUPPORTED WIRING, CONDUIT AND JUNCTION BOXES TO MEET MINIMUM CODE REQUIREMENTS.
- G. DEMOLISH ALL EXISTING LIGHT FIXTURES COMPLETE WITH EXISTING LIGHT CONTROL SWITCHES IN THE RENOVATION AREA COMPLETE WITH WIRING AND CONDUIT BACK TO SOURCE UNLESS OTHERWISE INDICATED.

KEY NOTES


- 1. PROVIDE ONE (1) (120V / 15A) QUADPLEX RECEPTACLE ON DEDICATED CIRCUIT ABOVE CEILING TILES AT THE LOCATION OF CEILING MOUNTED PROJECTOR. WIRE AND CONNECT MOTORIZED SCREEN COMPLETE WITH SAME CIRCUITING USED FOR QUADPLEX RECEPTACLE. PROJECTOR AND MOTORIZED SCREEN PROVIDED AND INSTALLED BY AV CONTRACTOR (NIC). COORDINATE EXACT LOCATION WITH DEPARTMENTAL REPRESENTATIVE ON SITE.
- 2. PROVIDE TWO (2) (120V / 15A) DEDICATED CIRCUIT RECEPTACLE INSTALLED WITHIN OVERFLOOR RACEWAY BOX. OVERFLOOR RACEWAY PROVIDED AND INSTALLED BY AV CONTRACTOR (NIC). COORDINATE EXACT LOCATION WITH DEPARTMENTAL REPRESENTATIVE ON SITE.
- 3. PROVIDE TWO (2) 27MM CONDUIT FROM THE WALL AND UP IN THE CEILING SPACE ABOVE T-BAR GRID. CONDUITS SHALL TERMINATE AT THE OVERFLOOR RACEWAY WALL TRANSITION BOX AT FLOOR AND SHALL BE OPEN WITH CONNECTOR AND BUSHING ABOVE T-BAR CEILING SPACE. COORDINATE EXACT LOCATION WITH DEPARTMENTAL REPRESENTATIVE ON SITE.
- 4. PROVIDE QUADPLEX RECEPTACLE AND DATA OUTLET UNDER RAISED ACCESS FLOOR. RECEPTACLE AND DATA OUTLET SHALL BE MOUNTED TO FLOOR UNDERNEATH.
- 5. PROVIDE NETWORKED SYSTEM WALL DIMMER SWITCH. DIMMER SWITCH SHALL HAVE ON/OFF & RAISE/LOWER DIMMING FUNCTIONALITY. DIMMER SWITCH SHALL BE PART OF DIGITALLY ADDRESSABLE LIGHTING CONTROL SYSTEM AND INTEGRATED WITH THE OCCUPANCY SENSOR IN THE ROOM.
- 6. PROVIDE NETWORKED SYSTEM DUAL TECH CEILING OCCUPANCY SENSOR. OCCUPANCY SENSOR SHALL BE PART OF DIGITALLY ADDRESSABLE LIGHTING CONTROL SYSTEM. EXTENDED RANGE 360 DEGREES, REAR RJ-45 PORT. LOW VOLTAGE. THE ROOM SHALL HAVE MANUAL ON/OFF FUNCTIONALITY INTEGRATED WITH WALL DIMMER SWITCH.
- 7. LIGHT FIXTURES SHALL BE PART OF EMERGENCY LIGHTING CIRCUIT. EMERGENCY FIXTURES SHALL BE PART OF DIGITALLY ADDRESSABLE LIGHTING CONTROL SYSTEM AND SHALL BE CONTROLLED BY DIMMER SWITCH AND OCCUPANCY SENSOR IN THE ROOM. FIXTURES SHALL MONITOR CIRCUITING OF OTHER FIXTURES IN THE ROOM, SUCH THAT DURING POWER OUTAGE, EMERGENCY FIXTURES SHALL FULLY (100%) TURN ON. CIRCUITING INDICATED IS REPRESENTATIONAL ONLY. COORDINATE ON SITE LOCATION OF EMERGENCY 600V PANEL. REFER TO SITE PLAN FOR ELECTRICAL ROOM LOCATIONS.
- 8. COORDINATE LOCATION AND MOUNTING HEIGHT OF RECEPTACLE AND DATA OUTLET FOR WALL MOUNTED MONITOR WITH DEPARTMENTAL REPRESENTATIVE PRIOR TO ROUGHIN.

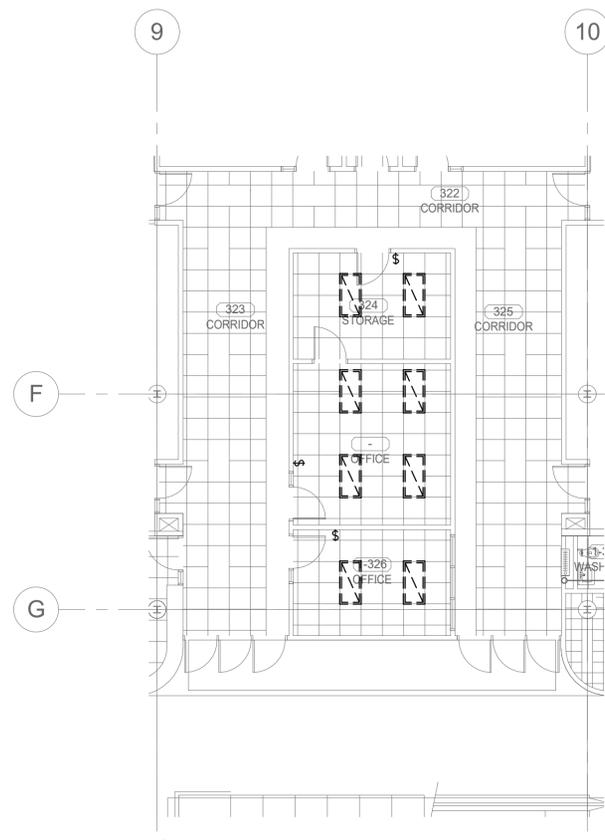


1 TRAINING ROOM 8 (324) RCP DEMOLITION PLAN
E2.1 SCALE: 1 : 100

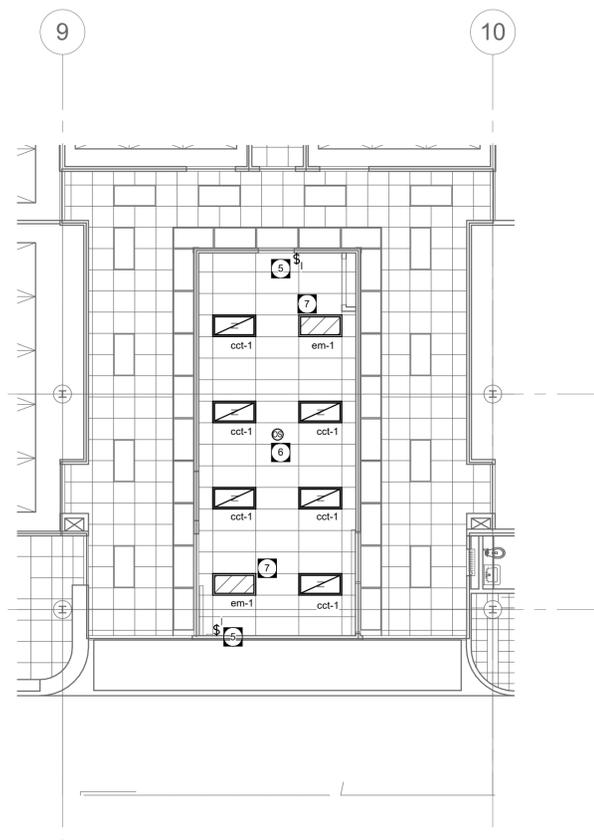

2 TRAINING ROOM 8 (324) RCP RENOVATION PLAN
E2.1 SCALE: 1 : 100

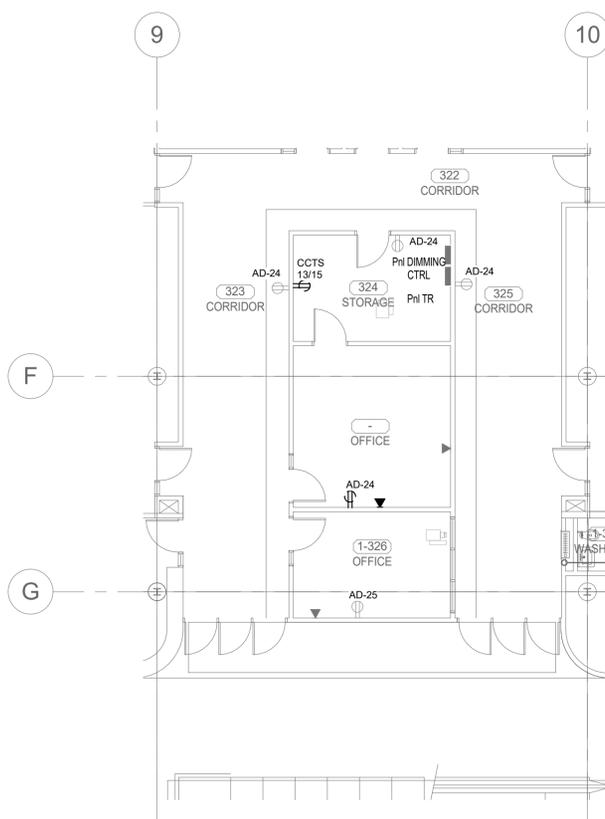

3 TRAINING ROOM 8 (324) POWER/SYSTEMS DEMOLITION PLAN
E2.1 SCALE: 1 : 100

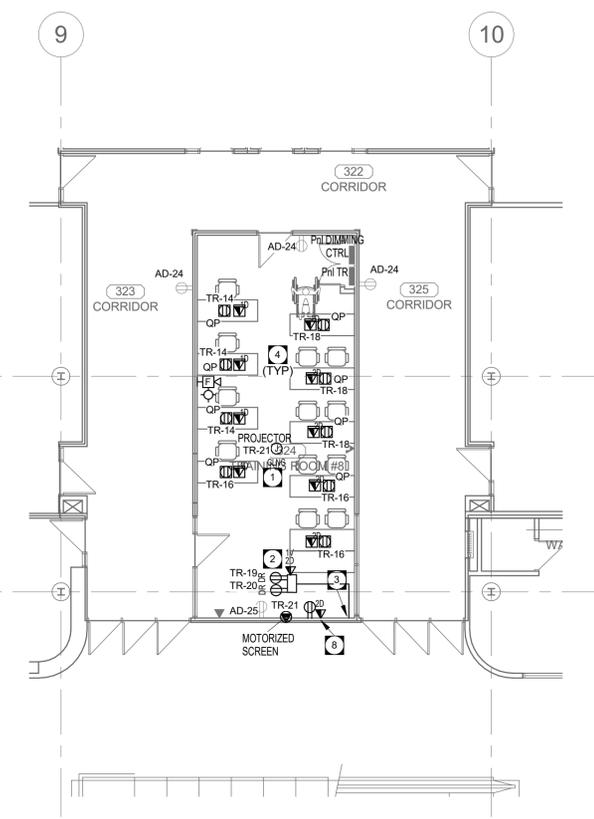

4 TRAINING ROOM 8 (324) POWER/SYSTEMS RENOVATION PLAN
E2.1 SCALE: 1 : 100

Revision	Description	Date
0	ISSUED FOR CONSTRUCTION	2017-04-24

PUBLIC WORK AND GOVERNMENT SERVICES CANADA

Project Title: **CRA WINNIPEG TAX-CENTRE FIT-UP**

WINNIPEG, MANITOBA

Designed by: **SV**
 Drawn by: **SV**
 Approved by: **MP**

PW/GSC Project Manager: **Jason Frezza**
 Administrateur de Projets TPS/GC

Drawing Title: **MAIN FLOOR - TRAINING RM #1 - LIGHTING & POWER PLAN - DEMO & RENO**

Project no./No. du projet	Drawing no./No. du dessin	Revision no.
R.078618	E2.1	3 OF 10