


1 SECOND FLOOR PARTIAL PLAN - FIRE PROTECTION - TRAINING ROOM 204
M1.2 SCALE: 1 : 100

FIRE PROTECTION GENERAL NOTES


- A. FIRE PROTECTION DRAWINGS ARE BASED ON SITE OBSERVATIONS AND ORIGINAL CONSTRUCTION DRAWINGS. RECORD DRAWINGS UNAVAILABLE TO THE CONSULTANT. CONTRACTOR TO CONFIRM EXISTING CONDITIONS WITH REQUIREMENTS OF RENOVATION PLAN. THE SPRINKLER CONTRACTOR SHALL REVISE THE EXISTING SPRINKLER SYSTEM TO SUIT THE NEW LAYOUT. SPRINKLER CONTRACTOR TO LAY OUT AND SIZE PIPING AND SUBMIT DESIGN TO THE ENGINEER FOR REVIEW AND COORDINATION.
- B. IN AREAS WITH SUSPENDED TILE CEILINGS INSTALL SPRINKLER HEADS TO SUIT TILE LOCATIONS. ALLOW FOR ADDITIONAL HEADS IF NECESSARY TO MEET THIS REQUIREMENT.
- C. THE SPRINKLER CONTRACTOR SHALL CONFIRM ON SITE THE LOCATIONS OF EXISTING STRUCTURES, EQUIPMENT, AND SYSTEMS FOR INTERFERENCE AND COORDINATION PURPOSES. INCLUDE ALL OFFSETS, ADDITIONAL LOW-POINT DRAINS, ADDITIONAL HEADS AS REQUIRED, ROUTE BRANCH LINES AS REQUIRED.
- D. THE SPRINKLER INSTALLATION SHALL COMPLY WITH THE APPLICABLE NFPA CODES AND REQUIREMENTS OF THE A.H.J. IF THERE IS A CONFLICT WITH THE PERCEIVED INTENT OF THIS DRAWING SET AND THE REQUIREMENTS OF NFPA OR THE A.H.J., NOTIFY THE ENGINEER TO RESOLVE. NO INCREASES TO THE CONTRACT WILL BE PERMITTED FOR COMPLIANCE WITH MINIMUM CODE REQUIREMENTS.
- E. FIRESTOP ALL NEW PENETRATIONS THROUGH FIRE SEPARATIONS.
- F. SPRINKLER CONTRACTOR SHALL COORDINATE LOCATIONS OF ALL SWITCHES AND VALVES REQUIRING WIRING WITH DIVISION 26.
- G. FIRE EXTINGUISHERS BY OWNER.

KEY NOTES

- 1 RECONFIGURE EXISTING SPRINKLER LAYOUT TO MATCH NEW CEILING AND LAYOUT CONFIGURATION WITH FLAT CEILING GRID, REFER TO ARCHITECTURAL FOR CHANGES. LIGHT HAZARD CLASSIFICATION. SPRINKLER HEAD LAYOUT REPRESENTATIVE OF EXISTING CONDITIONS. REPLACE EXISTING SPRINKLER HEADS WITH NEW IN ZONE HATCHED. PROVIDE PIPING AS REQUIRED TO LOCATE SPRINKLER HEADS IN CENTER OF CEILING TILE. CONTRACTOR TO PROVIDE COMPLETE COVERAGE BASED ON NFPA 13.
- 2 EXISTING CORRIDOR SPRINKLERS LOCATED AT HIGH LEVEL AT SKYLIGHTS. SPRINKLERS TO PROTECT EXISTING CEILING REMAINING OUTSIDE NEW TRAINING ROOM 204. REFER TO ARCHITECTURAL DETAIL.
- 3 NEW SPRINKLER HEAD IN EXISTING LINEAR METAL CEILING

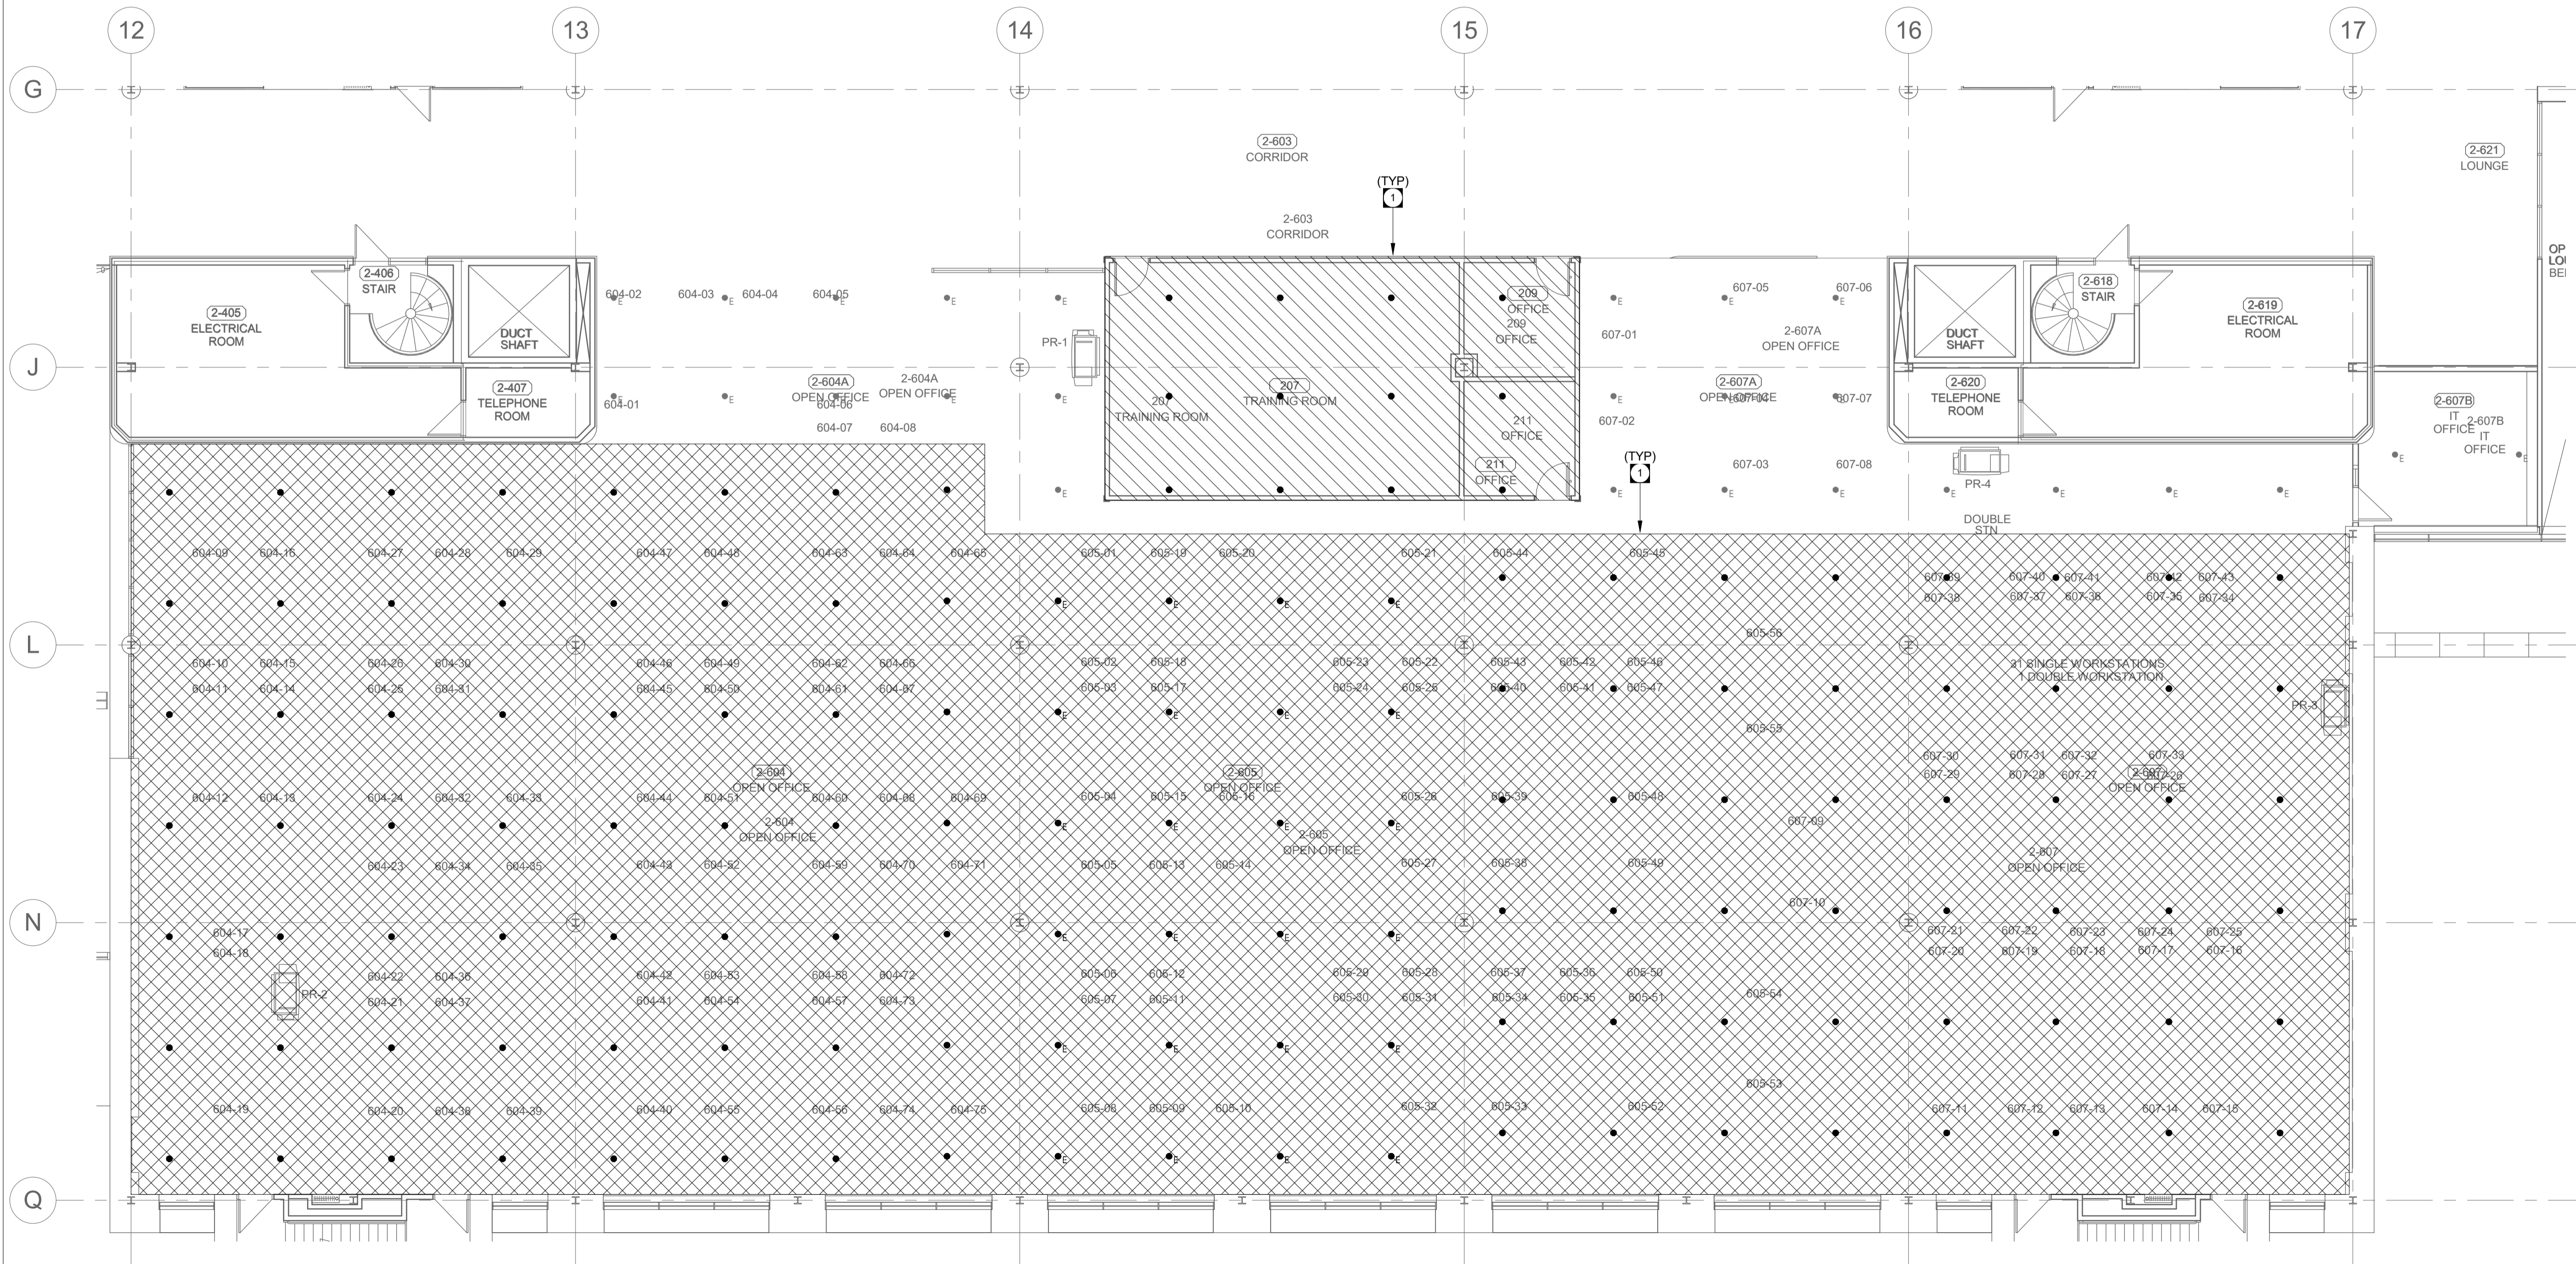


2 SECOND FLOOR PARTIAL PLAN - FIRE PROTECTION - TRAINING ROOM 207 AND FIT UP AREA
M1.2 SCALE: 1 : 100



Puublic Works and
Government Services
Canada


Travaux publics et
Services gouvernementaux
Canada

REAL PROPERTY SERVICES
Western Region
SERVICES IMMOBILIERS
Région de l'ouest




epp siepman
engineering

400 - 136 Market Avenue
Winnipeg, MB R3B 0P4
T 204 453 1090



Certificate of Authorization
Epp Siepman Engineering Inc.
No. 4035



O	ISSUED FOR CONSTRUCTION	2017-04-24
Revision	Description	Date
Client		client
<div><div>PUBLIC WORK AND GOVERNMENT SERVICES CANADA</div></div>		
<div><div>Project title</div><div>CRA WINNIPEG TAX-CENTRE FIT-UP</div></div>		
<div><div>Project title</div><div>WINNIPEG, MANITOBA</div></div>		
<div><div>Designed by</div><div>DR</div><div>Conçu par</div></div>		
<div><div>Drawn by</div><div>EB</div><div>Dessiné par</div></div>		
<div><div>Approved by</div><div>DS</div><div>Approuvé par</div></div>		
<div><div>PWSSC Project Manager</div><div>Administrateur de Projets TPSSC</div><div>Jason Frezza</div></div>		
<div><div>Drawing Title</div><div>Titre du dessin</div><div>SECOND FLOOR PARTIAL PLAN - FIRE SUPPRESSION</div></div>		
<div><div>Project no./No. du projet</div><div>R.078618</div></div>	<div><div>Drawing no./No. du dessin</div><div>M1.2</div><div>OF</div></div>	<div><div>Revision no.</div></div>

A000