


Z:\1 DELTA PROJECT\2017\PROJECTS\60001-140 WABUSH ATB - DESIGN - DRAWINGS & SPECIFICATIONS - TENDER SPECIFICATIONS AND DRAWINGS\2017\60001-140 WABUSH ATB - DESIGN - DRAWINGS & SPECIFICATIONS

PWGSC B1 (2004)

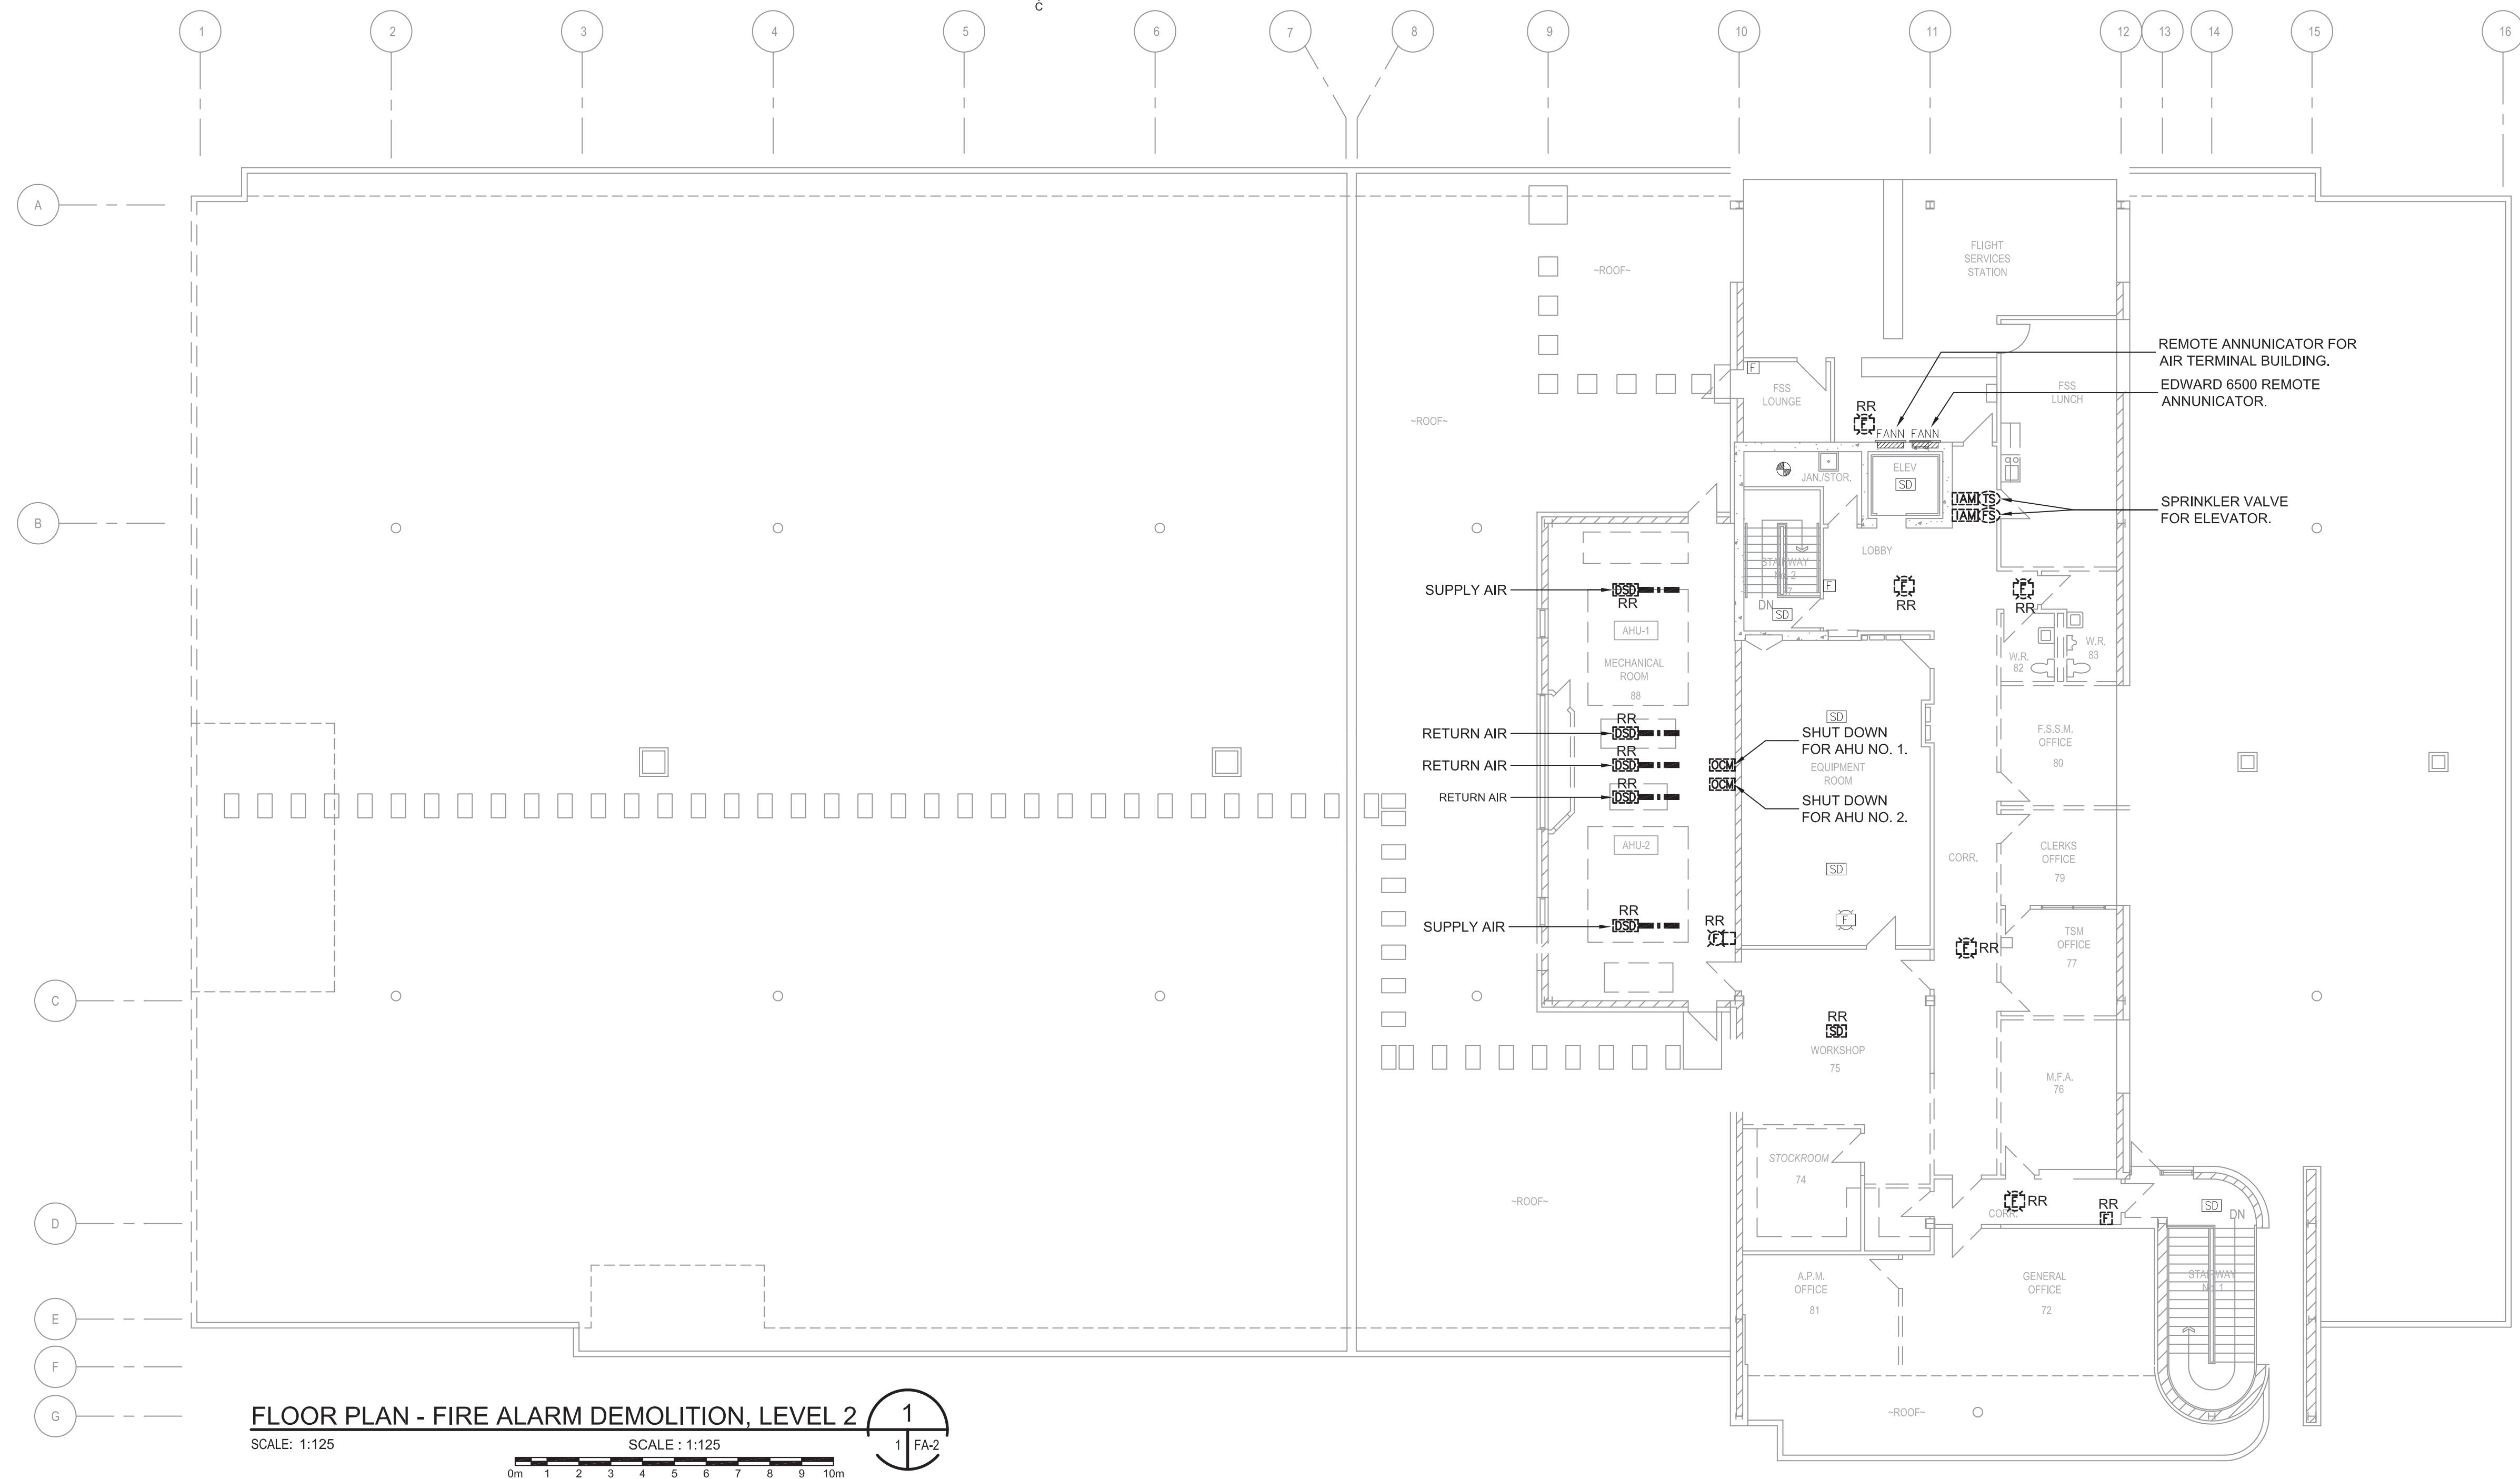

FLOOR PLAN - FIRE ALARM DEMOLITION, LEVEL 2
SCALE: 1:125
1 FA-2

FIRE ALARM SYSTEM	
SYMBOL	DESCRIPTION
	ADDRESSABLE FIRE ALARM PULL STATION
	FIRE ALARM HORN - WALL MOUNTED
	COMBINATION HORN / STROBE LIGHT - WALL MOUNTED
	COMBINATION HORN / STROBE LIGHT - CEILING MOUNTED
	HORN - CEILING MOUNTED
	ADDRESSABLE TRUE ALARM PHOTO-ELECTRIC SMOKE DETECTOR
	ADDRESSABLE PROGRAMMABLE HEAT DETECTOR
	ADDRESSABLE OUTPUT CONTROL MODULE
	ADDRESSABLE DUCT MOUNTED SMOKE DETECTOR
	FIRE ALARM ANNUNCIATOR
	ADDRESSABLE MODULE
	TAMPER SWITCH
	FLOW SWITCH
	LOW PRESSURE ALARM
	LOW PRESSURE SWITCH
N	SYMBOLS WITH SUFFIX 'N' INDICATES EXISTING EQUIPMENT OR OUTLETS REMOVED & RE-INSTALLED IN NEW LOCATIONS
RR	SYMBOLS WITH SUFFIX 'RR' INDICATES EXISTING EQUIPMENT OR OUTLETS TO BE REMOVED & RELOCATED IN NEW LOCATIONS
—	EXCEPT AS NOTED OTHERWISE, ALL EXISTING EQUIPMENT TO REMAIN IS SHOWN IN THIN SOLID LINES.
---	EXCEPT AS NOTED OTHERWISE, ALL EXISTING EQUIPMENT TO BE DEMOLISHED OR RELOCATED IS SHOWN IN THICK DASHED LINES. RELOCATED ITEMS ARE WITH SUFFIX 'RR' OR 'N'
—	EXCEPT AS NOTED OTHERWISE, ALL NEW EQUIPMENT IS SHOWN IN THICK SOLID LINES.

GENERAL NOTES	
A.	CO-ORDINATE DEMOLITION WORK WITH ARCHITECTURAL PHASING NOT SHOWN ON THIS DRAWING. REFER TO ARCHITECTURAL DRAWINGS FOR DETAILS.
B.	FIRE ALARM WORK IN SPECIFIC CONSTRUCTION ZONE SHOULD NOT IMPACT REMAINING PORTION OF THE FIRE ALARM SYSTEM IN THE FACILITY. PROVIDE TEMPORARY BY-PASSES AS REQUIRED.
C.	FIRE ALARM SYSTEM MUST BE FULLY OPERATIONAL AT THE END OF THE END OF EACH WORKING DAY.

Public Works and Government Services Canada

Travaux Publics et Services gouvernementaux Canada

PROVINCE OF NEWFOUNDLAND AND LABRADOR

PERMIT HOLDER
CLASS "A"
This Permit Allows
WSP CANADA INC.
Member in Responsible Charge
MANUSHA NAIDU, P.Eng. No. 07704
To practice Professional Engineering
in Newfoundland and Labrador
Permit No. as issued by PRONL 10079
which is valid for the year 2017.

prime consultant:

ARCHITECTURE 49

sub consultant:

0	ISSUED FOR TENDER	APR 12, 2017
revisions		date
project	WABUSH ATB RENOVATION WABUSH AIRPORT WABUSH, NL	
project		
drawing	FLOOR PLAN LEVEL 2 FIRE ALARM DEMOLITION	
design		
designed	BH	comp
date	FEB. 2017	
drawn	GG	designé
date	FEB. 2017	
approved	JH	approuvé
date	FEB. 2017	
Tender	<div>2017/05/10 Submission Administrateur de projets TPSCG</div>	
project number	R.076412.001	no. du projet
drawing no.	FA-2	no. du dessin

E-DRM/GDD-E: 540135 Version 1