



RETURN BIDS TO:
RETOURNER LES SOUMISSIONS À:
Public Works Government Services Canada- Bid
Receiving / Réception des soumissions
189 Prince William Street
Room 405
Saint John
New Brunswick
E2L 2B9
Bid Fax: (506) 636-4376

SOLICITATION AMENDMENT

MODIFICATION DE L'INVITATION

The referenced document is hereby revised; unless otherwise indicated, all other terms and conditions of the Solicitation remain the same.

Ce document est par la présente révisé; sauf indication contraire, les modalités de l'invitation demeurent les mêmes.

Comments - Commentaires

Vendor/Firm Name and Address
Raison sociale et adresse du
fournisseur/de l'entrepreneur

Issuing Office - Bureau de distribution
Public Works Government Services Canada- Bid
Receiving / Réception des soumissions
189 Prince William Street
Room 405
Saint John
New Bruns
E2L 2B9

Title - Sujet Interpretation Center-Mary's Point,	
Solicitation No. - N° de l'invitation EC015-180296/A	Amendment No. - N° modif. 002
Client Reference No. - N° de référence du client EC015-180296	Date 2017-07-06
GETS Reference No. - N° de référence de SEAG PW-\$PWB-100-4143	
File No. - N° de dossier PWB-7-40025 (100)	CCC No./N° CCC - FMS No./N° VME
Solicitation Closes - L'invitation prend fin at - à 02:00 PM on - le 2017-07-13	
Time Zone Fuseau horaire Atlantic Daylight Saving Time ADT	
F.O.B. - F.A.B. Plant-Usine: <input type="checkbox"/> Destination: <input checked="" type="checkbox"/> Other-Autre: <input type="checkbox"/>	
Address Enquiries to: - Adresser toutes questions à: MacDonald, Anne (PWB) D.	Buyer Id - Id de l'acheteur pwb100
Telephone No. - N° de téléphone (902) 626-4949 ()	FAX No. - N° de FAX (506) 636-4376
Destination - of Goods, Services, and Construction: Destination - des biens, services et construction:	

Instructions: See Herein

Instructions: Voir aux présentes

Delivery Required - Livraison exigée	Delivery Offered - Livraison proposée
Vendor/Firm Name and Address Raison sociale et adresse du fournisseur/de l'entrepreneur	
Telephone No. - N° de téléphone Facsimile No. - N° de télécopieur	
Name and title of person authorized to sign on behalf of Vendor/Firm (type or print) Nom et titre de la personne autorisée à signer au nom du fournisseur/ de l'entrepreneur (taper ou écrire en caractères d'imprimerie)	
Signature	Date

2017-07-06

THE FOLLOWING CHANGES TO THE PLANS AND SPECIFICATIONS ARE TO BE INCORPORATED AND BECOME PART OF THE CONTRACT DOCUMENTS.

NOTE:

Only products approved in the addenda will be considered as alternates.

Remarque

« En tant qu'alternatif, seul les produits approuvés dans l'addendum seront considérés. »

THE FOLLOWING CHANGES TO THE PLANS AND SPECIFICATIONS ARE TO BE INCORPORATED AND BECOME PART OF THE CONTRACT DOCUMENTS.

ARCHITECTURAL

SPECIFICATIONS

- Item 1** Specification Section 07 92 10 - Joint Sealants: Article 2.02.1.1.1 Add Pecora Dynatrol II as acceptable product.
- Item 2** Specification Section 07 92 10 - Joint Sealants: Article 2.02.2.1 Add Pecora Dynatrol I-XL as acceptable product.
- Item 3** Specification Section 07 92 10 - Joint Sealants: Article 2.02.3.1.1 Add NR-200 by Pecora as acceptable product.
- Item 4** Specification Section 08 50 00 - Windows.
Question: No colour is specified for the colour of frame?

Answer: Colours to be selected by Department Representative from manufacturer's standard colours.

CIVIL

CLARIFICATION

- Item 5** The Contractor is to verify the location of the existing foundation drain and existing septic system in the field. The existing septic system is to be modified as required by the Contractor per Addendum No. 1, Item #7 and will coordinate the location of the relocated existing foundation drain with the modifications. Existing foundation drain from existing building is to be relocated to the new alignment in a way so as not to interfere with the existing septic system after modification is completed.

MECHANICAL

SPECIFICATIONS

- Item 6** Reference Addendum No. 1: See attached (3 pages) list of approved products for Addendum No. 1, Item No. 4.

ELECTRICAL

GENERAL

Item 7 Question: Do we have model/type of baseboard heater specified for Mary's Point?

Answer: **Stalpro Series B** is recommended. Please note that some heater sizes would have to be rounded up to the next standard size depending on the exact product chosen.

ARCHITECTURAL

DRAWINGS

Item 8 Drawing A-301 - Revise detail 8 on sheet A-301 to be as per sketch ASK-01 (attached).

- END OF ADDENDUM NO. 2 -



ANCAMNA SALES LTD

Alternates

TO :	Suppliers	REFERENCE NO.	NB170623A
	Subject to Approval *	ISSUE DATE	June 23, 2017
Consultant	Stantec	QUOTED BY	Trish MacDonald
Engineer	J Paul Lapointe	PROJECT	Interpretive Centre Marys Point
CANS #	NB17-769	TEL:	506 863 4417
ATT.	Quotations	FAX.:	506 384 5111
Closes July 11,2017			
PRODUCT CODE	DESCRIPTION		
P-1 *	Zurn Z5324-PED 20"x23" ADA China Lav Wall Hung c/w semi pedestal		
*	Z81000-XL-17M Zurn single lever faucet 1.5gpm		
*	Zurn Z8700BD-PC 11/4" P Trap		
*	Zurn Z8746-PC Offset Grid P/O Strainer		
*	ZH8820-XL-LR-LK-PC-3 Zurn Lav Supplies		
P-2 *	Z5555-IN Zurn ADA High Performance 1.28 gpf Toilet, lined,		
*	Zurn Z5957SS-AM Antimicrobial Seat Open Front With/Cover		
*	Zurn ZH8820-XL-CR-LK-PC-3 Closet Supply		
P-3 *	AMI 2007AEM Novanni SS sink 31-1/8"x20-5/8"x5"deep		
*	Zurn Z7870-XL-FC 0.5 gpm Single Lever Faucet 8"cc		
*	Z8702BD-PC 11/2" P Trap		
*	ZH8820-XL-LR-LK-PC-3 Zurn Lav Supplies		
P-4 *	1105 Haws 18 Ga. SS Wall Mount Fountain		
*	Zurn Z8700BD-PC 11/4" P Trap		
P-5 *	Z1996-24 Zurn Mop Service Basin		
*	Zurn Z843M1-RC Faucet Wall Mount Rough Chrome		

Zurn Quote page 1


NOTE ALL MFG TERMS AND CONDITIONS APPLY

PRODUCT CODE	DESCRIPTION		
*	MH	Mop Hanger	
*	WG	Wall Guard	
*	SDL	3" Stainless Steel Drain c/w dome strainer	
*	HH	Hose and Hose Bracket	
*	BS	Stainless Steel Bumper Guard	
DHW ET *	ST-20VC	ASME 8.0 gal. 3.2 acceptance Amtrol DHW Expansion Tank	
WT *	WX-350	Well X Trol 119 gallon Well Tank	
Vacuum Breakers *	35	1/2" Atmospheric Vacuum Breaker	
*	35	3/4" Atmospheric Vacuum Breaker	
PRV *	600XL	Wilkins Water Pressure Reducing Valve 1/2"	
*	600XL	Wilkins Water Pressure Reducing Valve 3/4"	
*	600XL	Wilkins Water Pressure Reducing Valve 1"	
*	600XL	Wilkins Water Pressure Reducing Valve 1-1/4"	
*	600XL	Wilkins Water Pressure Reducing Valve 1-1/2"	
*	600XL	Wilkins Water Pressure Reducing Valve 2"	
Strainers *	SXL	1/2" Bronze threaded Strainer	
*	SXL	3/4" Bronze threaded Strainer	
*	SXL	1" Bronze threaded Strainer	
PRODUCT CODE	DESCRIPTION		
*	SXL	1-1/4" Bronze threaded Strainer	
*	SXL	1-1/2" Bronze threaded Strainer	
*	SXL	2" Bronze threaded Strainer	
Std Access Doors	UF-5000	Universal Flush Mount 6"x6" Access Door	
	UF-5000	Universal Flush Mount 8"x8" Access Door	

Zurn Quote page 2

NOTE ALL MFG TERMS AND CONDITIONS APPLY

	UF-5000	Universal Flush Mount 12"x12" Access Door	
	UF-5000	Universal Flush Mount 18"x18" Access Door	
	UF-5000	Universal Flush Mount 24"x24" Access Door	
	Cylinder Lock & key,	all keyed alike	
Std Access Doors Stainless	Acudor Flush Universal Access Doors (STAINLESS)		
	UF-5000-SS	Universal Flush Mount 6"x6" Access Door	
	UF-5000-SS	Universal Flush Mount 8"x8" Access Door	
	UF-5000-SS	Universal Flush Mount 12"x12" Access Door	
	UF-5000-SS	Universal Flush Mount 18"x18" Access Door	
	UF-5000-SS	Universal Flush Mount 24"x24" Access Door	
	Cylinder Lock & key,	all keyed alike	

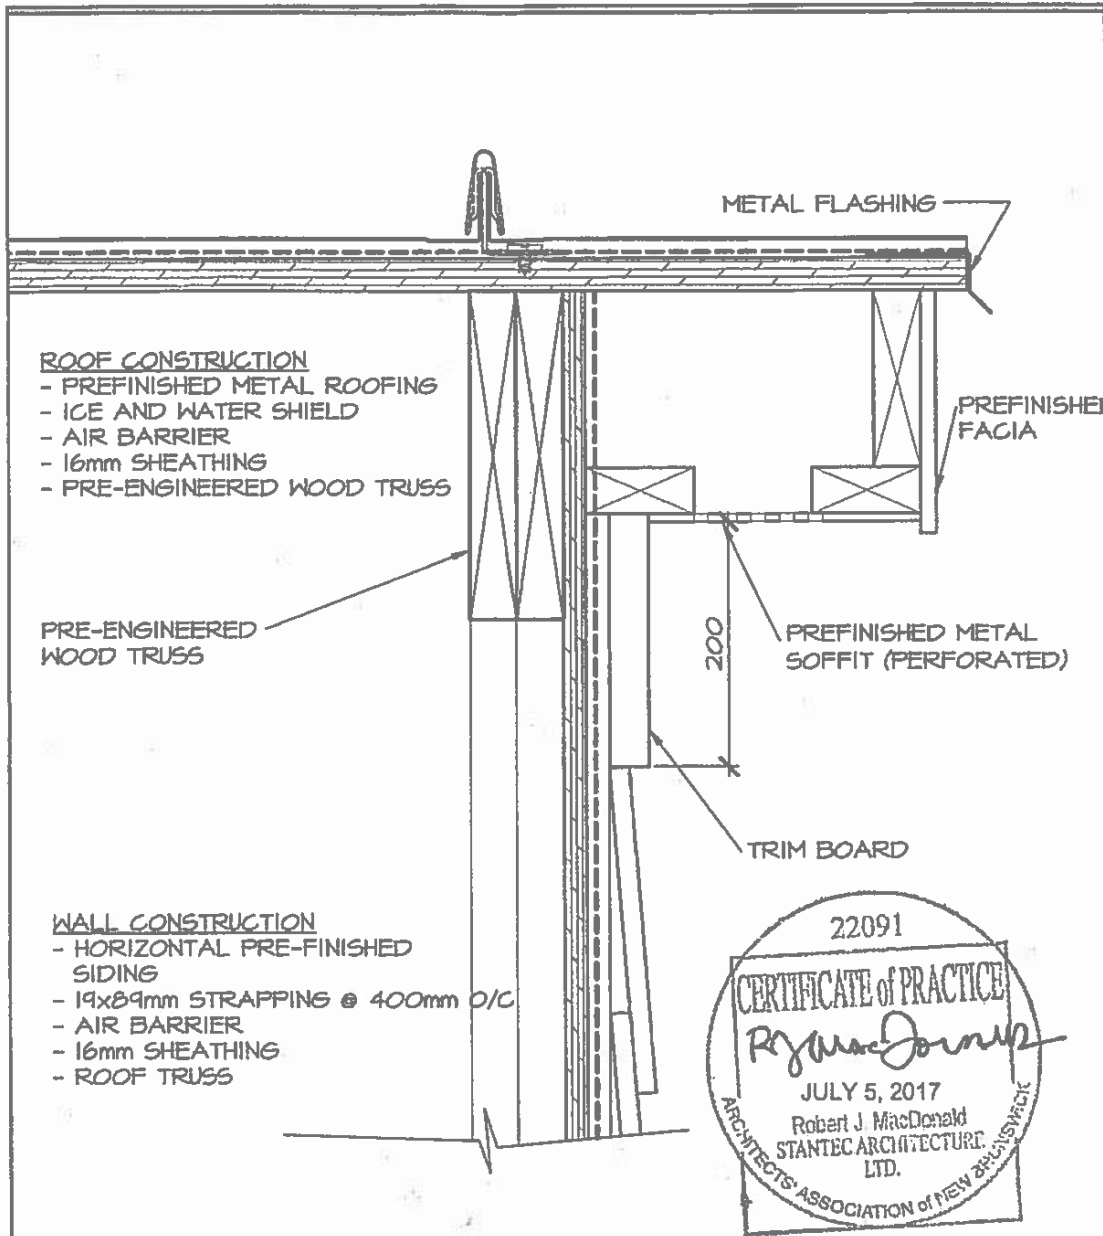

8
A301A301

EAVE SECTION (TYPICAL)

SCALE: 1:5



Public Works and Government Services Canada Travaux publics et Services gouvernementaux Canada	Drawing title REVISED EAVE SECTION	Title du dessin	designed RJM	conçu RJM	date JULY 2017
			drawn HGA	dessiné HGA	date JULY 2017
project INTERPRETIVE CENTER MARY'S POINT, NB	project number R.076495.001	no. du projet R.076495.001	drawing no. ASK-1	approved approved	date date
Tender PWGSC Project Manager		Soimission Administrateur de projets TPSGC			