



RETURN BIDS TO:

RETOURNER LES SOUMISSIONS À:

Public Works and Government Services Canada
ATB Place North Tower
10025 Jasper Ave./10025 ave. Jasper
5th floor/5e étage
Edmonton
Alberta
T5J 1S6
Bid Fax: (780) 497-3510

**SOLICITATION AMENDMENT
MODIFICATION DE L'INVITATION**

The referenced document is hereby revised; unless otherwise indicated, all other terms and conditions of the Solicitation remain the same.

Ce document est par la présente révisé; sauf indication contraire, les modalités de l'invitation demeurent les mêmes.

Comments - Commentaires

Vendor/Firm Name and Address
Raison sociale et adresse du
fournisseur/de l'entrepreneur

Issuing Office - Bureau de distribution
Public Works and Government Services Canada
ATB Place North Tower
10025 Jasper Ave./10025 ave Jasper
5th floor/5e étage
Edmonton
Alberta
T5J 1S6

Title - Sujet Beef Feedlot Water Renovation	
Solicitation No. - N° de l'invitation EP922-180336/B	Amendment No. - N° modif. 003
Client Reference No. - N° de référence du client EP922-180336	Date 2017-08-10
GETS Reference No. - N° de référence de SEAG PW-\$PWU-066-11146	
File No. - N° de dossier PWU-7-40041 (066)	CCC No./N° CCC - FMS No./N° VME
Solicitation Closes - L'invitation prend fin at - à 02:00 PM on - le 2017-08-18	Time Zone Fuseau horaire Mountain Daylight Saving Time MDT
F.O.B. - F.A.B. Plant-Usine: <input type="checkbox"/> Destination: <input type="checkbox"/> Other-Autre: <input type="checkbox"/>	
Address Enquiries to: - Adresser toutes questions à: Lee, Mony	Buyer Id - Id de l'acheteur pwu066
Telephone No. - N° de téléphone (780) 224-6675 ()	FAX No. - N° de FAX (780) 497-3510
Destination - of Goods, Services, and Construction: Destination - des biens, services et construction:	

Instructions: See Herein

Instructions: Voir aux présentes

Delivery Required - Livraison exigée	Delivery Offered - Livraison proposée
Vendor/Firm Name and Address Raison sociale et adresse du fournisseur/de l'entrepreneur	
Telephone No. - N° de téléphone Facsimile No. - N° de télécopieur	
Name and title of person authorized to sign on behalf of Vendor/Firm (type or print) Nom et titre de la personne autorisée à signer au nom du fournisseur/ de l'entrepreneur (taper ou écrire en caractères d'imprimerie)	
Signature	Date

SOLICITATION AMENDMENT No. 003

The following questions and answers are addressed to the specifications for clarification purposes only.

Question 1. Please provide Insulated metal panel manufacturers and profile for both roof and wall panels.

Response: The General Contractor is to choose the manufacturer and the profile for the roof and walls.

Question 2. Please confirm Insulated metal panels thickness. Spec calls out 102mm (4") thickness, drawings show 150mm (6") thickness.

Response: The thickness of the insulated metal panels should be 150mm (6") thick, as specified on the drawings. The specification was incorrect.

Question 3. On the feeder schedule on drawing E201, #1 refers to (Table D108, Diagram D10, Detail 1). Where do I find these tables and diagrams?

Response: Please refer to CEC 2015, page 557 (Attached)

Question 4. Are there any other specifications on the lighting, other than the legend on drawing E101?

Response: Please refer to Section 26 50 00 of the project specifications for lighting required.




Question 5. Is the mechanical contractor supplying the heat trace cables?

Response: The General Contractor is to determine this; all we require is that the work must be completed.

Question 6. Can we use EMT and normal boxes, wiring methods in pump house, or does it have to be Teck/weatherproof?

Response: EMT and normal boxes can be used in the pump house only. The exterior must be Teck/weatherproofed.

All other terms and conditions of the Invitation to Tender remain unchanged.

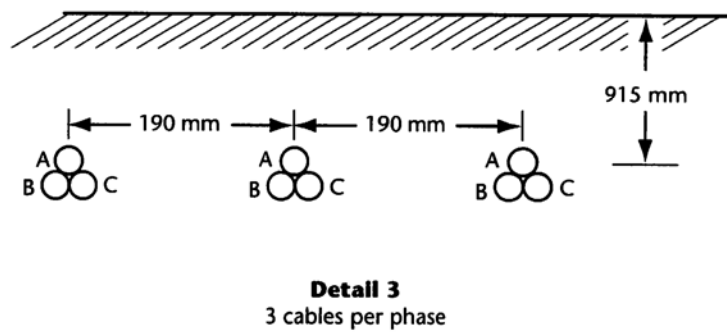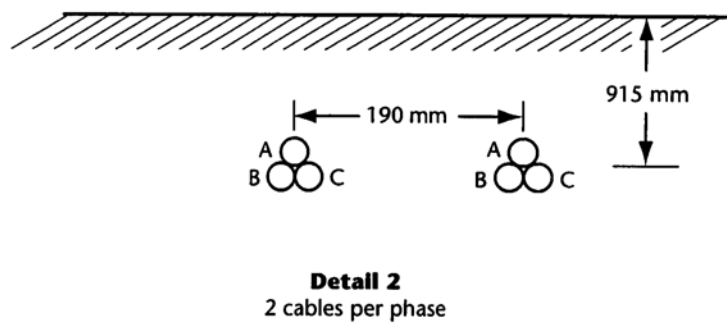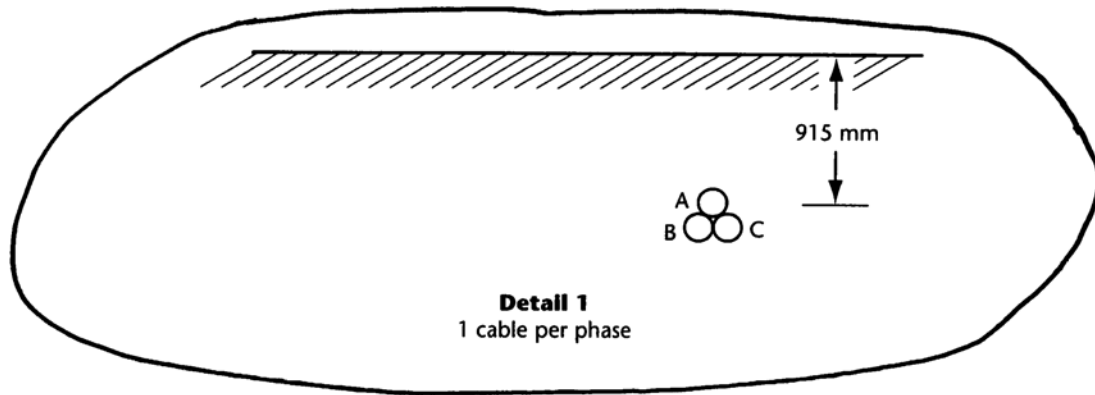

Δ

Diagram D10
Installation configurations — Direct buried

(Continued)

Appendix D