



ARCHITECTS

300 - 214 McDermot Avenue, Winnipeg Manitoba R3B 0S3  
Tel (204) 956-0530 Fax (204) 943-5704 www.towereng.ca

TOWER PROJECT NO. : 161364

**TOWER ENGINEERING GROUP**

UNIT 1-1140 WAVERLEY ST. WINNIPEG, MB R3T 0P4  
TEL: (204) 925-1150 FAX: (204) 925-1155  
EMAIL: towereng@towereng.ca WEB: www.towereng.ca

• WINNIPEG • CALGARY



5		
4		
3	RE-ISSUED FOR CONSTRUCTION	2017/07/26
2	ISSUED FOR CONSTRUCTION	2017/07/11
1	ISSUED FOR REVIEW	2017/06/30
0	Design Completion	

Designer: 

Client:

Author/Drawn: 

Client:

FISHERIES AND  
OCEANS CANADA

Project title: 

Projet:

GIMLI, MB  
17 HARBOUR LANE

**GIMLI SEARCH &  
RESCUE STATION**

Designed by: 

Conçu par:

PC

Drawn by: 

Dessiné par:

VRR

Approved by: 

Approuvé par:

DKG

PM/SC: Project Manager 

Administrateur de Projets (PM/SC):

Drawing title: 

Titre du dessin:

**ELECTRICAL  
LIGHTING LAYOUT  
OFFICE**


Project no./N° du projet:	Drawing no./N° du dessin:	Sheet no./N°
2016-39	E2.1 OF 10	2

GENERAL NOTE


- A. ALL ELECTRICAL WORK SHALL BE DONE IN COMPLETE COMPLIANCE WITH 2011 MANITOBA BUILDING CODE AND 2015 CANADIAN ELECTRICAL CODE.
- B. PROVIDE DEDICATED AND SEPARATED NEUTRAL CONDUCTOR FOR EACH LIGHTING CIRCUIT. SHARING OF NEUTRAL CONDUCTORS AMONG LIGHTING CIRCUITS ARE NOT ACCEPTABLE. TYPICAL.

DRAWING NOTES:

- 1 PROVIDE PHOTOCELL FOR CONTROL OF ALL EXTERIOR LIGHTS.
- 2 COORDINATE EXACT LOCATION OF LIGHT FIXTURES IN CRAWL SPACE WITH MECHANICAL CONTRACTOR AND ARCHITECT AND ENSURE THEY DO NOT INTERSECT WITH DUCT/PIPE ROUTING AND OTHER MECHANICAL EQUIPMENT.
- 3 PROVIDE UNDER CABINET LED STRIP LIGHTING AS SHOWN IN THE KITCHEN. COORDINATE WITH ARCHITECT FOR EXACT LENGTH, LOCATION AND MOUNTING PRIOR TO INSTALLATION.
- 4 CONFIRM EXACT LOCATION OF DOWN LIGHT WITH ARCHITECT AND OWNER.

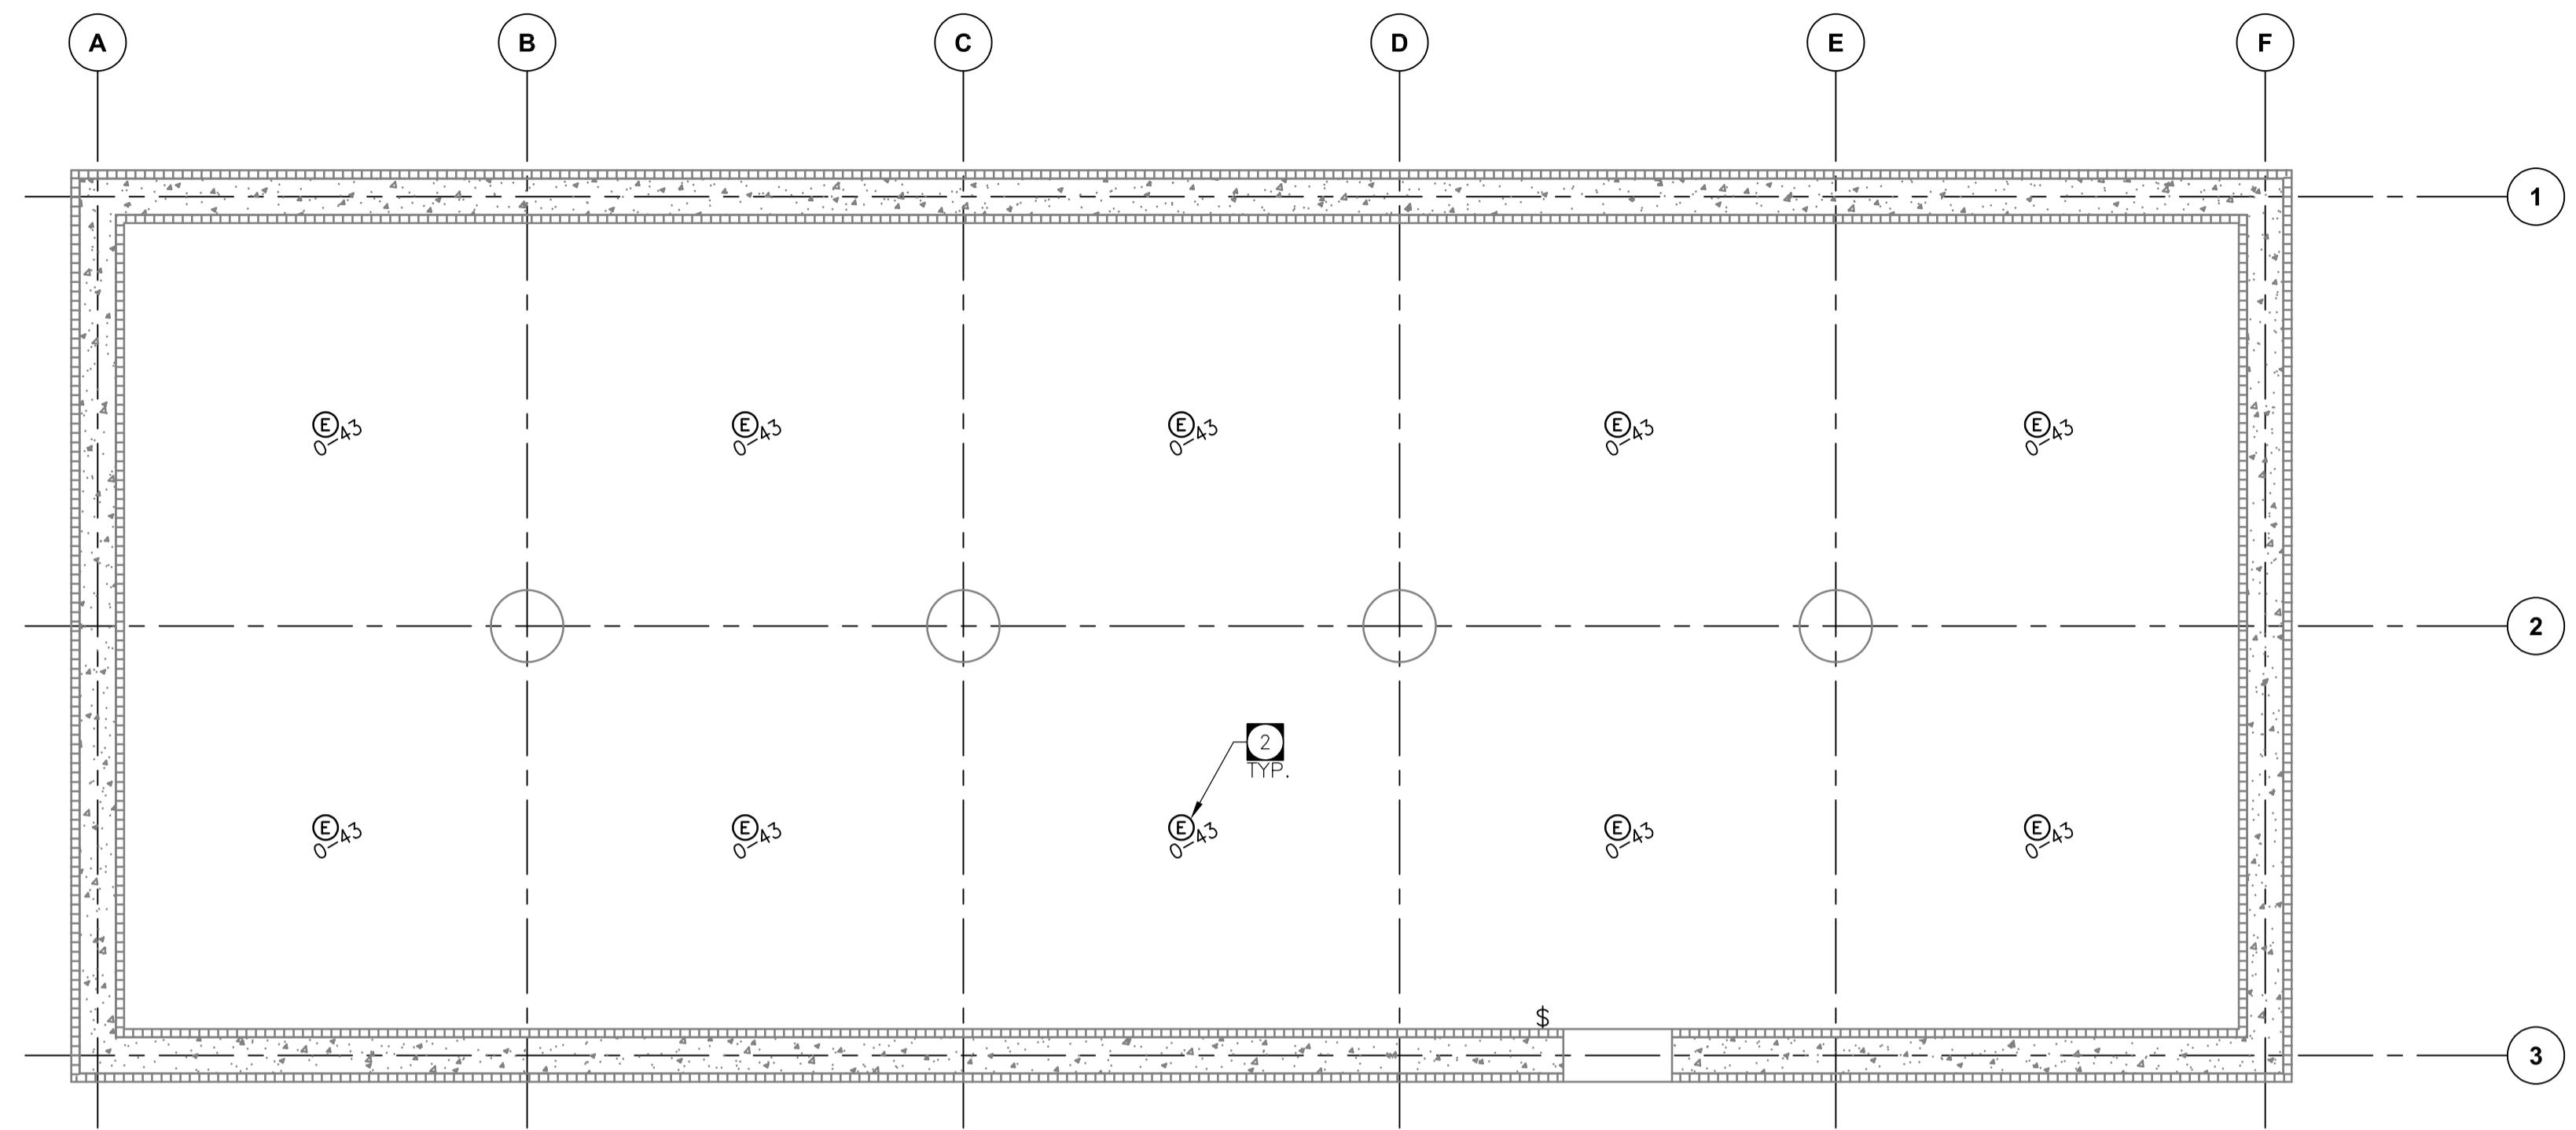

1 CRAWLSPACE PLAN  
SCALE: 1:50

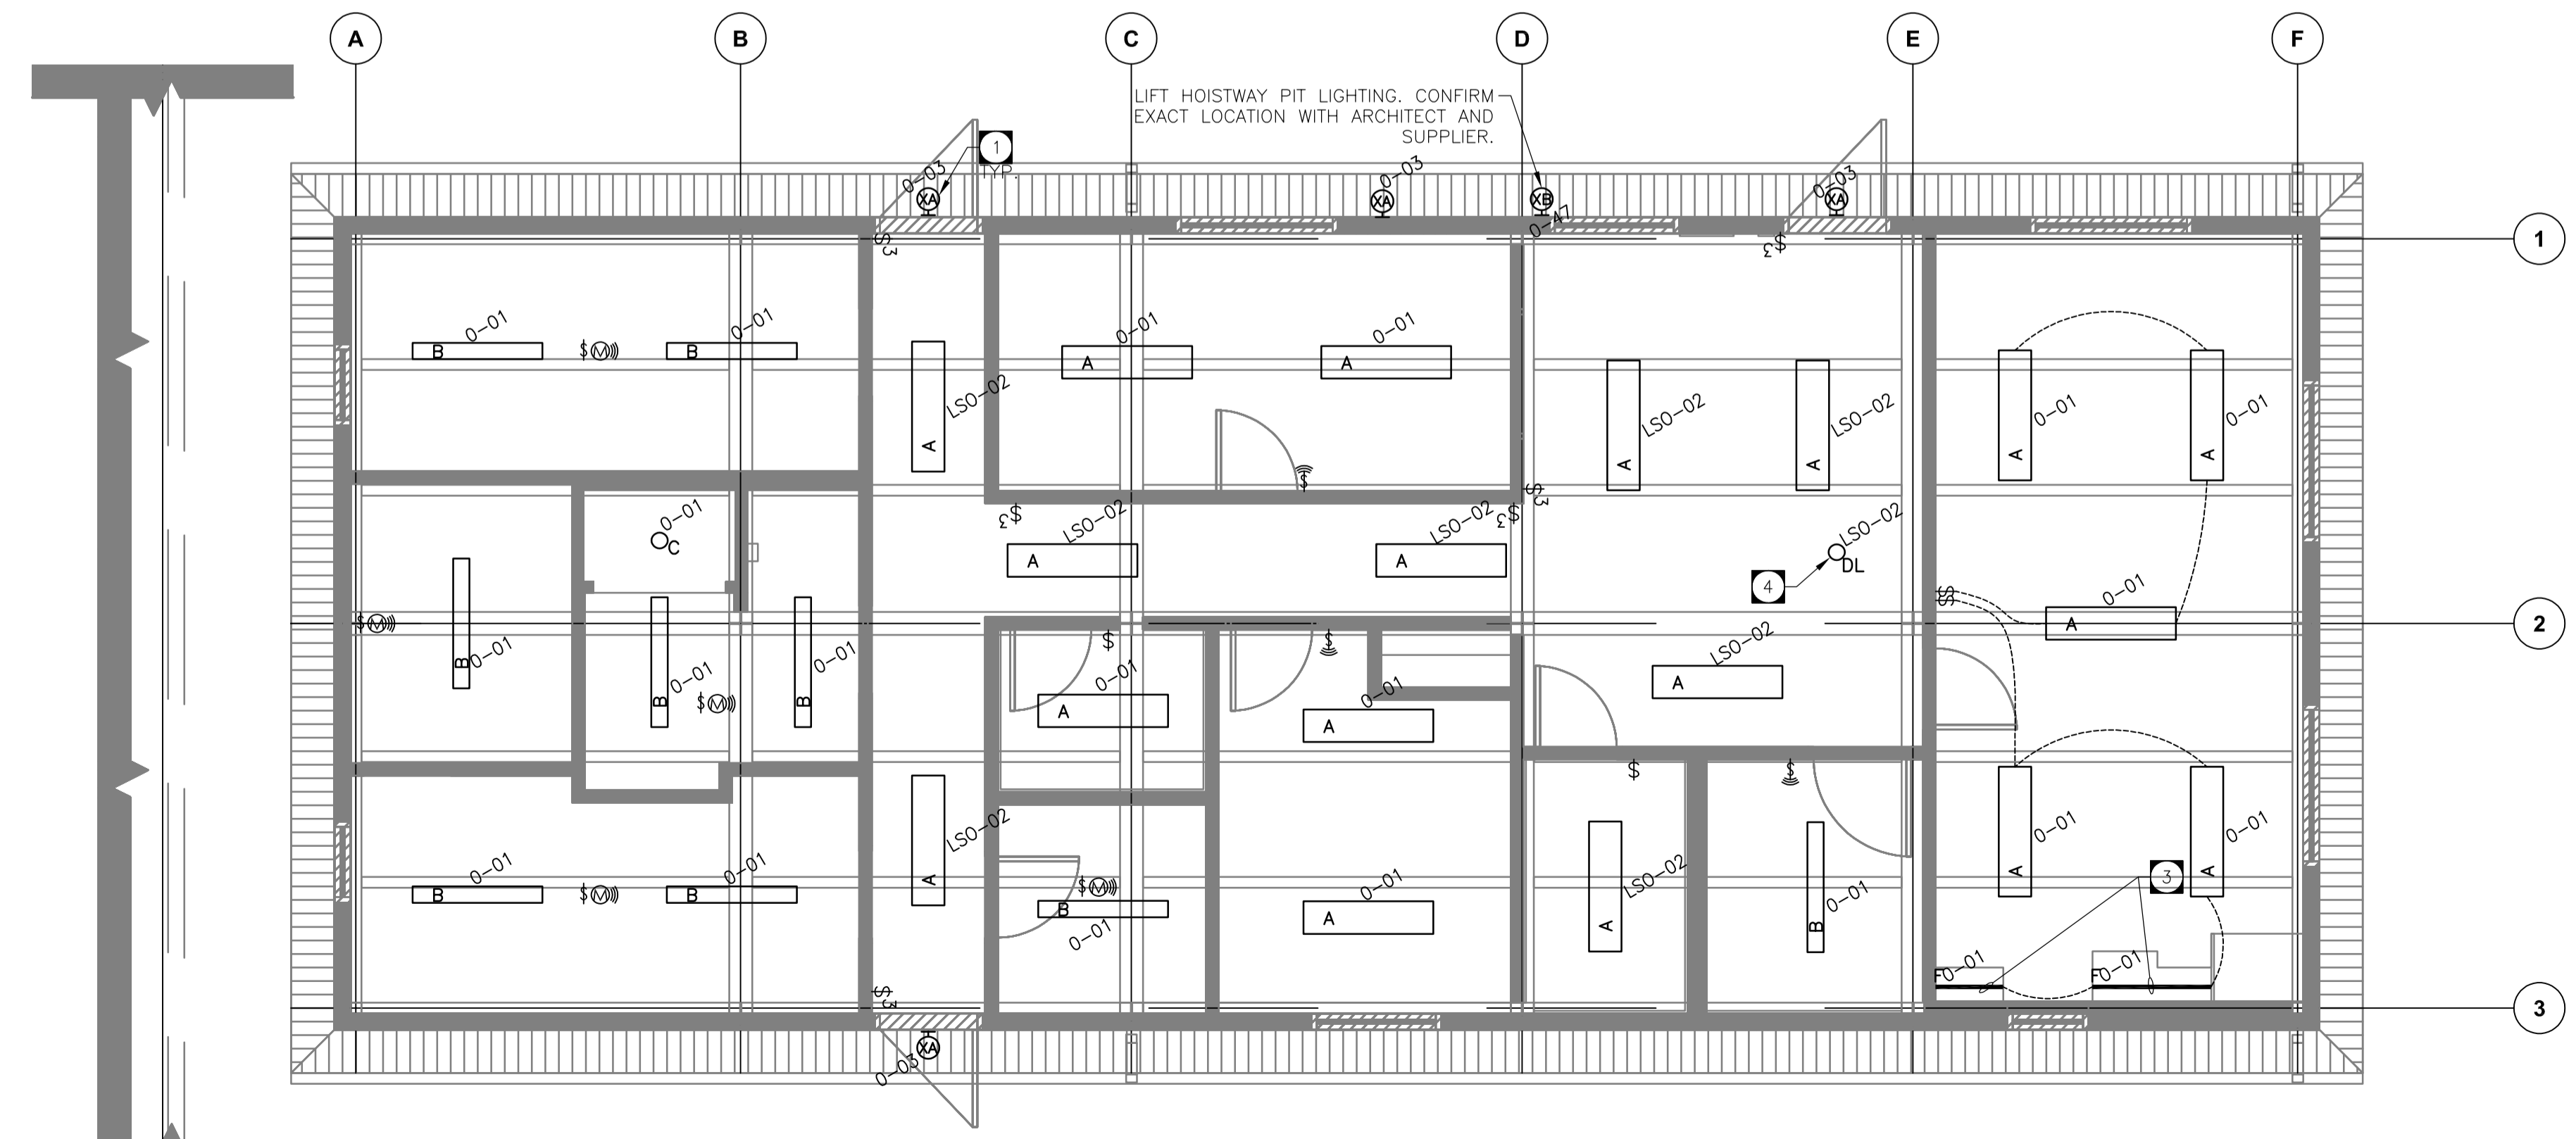

2 MAIN FLOOR PLAN  
SCALE: 1:50