


NOTES:

1. ALL WIRING AND INSTALLATIONS TO BE IN ACCORDANCE WITH TRANSPORT CANADA TP 1 27E.
2. DISTRIBUTION PANELS AND CIRCUIT BREAKERS TO BE CHOSEN BASED UPON OTHER EQUIPMENT FITTED ON BOARD. WHEREVER POSSIBLE, SIMILAR AND INTERCHANGEABLE EQUIPMENT IS TO BE USED.

MATERIALS:

- CABLING TO BE APPROVED SHIPBOARD CABLE (BOSTRIG TYPE P UNARMORED OR EQUAL)

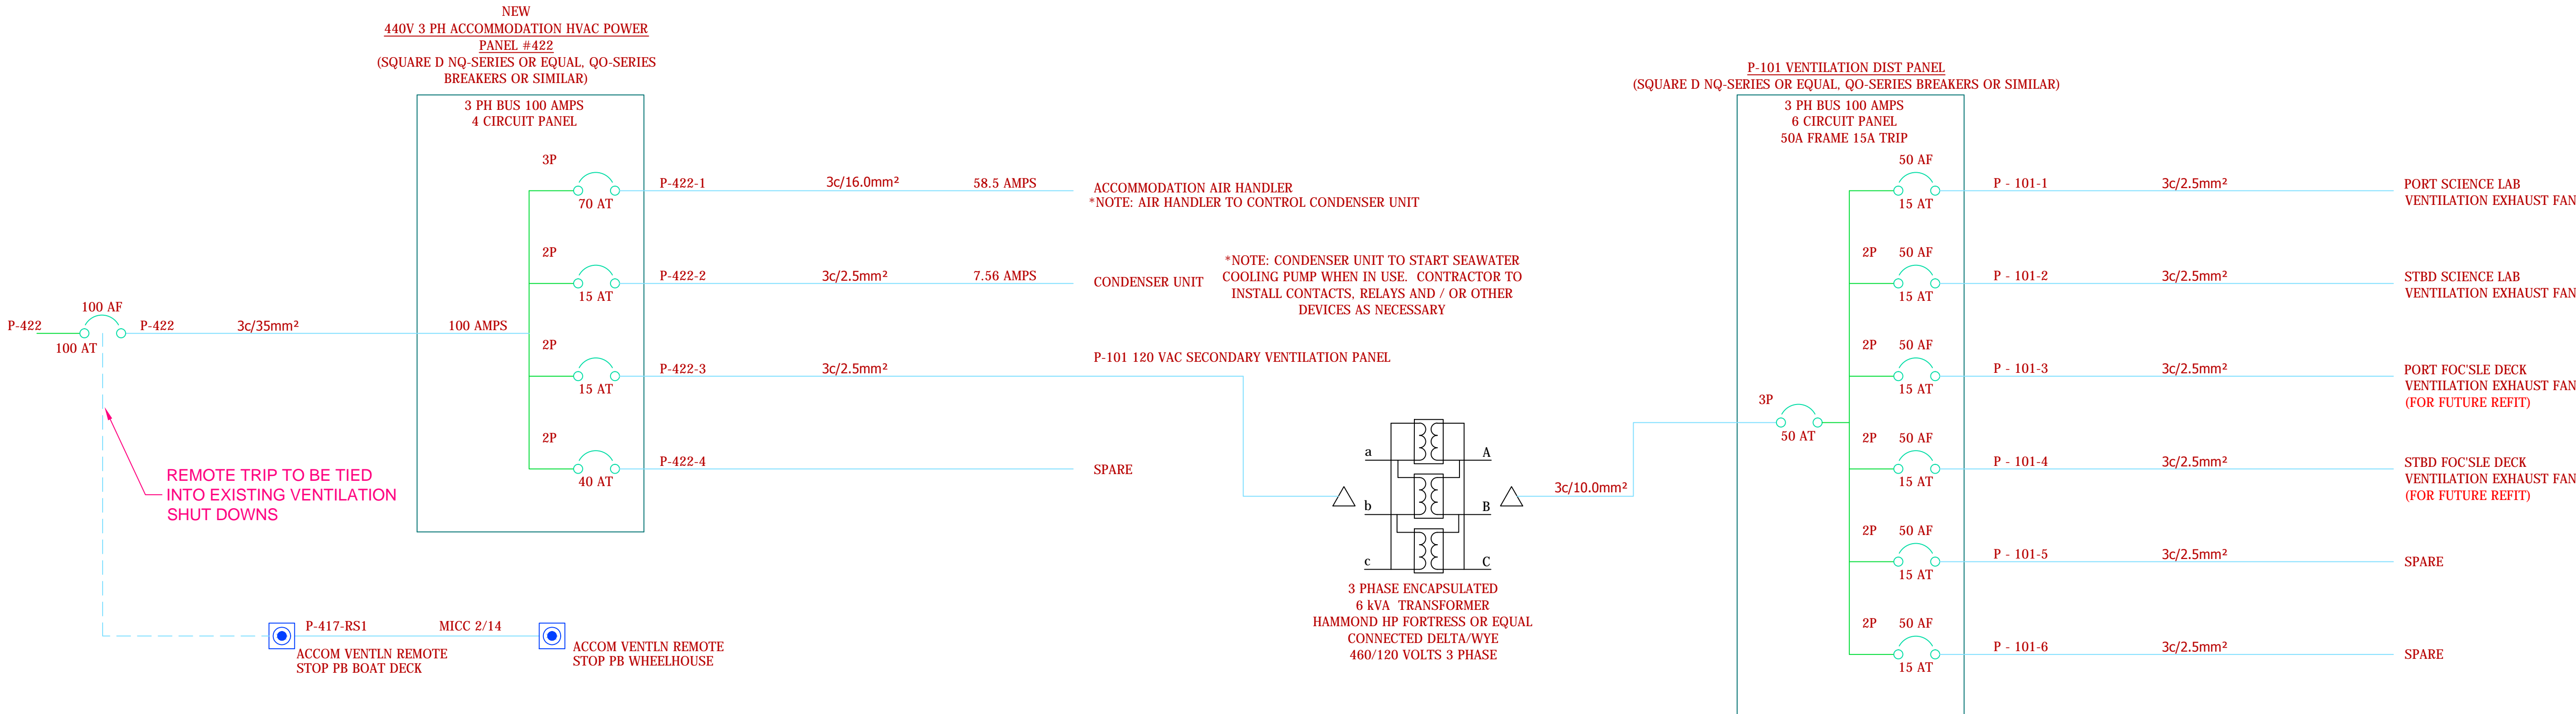

NOTE: FINAL SPECIFICS OF THE ARRANGEMENT TO BE DETERMINED BY THE CONTRACTOR IN CONSULTATION WITH THE VESSEL OWNER

REVISION	REVISION DATE	ISSUED : Aug 9, 2017
		DRAWING BY : MD
		CHECKED BY : MD

CCG VECTOR
HVAC SYSTEM

STATUS	APPROVED BY	REV -
SHEET# 1/1	FOR REVIEW	
1146-4-402-01	HVAC SYSTEM ONE LINES	REV -