

BUILDING KEY PLAN

LEGEND

- (N) NEW
(E) EXISTING
(R) RELOCATE
 DEMOLITION

REV	Description	Date
0	ISSUED FOR TENDER	23-JUN-2017

A	A detail no. no. du détail	A
C	B location drawing no. sur dessin no.	B C
	C drawing no. dessin no.	

project projet
**MECHANICAL UPGRADE
115 PERIMETER ROAD
SASKATOON, SASK.**
ENVIRONMENT CANADA
335 River Rd
Ottawa ON, K1V 1C7

drawing dessin
**MECHANICAL
SOUTH WING
DEMOLITION PLAN**

Designed By	GDK	Conçu par
Date	2017/05/21	(yyyy/mm/dd)
Drawn By	BJB	Dessiné par
Date	2017/04/21	(yyyy/mm/dd)
Reviewed By	ADR	Examiné par
Date	2017/06/23	(yyyy/mm/dd)
Approved By	AMB	Approuvé par
Date	2017/06/23	(yyyy/mm/dd)
Tender		Soumission


Project Manager	Administrateur de projets
EC PMDI Proj no.	Consultant Proj no.
	17-0006-001

Drawing no. No. du dessin

D01


SCOPE OF DEMOLITION

1. REMOVE EXISTING SOUTH WING STEAM HUMIDIFIERS.
2. REMOVE SOUTH WING AHU HEATING COIL ONLY.
3. REMOVE EXISTING SOUTH WING ZONE PUMPS.
4. REMOVE ALL STEAM AND CONDENSATE PIPING IN SOUTH WING MECHANICAL ROOM AS WELL AS PIPING BETWEEN THE SOUTH AND NORTH WING.
5. REMOVE ALL UNNECESSARY HYDRONIC HEATING PIPING THAT IS NO LONGER REQUIRED ONCE NEW HEATING SYSTEM IS INSTALLED. REFER TO THE BALANCE OF DRAWINGS FOR EXTENT OF EXISTING SYSTEM THAT IS TO REMAIN.
6. ENSURE ALL MATERIAL CONTAINING ASBESTOS ON THE EXISTING PIPING HAS BEEN ABATED PRIOR TO ANY DEMOLITION.
7. ALL DEMOLISHED EQUIPMENT, PIPING AND DUCT MATERIALS SHALL BE DISPOSED OF ACCORDING TO ALL APPLICABLE CODES AND REGULATIONS.
8. FLOOR SHALL BE CLEANED AND EPOXY SEALED WHEN ALL EQUIPMENT IS REMOVED.

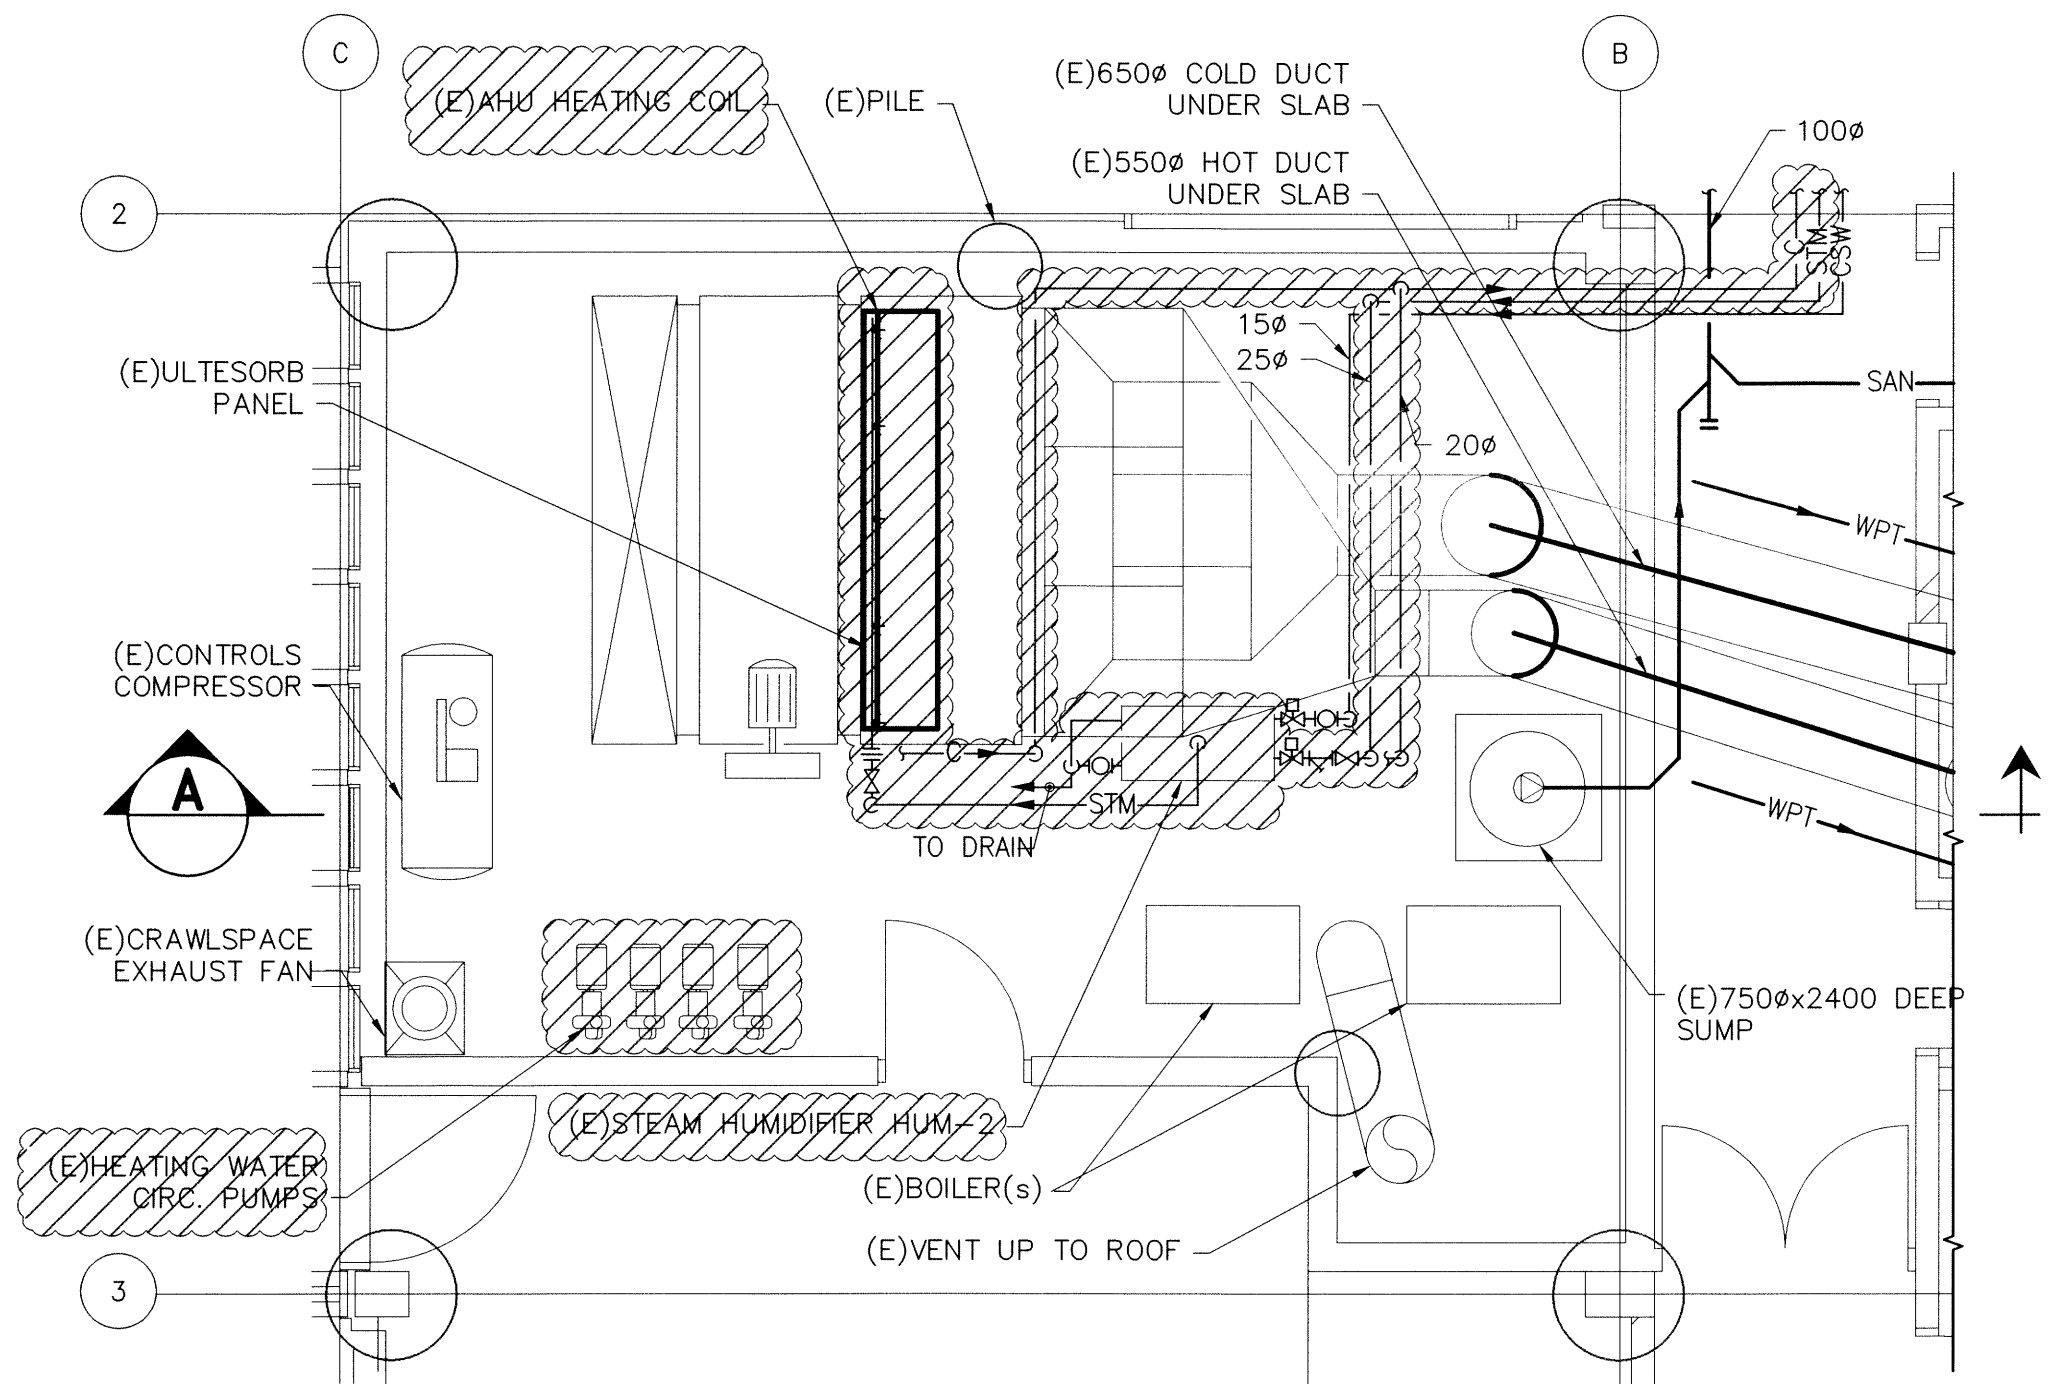

SOUTH WING MECHANICAL ROOM PLAN

SCALE: 1: 50

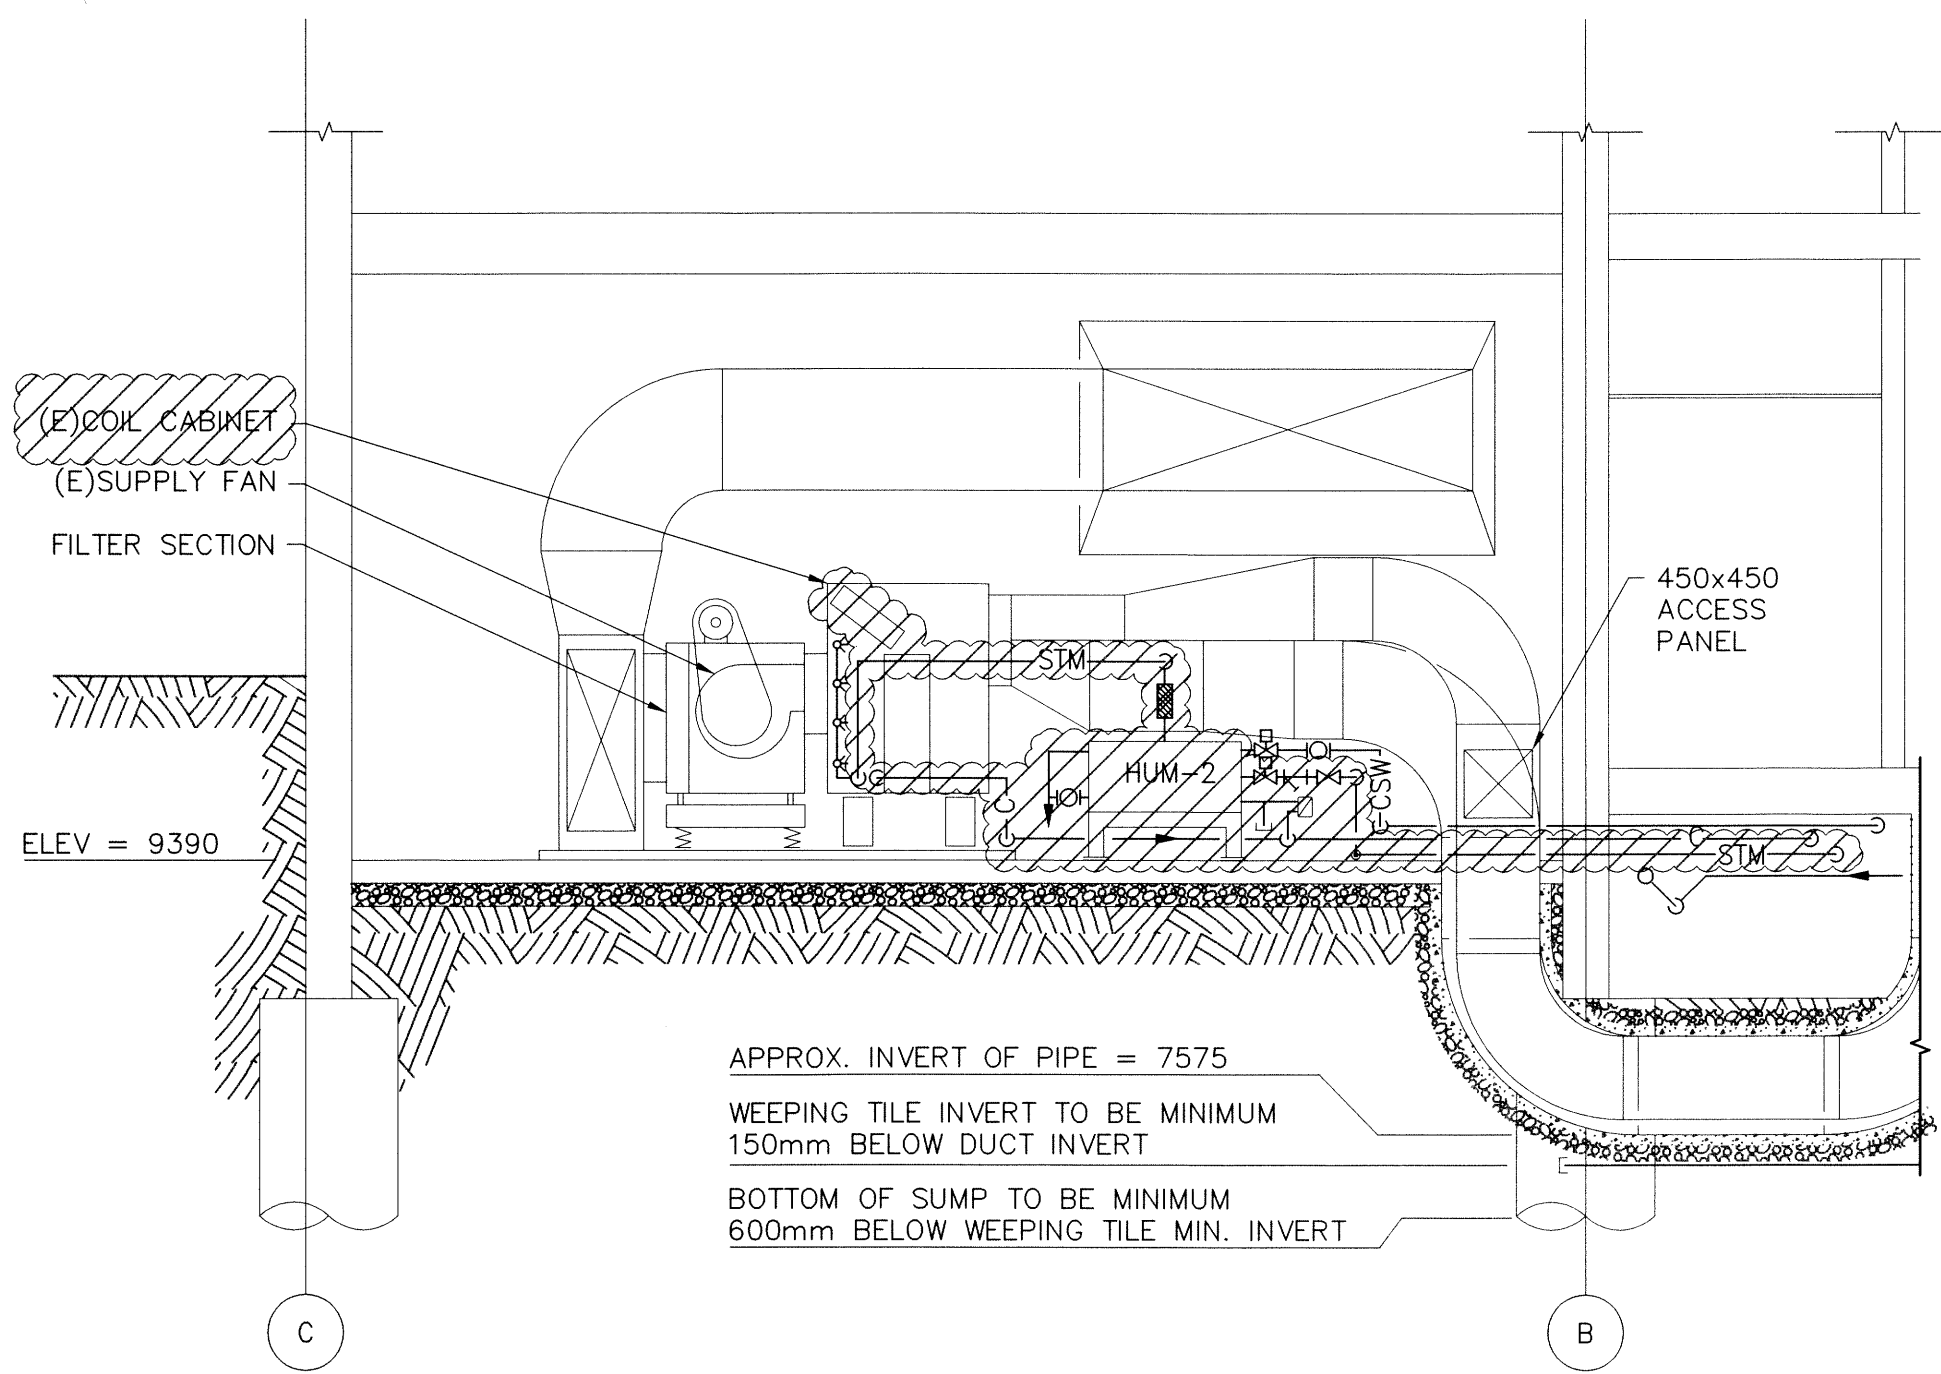

A SECTION
SCALE: 1: 50



Association of Professional Engineers & Geoscientists
of Saskatchewan
CERTIFICATE OF AUTHORIZATION
KGS Group
Number C0620
Permission to Consult held by:
Discipline SK. Reg. No. Signature
MECHANICAL 20102 *[Signature]*