



REFERENCES			
NO.	AUTEUR/AUTHOR	TITRE / TITLE	ID DOCUMENT
1			
REVISIONS			
NO.	DATE	DESCRIPTION	PAR / BY
0	31 OCT 2014	OFFICIAL ISSUE	M. VIDORI


- NOTES
1. ALL DUCT ROUTING SHALL BE FIELD VERIFIED TO ENSURE ADEQUATE CLEARANCES.
 2. ALL DUCT ROUTING AND PENETRATION LOCATIONS SHALL BE IDENTIFIED FOR APPROVAL PRIOR TO INSTALLING.
 3. FOR DUCT GAUGES AND INSULATION DETAILS REFER TO THE HVAC SPECIFICATION.
 4. FOR EXISTING HVAC SYSTEM ARRANGEMENT, REFER TO DRAWINGS 716-014 SHEETS 1 AND 2.
 5. ALL DIMENSIONS ARE IN MM UNLESS INDICATED.

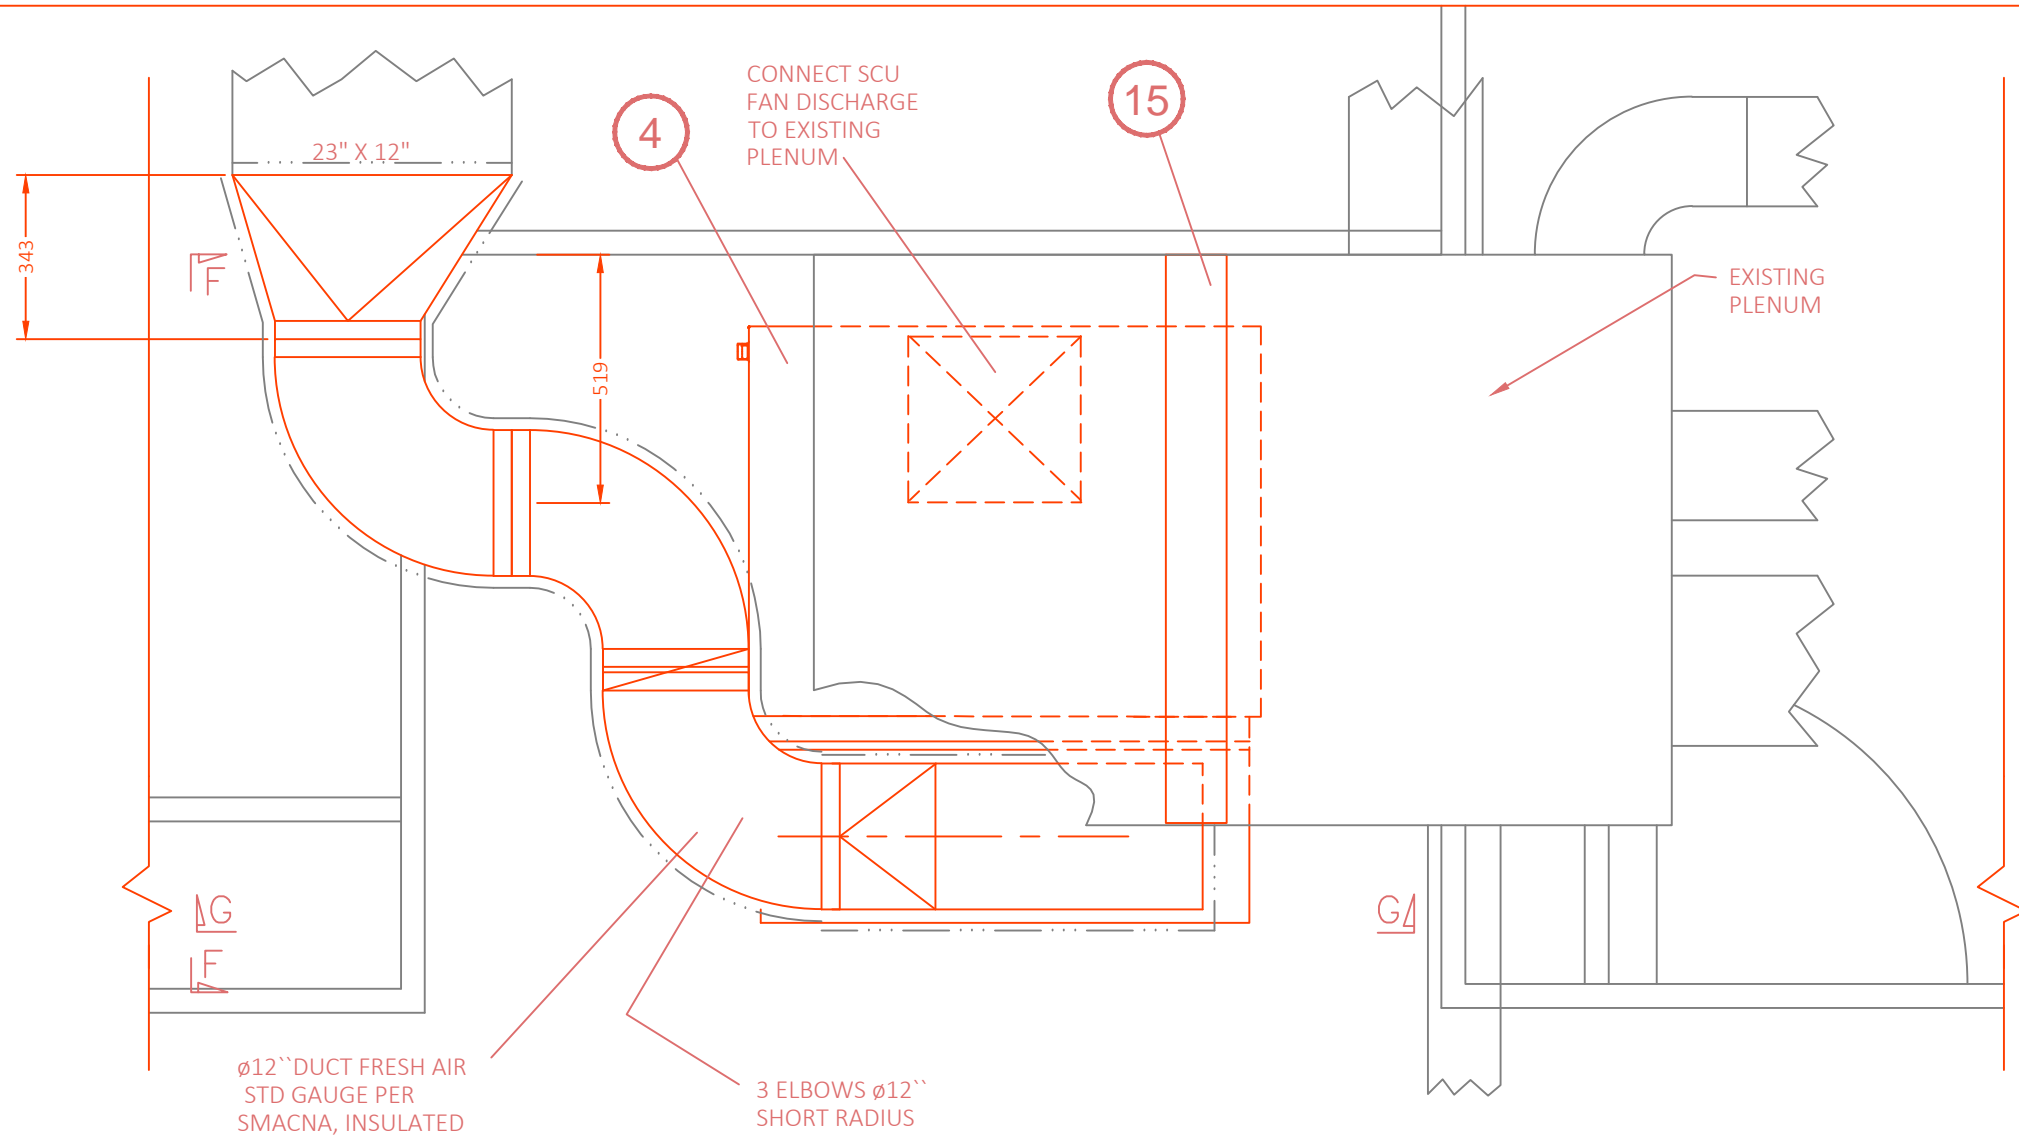

MAIN DECK
PLAN VIEW

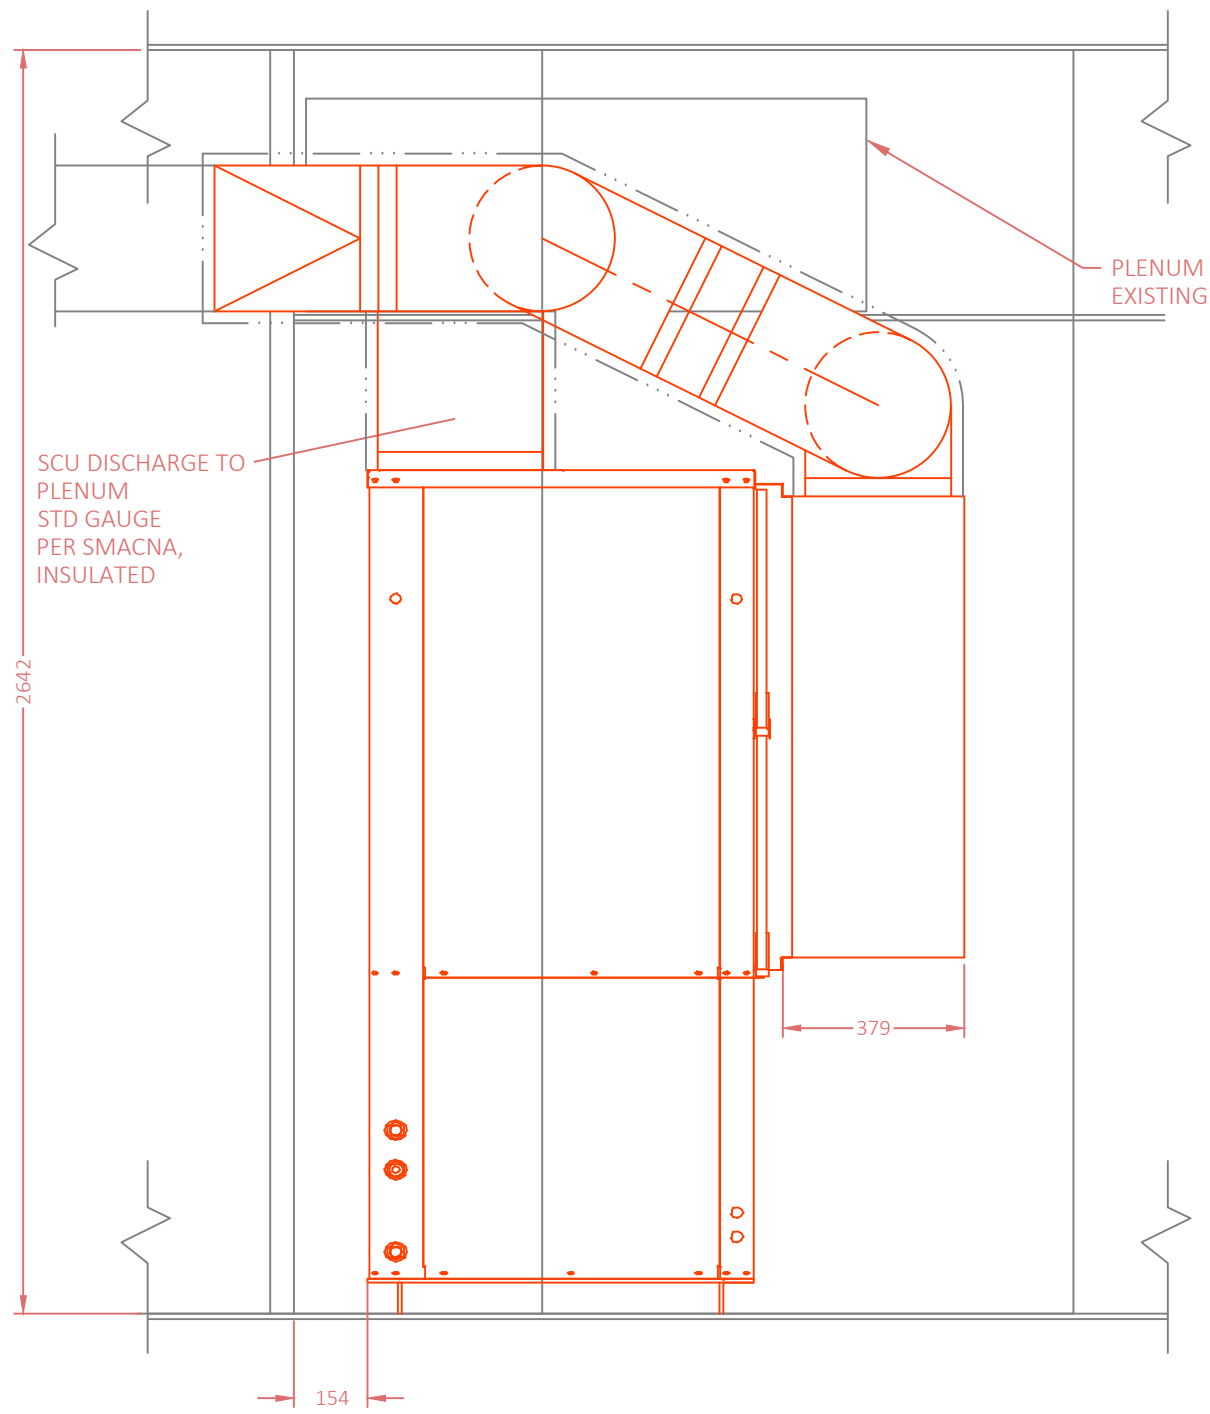

SECTION F-F

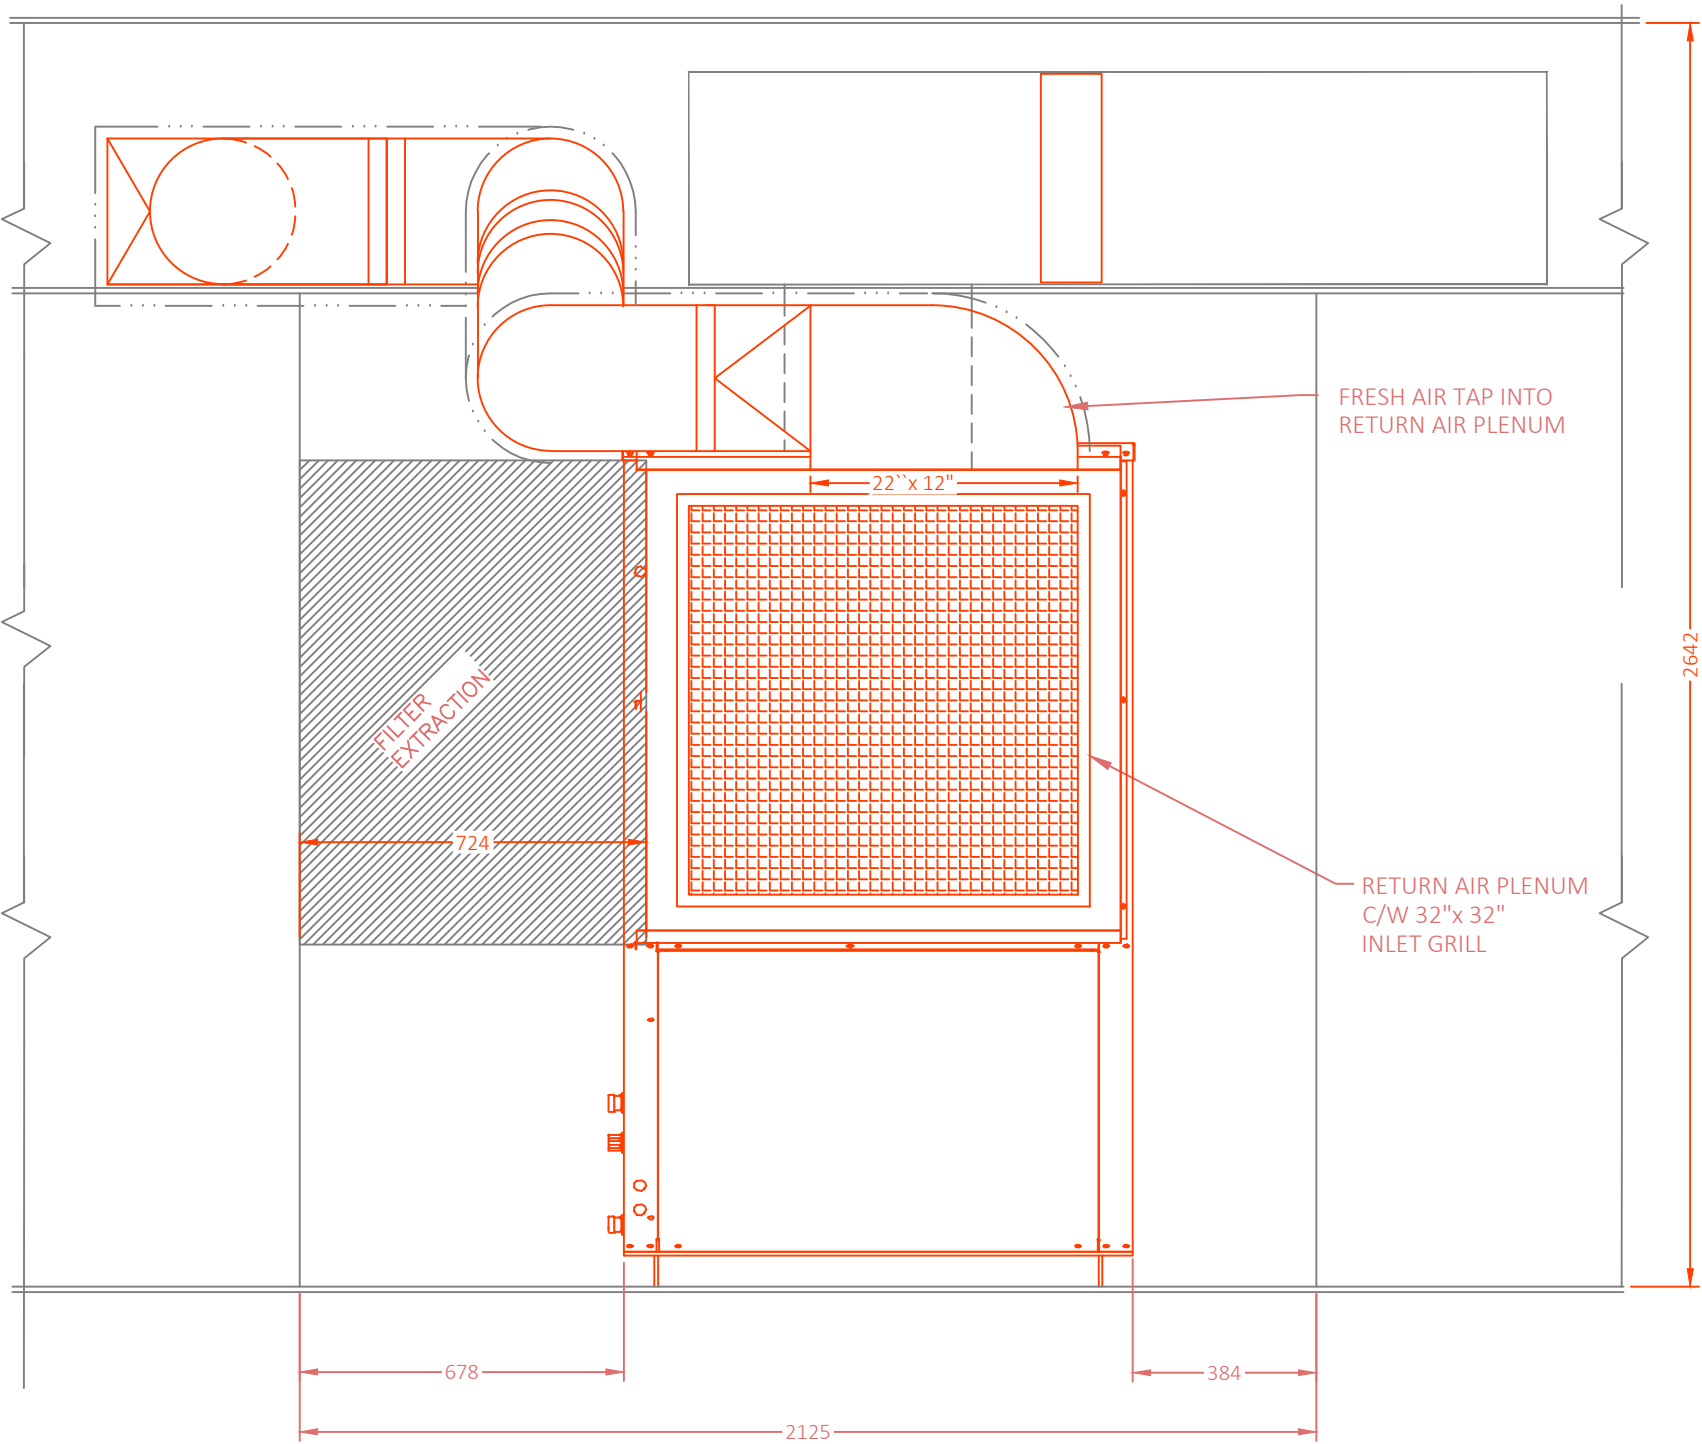

TO BE FIELD
VERIFIED

SECTION G-G