

KEY PLAN



DO NOT SCALE DRAWINGS

Revision/	Description/Description	Date/Date
0	ISSUED FOR TENDER	2017.08.16

Client/client
PUBLIC WORKS & GOVERNMENT SERVICES CANADA

Project title/Titre du projet
EDMONTON MAXIMUM SECURITY INSTITUTION

Approved by/Approuvé par
J. MAH

Designed by/Concept par
J. MAH

Drawn by/Dessiné par
J. CHOA


PWGC Project Manager/Administrateur de Projets TPSGC
ANDREW GILLESSE

PWGC, Architectural and Engineering Resources Manager/
Ressources Architectural et de Directeur d'ingénierie, TPSGC

Client/client
PUBLIC WORKS & GOVERNMENT SERVICES CANADA

Drawing title/Titre du dessin
**EXECUTIVE SERVICES
DEMOLITION PLAN**

Project No./No. du projet R.078013.001	Sheet/Feuille M12 OF 103	Revision no./La Révision no. 0
---	---------------------------------------	--

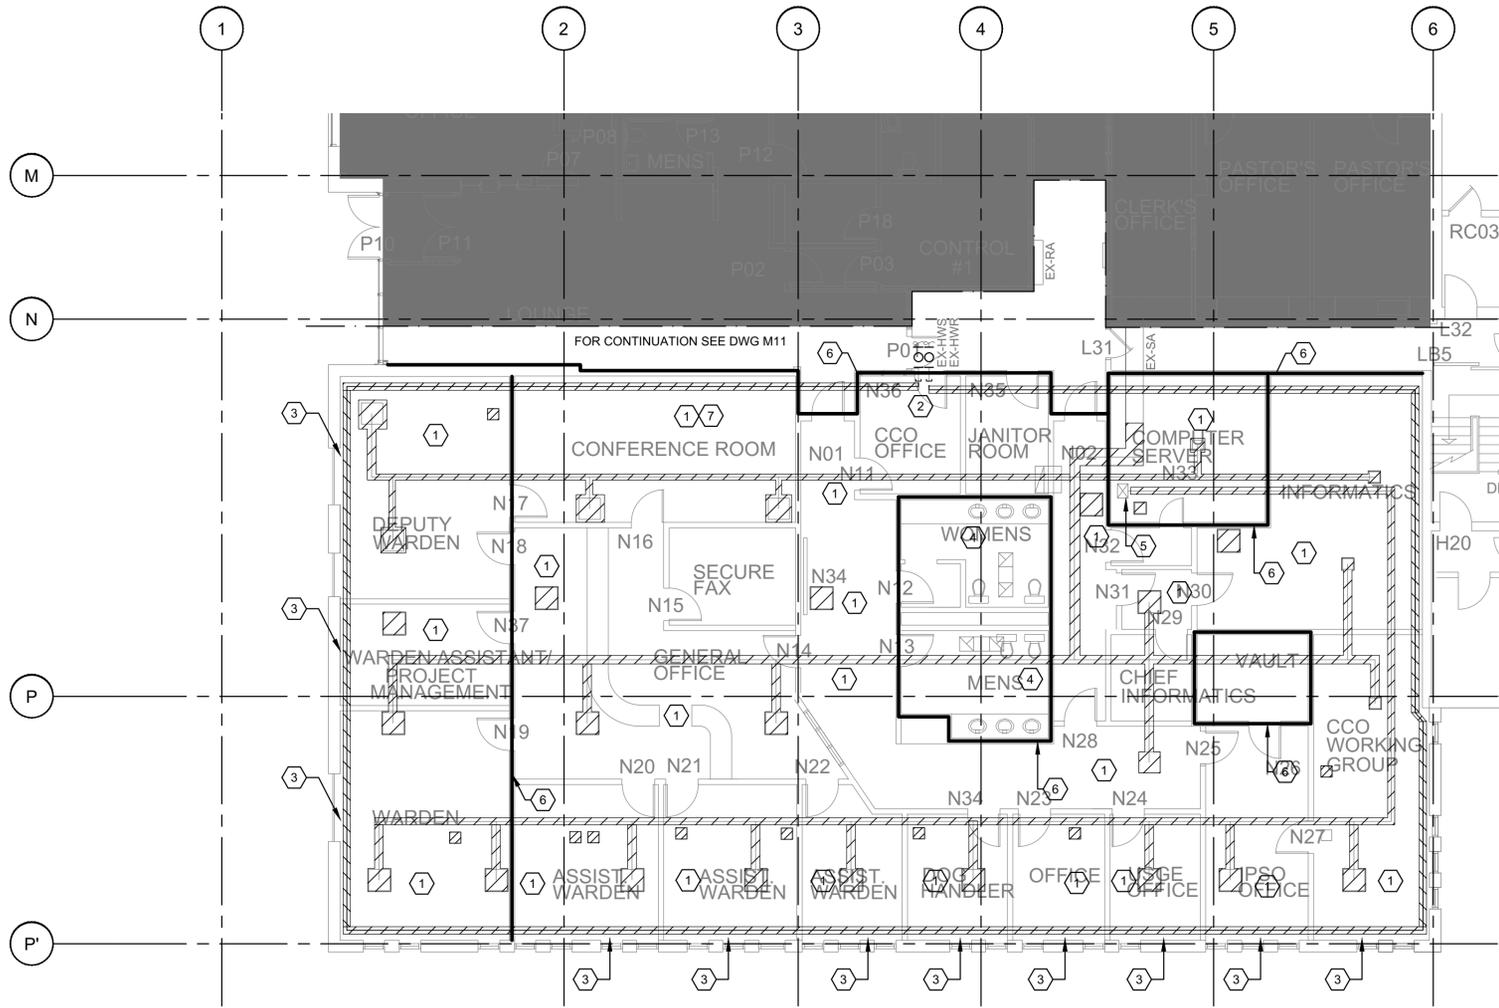

SHEET KEY NOTES

- 1 REMOVE ALL DUCTWORK, DIFFUSERS, AND GRILLES AS SHOWN.
- 2 REMOVE ALL HEATING LINES IN EXECUTIVE SERVICES AREA AND CAP/VALVE AS SHOWN.
- 3 REMOVE ALL RADIATION ELEMENT, RADIATION CABINET AND ASSOCIATED PIPING IN ROOM.
- 4 BATHROOM EXHAUST SYSTEM/DUCTWORK TO REMAIN.
- 5 REMOVE DUCT UP TO MECHANICAL ROOM ABOVE.
- 6 FULL HEIGHT WALL.
- 7 ALL FURNITURE SHALL REMAIN IN PLACE DURING CONSTRUCTION. PROTECT FURNITURE DURING WORK. ROOM MAY BE REQUIRED BY OPERATIONS ON SHORT NOTICE.

GENERAL NOTES

- 1 EXISTING DRAWING INFORMATION IS NOT AS-BUILT. CONTRACTOR TO CONFIRM EXISTING CONDITIONS AND ROUTING PRIOR TO COMMENCING WORK.
- 2 CONSTRUCTION ACTIVITIES SHALL BE COORDINATED WITH THE BUILDING OPERATOR TO MINIMIZE INTERRUPTION TO OPERATIONS.
- 3 PATCH AND REPAIR OPENINGS TO MAINTAIN FIRE SEAL.
- 4 DEMOLITION OF DUCTWORK AND HEATING SHALL BE SCHEDULED IN CONSIDERATION WITH OUTDOOR TEMPERATURE.
- 5 PATCH AND REPAIR HOLES LEFT BEHIND BY RADIATION CABINET PIPES ON INTERIOR WALLS. REFER TO ARCHITECTURAL FOR DETAILS.

1 PLAN
M12 EXECUTIVE SERVICES DEMOLITION 1:100