



1 PLAN
M46 GYM AREA VENTILATION 1:100

- ### SHEET KEY NOTES
- 1 REBALANCE EXISTING SUPPLY DIFFUSER.
 - 2 SUPPLY DUCT FROM AHU-103 ABOVE IN MECHANICAL ROOM.
 - 3 SUPPLY DUCT FROM AHU-27 ABOVE IN MECHANICAL ROOM.
 - 4 SUPPLY DUCT FROM AHU-26 ABOVE IN MECHANICAL ROOM.
 - 5 CONNECT NEW DIFFUSERS TO EXISTING BRANCH DUCT AND BALANCE.

- ### GENERAL NOTES
- 1 EXISTING DRAWING INFORMATION IS NOT AS-BUILT. CONTRACTOR TO CONFIRM EXISTING CONDITIONS AND ROUTING PRIOR TO COMMENCING WORK.
 - 2 CONSTRUCTION ACTIVITIES SHALL BE COORDINATED AND STAGED WITH THE BUILDING OPERATOR TO MINIMIZE INTERRUPTION TO OPERATIONS.
 - 3 PATCH AND REPAIR OPENINGS TO MAINTAIN FIRE SEAL.

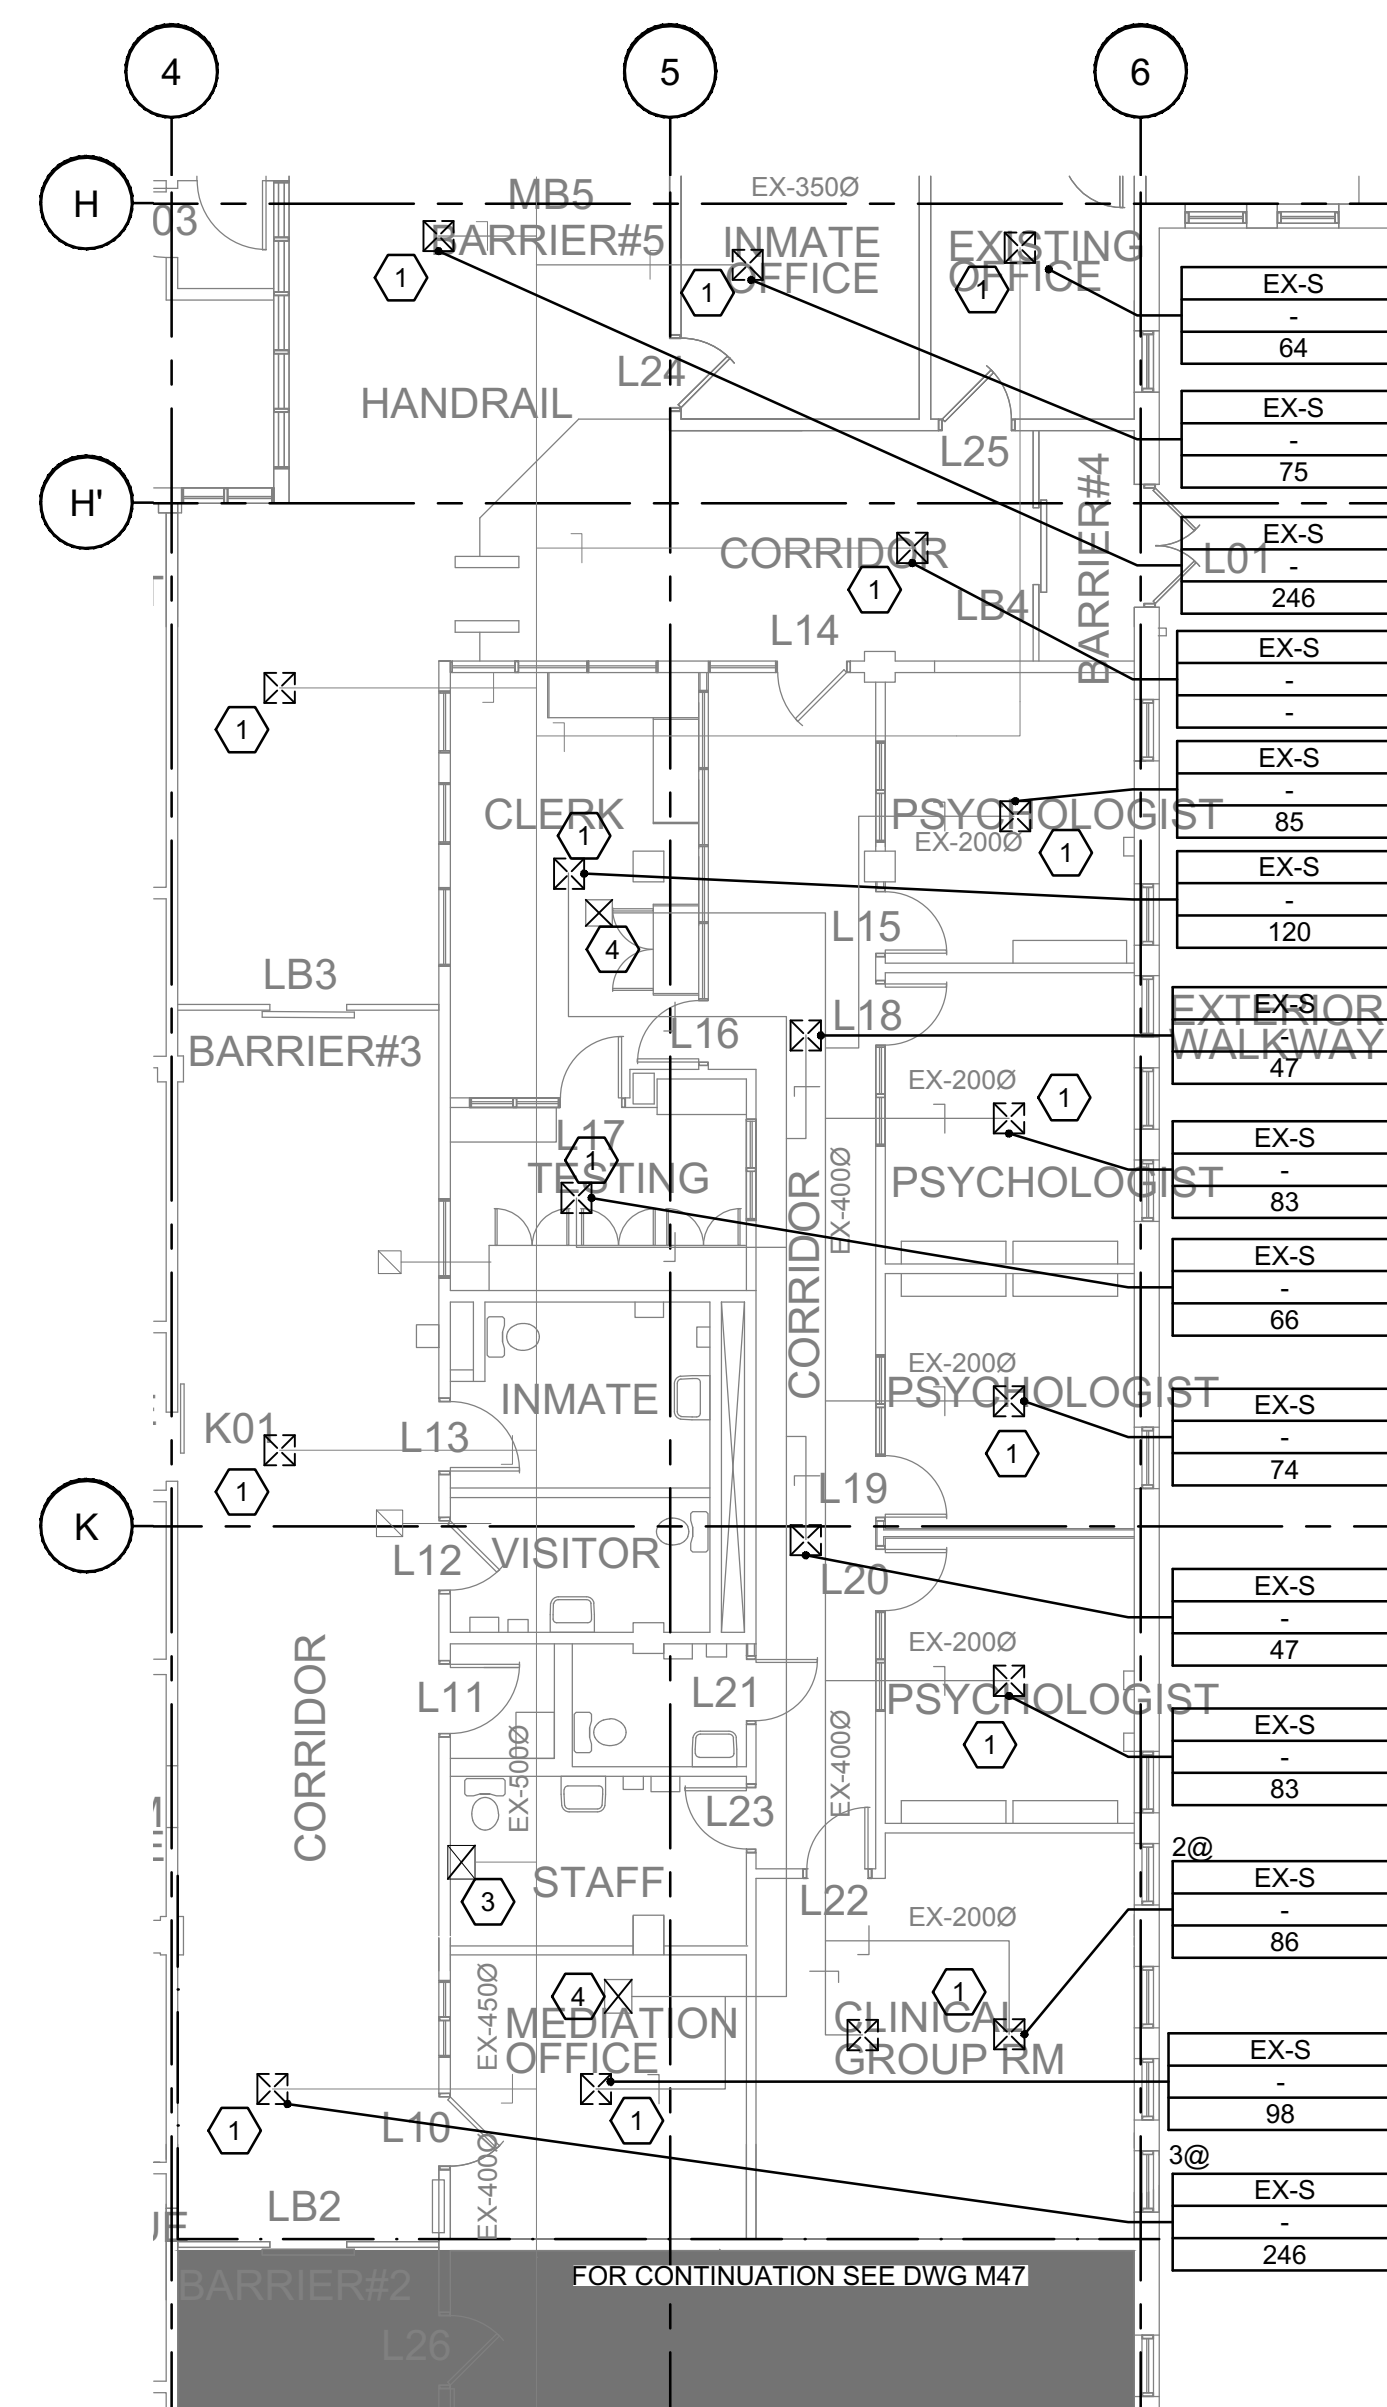

2 PLAN
M46 PSYCHOLOGY AREA VENTILATION 1:100

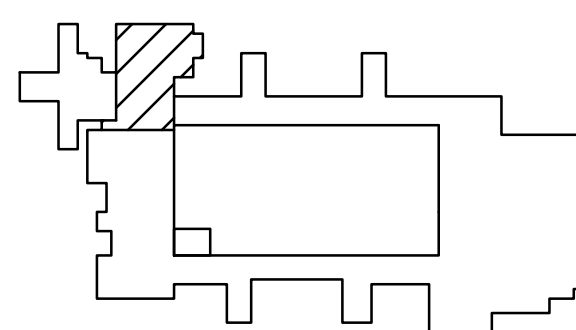

KEY PLAN

APEGA
PERMIT TO
PRACTICE
P 3979

DO NOT SCALE DRAWINGS

Revision/	Description/Description	Date/Date
0	ISSUED FOR TENDER	2017.08.16

Client/client

PUBLIC WORKS &
GOVERNMENT SERVICES
CANADA

Project title/Titre du projet

EDMONTON MAXIMUM
SECURITY INSTITUTION

Approved by/Approuvé par
J. MAH

Designed by/Concept par
J. MAH

Drawn by/Dessiné par
J. CHOA

PWSC Project Manager/Administrateur de Projets TPSGC
ANDREW GILLESSE

PWSC, Architectural and Engineering Resources Manager/
Ressources Architectural et de Directeur d'Ingénierie, TPSGC

Client/client
PUBLIC WORKS & GOVERNMENT SERVICES CANADA

Drawing title/Titre du dessin

GYM AREA & PSYCHOLOGY
VENTILATION PLAN

Project No./No. du projet	Sheet/Feuille	Revision no./La Révision no.
R.078013.001	M46 OF 103	0