



DO NOT SCALE DRAWINGS

0	ISSUED FOR TENDER	2017.08.16
---	-------------------	------------

Revision/	Description/Description	Date/Date
-----------	-------------------------	-----------

Client/client  
**PUBLIC WORKS & GOVERNMENT SERVICES CANADA**

Project title/Titre du projet  
**EDMONTON MAXIMUM SECURITY INSTITUTION**

Approved by/Approuvé par  
J. MAH

Designed by/Conçu par  
C. WATTS


PWSC Project Manager/Administrateur de Projets TPSGC  
ANDREW GILLESSE

PWSC, Architectural and Engineering Resources Manager/  
Ressources Architecturales et de Directeur d'ingénierie, TPSGC


Client/client  
PUBLIC WORKS & GOVERNMENT SERVICES CANADA

Drawing title/Titre du dessin  
**DETAILS 4**


Project No./No. du projet <b>R.078013.001</b>	Sheet/Feuille <b>M65</b> OF 103	Revision no./ La Révision no. <b>0</b>
--	---------------------------------------	--

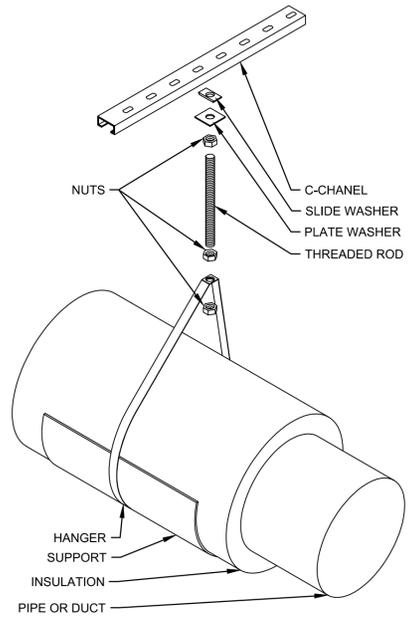


**1** DETAIL NTS  
M65 HORIZONTAL DUCT AND PIPE HANGER

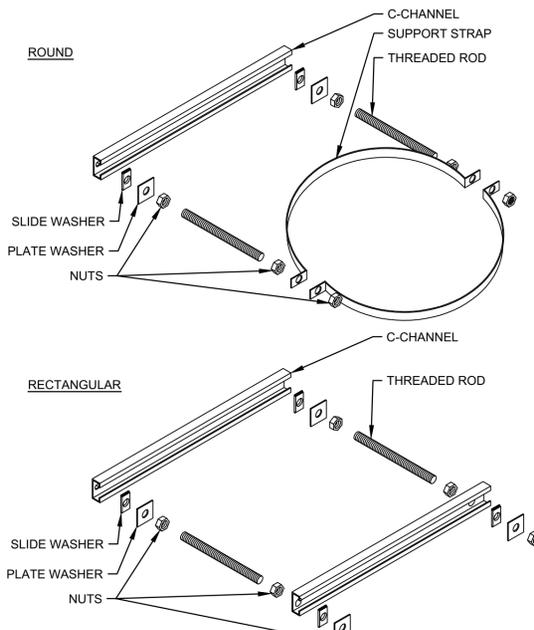


**2** DETAIL NTS  
M65 VERTICAL DUCT AND PIPE SUPPORT

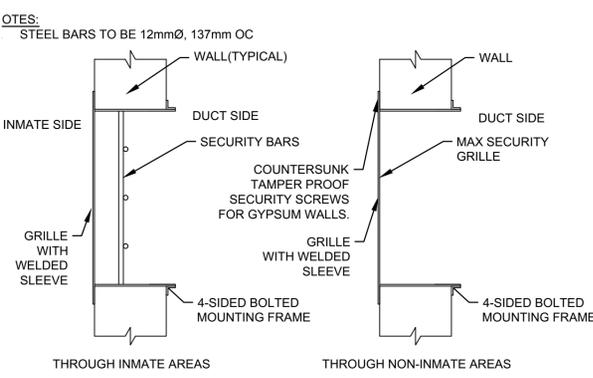


**4** DETAIL NTS  
M65 TYPICAL MAXIMUM SECURITY GRILLE INSTALL

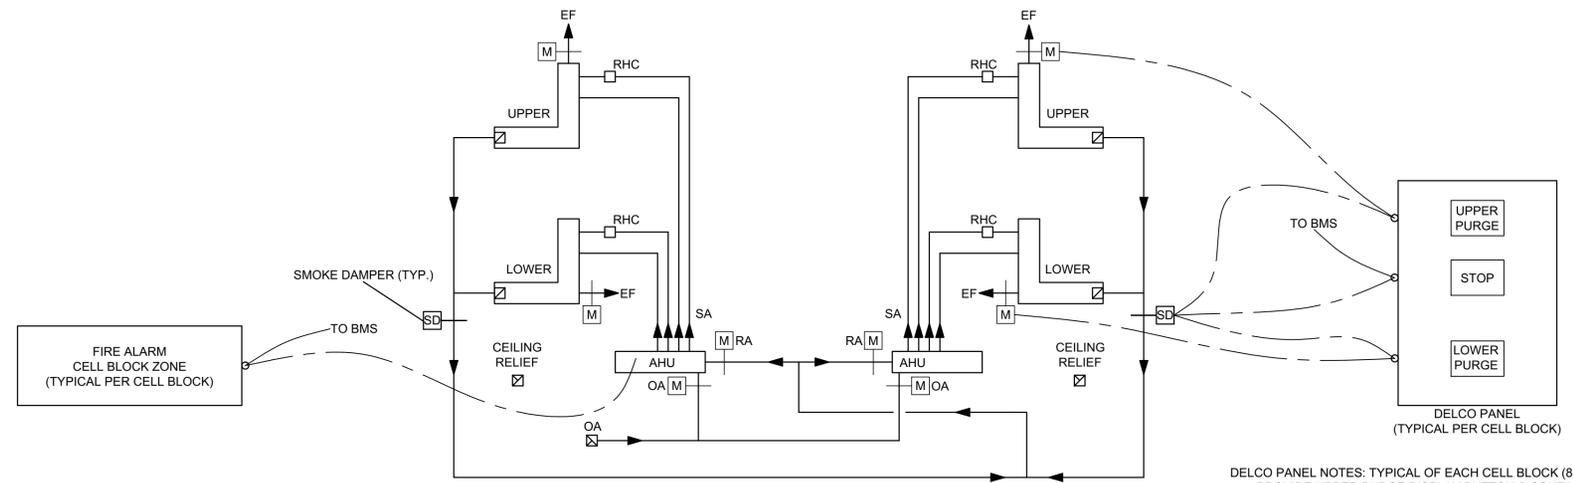

**3** DIAGRAM NTS  
CELL UNIT HVAC(TYP.)

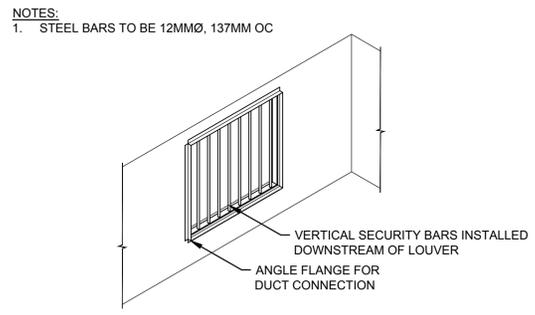

**5** DETAIL NTS  
M65 SG SECURITY LOUVER INSTALL

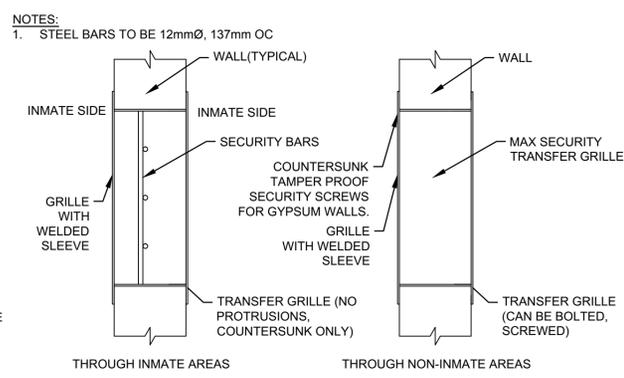

**6** DETAIL NTS  
M65 TYPICAL MAXIMUM SECURITY TRANSFER GRILLE INSTALL

DELCO PANEL NOTES: TYPICAL OF EACH CELL BLOCK (8 TOTAL)

- PROVIDE UPPER PURGE DISPLAY BUTTON & CONTACTS
- PROVIDE LOWER PURGE DISPLAY BUTTON & CONTACTS
- PROVIDE STOP PURGE DISPLAY BUTTON & CONTACTS
- PURGE MODE ACTIVATION SHALL INCLUDE DIGITAL RUN TIMER CODED TO 1 HR.

WORK ON SECURITY SYSTEM TO BE BY DELCO SECURITY.  
CONTACT: ADAM GRABKA  
EMAIL: grabka@delcoautomation.com  
PHONE: 780-394-2435

CONTROLS NOTES:

- CONTROLS CONTRACTOR TO CONNECT THE CONTACT AND RELAYS AS REQUIRED FOR THE INTERLOCKS NOTED IN THE CONTROLS SEQUENCE.
- INTERLOCK THE FANS WITH THEIR CORRESPONDING MOTORIZED DAMPER.

NOTES:  
1. STEEL BARS TO BE 12MMØ, 137MM OC

NOTES:  
1. STEEL BARS TO BE 12mmØ, 137mm OC