



A PLAN 1:75
E3 UPPER LEVEL WEST MECHANICAL ROOM

- NOTES:
- AHU-30 IS BEING RELOCATED APPROXIMATELY 10 METERS AWAY FROM EXISTING LOCATION. RUN NEW CONDUIT AND CABLE FROM EXISTING LOCATION AS REQUIRED.
 - DISCONNECT AND PROTECT EXISTING POWER CABLES FOR DWH-3 AND 4. ONCE NEW WATER HEATERS ARE INSTALLED, RECONNECT EXISTING POWER CABLES. RE-USE EXISTING BREAKERS.



- LEGEND:
- LOADS BEING DEMOLISHED. DISCONNECT LOAD AND DEMOLISH EXISTING BREAKER AND STARTER
 - LOADS BEING REPLACED. DEMOLISH BREAKER, STARTER AND DISCONNECT SWITCH, IF PRESENT. DISCONNECT LOAD. RECONNECT LOAD AS PER SINGLE LINE DIAGRAM AND EQUIPMENT SCHEDULE
 - NEW LOAD. REFER TO SLD AND ELECTRICAL EQUIPMENT SCHEDULE FOR REQUIREMENTS. INSTALL NEW DISCONNECT IF INDICATED.

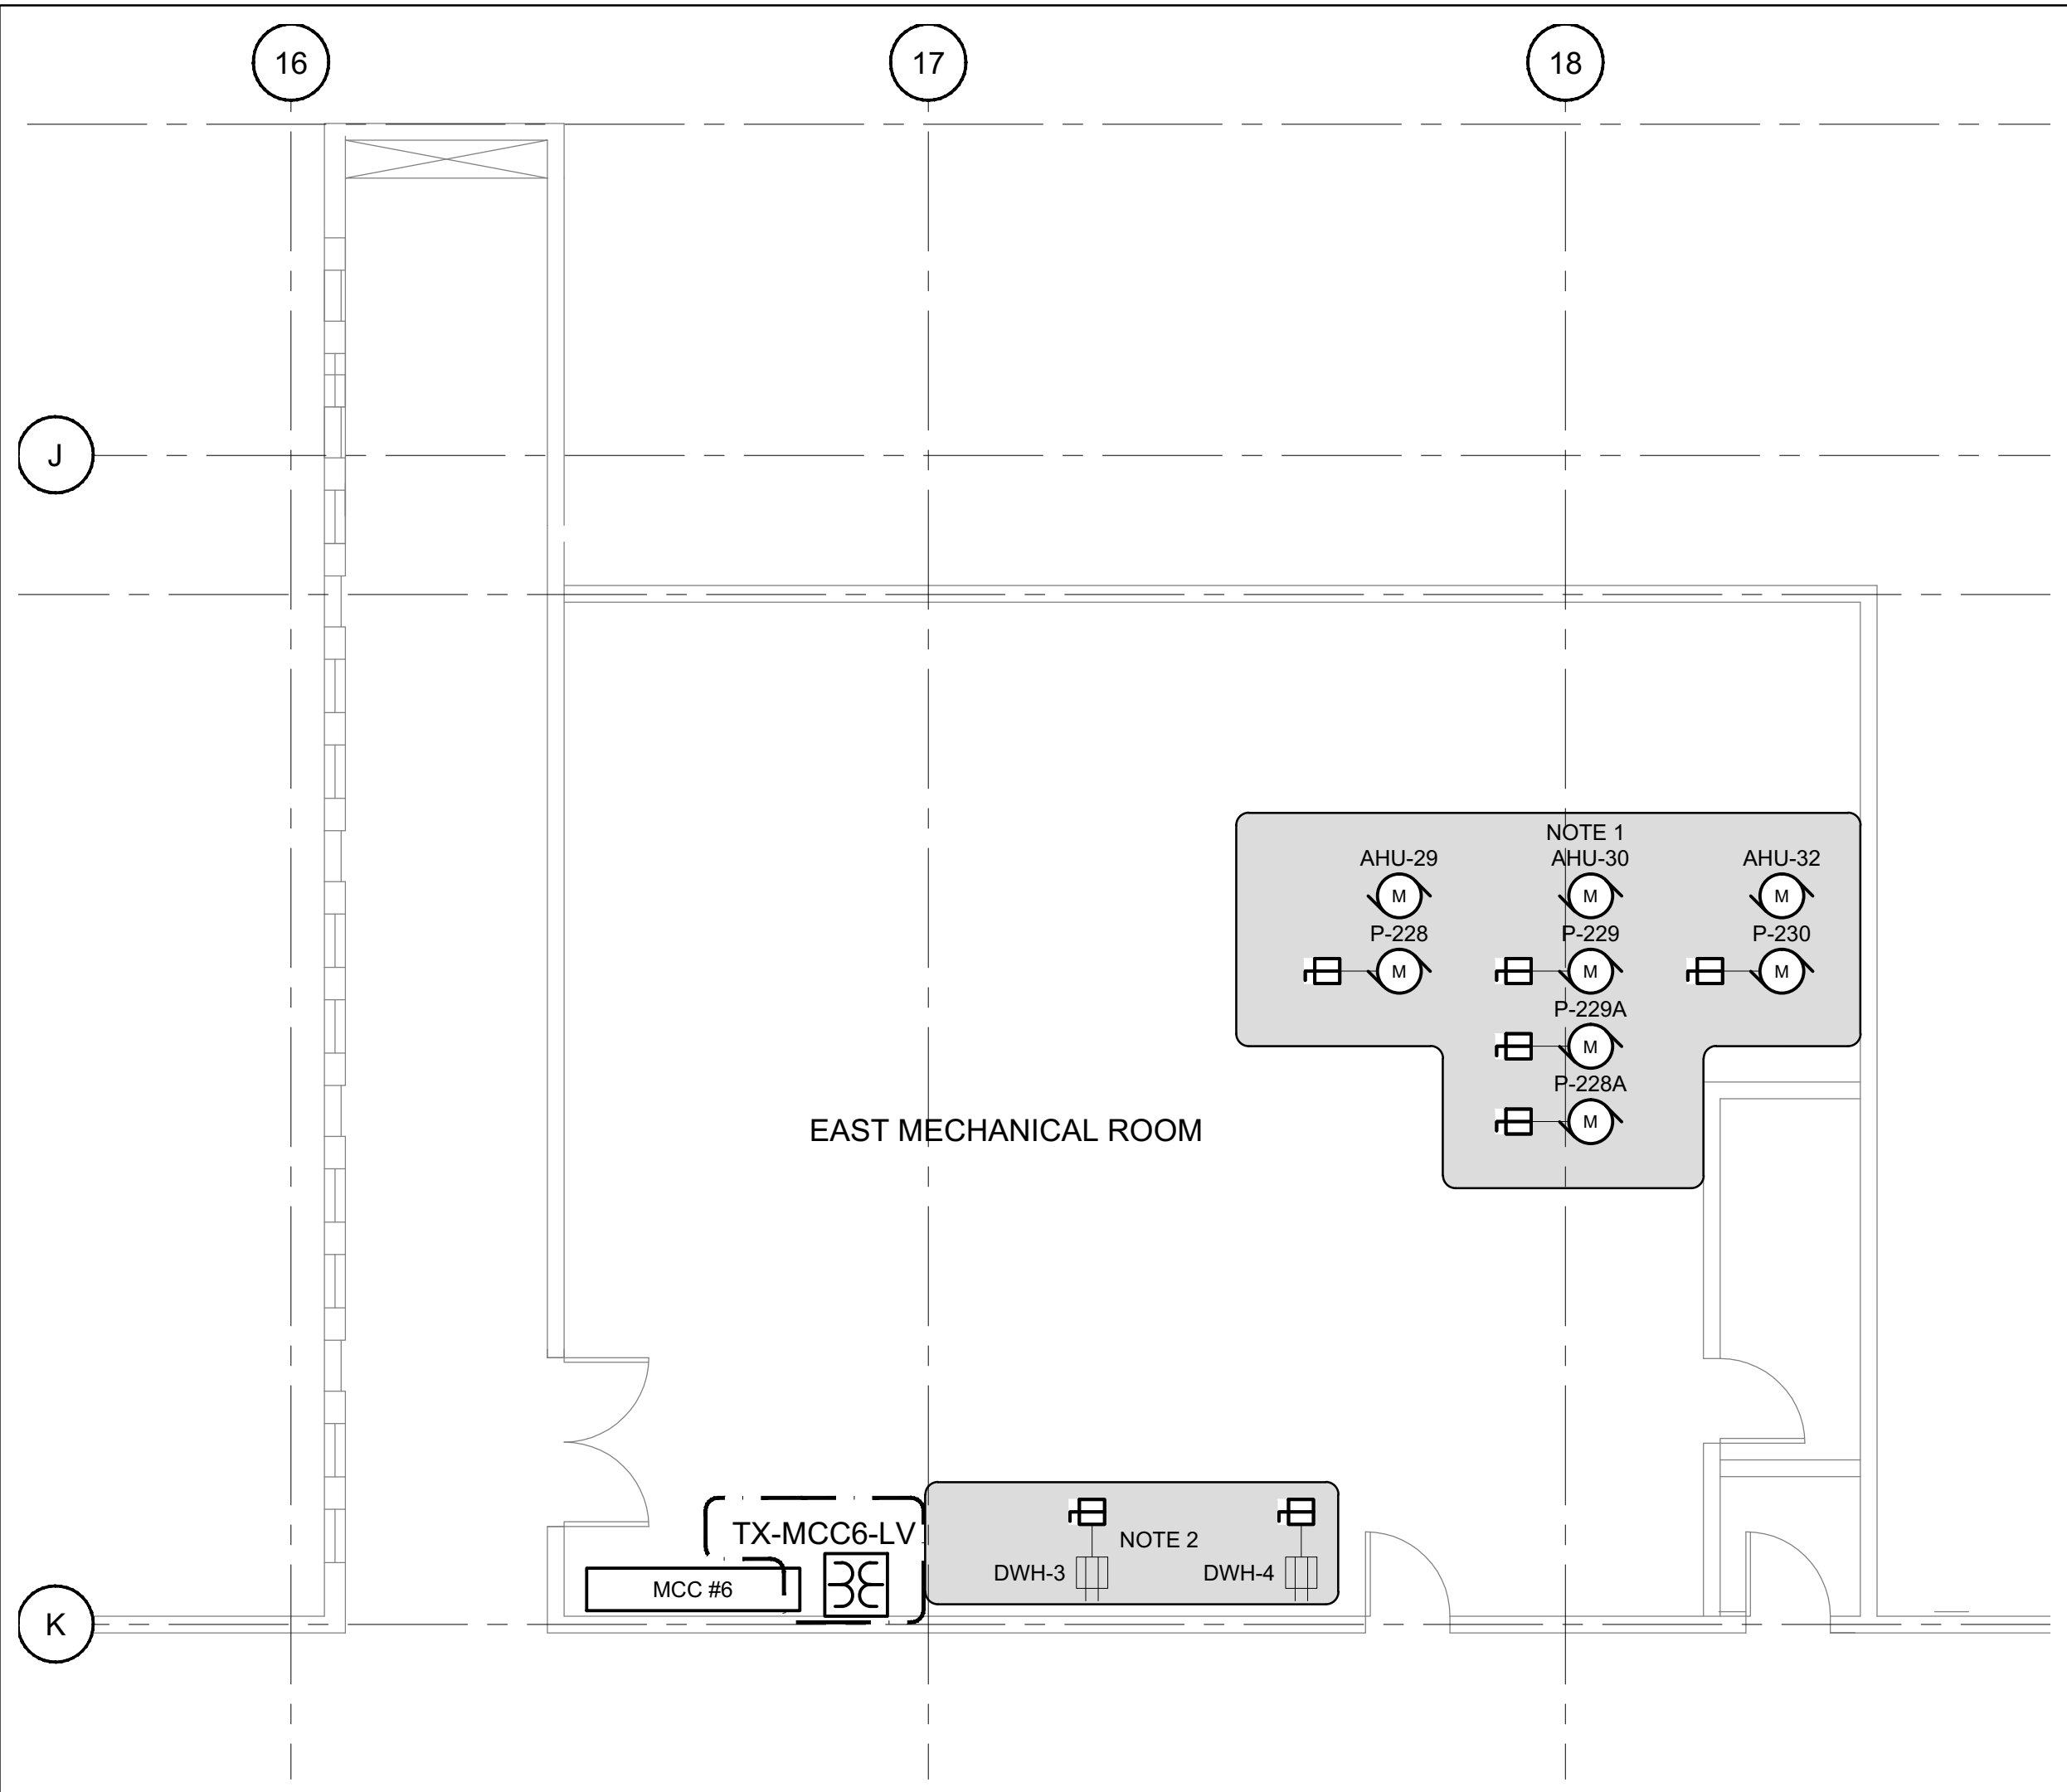

B PLAN 1:75
E4 UPPER LEVEL EAST MECHANICAL ROOM

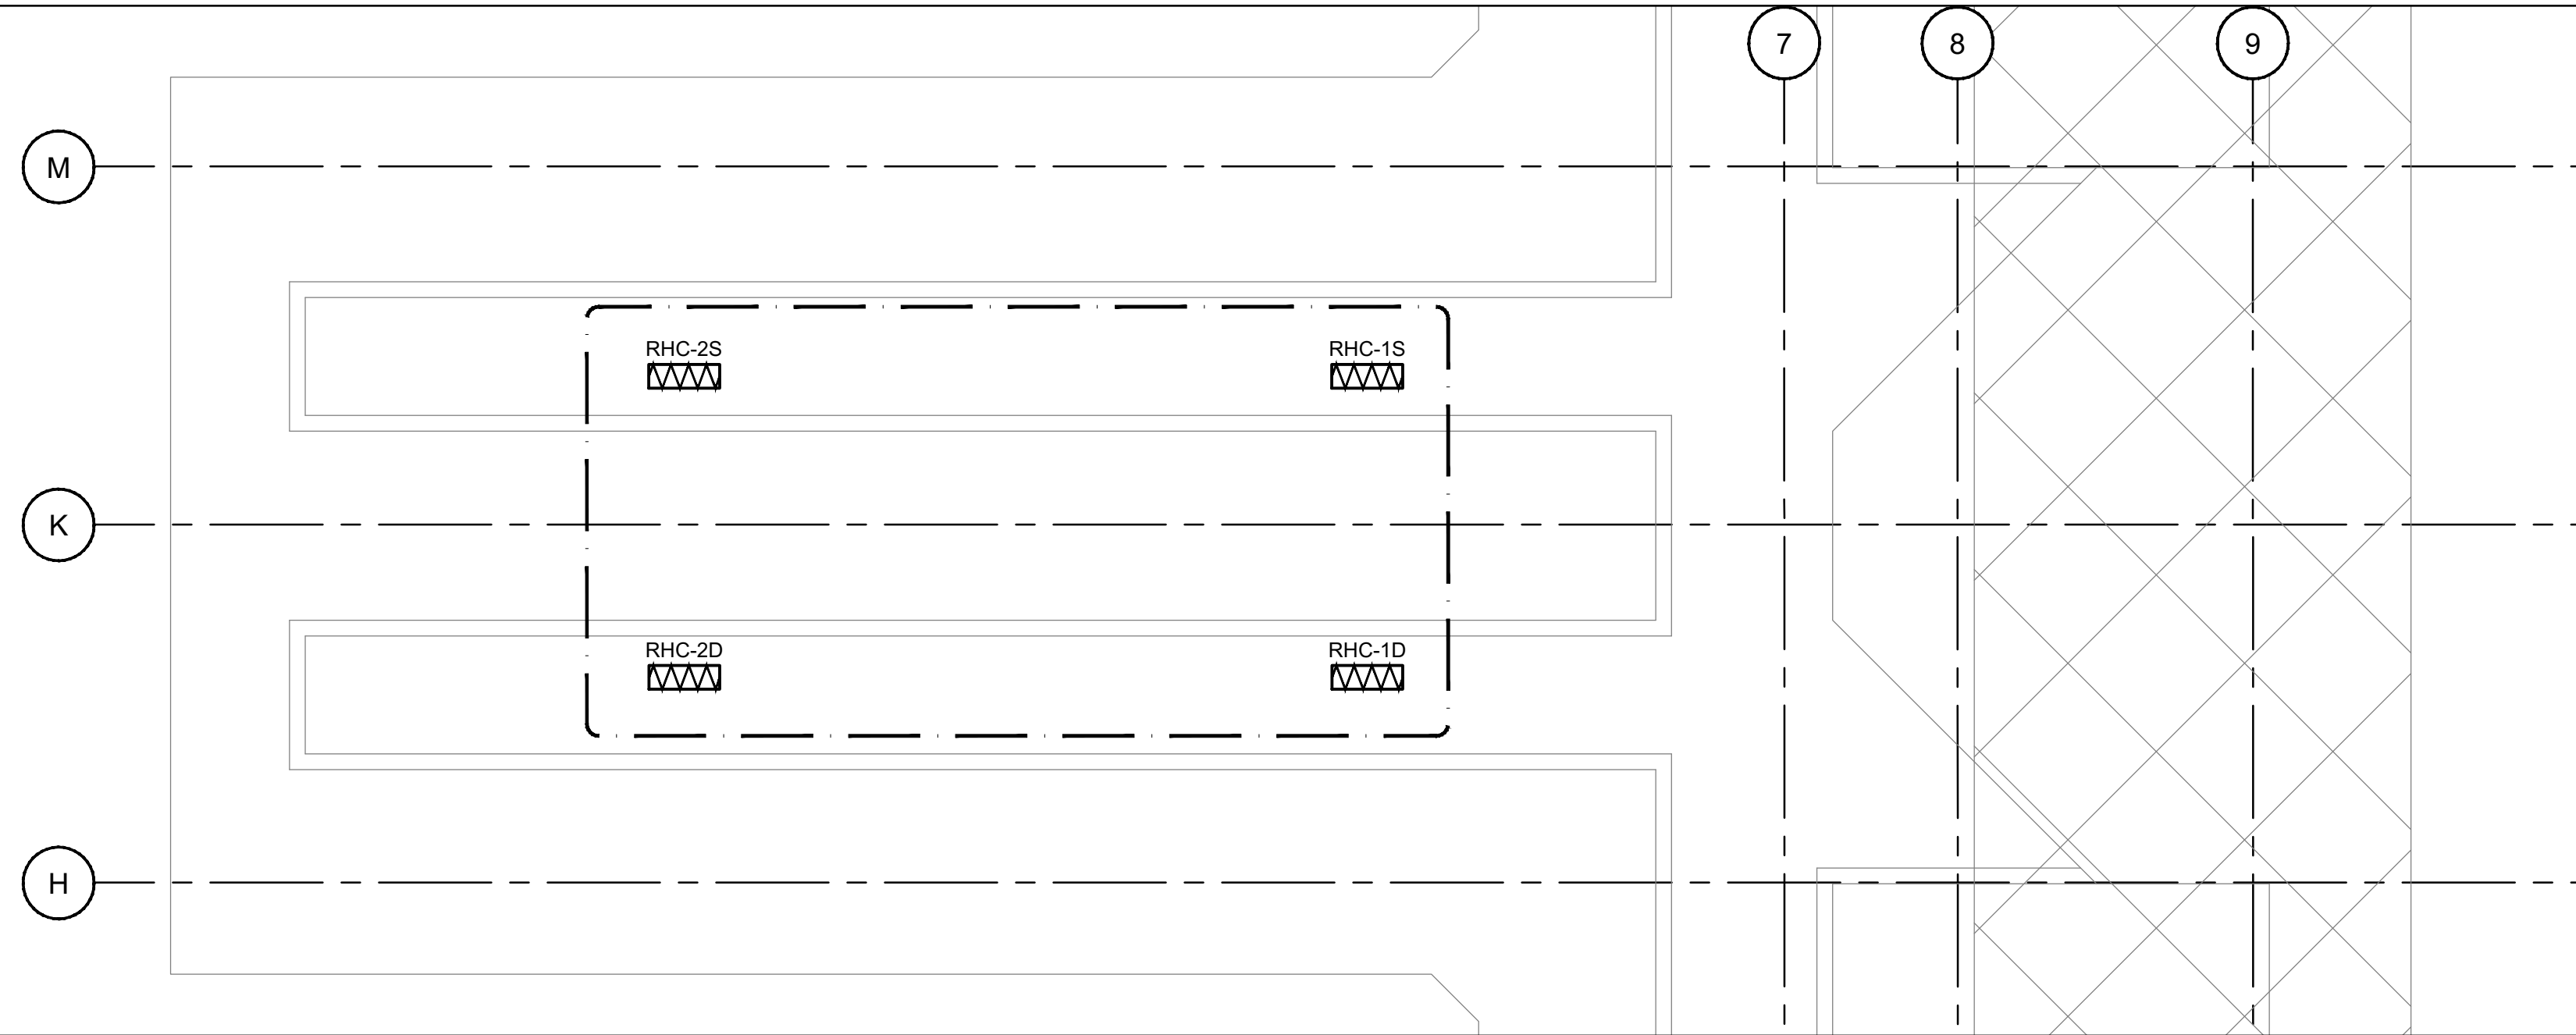

C PLAN 1:75
E4 S AND D BLOCK ROOF

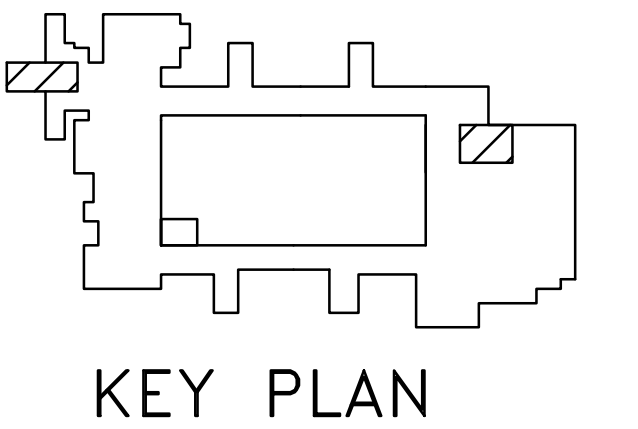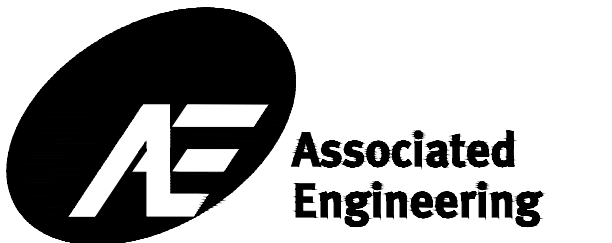

APEGA
PERMIT TO
PRACTICE
P 3979

Revision/Revision	Description/Description	Date/Date
0	ISSUED FOR TENDER	2017.06.16

Client/client
PUBLIC WORKS & GOVERNMENT SERVICES CANADA

Project title/Titre du projet

EDMONTON MAXIMUM SECURITY INSTITUTION

Approved by/Approuvé par
JM

Designed by/Concept par
JS/KD

Drawn by/Dessiné par
RJN

PWGSC Project Manager/Administrateur de Projets TPSGC
ANDREW GILLESSE

PWGSC, Architectural and Engineering Resources Manager/
Ressources Architectural et de Directeur d'Ingénierie, TPSGC

Client/client
PUBLIC WORKS & GOVERNMENT SERVICES CANADA

Drawing title/Titre du dessin

**UPPER LEVEL
EAST AND WEST
MECHANICAL ROOMS
EQUIPMENT LAYOUT**

Project No./No. du projet
R.078013.001

Sheet/Feuille
E5

Revision no./
La Révision
no.
0
OF 103