


PRELIMINARY
NOT FOR CONSTRUCTION


HDK HDK CONSULTING INCORPORATED
55-81 Garry St.
Winnipeg, Manitoba
Canada, R3C 4J9
T: 204.618.0389
F: 204.618.0388
www.hdkconsulting.com
info@hdkconsulting.com
Mechanical | Electrical | Communications | Security Engineering

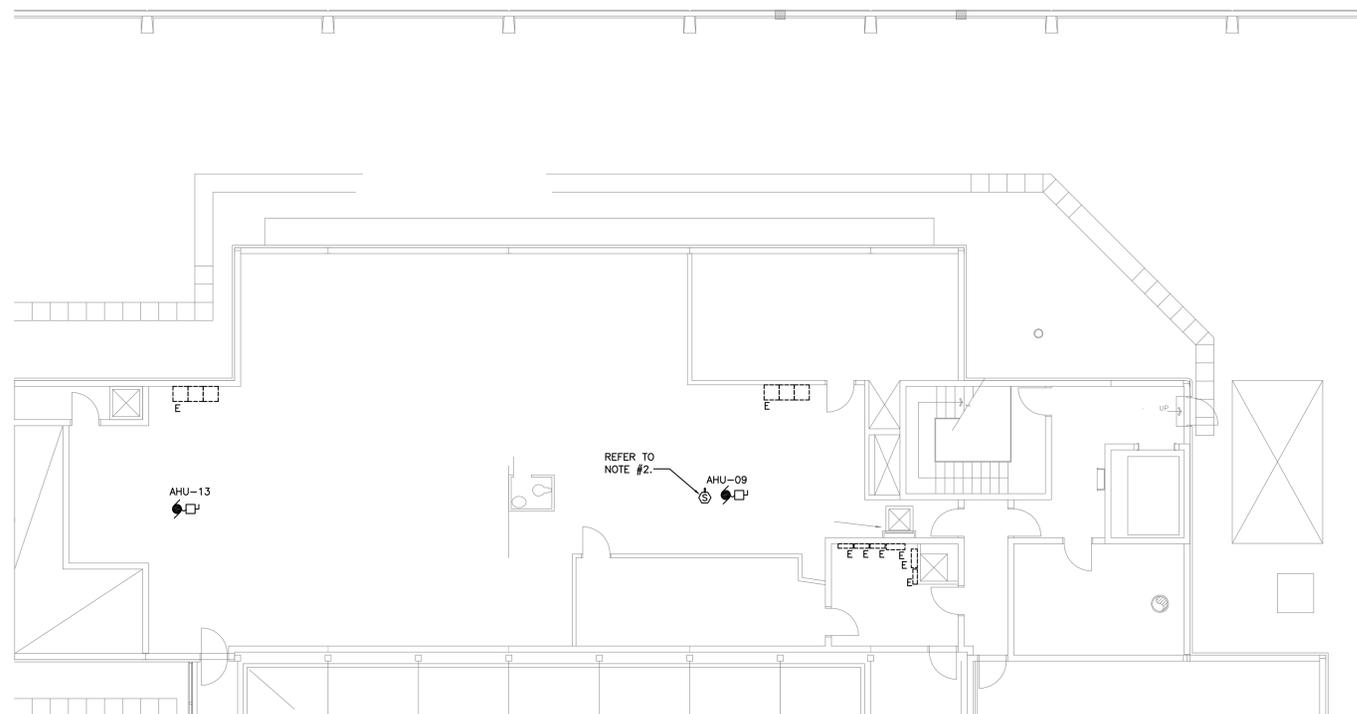


2 PARTIAL ELECTRICAL – PENTHOUSE NEW POWER PLAN
E2.2 | E2.2 1:100

NOTES:

1. PROVIDE FIRE ALARM VERIFICATION OF ALL FIRE ALARM ZONES AND DEVICES AFFECTED BY RENOVATION.
2. SUPPLY AND INSTALL NEW SMOKE DUCT DETECTOR FOR AIR HANDLING UNIT 'AHU-9'. WIRE AND CONNECT TO DEDICATED ZONE BACK TO EXISTING 'EDWARDS EST-2' FIRE ALARM CONTROL PANEL LOCATED IN BASEMENT ELECTRICAL ROOM. REFER TO MECHANICAL EQUIPMENT SCHEDULE.
3. PROVIDE FIRE ALARM VERIFICATION FOR ALL AFFECTED FIRE ALARM ZONES/LOOPS.

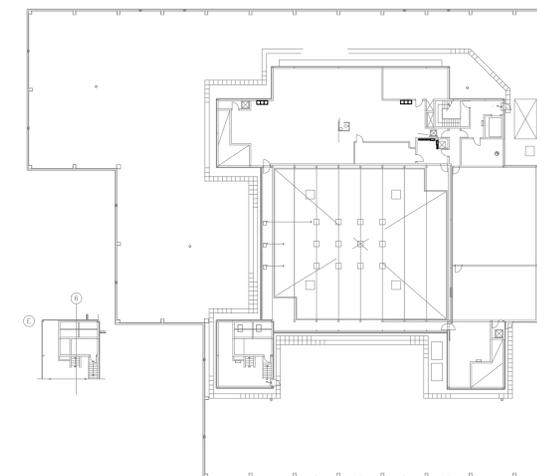

1 ELECTRICAL PENTHOUSE – KEYPLAN
E2.2 | E2.2 N.T.S.



Revision	Description	Date
5		
4		
3		
2	ISSUED FOR CONSTRUCTION	FEB 23/15
1	ISSUED FOR 99% REVIEW	DEC 22/14
0	ISSUED FOR 50% REVIEW	OCT 20/14

Client: **ROYAL CANADIAN MOUNTED POLICE D-DIVISION**
1091 PORTAGE AVENUE
WINNIPEG, MANITOBA

Project: **WINNIPEG, MANITOBA 1091 PORTAGE AVENUE D-DIVISION HEADQUARTERS FIRING RANGE UPGRADE**

Designed by: **HUGO CEA CANAS / PAUL LAPOINTE** Conçu par

Drawn by: **PAUL LAPOINTE** Dessiné par

Approved by: **HUGO CEA CANAS** Approuvé par

PWOSC Project Manager: **PAUL DUCHARME** Administrateur de Projets TPSCG

Drawing title: **PARTIAL ELECTRICAL PENTHOUSE NEW POWER PLAN** Titre du dessin

Project no./No. du projet	Drawing no./No. du dessin	Revision no.
	E2.2 OF XX	0