



**RETURN BIDS TO:**

**RETOURNER LES SOUMISSIONS À:**

Bid Receiving Public Works and Government  
Services Canada/Réception des soumissions Travaux  
publics et Services gouvernementaux Canada  
800 Burrard Street, Room 219  
800, rue Burrard, pièce 219  
Vancouver  
British Columbia  
V6Z 0B9  
Bid Fax: (604) 775-9381

**SOLICITATION AMENDMENT  
MODIFICATION DE L'INVITATION**

The referenced document is hereby revised; unless otherwise  
indicated, all other terms and conditions of the Solicitation  
remain the same.

Ce document est par la présente révisé; sauf indication contraire,  
les modalités de l'invitation demeurent les mêmes.

**Comments - Commentaires**

**Vendor/Firm Name and Address  
Raison sociale et adresse du  
fournisseur/de l'entrepreneur**

**Issuing Office - Bureau de distribution**  
Public Works and Government Services Canada - Pacific  
Region  
800 Burrard Street, Room 219  
800, rue Burrard, pièce 219  
Vancouver  
British C  
V6Z 0B9

<b>Title - Sujet</b> Air Handler/Manifold Replacement	
<b>Solicitation No. - N° de l'invitation</b> 39903-180402/A	<b>Amendment No. - N° modif.</b> 004
<b>Client Reference No. - N° de référence du client</b> 39903-180402	<b>Date</b> 2017-10-05
<b>GETS Reference No. - N° de référence de SEAG</b> PW-\$PWY-025-8166	
<b>File No. - N° de dossier</b> PWY-7-40174 (025)	<b>CCC No./N° CCC - FMS No./N° VME</b>
<b>Solicitation Closes - L'invitation prend fin</b> <b>at - à 02:00 PM</b> <b>on - le 2017-10-17</b>	
<b>F.O.B. - F.A.B.</b> <b>Plant-Usine:</b> <input type="checkbox"/> <b>Destination:</b> <input checked="" type="checkbox"/> <b>Other-Autre:</b> <input type="checkbox"/>	
<b>Address Enquiries to: - Adresser toutes questions à:</b> Fung, Donna(PWY)	<b>Buyer Id - Id de l'acheteur</b> pwy025
<b>Telephone No. - N° de téléphone</b> (604) 671-9689 ( )	<b>FAX No. - N° de FAX</b> (604) 775-6633
<b>Destination - of Goods, Services, and Construction:</b> <b>Destination - des biens, services et construction:</b> CFIA - Burnaby Lab - Burnaby, BC	

**Instructions: See Herein**

**Instructions: Voir aux présentes**

<b>Delivery Required - Livraison exigée</b>	<b>Delivery Offered - Livraison proposée</b>
<b>Vendor/Firm Name and Address</b> <b>Raison sociale et adresse du fournisseur/de l'entrepreneur</b>	
<b>Telephone No. - N° de téléphone</b> <b>Facsimile No. - N° de télécopieur</b>	
<b>Name and title of person authorized to sign on behalf of Vendor/Firm</b> <b>(type or print)</b> <b>Nom et titre de la personne autorisée à signer au nom du fournisseur/ de l'entrepreneur (taper ou écrire en caractères d'imprimerie)</b>	
<b>Signature</b>	<b>Date</b>

Solicitation No. - N° de l'invitation  
39903-180402

Amd. No. - N° de la modif.  
004

Buyer ID - Id de l'acheteur  
pwy025

Client Ref. No. - N° de réf. du client

File No. - N° du dossier CCC No./N°

CCC - FMS No./N° VME

---

The Solicitation Amendment 004 is raised to issue Addendum 003.

Please find Addendum 003 herein.

All other terms and conditions remain unchanged.

## ADDENDUM #3

Date: October 5, 2017

CANADIAN FOOD INSPECTION AGENCY  
AHU REPLACEMENT/EXHAUST MANIFOLD  
BURBABY BC  
Project No: R.39903-180402

---

The following revisions supersede the information contained in the original drawings and specification issued for the above named project, and shall become part thereof. No consideration will be allowed for extras due to the contractor or any subcontractor not being familiar with this Addendum.

---

### **1.0 CONTRACTOR QUESTIONS:**

1. Please clarify what type or number stormceptor is required.

**Response: Oil Interceptor unit specifications are found in Clause 2.11 of Specification 33 40 01. The Contractor will be required to source from a supplier and submit shop drawings of a proposed unit for review and approval by the Departmental Representative prior to installation.**

2. The drawings note to prepare and submit an Erosion and Sediment Control Plan. Please confirm this requirement is needed.

**Response: Yes. Guichon Creek (which leads to Still Creek) is immediately adjacent to and downstream of the site, so adequate protection measures must be in place during construction.**

3. Spec Section 02 41 99 item 1.4.1 indicate hazardous materials have been identified in the building. Please provide the hazardous materials survey.

**Response: An asbestos survey was conducted and will be released to the successful bidder upon award. Note that the survey identifies asbestos containing materials in the areas identified in point 1.4.1 of section 02 41 99 of the specification.**

4. Please clarify the staging area(s) to be made available for the contractor's use. Please also confirm the area provided is sufficient to hold the number of bins required by the Waste Management Plan.

**Response: The Contractor will be able to use the fenced enclosure in which the AHU's will eventually be located along with the shipping container (40 ft.) for storage. One waste bin can be placed on the side of the building along the existing driving on the east side of the building.**

5. Please provide details for the new guardrails at the roof.

**Response: Refer to 5/A214 for a typical guardrail detail.**

## ADDENDUM #3

Date: October 5, 2017

CANADIAN FOOD INSPECTION AGENCY  
AHU REPLACEMENT/EXHAUST MANIFOLD  
BURBABY BC  
Project No: R.39903-180402

---

The following revisions supersede the information contained in the original drawings and specification issued for the above named project, and shall become part thereof. No consideration will be allowed for extras due to the contractor or any subcontractor not being familiar with this Addendum.

---

6. The architectural drawings show a number of exhaust fans to be removed. However, the drawings do not indicate if these are to be capped, re-roofed, etc. Please clarify.

**Response: “Refer to mechanical drawings M-200 through M-211 for information on exhaust fan removal/new duct connections/new duct routing. Refer to detail “TYP. ROOF EXHAUST FAN REMOVAL AND NEW CONNECTION” on sheet M-212 for additional information.”**

7. Specification Section 31.63.33.2.5 requires the application and protection of a viscous coating on the Micro Pile surface. Please specify a pre-approved coating for use with micro-piles installed using a down-hole hammer.

**Response: Nano painting or bitumen are acceptable coatings.**

### **2.0 ARCHITECTURAL DRAWINGS:**

1. Revise PARTIAL A04 – CRAWL SPACE NEW PLAN as per attached AD-01.

END OF ADDENDUM #3




Public Works and  
Government Services  
Canada

Travaux publics et  
Services gouvernementaux  
Canada

REAL PROPERTY SERVICES  
Pacific Region

SERVICES IMMOBILIERS  
Region de Pacifique

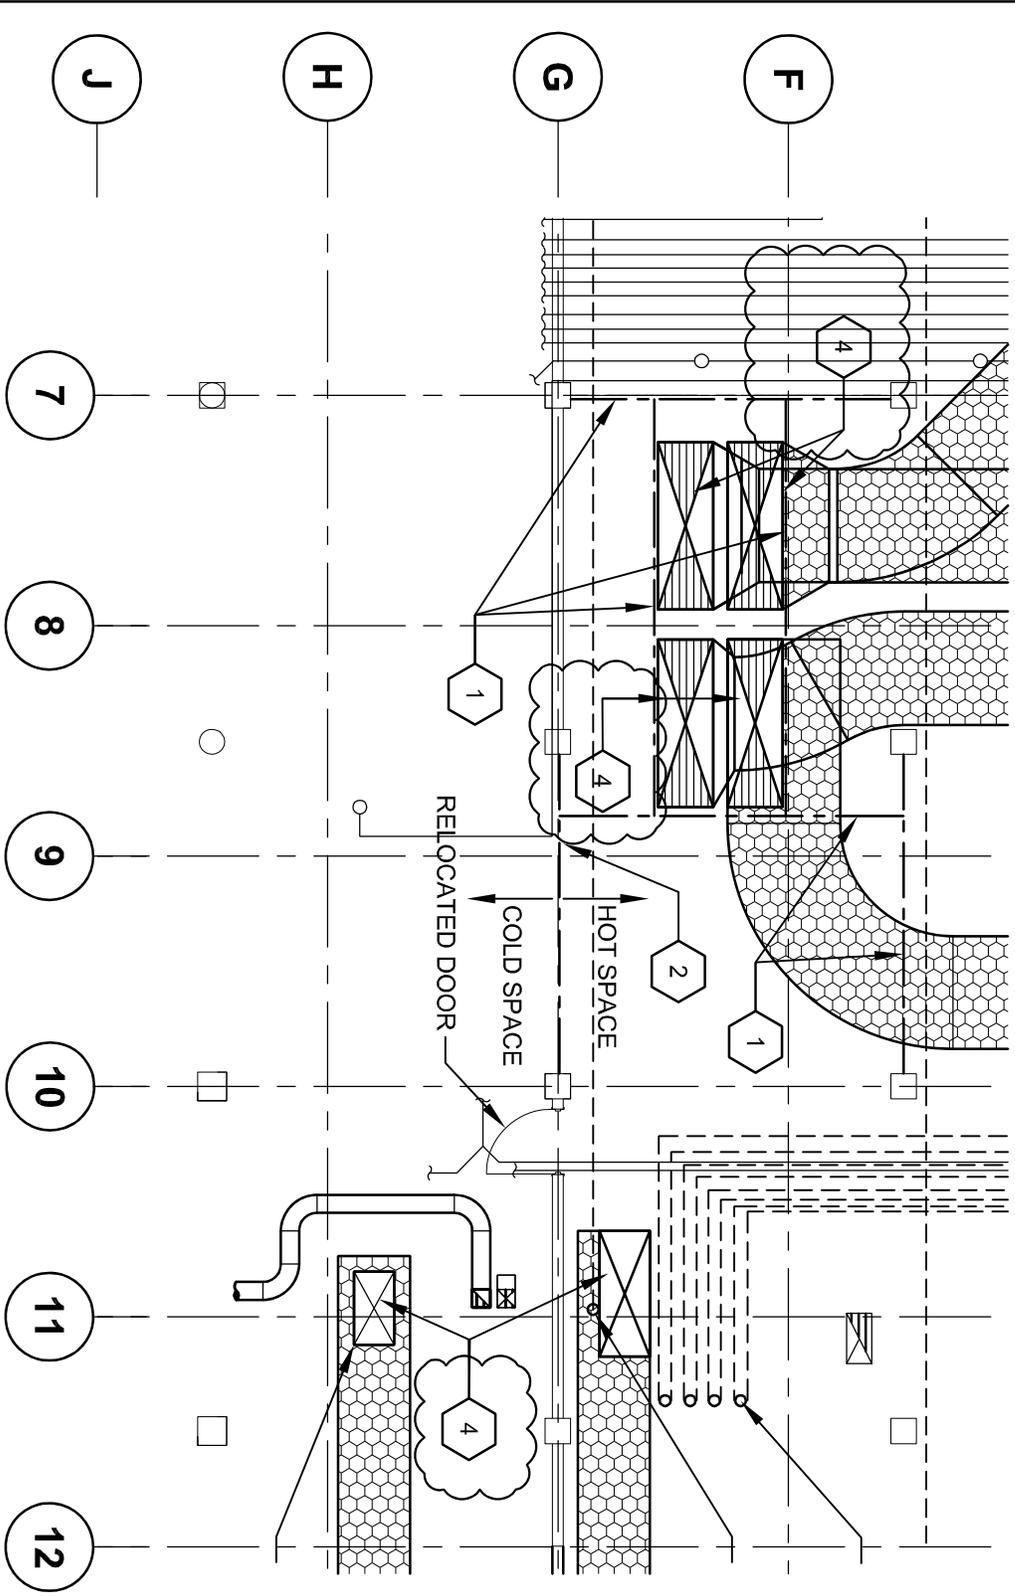

Project title/Titre du projet

Drawing title/Titre du dessin

Consultant Signature/Only

PWOSC Project Manager/Administrateur  
de Projets TPSGC

Scale/Echelle  
1:100

**CFIA - AHU & EXHAUST MANIFOLD  
SYSTEM REPLACEMENTS**

3155 WILLINGDON GREEN, BURNABY, BC V5G 4P2

**PARTIAL A04 - CRAWL SPACE  
NEW PLAN**

Designed by/Concept par  
RC

Project No./No. du projet  
35023

Date/Date  
OCT. 04, 2017

Drawn by/Dessiné par  
LM

35023

Sheet/Feuille

Revision/  
Révision  
ADD-01