

2 PARTIAL 2nd FLOOR PLAN POWER AND SYSTEMS DEMOLITION  
1:100

GENERAL NOTES:


1. REMOVE ALL POWER AND COMMUNICATION OUTLETS AS WELL AS EXISTING PACK POLES UNLESS INDICATED OTHERWISE.
2. PULL POWER WIRING TO THE NEAREST POWER ZONE JUNCTION BOX IN THE CEILING SPACE. WHERE EXISTING CIRCUITS ARE TIED DIRECTLY TO THE PANEL, CONTRACTOR MAY EXTEND AND RE-USE EXISTING CIRCUITS FOR THE NEW CONSTRUCTION. WHERE EXISTING CIRCUITS ARE TIED DIRECTLY TO THE PANEL AND ARE NOT REQUIRED FOR THE NEW CONSTRUCTION, CONTRACTOR SHALL PULL THE CIRCUITS BACK TO THE RESPECTIVE PANEL.
3. PULL EXISTING COMMUNICATION WIRING BACK TO THE PATCH PANEL. COORDINATE THE REMOVAL OF THE EXISTING PATCH PANEL WITH OWNER'S IT TEAM.
4. MODIFY RESPECTIVE PANEL SCHEDULE(S): INDICATE UNUSED CIRCUITS AS "SPARE".
5. RECORD ALL CIRCUIT NUMBERS ASSOCIATED WITH EACH JUNCTION BOX ON AS-BUILT DRAWINGS.

KEYNOTES:

- (N-1) ENGAGE BUILDING FIRE ALARM CONTRACTOR TO DISCONNECT HORN/STROBE DEVICES, ENSURING THAT THE REMAINDER OF THE FIRE ALARM SYSTEM CONTINUES TO FUNCTION.
- (N-2) NOT USED.
- (N-3) COORDINATE REMOVAL OF EXISTING ACCESS CONTROL DEVICES WITH IIT. ONCE DEVICES HAVE BEEN REMOVED AND WIRING HAS BEEN DISCONNECTED FROM THE ACCESS CONTROL HARDWARE, REMOVE THE UNUSED WIRING, CONDUIT AND ANY ASSOCIATED ROUGH-INS.
- (N-4) DISCONNECT AND REMOVE THE EXISTING PACK POLE. DISCONNECT POWER FROM THE SYSTEM FURNITURE AND PULL BACK TO THE NEAREST POWER ZONE JUNCTION BOX.
- (N-5) RELOCATE EXISTING SMARTBOARD, CEILING MOUNTED PROJECTOR AND THE VIDEO CABLES ASSOCIATED WITH THE PROJECTOR TO THE NEW BOARDROOM. REFER TO DRAWING E2.0 FOR ADDITIONAL INFORMATION.


SCOPE OF WORK:

- A. ALL WORK INDICATE ON THIS DRAWING SHALL BE UNDER TENANT'S SCOPE OF WORK UNLESS NOTED OTHERWISE.
- B. DEMOLITION OF DEVICES IN THIS AREA IS OUTSIDE OF CONTRACTOR'S SCOPE OF WORK. WHERE WIRING AND COMMUNICATION CABLING RUNS THROUGH THIS AREA, THE WORK SHALL BE COMPLETED AS PER KEYNOTES AND GENERAL NOTES ON THIS DRAWING.
- C. DEMOLITION ON THE EXISTING TELECOM ROOM SHALL NOT COMMENCE UNTIL THE NEW TELECOM ROOM IS FULLY OPERATIONAL.



Smith + Andersen

2031 Portage Avenue 2nd Floor Winnipeg Manitoba R3J 0K6  
204 885 8668 smithandanderson.com

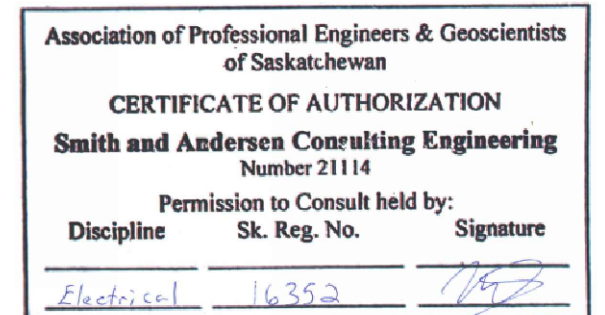

Revision	Description	Date
3	ISSUED FOR CONSTRUCTION	2017/05/18
2	ISSUED FOR 90% CD	2017/04/27
1	ISSUED FOR 50% CD	2017/04/03

Client: PUBLIC WORKS AND GOVERNMENT SERVICES CANADA (PWGSC)

PUBLIC WORKS AND GOVERNMENT SERVICES CANADA (PWGSC)

Project title: FORT QU'APPELLE, SASKATCHEWAN

2ND FLOOR, 740 SIOUX AVENUE  
INAC FORT QU'APPELLE OFFICE FIT-UP

INDIGENOUS AND NORTHERN AFFAIRS CANADA

Designed by: AA

Drawn by: LH

Approved by: MZ

Project Manager: Project Manager

Drawing title: PARTIAL 2nd FLOOR PLAN POWER AND SYSTEMS DEMOLITION

PARTIAL 2nd FLOOR PLAN  
POWER AND SYSTEMS  
DEMOLITION

Project number: 16729.001

Sheet number: E1.1

Revision: 3