





DUMAC ENERGY LTD.
CONSULTING ENGINEERS
752 BEDFORD HIGHWAY
DARTMOUTH, N.S.
Tel: (902) 491-1300
Fax: (902) 491-1777
Email: DUMAC@DUMAC.NS

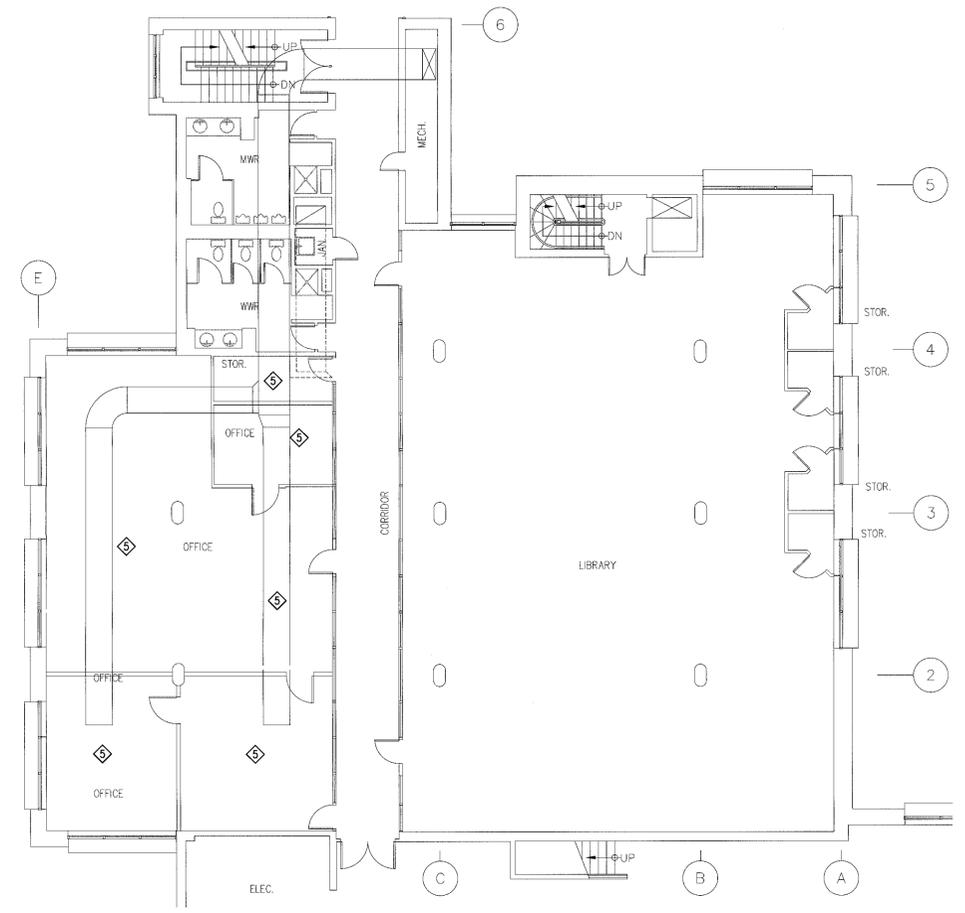


3RD LEVEL ELECTRICAL DEMOLITION

SCALE : 1:100
0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m

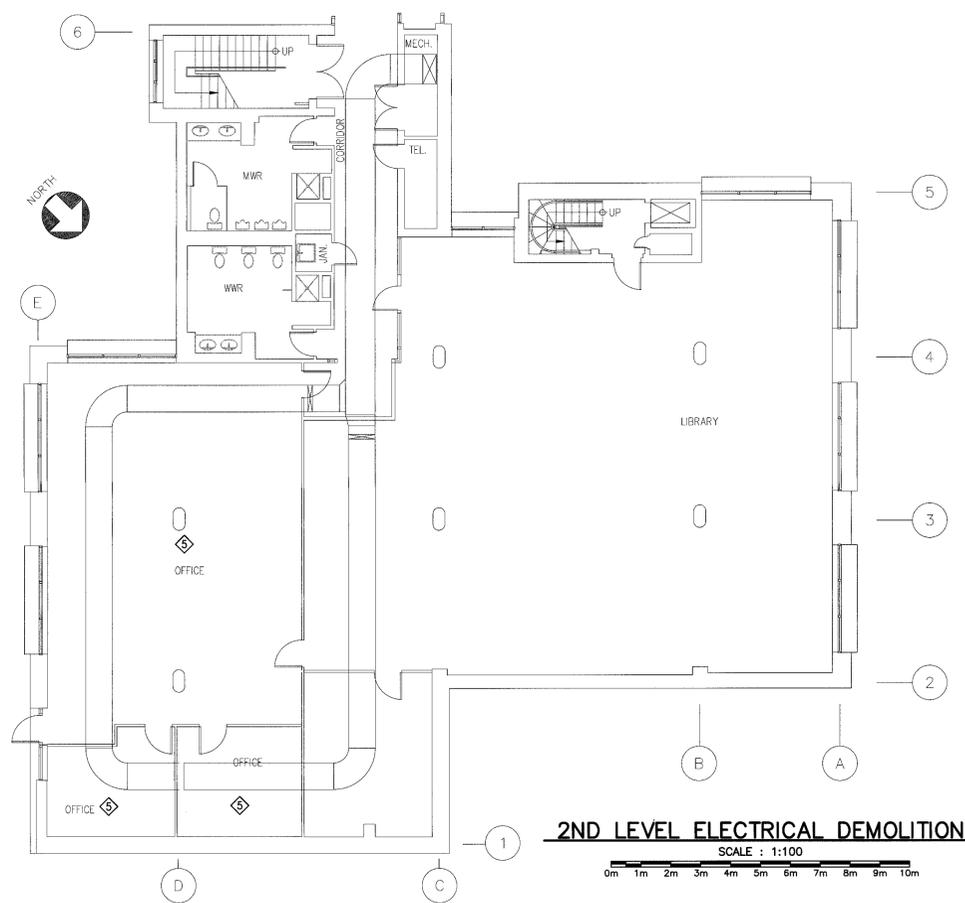


2ND LEVEL ELECTRICAL DEMOLITION

SCALE : 1:100
0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m

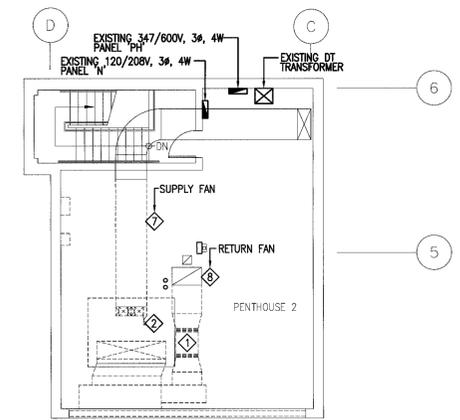

5TH LEVEL ELECTRICAL DEMOLITION

SCALE : 1:100
0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m

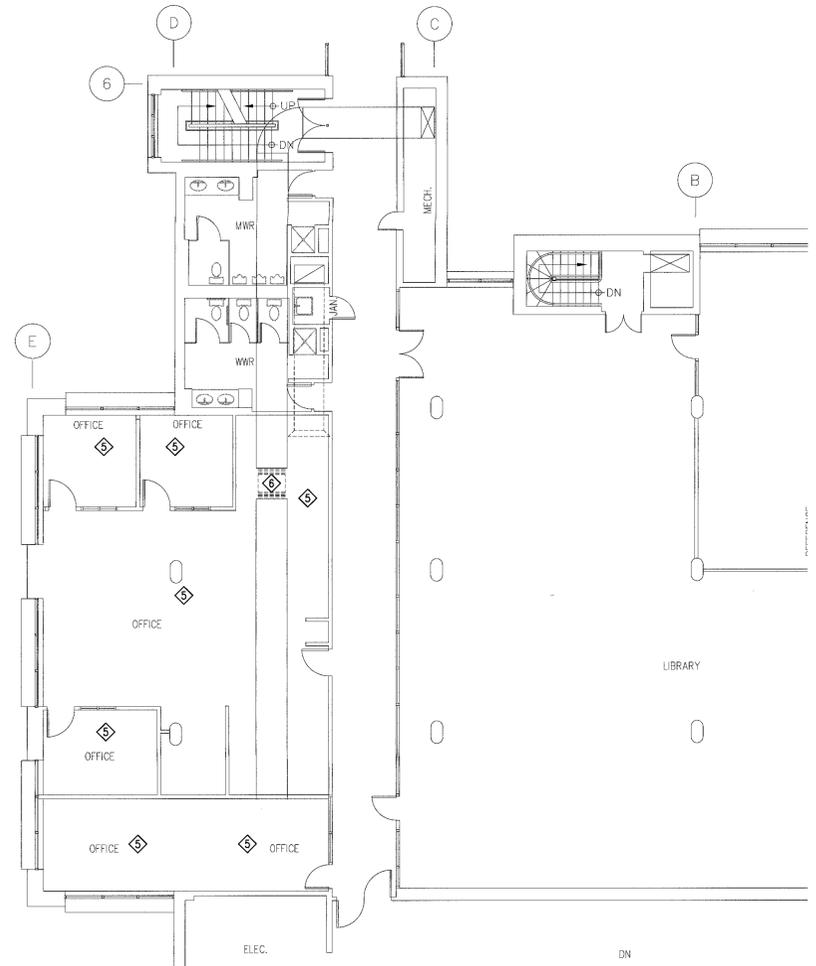

4TH LEVEL ELECTRICAL DEMOLITION

SCALE : 1:100
0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m

DEMOLITION NOTES:

- ◆ DISCONNECT AND REMOVE EXISTING ELECTRICAL EQUIPMENT, WIRE, CONDUIT, ETC. ASSOCIATED WITH EXISTING RETURN FAN #6.
- ◆ DISCONNECT AND REMOVE EXISTING ELECTRICAL EQUIPMENT, WIRE, CONDUIT, ETC. ASSOCIATED WITH EXISTING SUPPLY FAN #5.
- ◆ DISCONNECT AND REMOVE EXISTING ELECTRICAL EQUIPMENT, WIRE, CONDUIT, ETC. ASSOCIATED WITH EXISTING A/C UNIT ON ROOF.
- ◆ REPAIR AND MAKE WATERPROOF EXISTING HOLES IN EXTERIOR WALLS.
- ◆ ELECTRICAL CONTRACTOR SHALL DISCONNECT, REMOVE AND OR RELOCATE ALL EXISTING ELECTRICAL EQUIPMENT I.E. LIGHTING, OCCUPANCY SENSORS, FIRE ALARM DEVICES, EMERGENCY LIGHTING, EXIT LIGHTING, ETC. AS REQUESTED BY MECHANICAL CONTRACTOR, SO THAT THEY CAN REMOVE CEILING TO REMOVE EXISTING DUCTWORK AND INSTALL NEW. RE-INSTALL ALL EXISTING EQUIPMENT IN SAME LOCATIONS WHEN CEILING IS RE-INSTALLED.
- ◆ DISCONNECT AND REMOVE ALL EXISTING ELECTRICAL EQUIPMENT, WIRE, CONDUIT, ETC. ASSOCIATED WITH EXISTING A/C UNIT IN CEILING SPACE. LABEL EXISTING BREAKER AS SPARE.
- ◆ EXISTING FIRE ALARM DUCT MOUNTED SMOKE DETECTOR AND SUPPLY FAN SHUTDOWN RELAY TO BE DISCONNECTED FROM EXISTING SUPPLY FAN AND ASSOCIATED DUCTWORK. STORED DURING CONSTRUCTION AND RE-INSTALLED FOR NEW SUPPLY FAN WHEN NEW SUPPLY FAN IS INSTALLED. PROVIDE WRITTEN MANUFACTURERS VERIFICATION REPORT ON RE-INSTALLED DEVICES.
- ◆ EXISTING FIRE ALARM DUCT MOUNTED SMOKE DETECTOR AND RETURN FAN SHUTDOWN RELAY TO BE DISCONNECTED FROM EXISTING RETURN FAN AND ASSOCIATED DUCTWORK. STORED DURING CONSTRUCTION AND RE-INSTALLED FOR NEW RETURN FAN WHEN NEW RETURN FAN IS INSTALLED. PROVIDE WRITTEN MANUFACTURERS VERIFICATION REPORT ON RE-INSTALLED DEVICES.
- ◆ PROVIDE TEMPORARY LIGHTING AS REQUIRED IN SPACES WHERE PERMANENT LIGHTING HAS BEEN REMOVED FOR INSTALLATION OF MECHANICAL SERVICES.

1	FOR TENDER	17.03.31
revisions		date

project BEDFORD INSTITUTE OF OCEANOGRAPHY HOLLAND WEST VENTILATION UPGRADE DARTMOUTH NS

drawing ELECTRICAL DEMOLITION FLOOR PLANS

designed STAFF conçu

date

drawn STAFF dessiné

date

approved [Signature] approuvé

date 17.03.31

Tender Sourcilisation

project number R.082149.001 no. du projet

drawing no. E-1 no. du dessin