


KEY PLAN

SCALE/ÉCHELLE : 1:1000

0m 10m 20m 30m 40m 50m 60m 70m 80m 90m 100m

1
H1

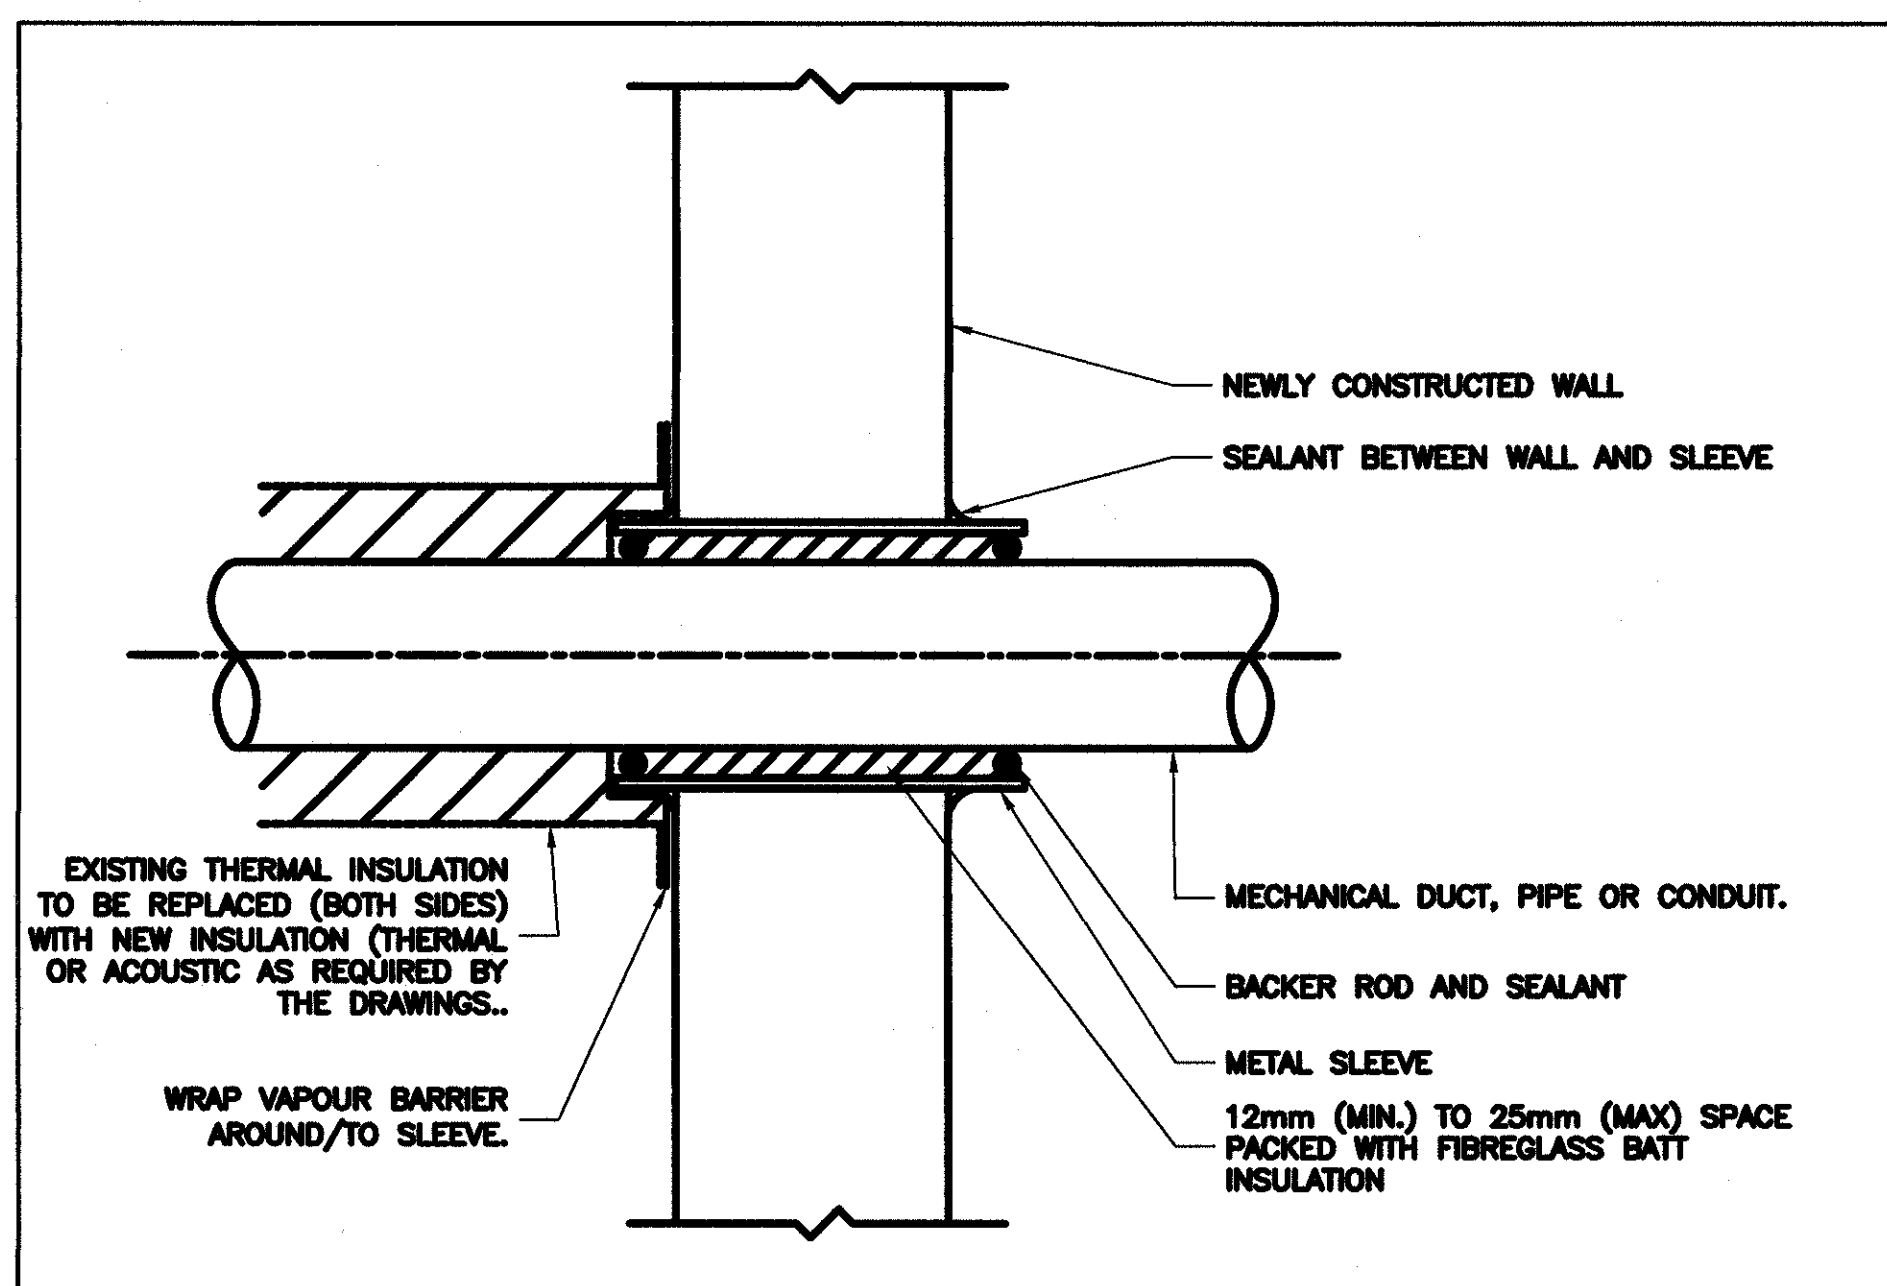


DETAIL: MECHANICAL SERVICES THROUGH WALL

SCALE : N.T.S.

2
H1

| LEGEND | |
|---|------------|
| EXISTING TO BE REMOVED | ---- |
| NEW DUCTWORK | — |
| EXISTING THERMOSTAT TO REMAIN | Ⓣ |
| EXISTING THERMOSTAT TO BE REMOVED | Ⓣ |
| RELOCATED THERMOSTAT | Ⓣ |
| EXISTING GRILLE TO REMAIN | R-8 216 |
| EXISTING GRILLE TO REMAIN AND BE REBALANCED | R-8 216 |
| EXISTING GRILLE TO BE REMOVED | S-7 158 |
| NEW GRILLE TO BE INSTALLED | S-7 90 |
| FLEXIBLE DUCTWORK TO BE REMOVED | ---- |
| NEW FLEXIBLE DUCTWORK | — |
| EXISTING CONTROL WIRING TO BE REMOVED | ---- |
| EXISTING CONTROL WIRING TO REMAIN | ---- |
| NEW/RELOCATED CONTROL WIRING | ---- |
| EXISTING RETURN GRILLE | Ⓢ |
| RETURN GRILLE TO BE REMOVED | Ⓢ |
| RELOCATED RETURN GRILLE | Ⓢ |
| EXISTING SUPPLY DIFFUSER | Ⓢ |
| SUPPLY DIFFUSER TO BE REMOVED | Ⓢ |
| RELOCATED SUPPLY DIFFUSER | Ⓢ |
| NEW LINEAR DIFFUSER BLANK-OFF | — |
| NEW LINEAR DIFFUSER | — |
| VARIABLE AIR VOLUME BOX | VAV |
| CONTROL DESIGNATION | 3-AA |
| EXISTING BALANCING DAMPER | Ⓢ |
| NEW EXTERNAL ACOUSTIC INSULATION | Ⓢ |

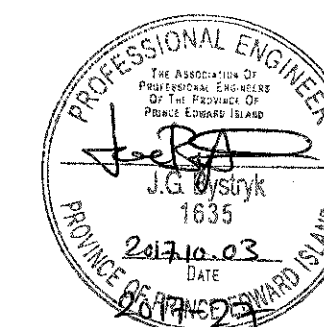

| | | |
|-----------|-----------------------------|----------|
| 1. | ISSUED FOR 33% PROGRESS SET | 17.08.02 |
| 2. | ISSUED FOR 66% PROGRESS SET | 17.08.21 |
| 3. | ISSUED FOR 99% PROGRESS SET | 17.08.13 |
| 4. | ISSUED FOR TENDER | 17.10.03 |
| revisions | | date |
| project | | project |

CID OFFICE RENOVATION
— JOSEPH A. GHIZ
BUILDING

SUMMERSIDE/PE

drawing dessin
**HVAC DETAILS
AND LEGEND**

| | |
|-----------------------|---------------------------------|
| designed Joe Bystrik | conçu |
| date 2017.08.02 | |
| drawn Joe Bystrk | dessiné |
| date 2017.08.02 | |
| approved Joe Bystrik | approuvé |
| date 2017.08.02 | |
| Tender | Soumission |
| PWGSC Project Manager | Administrateur de projets TPSGC |
| project number | no. du projet |
| R.090981.001 | |
| drawing no. | no. du dessin |
| H1 of 3 | |