




BRENKMAN & Company LTD.  
PERMIT NUMBER P11225  
The Association of Professional Engineers, Geologists and Geophysicists of Alberta

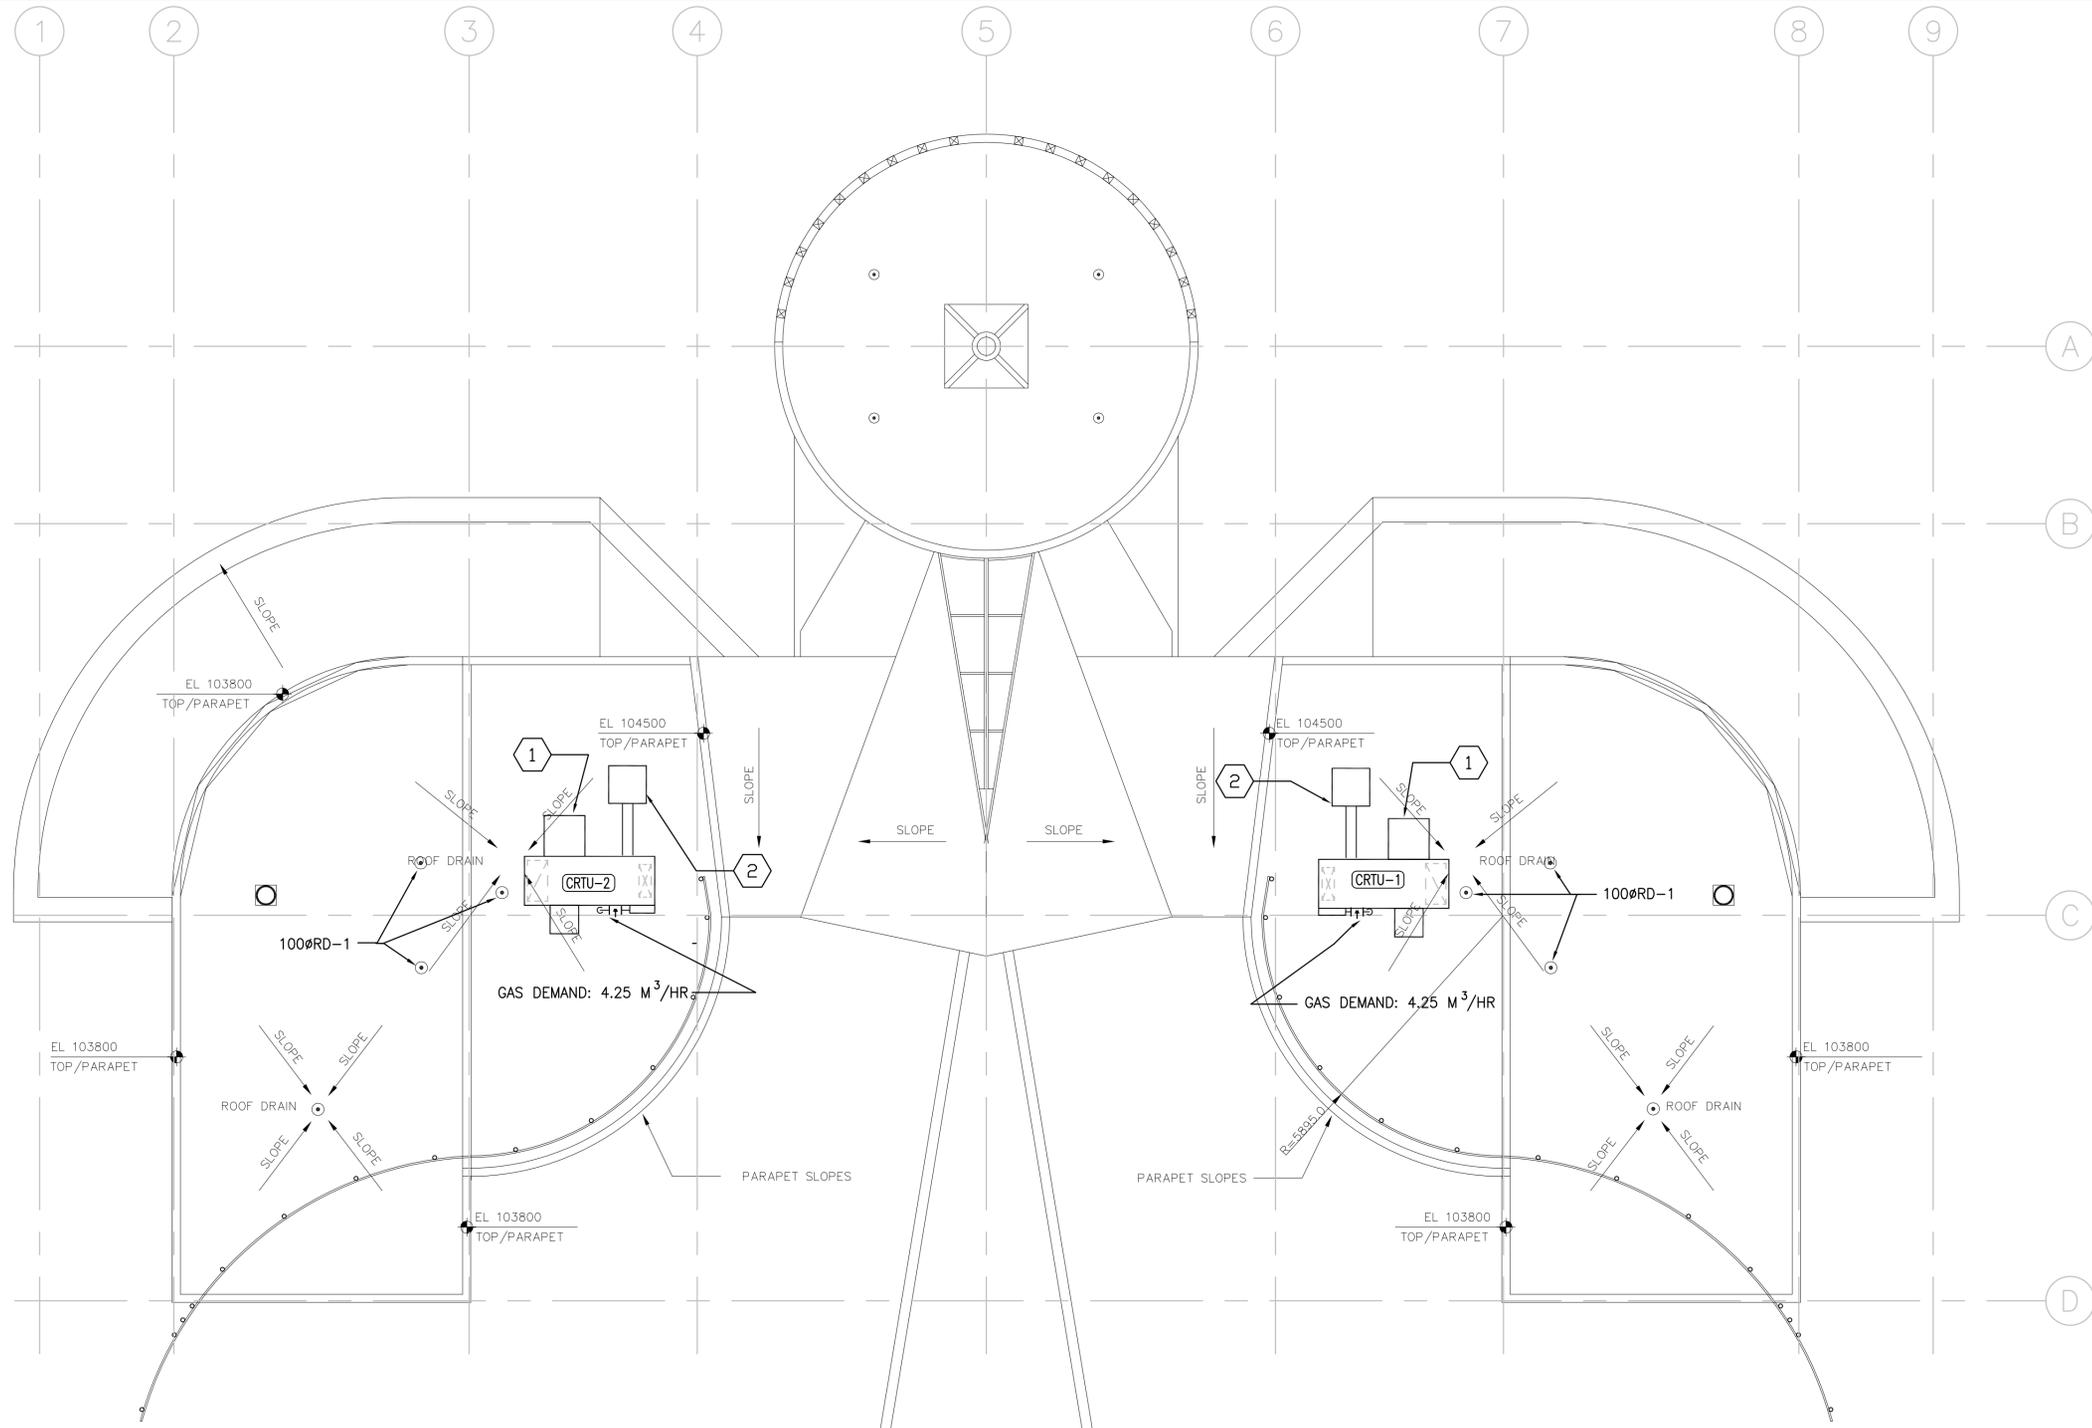

GENERAL NOTES	
1	CONTRACTOR IS RESPONSIBLE FOR ALL PERMITS.
2	CONTRACTOR TO ENSURE ALL WORK COMPLIES WITH AUTHORITY HAVING JURISDICTION.
3	CONTRACTOR TO VERIFY EXISTING UNITS' POWER REQUIREMENT PRIOR TO ORDER OF NEW UNITS AND TO ENSURE NEW UNITS DO MATCH VOLTAGE AND PHASE AND DO NOT EXCEED EXISTING AMP DRAW REQUIREMENTS. CONTRACTOR TO RECONNECT ALL NEW UNITS TO EXISTING ELECTRICAL AND TO REPAIR/REPLACE DAMAGED CONDUITE, WIRING, JUNCTION BOXES AND OTHER ELECTRICAL DAMAGED DURING DEMOLITION AND INSTALL OF NEW EQUIPMENT WITH SAME THAN ORIGINAL.
4	RECONNECT EXISTING DDC HVAC CONTROL SYSTEM TO NEW UNITS AS PER ORIGINAL. PERFORM ALL NECESSARY CHECKS TO ENSURE IT OPERATES CORRECTLY AS PER PRE-DEMOLITION INSTALL.

**ROOF PLAN**  
SCALE: 1:100

KEY NOTES	
1	NEW ROOFTOP UNIT. REFER TO SPECIFICATION FOR MOUNTING. RECONNECT BUILDING CONTROLS INTERLOCK WITH NEW CONDENSING UNIT. RECONNECT GAS AND ELECTRICAL.
2	INSTALL NEW CONDENSING UNIT ON EXISTING ROOF SUPPORT SLABS AND CONNECT REFRIGERANT LINES TO ROOF TOP UNIT. RECONNECT EXISTING ELECTRICAL.

#	Description/Description	Date/Date
2	ISSUED FOR TENDER	16/09/07
1	ISSUED FOR 90% REVIEW	16/05/30
0	ISSUED FOR 60% REVIEW	15/10/10

Client/client  
**PUBLIC WORKS AND GOVERNMENT SERVICES CANADA**

Project title/Titre du projet  
**Pê Sâkâstêw Centre  
Maskwacis, Alberta**

**Pê Sâkâstêw Centre  
REPLACEMENT OF  
ROOFTOP UNITS BOILERS**

Approved by/Approuvé par  
**GBB**

Designed by/Concept par  
**HFB**

Drawn by/Dessiné par  
**HFB**

PWGSC Project Manager/Administrateur de Projets TFSGC  
**STEVE PHYPERS**

PWGSC Architectural and Engineering Resources Manager/  
Ressources Architectural et de Directeur d'ingénierie, TFSGC

Client/client  
**PWGSC**

Drawing title/Titre du dessin  
**BUILDING C - BOILERS  
CONSTRUCTION PLAN**

Project No./No. du projet	Sheet/Feuille	Revision no./La Révision no.
<b>R.077183.00</b>	<b>M1.3</b>	<b>2</b>
	OF 16	

