

BRENKMAN & Company LTD.  
PERMIT NUMBER P11225  
The Association of Professional Engineers,  
Geologists and Geophysicists of Alberta

#		
#		
#		
2	ISSUED FOR TENDER	16/09/07
1	ISSUED FOR 95% REVIEW	16/05/30
0	ISSUED FOR 60% REVIEW	15/10/10
Revision/	Description/Description	Date/Date

Client/client

PUBLIC WORKS AND  
GOVERNMENT SERVICES  
CANADA

Project title/Titre du projet

Pê Sâkâstêw Centre  
Maskwacis, Alberta

Pê Sâkâstêw Centre  
REPLACEMENT OF  
ROOFTOP UNITS BOILERS

Approved by/Approuvé par

GBB

Designed by/Concept par

HFB

Drawn by/Dessiné par

HFB

PWGSC Project Manager/Administrateur de Projets TFSGC

STEVE PHYPPERS

PWGSC, Architectural and Engineering Resources Manager/  
Ressources Architectural et de Directeur d'ingénierie, TFSGC

Client/client

PWGSC

Drawing title/Titre du dessin


BUILDING C - BOILERS  
DEMOLITION PLAN

Project No./No. du  
projet  
R.077183.00

Sheet/ Feuille  
M1.0  
OF 16

Revision no./  
La Révision  
no.  
2


C-DWH1 GAS DEMAND: 1.49 M<sup>3</sup>/HR

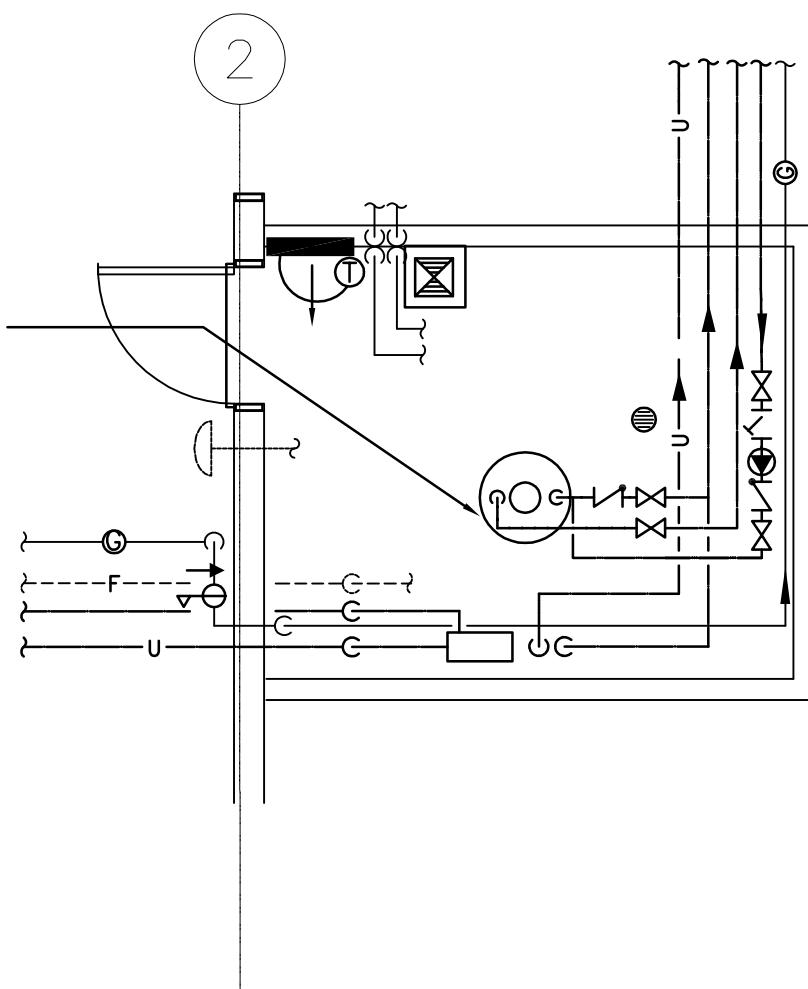

WEST MECHANICAL  
ROOM FLOOR PLAN  
SCALE: 1:50

KEY NOTES	
1	DEMOLISH BOILERS CB-1 & CB-2 C/W ALL ACCESSORIES. PREPARE CHIMNEY, HWS/HWR LINE & GAS FOR RECONNECTION.

GENERAL NOTES	
1	CONTRACTOR IS RESPONSIBLE FOR ALL PERMITS.
2	CONTRACTOR TO ENSURE ALL WORK COMPLIES WITH AUTHORITY HAVING JURISDICTION.
3	BOILER GAS DEMAND 8.92 M <sup>3</sup> /HR EACH.
4	CONTRACTOR TO RETAIN ELECTRICAL FOR RECONNECTION.

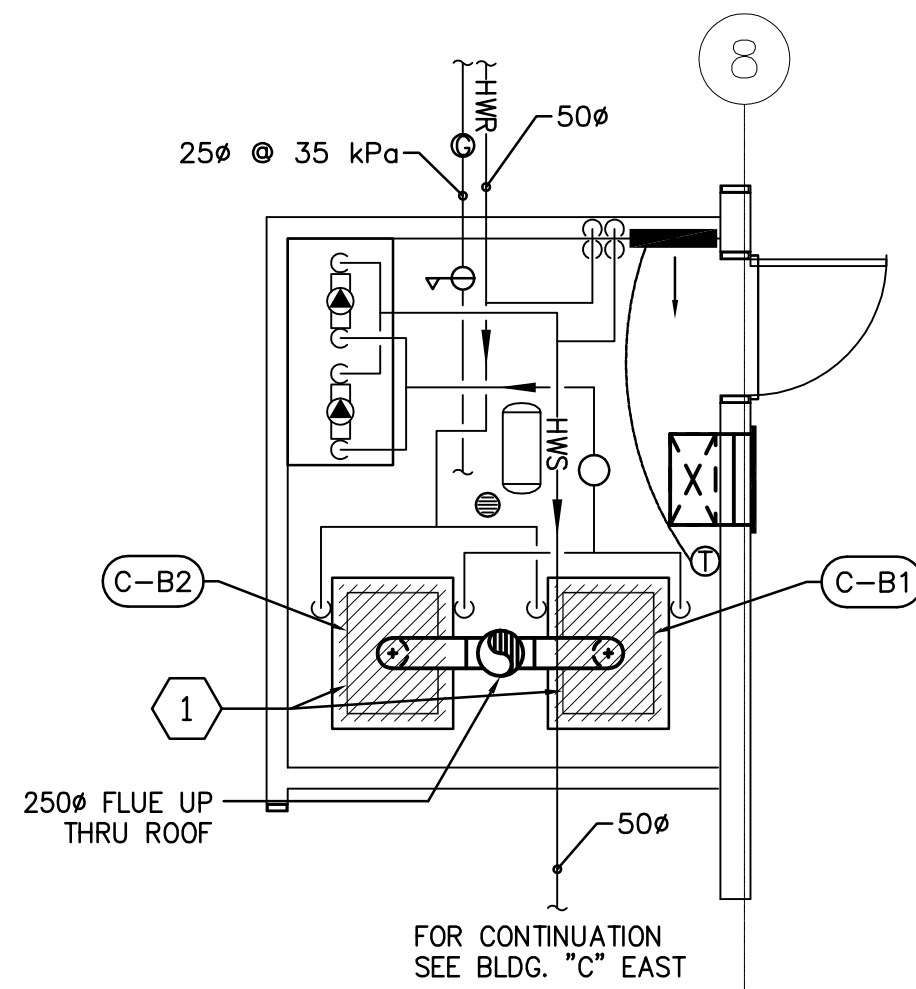

EAST MECHANICAL  
ROOM FLOOR PLAN  
SCALE: 1:50

NOTES:

- ALL HEATING WATER SUPPLY AND RETURN PIPE SIZES TO BE 20" UNLESS OTHERWISE NOTED.
- NATURAL GAS PRESSURE IN BUILDING IS 35 KPa.

FLOOR PLAN  
SCALE: 1:100