


- NOTES**
- OCCUPANCY SENSOR OPERATING EF-1 IS TO BE MONITORED BY THE EXISTING DDC SYSTEM FOR SMUDGING ROOM AIR HANDLING CONTROL. SEE DRAWING M&2 FOR DETAILS AND COORDINATE ON SITE.
 - TIMED WALL SWITCH OPERATING EF-2 IS TO BE MONITORED BY THE EXISTING DDC SYSTEM FOR SMUDGING ROOM AIR HANDLING CONTROL. SEE DRAWING M&2 FOR DETAILS AND COORDINATE ON SITE.



1
E2.0
MAIN FLOOR PLAN
SCALE: 1:300

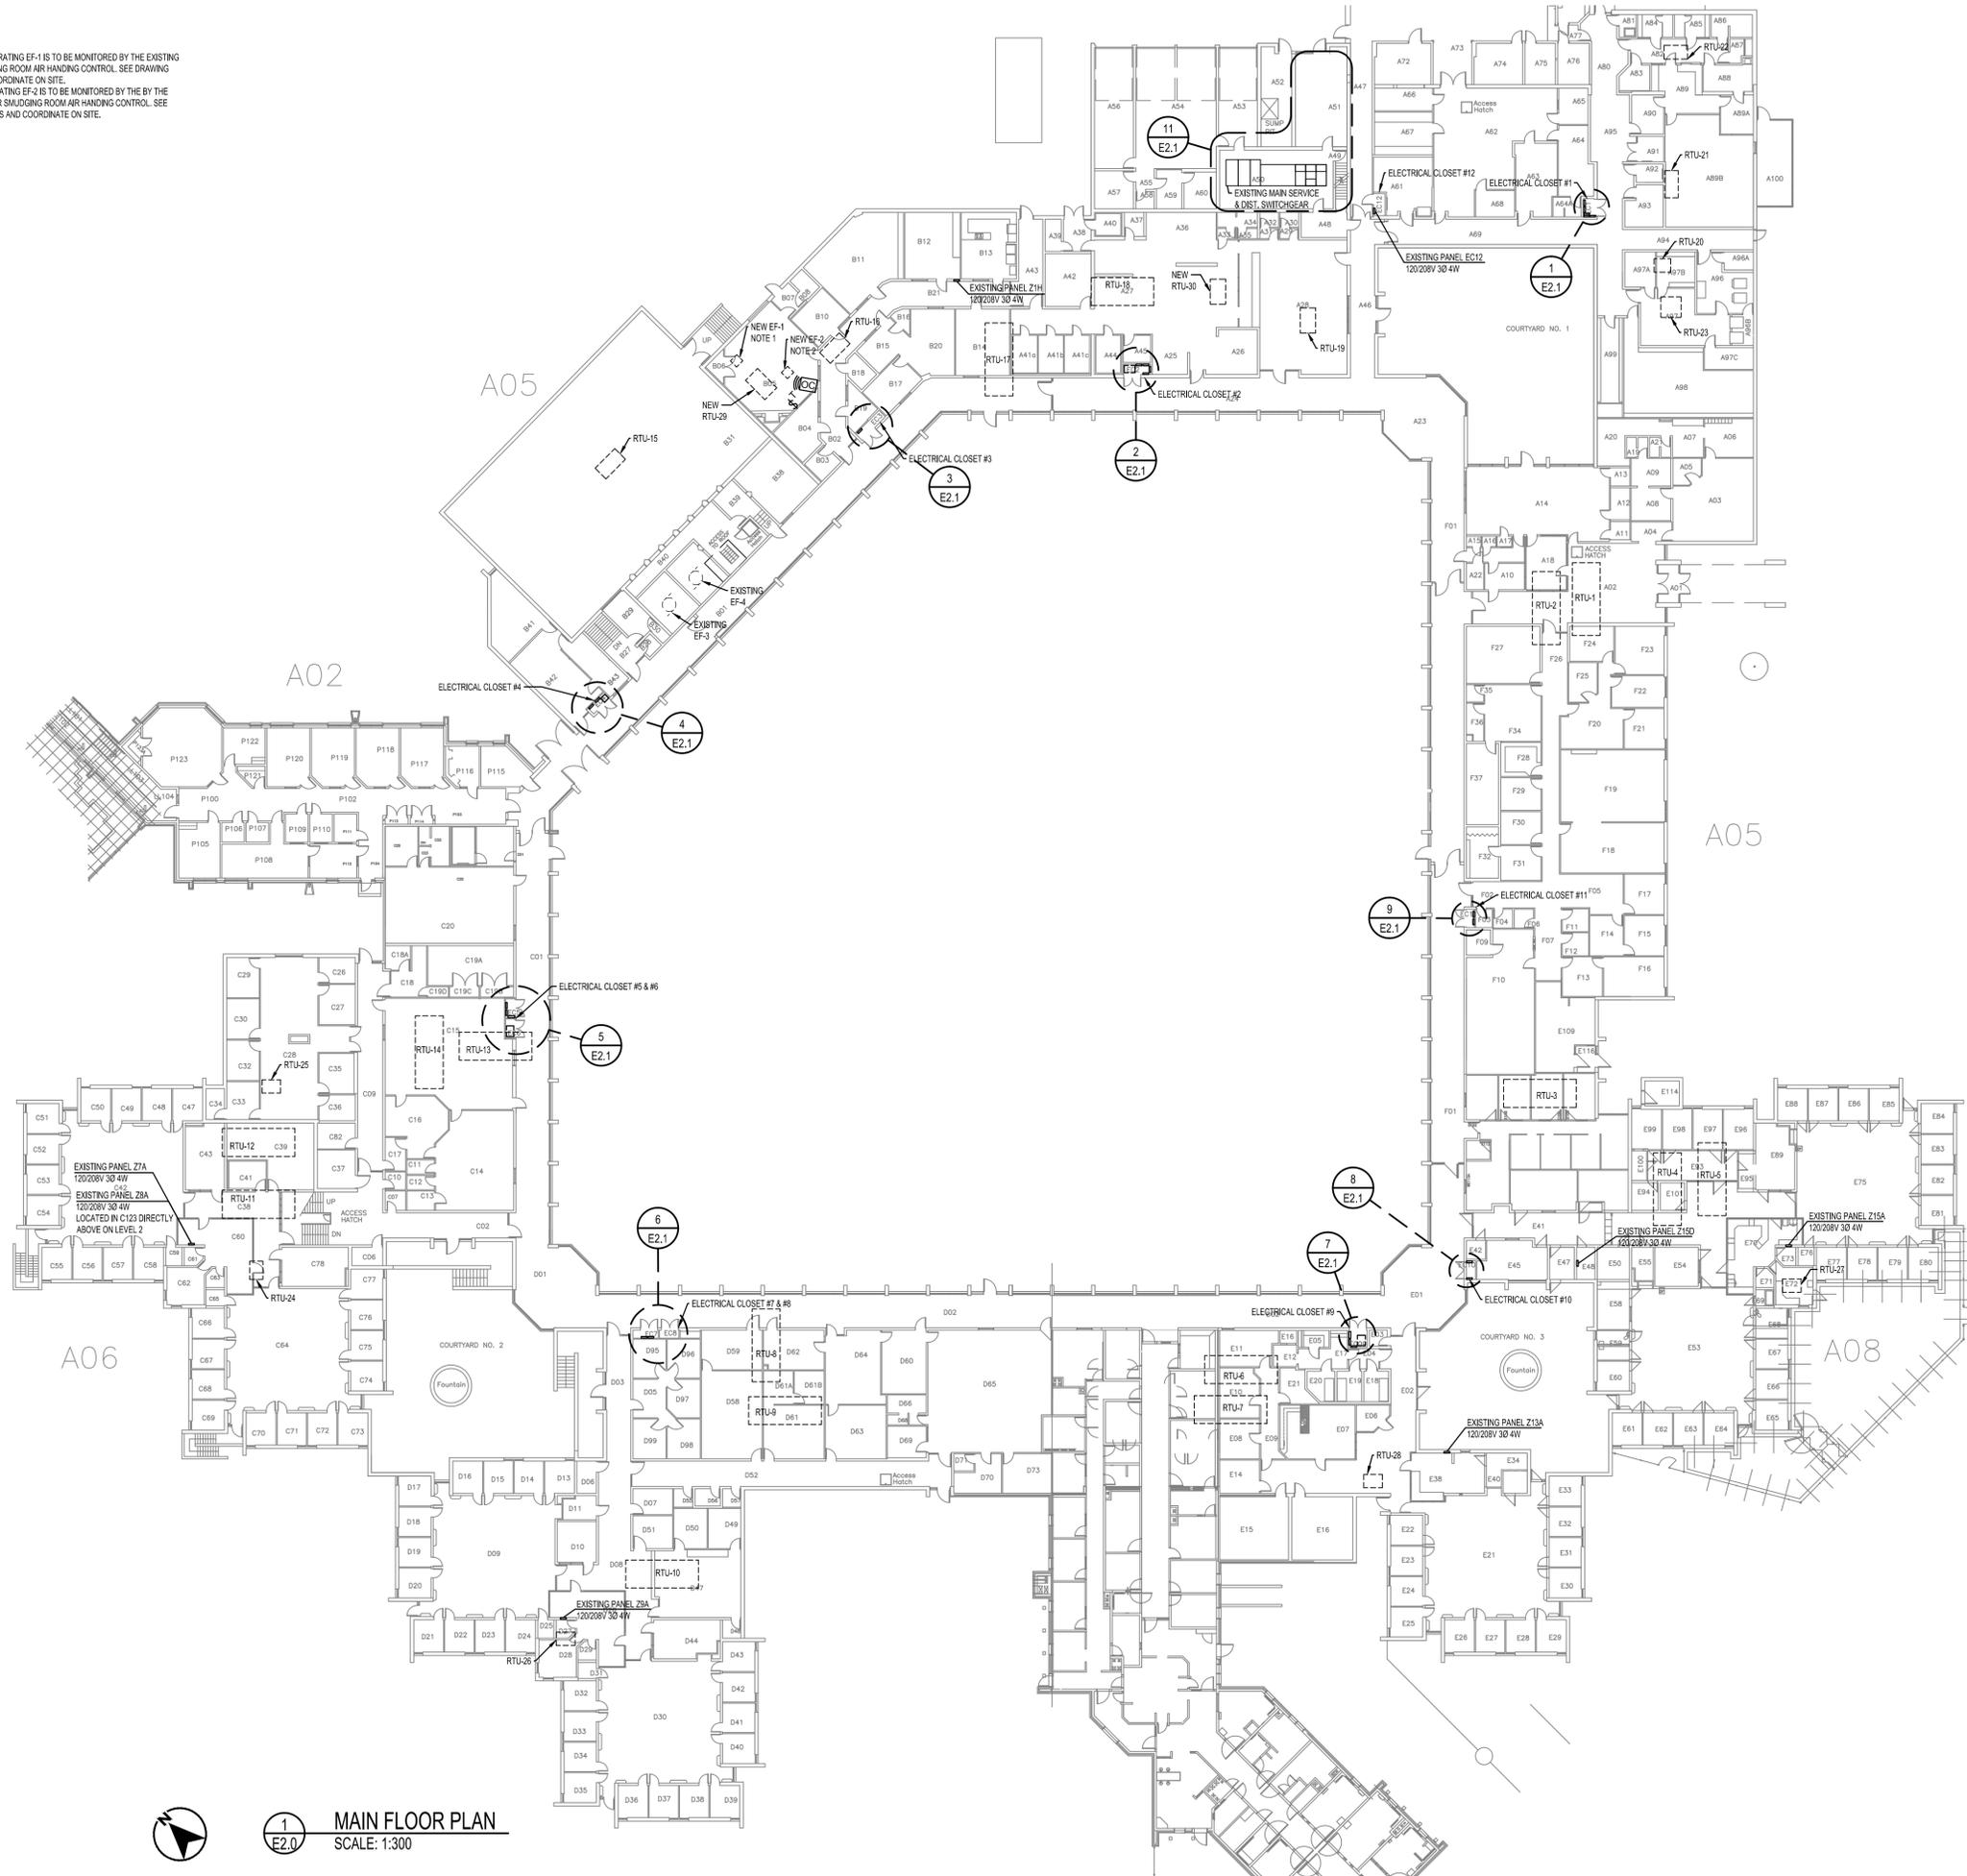


203 WELLMAN CRESCENT
SASKATOON SASKATCHEWAN CANADA S7T 6J1
TEL: 1-306-665-6223 | FAX: 1-306-665-8589 | WWW.WSPGROUP.COM

PROFESSIONAL ENGINEER
B.K. BERGLOF
MEMBER 5369
17/10/22
TR MW DPT
SASKATCHEWAN

Association of Professional Engineers & Geoscientists of Saskatchewan
CERTIFICATE OF AUTHORIZATION
WSP Canada Inc.
Number 00868
Permission to Consult held by:
Discipline: ELECTRICAL 5369

KEY PLAN

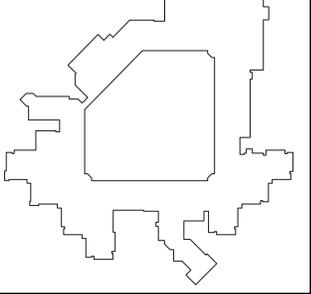

#	description	date
0	ISSUED FOR TENDER	17/09/23

PUBLIC WORKS AND GOVERNMENT SERVICES CANADA
SASKATOON SASKATCHEWAN

project title
SASKATOON, SK REGIONAL PSYCHIATRIC CENTRE
ROOFTOP AIR HANDLING UNITS REPLACMENT

approved by: **BKB**
designed by: **TWK**
drawn by: **TWK**
PWGSC Project Manager

PWGSC Architectural and Engineering Resources Manager

Client: **CORRECTIONAL SERVICE CANADA**

ELECTRICAL
MAIN FLOOR PLAN

project no.	sheet	revision no.
R.079699.001	E2.0	0