




KEY PLAN

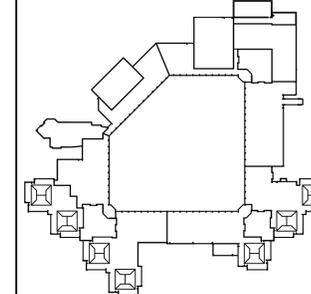

Association of Professional Engineers & Geoscientists of Saskatchewan
CERTIFICATE OF AUTHORIZATION
WSP Canada Inc.
Number C0888
Permission to Consult held by:
Discipline: MECHANICAL 9159

revisions	description	date
0	ISSUED FOR TENDER	17/09/13

Client
PUBLIC WORKS AND GOVERNMENT SERVICES CANADA
SASKATOON SASKATCHEWAN

project title
SASKATOON, SK REGIONAL PSYCHIATRIC CENTRE
ROOFTOP AIR HANDLING UNITS REPLACEMENT

approved by
BND
designed by
BP
drawn by
ML/MB
PWGSC Project Manager



PWGSC, Architectural and Engineering Resources Manager

Client
CORRECTIONAL SERVICE CANADA

drawing title
MECHANICAL
OVERALL
ROOF PLAN

project no.	sheet	revision no.
R.079699.001	M1.2	0

LEGEND

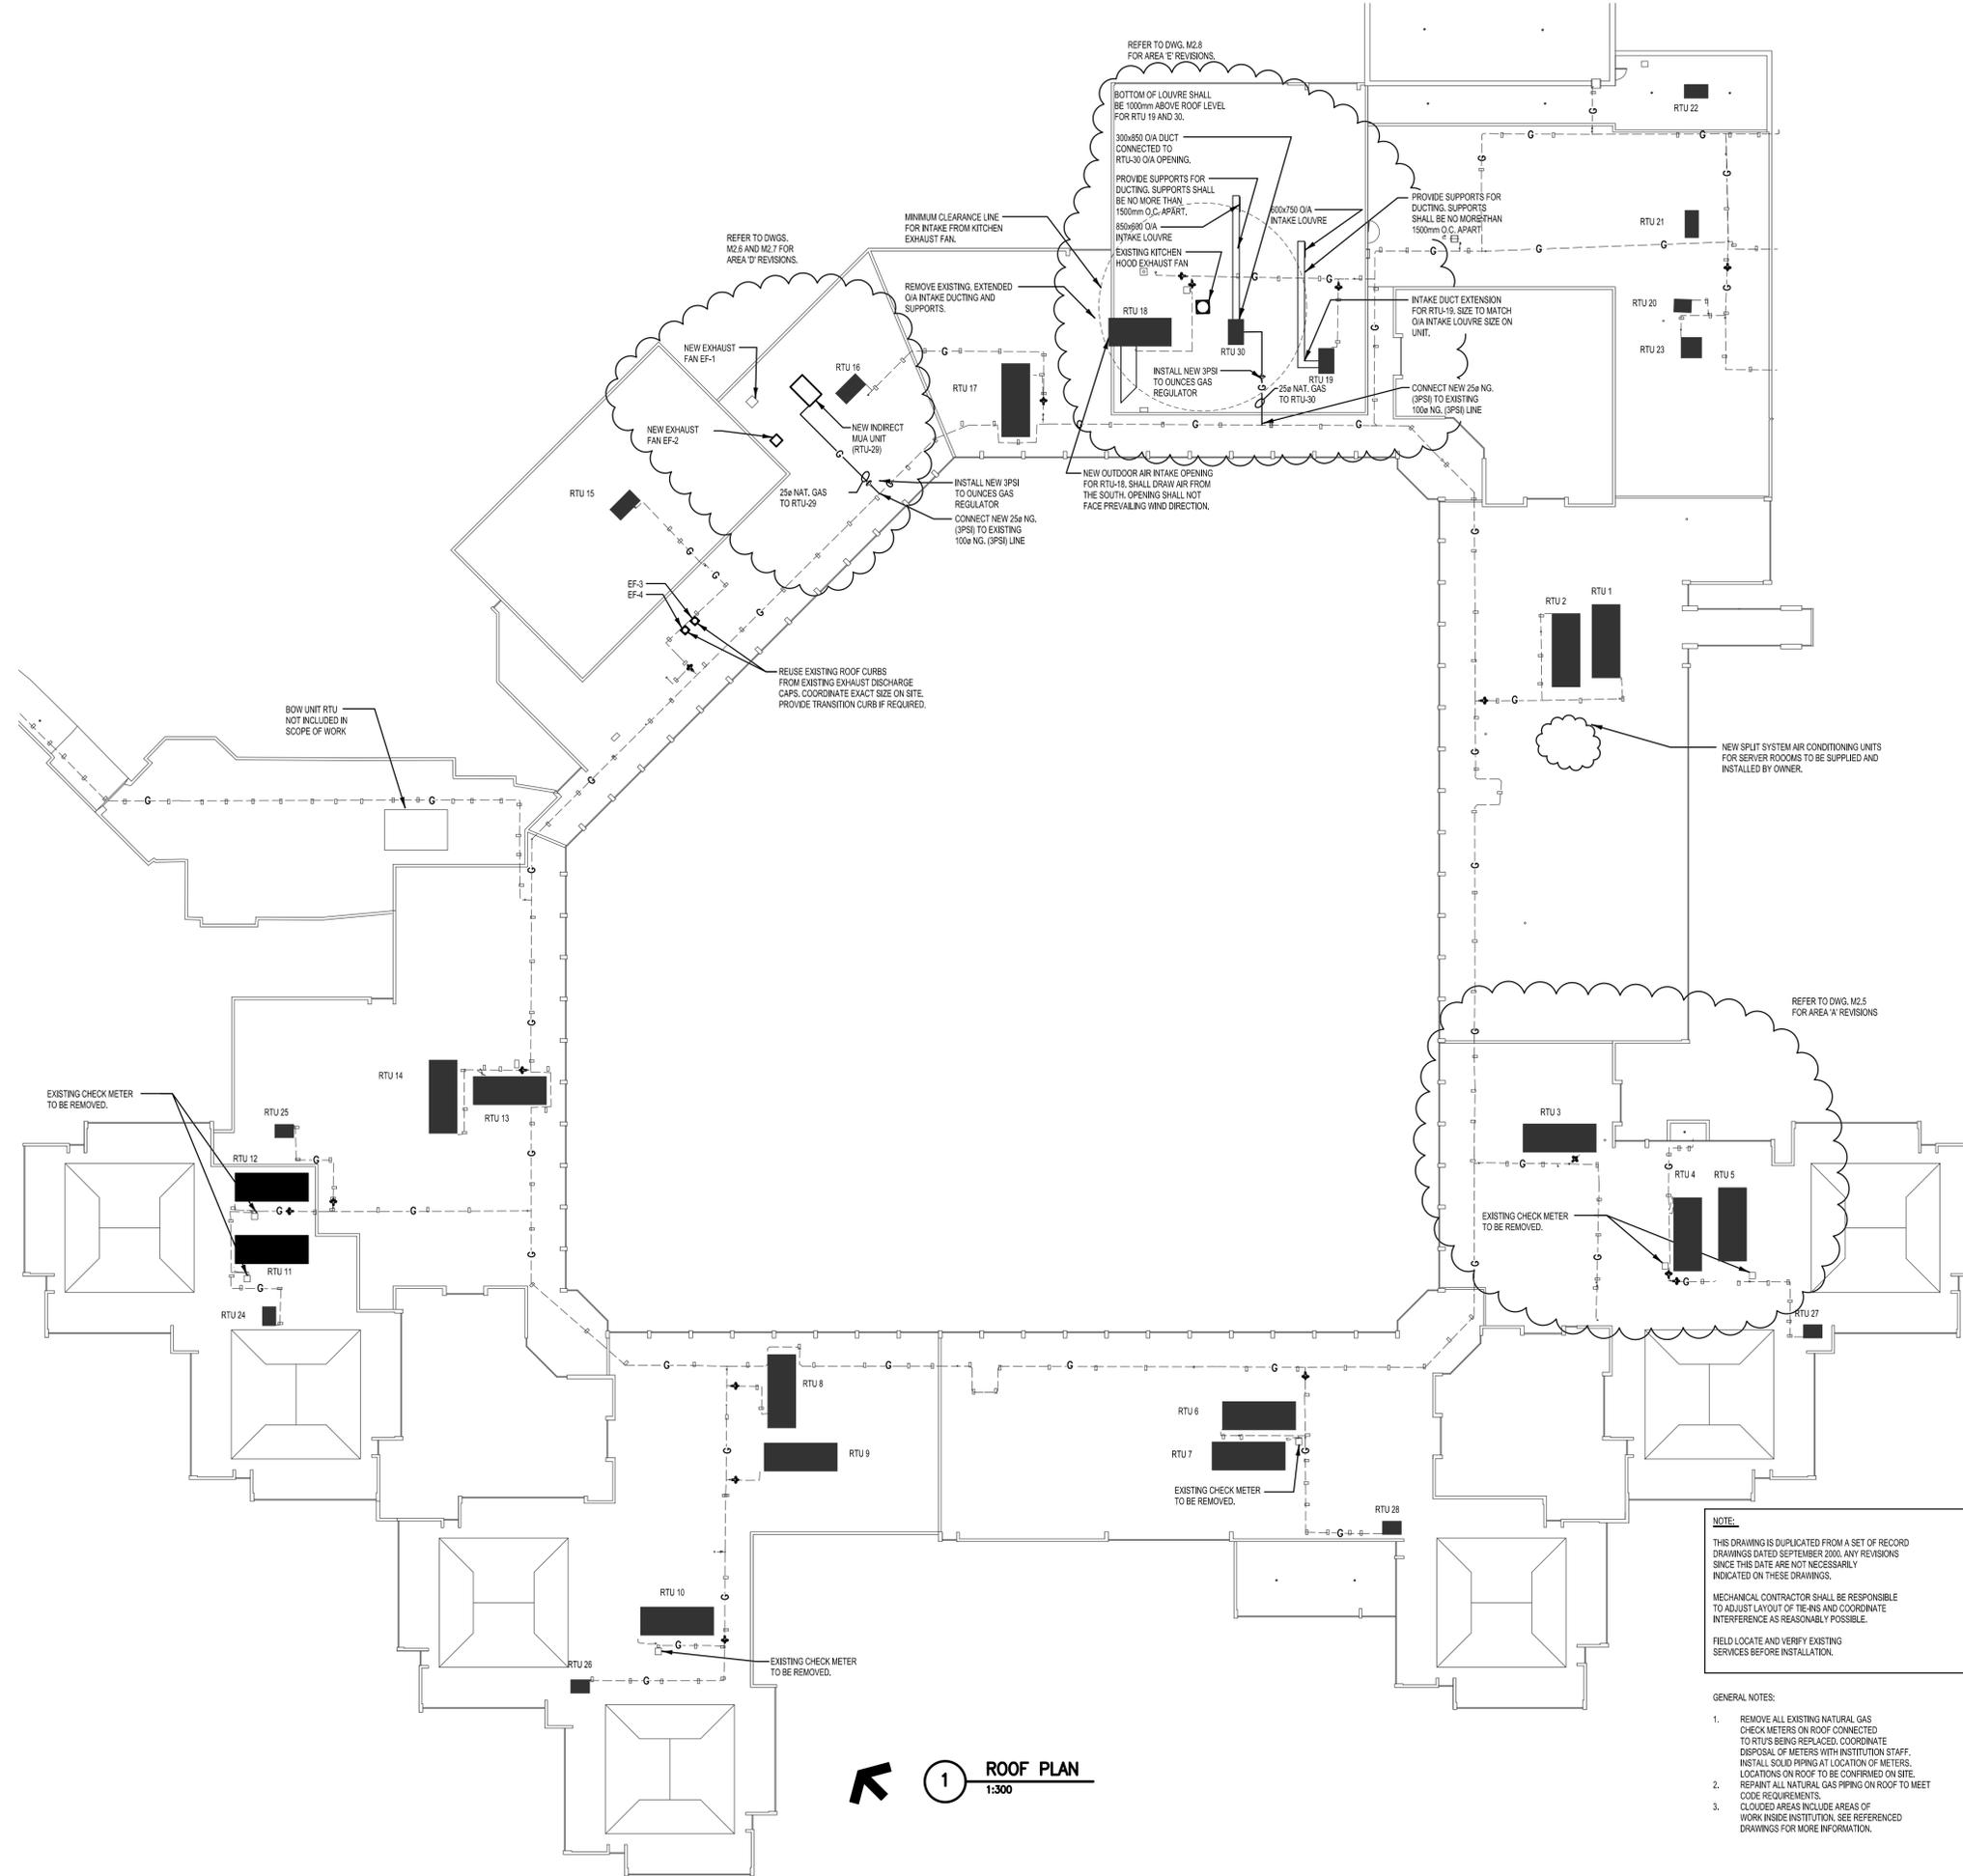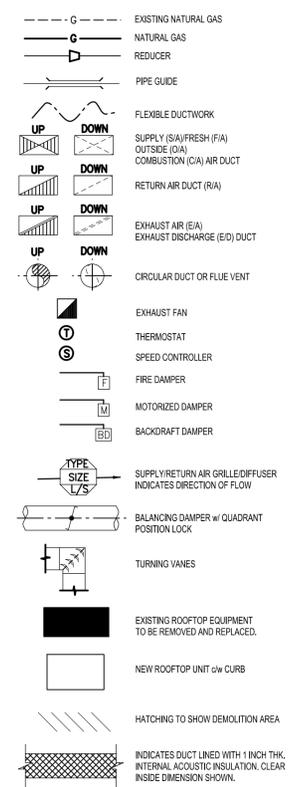

NOTE:
THIS DRAWING IS DUPLICATED FROM A SET OF RECORD DRAWINGS DATED SEPTEMBER 2000. ANY REVISIONS SINCE THIS DATE ARE NOT NECESSARILY INDICATED ON THESE DRAWINGS.
MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE TO ADJUST LAYOUT OF TIE-INS AND COORDINATE INTERFERENCE AS REASONABLY POSSIBLE.
FIELD LOCATE AND VERIFY EXISTING SERVICES BEFORE INSTALLATION.

- GENERAL NOTES:
- REMOVE ALL EXISTING NATURAL GAS CHECK METERS ON ROOF CONNECTED TO RTUS BEING REPLACED. COORDINATE DISPOSAL OF METERS WITH INSTITUTION STAFF. INSTALL SOLID PIPING AT LOCATION OF METERS. LOCATIONS ON ROOF TO BE CONFIRMED ON SITE. REPAINT ALL NATURAL GAS PIPING ON ROOF TO MEET CODE REQUIREMENTS.
 - CLOUDED AREAS INCLUDE AREAS OF WORK INSIDE INSTITUTION. SEE REFERENCED DRAWINGS FOR MORE INFORMATION.

1 ROOF PLAN 1:300

