

PROVINCE OF NEWFOUNDLAND
PERMIT HOLDER
CLASS "A"
This Permit Allows

SNC-LAVALIN Inc.

To practice Professional Engineering
in Newfoundland and Labrador.
Permit No. as issued by PEGNL N0458
which is valid for the year 2017.

ENGINEER IN RESPONSIBLE CHARGE

D.M. Morris

C01	ISSUED FOR TENDER	12/21/2017
revisions		date

project

SAR STATION
REFURBISHMENT
ST. ANTHONY

LIFEBOAT STATION

drawing


HVAC
DETAILS
SHEET 2

designed	D.M.	conçu
date	2017-11-17	
drawn	D.B.	dessiné
date	2017-11-17	
approved	MK	approuvé
date	2017-11-17	

Tender
D.B.
PWGSC Project Manager
no. du projet
R.089934.001

drawing no.

M11

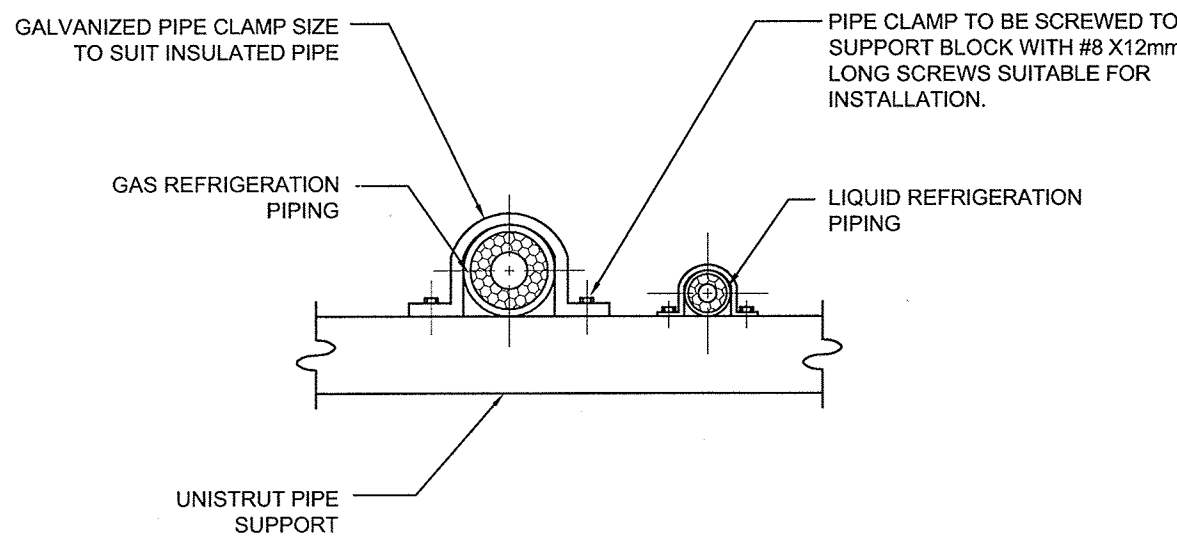

NOTES:

1. SUPPORTS TO BE SPACED AT 1800MM CENTERS.
2. SEE FLOOR PLANS FOR PIPE SIZES.
3. SEE SPECIFICATION FOR PIPE INSULATION TYPE AND THICKNESS.

TYP. REFRIGERATION PIPE SUPPORT DETAIL


NTS

3

M11

NOTES:

1. ALL CUTTING OF WALL TO ACCOMMODATE LOUVRE INSTALLATION SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR.
2. ALL NECESSARY STRUCTURAL SUPPORTS REQUIRED TO FRAME THE LOUVRE OPENING SHALL BE SUPPLIED AND INSTALLED BY THE GENERAL CONTRACTOR.
3. CAULKING AND SEALING OF WALL OPENING TO MAKE WEATHER TIGHT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR.
4. ALL EXHAUST DUCTWORK 1.5m BACK FROM LOUVRE SHALL BE ALL WELDED WATERTIGHT CONSTRUCTION.
5. INSTALLATION OF THE LOUVRE INTO THE FRAMED WALL OPENING SHALL BE THE RESPONSIBILITY OF THE MECHANICAL CONTRACTOR.
6. ALL NECESSARY LINTELS, SILLS, STOOLS, MOLDINGS, WOOD BLOCKING, BRACKETS, HEADERS, SIDING, FLASHING, ETC. TO FACILITATE INSTALLATION OF LOUVRE IN EXTERIOR WALL SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR.
7. EXACT OPENING SIZES REQUIRED TO ACCOMMODATE LOUVRE SIZES SHALL BE FORWARDED TO THE GENERAL CONTRACTOR BY THE DIV. 15 MECHANICAL CONTRACTOR.

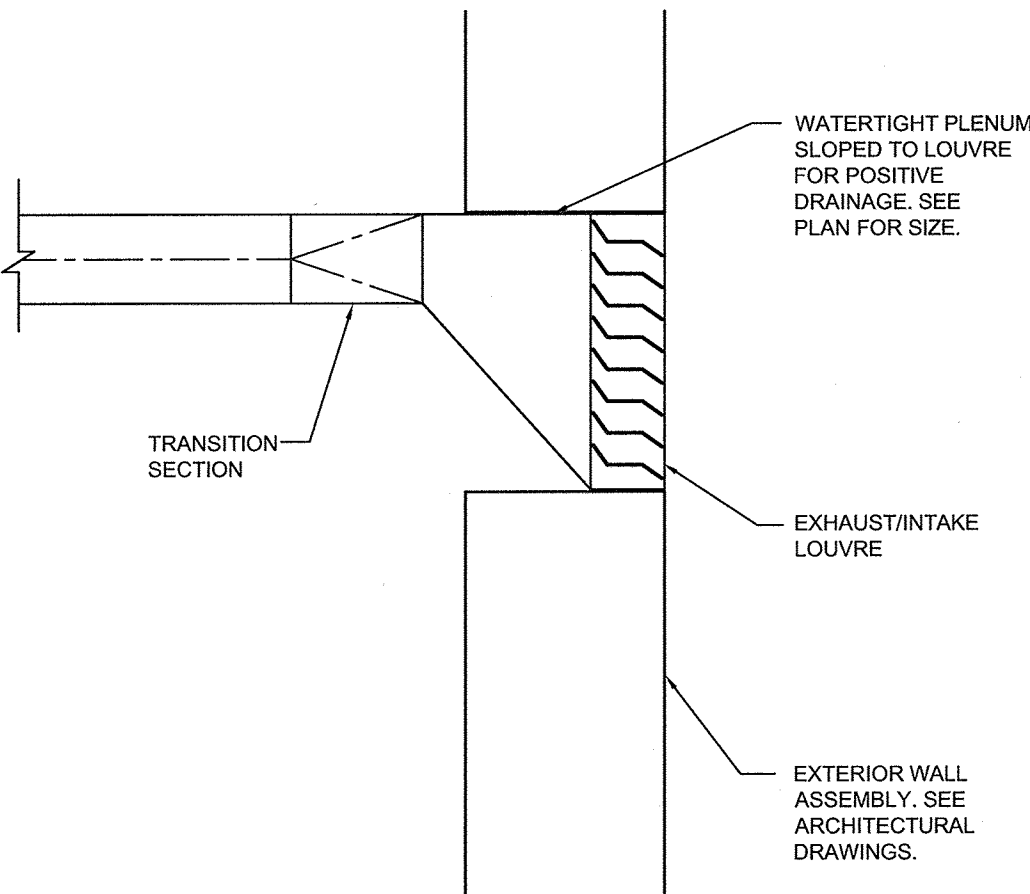


EXHAUST/INTAKE LOUVRE DETAIL

NTS

2

M11

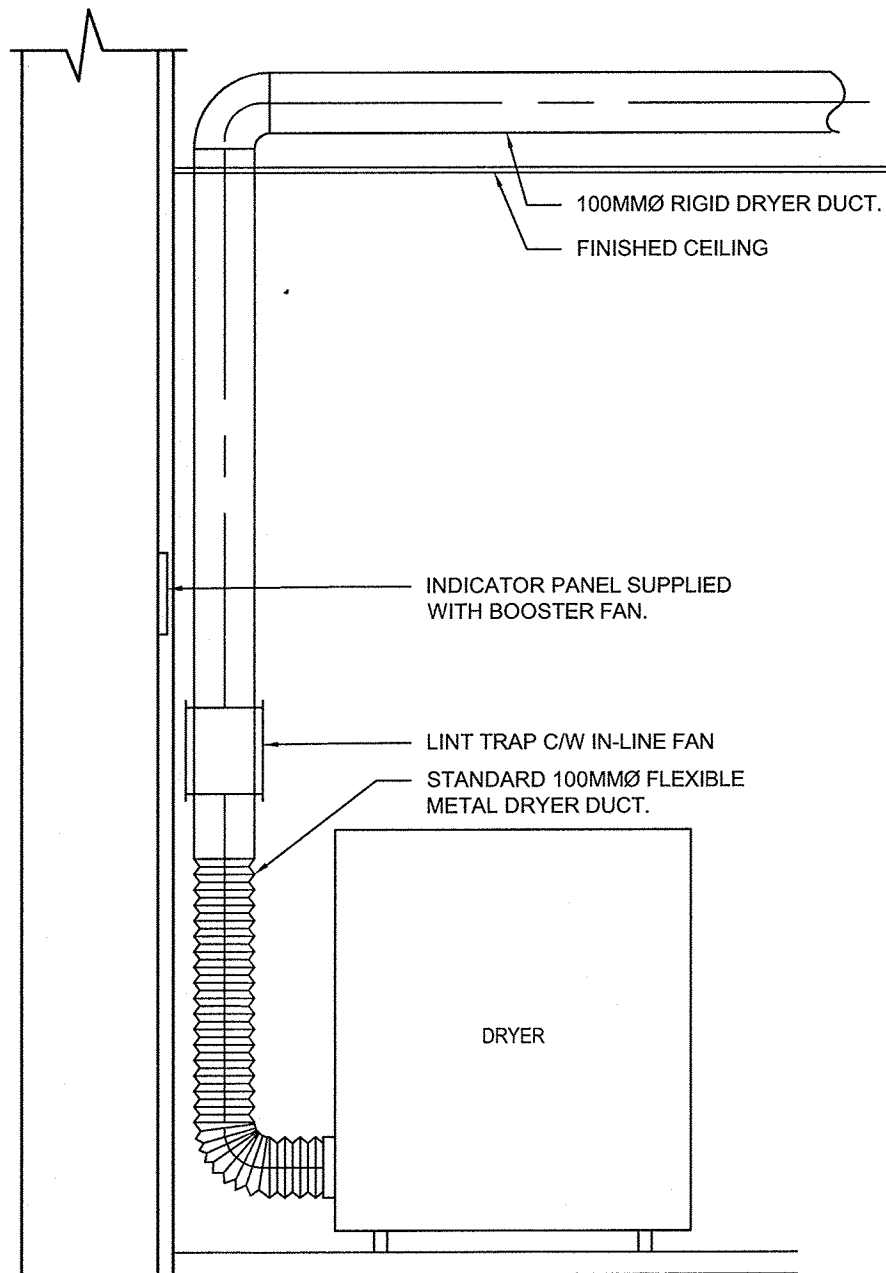


TYP. CLOTHES DRYER FAN DETAIL

NTS

1

M11

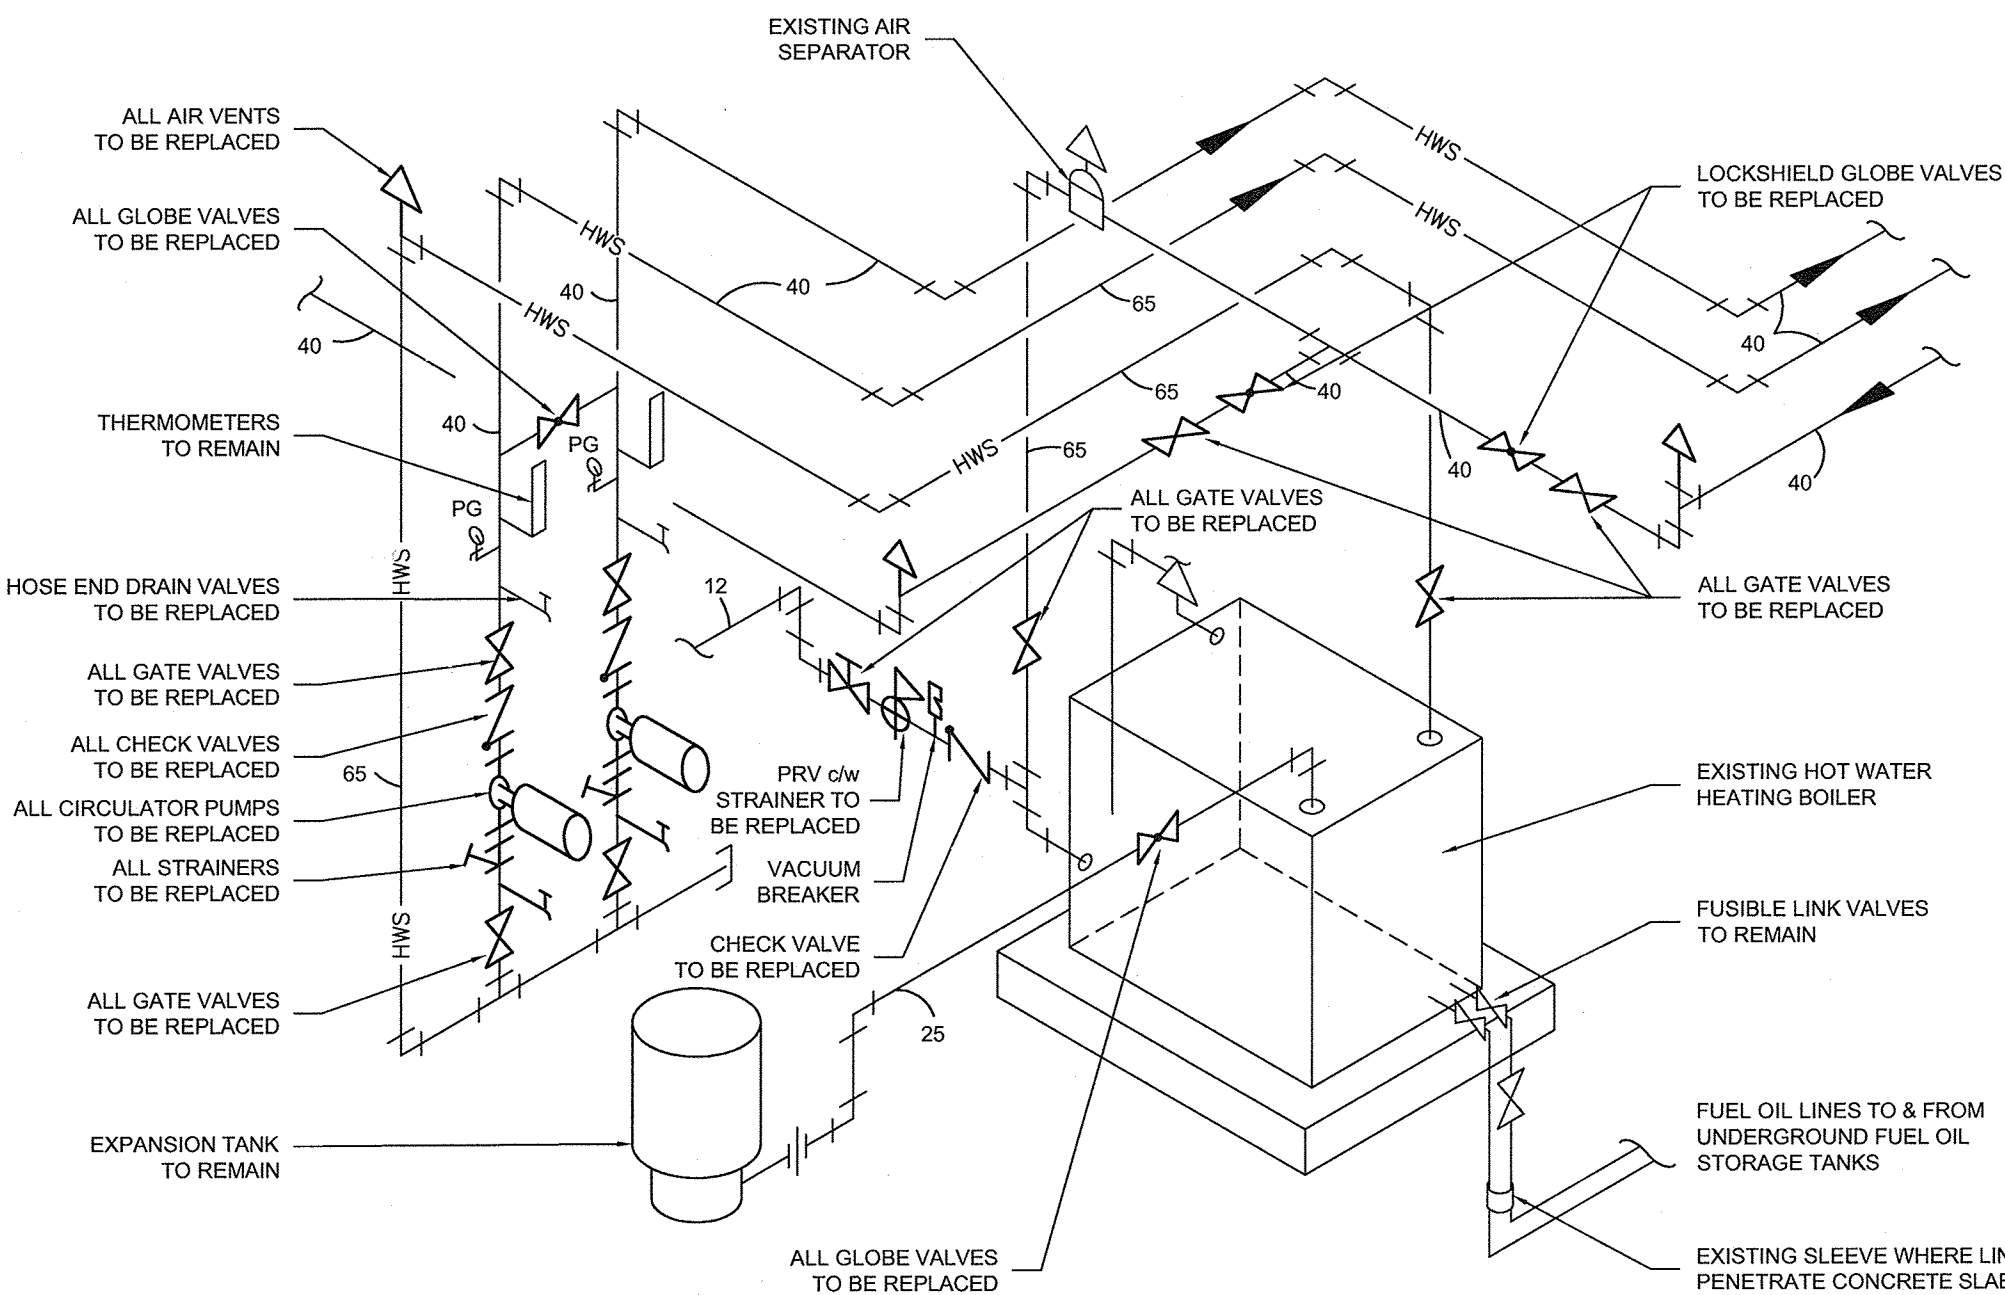

NOTES:

1. REPLACE VALVES, PUMPS, PRV'S, AIR VENTS.

EXISTING BOILER PIPING DETAIL

NTS

4

M11