


kadesigns
(902) 454-9889 kadesigns@eastlink.ca
3873 Memorial Drive, Halifax, N.S. B3K 5A4




DUMAC ENERGY LTD.
CONSULTING ENGINEERS
752 BEDFORD HIGHWAY
HALIFAX, N.S.
Tel: (902) 457-1300
Fax: (902) 457-1777
Email: DUMAC@DUMACNS.CA

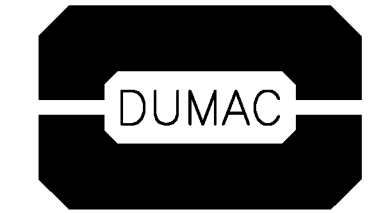

1.	ISSUED FOR TENDER	01.26.2018
revisions		date
project		project


CCG WP2.0 FIT-UP
MARITIME HEADQUARTERS
BEDFORD INSTITUTE OF OCEANOGRAPHY
DARTMOUTH
NOVA SCOTIA

drawing dessin
designed conçu
date
drawn KAD dessin
date OCT.02.2017
approved approuvé
date
Tender IAN SCELES Soumission
PWGSC Project Manager Administrateur de projets TPSGC
project number no. du projet
R.082156.001
drawing no. no. du dessin
E.02

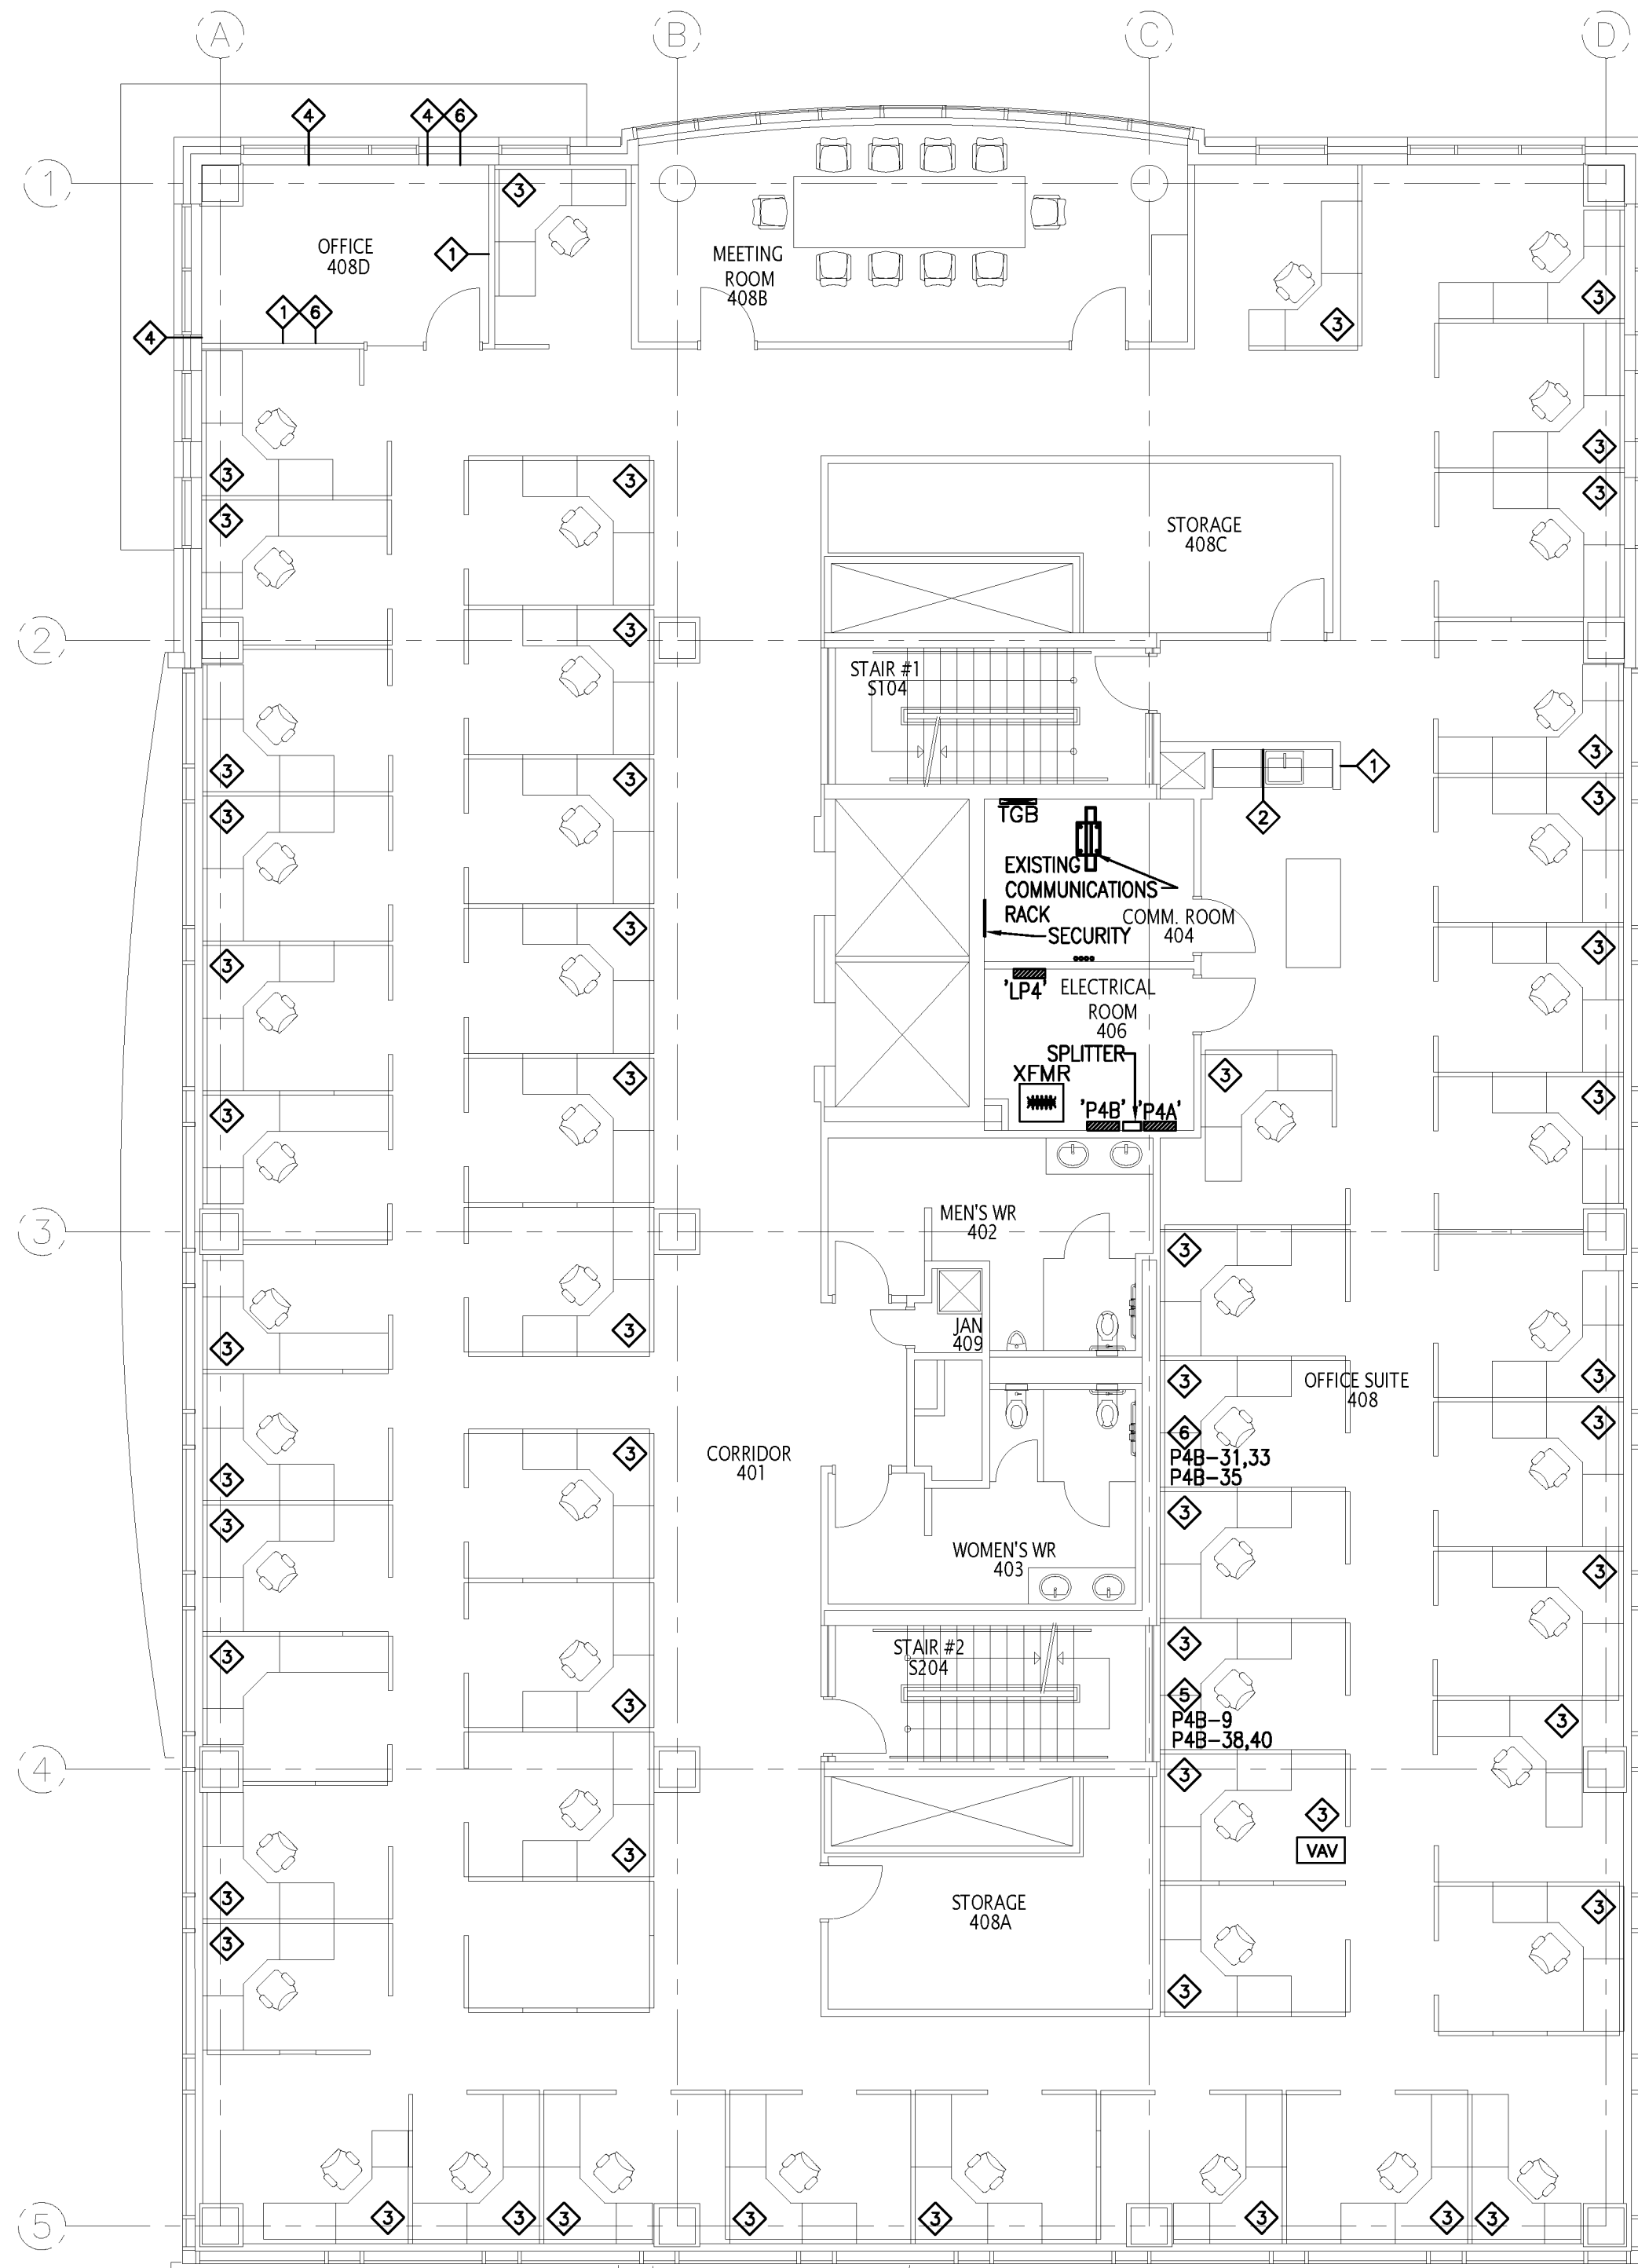

1
E.02 LEVEL 400 FLOOR PLAN - DEMOLITION
SCALE : 1:100
0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m
LEVEL 400 DEMOLITION NOTES:

- DISCONNECT AND REMOVE EXISTING RECEPTACLE, VOICE/DATA OUTLETS, ETC. LOCATED ON THIS WALL.
- DISCONNECT AND REMOVE EXISTING ELECTRICAL EQUIPMENT, RECEPTACLES, UNDERCOUNTER LIGHT, VOICE/DATA OUTLETS, ETC. IN EXISTING KITCHENETTE.
- DISCONNECT AND REMOVE EXISTING LINE VOLTAGE WIRING AND VOICE/DATA CABLING TO SYSTEMS FURNITURE FROM WALL MOUNTED JUNCTION BOXES. RE-USE EXISTING CIRCUITS IN JUNCTION BOXES TO FEED NEW SYSTEMS FURNITURE SUPPLIED AND INSTALLED BY OTHERS. RE-USE EXISTING VOICE/DATA CABLING FOR NEW SYSTEMS FURNITURE WHERE LENGTH OF CABLE PERMITS.
- DISCONNECT AND REMOVE EXISTING RECEPTACLE.
- DISCONNECT AND REMOVE EXISTING FURNITURE FEEDS FOR POWER, VOICE AND DATA. RE-USE EXISTING CIRCUITS TO FEED WALL MOUNTED RECEPTACLES OR NEW FURNITURE FEEDS. EXTEND WIRING AS REQUIRED. USE VOICE/DATA CABLING TO FEED NEW VOICE/DATA WALL MOUNTED OUTLET.
- DISCONNECT AND REMOVE EXISTING VOICE/DATA OUTLET. COIL EXISTING CABLING UP IN CEILING AND LABEL AT BOTH ENDS. RE-USE CABLES IF POSSIBLE FOR NEW OUTLETS.
- VISIT SITE PRIOR TO CLOSE OF TENDER TO ASSESS EXISTING CONDITIONS, OBSTRUCTIONS, ETC.
- DISCONNECT AND REMOVE 120V CIRCUIT TO EXISTING VAV BOX.

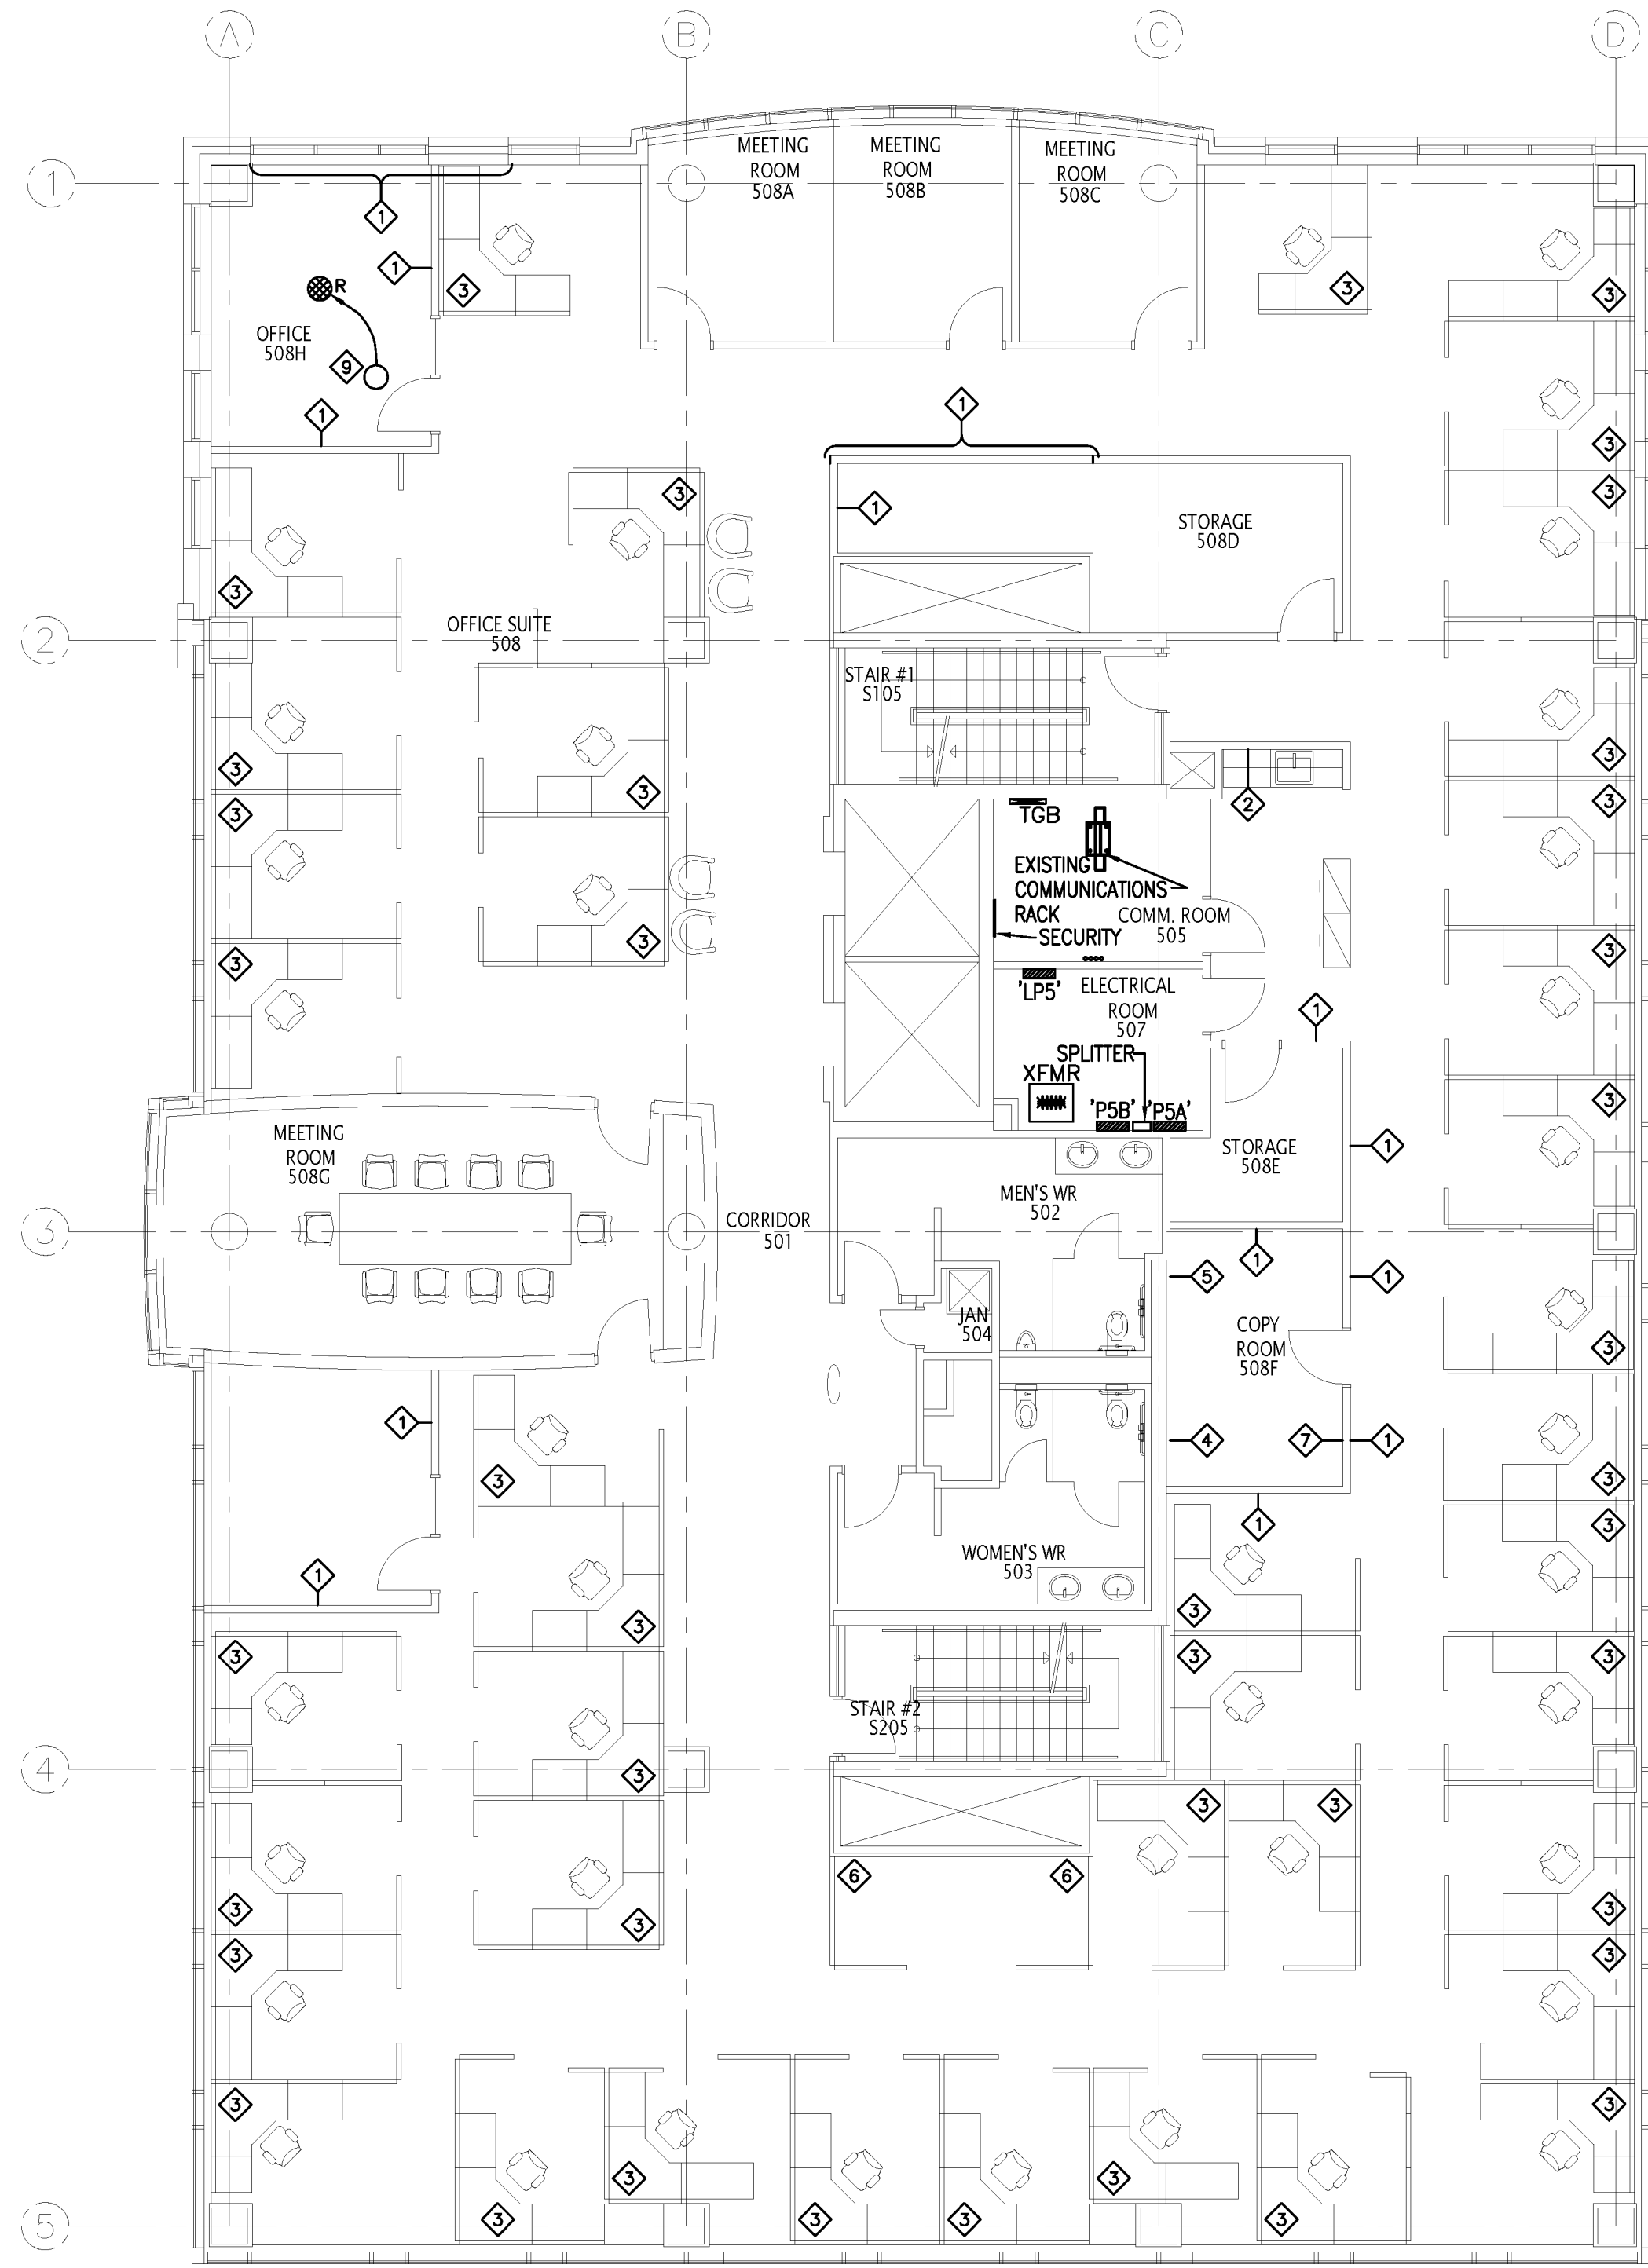

2
E.02 LEVEL 500 FLOOR PLAN - DEMOLITION
SCALE : 1:100
0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m
LEVEL 500 DEMOLITION NOTES:

- DISCONNECT AND REMOVE EXISTING RECEPTACLE, VOICE/DATA OUTLETS, ETC. LOCATED ON THIS WALL.
- DISCONNECT AND REMOVE EXISTING ELECTRICAL EQUIPMENT, RECEPTACLES, UNDERCOUNTER LIGHT, VOICE/DATA OUTLETS, ETC. IN EXISTING KITCHENETTE.
- DISCONNECT AND REMOVE EXISTING LINE VOLTAGE WIRING AND VOICE/DATA CABLING TO SYSTEMS FURNITURE FROM WALL MOUNTED JUNCTION BOXES. RE-USE EXISTING CIRCUITS IN JUNCTION BOXES TO FEED NEW SYSTEMS FURNITURE SUPPLIED AND INSTALLED BY OTHERS. RE-USE EXISTING VOICE/DATA CABLING FOR NEW SYSTEMS FURNITURE WHERE LENGTH OF CABLE PERMITS.
- DISCONNECT AND REMOVE EXISTING RECEPTACLE.
- EXISTING RECEPTACLE TO REMAIN.
- DISCONNECT AND REMOVE EXISTING FURNITURE FEEDS AND ASSOCIATED CONDUIT AND BOXES FOR POWER, VOICE AND DATA. RE-USE EXISTING CIRCUITS TO FEED WALL MOUNTED RECEPTACLES OR NEW FURNITURE FEEDS. EXTEND WIRING AS REQUIRED. USE VOICE/DATA CABLING TO FEED NEW VOICE/DATA WALL MOUNTED OUTLET.
- DISCONNECT AND REMOVE EXISTING VOICE/DATA OUTLET. COIL EXISTING CABLING UP IN CEILING AND LABEL AT BOTH ENDS. RE-USE CABLES IF POSSIBLE FOR NEW OUTLETS.
- VISIT SITE PRIOR TO CLOSE OF TENDER TO ASSESS EXISTING CONDITIONS, OBSTRUCTIONS, ETC.
- RELOCATE EXISTING FIRE ALARM SPEAKER TO SUIT NEW CONSTRUCTION EXTEND WIRING AS REQUIRED. PROVIDE MANUFACTURERS VERIFICATION REPORT FOR RELOCATED DEVICES.