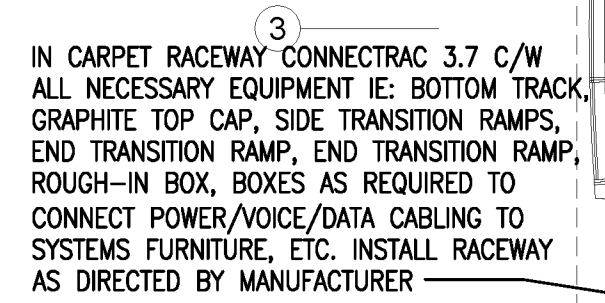


CCG WP2.0 FIT-UP  
MARITIME HEADQUARTERS  
BEDFORD INSTITUTE OF OCEANOGRAPHY  
DARTMOUTH  
NOVA SCOTIA

E-DRM/GDD-E: 552664 Version 1

ELECTRICAL NOTES:

- 1 EXISTING SYSTEMS FURNITURE FEED. RE-USE TO FEED NEW SYSTEMS FURNITURE.
- 2 NEW SYSTEMS FURNITURE FEED. INSTALL 2 x 27mm CONDUITS DOWN WALL FROM JUNCTION BOX TO NEW FLUSH WALL 2 GANG BOX MOUNTED AT 458mm A.F.F. C/W SYSTEMS FURNITURE CONNECTION COVERPLATE TO MATCH EXISTING
- 3 EXISTING CIRCUIT TO BE RE-USED FOR NEW DEVICE, EXTEND WIRING AS REQUIRED.
- 4 FEED A MAXIMUM OF 6 SYSTEMS FURNITURE WORKSTATIONS FROM A THREE CIRCUIT FEED.
- 5 INSTALL BLANK COVERPLATE ON ALL UN-USED EXISTING SYSTEMS FURNITURE CONNECTION.

**NOTE:**  
FURNITURE FEED CIRCUITS WERE OBTAINED FROM AS BUILT ELECTRICAL DRAWING. ELECTRICAL CONTRACTOR SHALL VERIFY ON SITE EXACT CIRCUITS DRAWING EXISTING FURNITURE FEED CIRCUITS SO THAT EACH PIECE OF SYSTEMS FURNITURE HAS 3 CIRCUITS. NEUTRAL GROUND EXTEND CIRCUITS FROM CEILING MOUNTED JUNCTION BOXES DOWN EXISTING COLUMN FEEDS AS REQUIRED. ONE 3 CIRCUIT FEED SHALL FEED A MAXIMUM 6 WORKSTATIONS.