


ka designs
(902) 454-9889 kadesigns@eastlink.ca
3873 Memorial Drive, Halifax, N.S. B3K 5A4



DUMAC ENERGY LTD.
CONSULTING ENGINEERS
752 BEDFORD HIGHWAY
HALIFAX, N.S.
Tel: (902) 457-1300
Fax: (902) 457-1777
Email: DUMAC@DUMACNS.CA

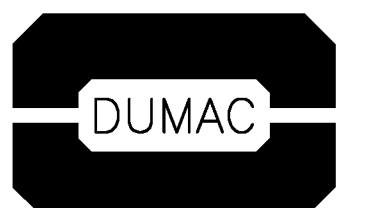


1.	ISSUED FOR TENDER	01.26.2018
revisions		date
project		project


CCG WP2.0 FIT-UP
MARITIME HEADQUARTERS
NBEDFORD INSTITUTE OF OCEANOGRAPHY
DARTMOUTH
NOVA SCOTIA

drawing E.08
dessein
CCG FIT-UP
LEVELS 400 & 500
FLOOR PLAN -
POWER

designed	KADESIGNS	conçu
date		
drawn	KAD	dessiné
date	OCT.02.2017	
approved		approuvé
date		
Tender	IAN SCELES	Soumission
PWGSC Project Manager	Administrateur de projets TPSGC	
project number		no. du projet
	R.082156.001	
drawing no.		no. du dessin
	E.08	

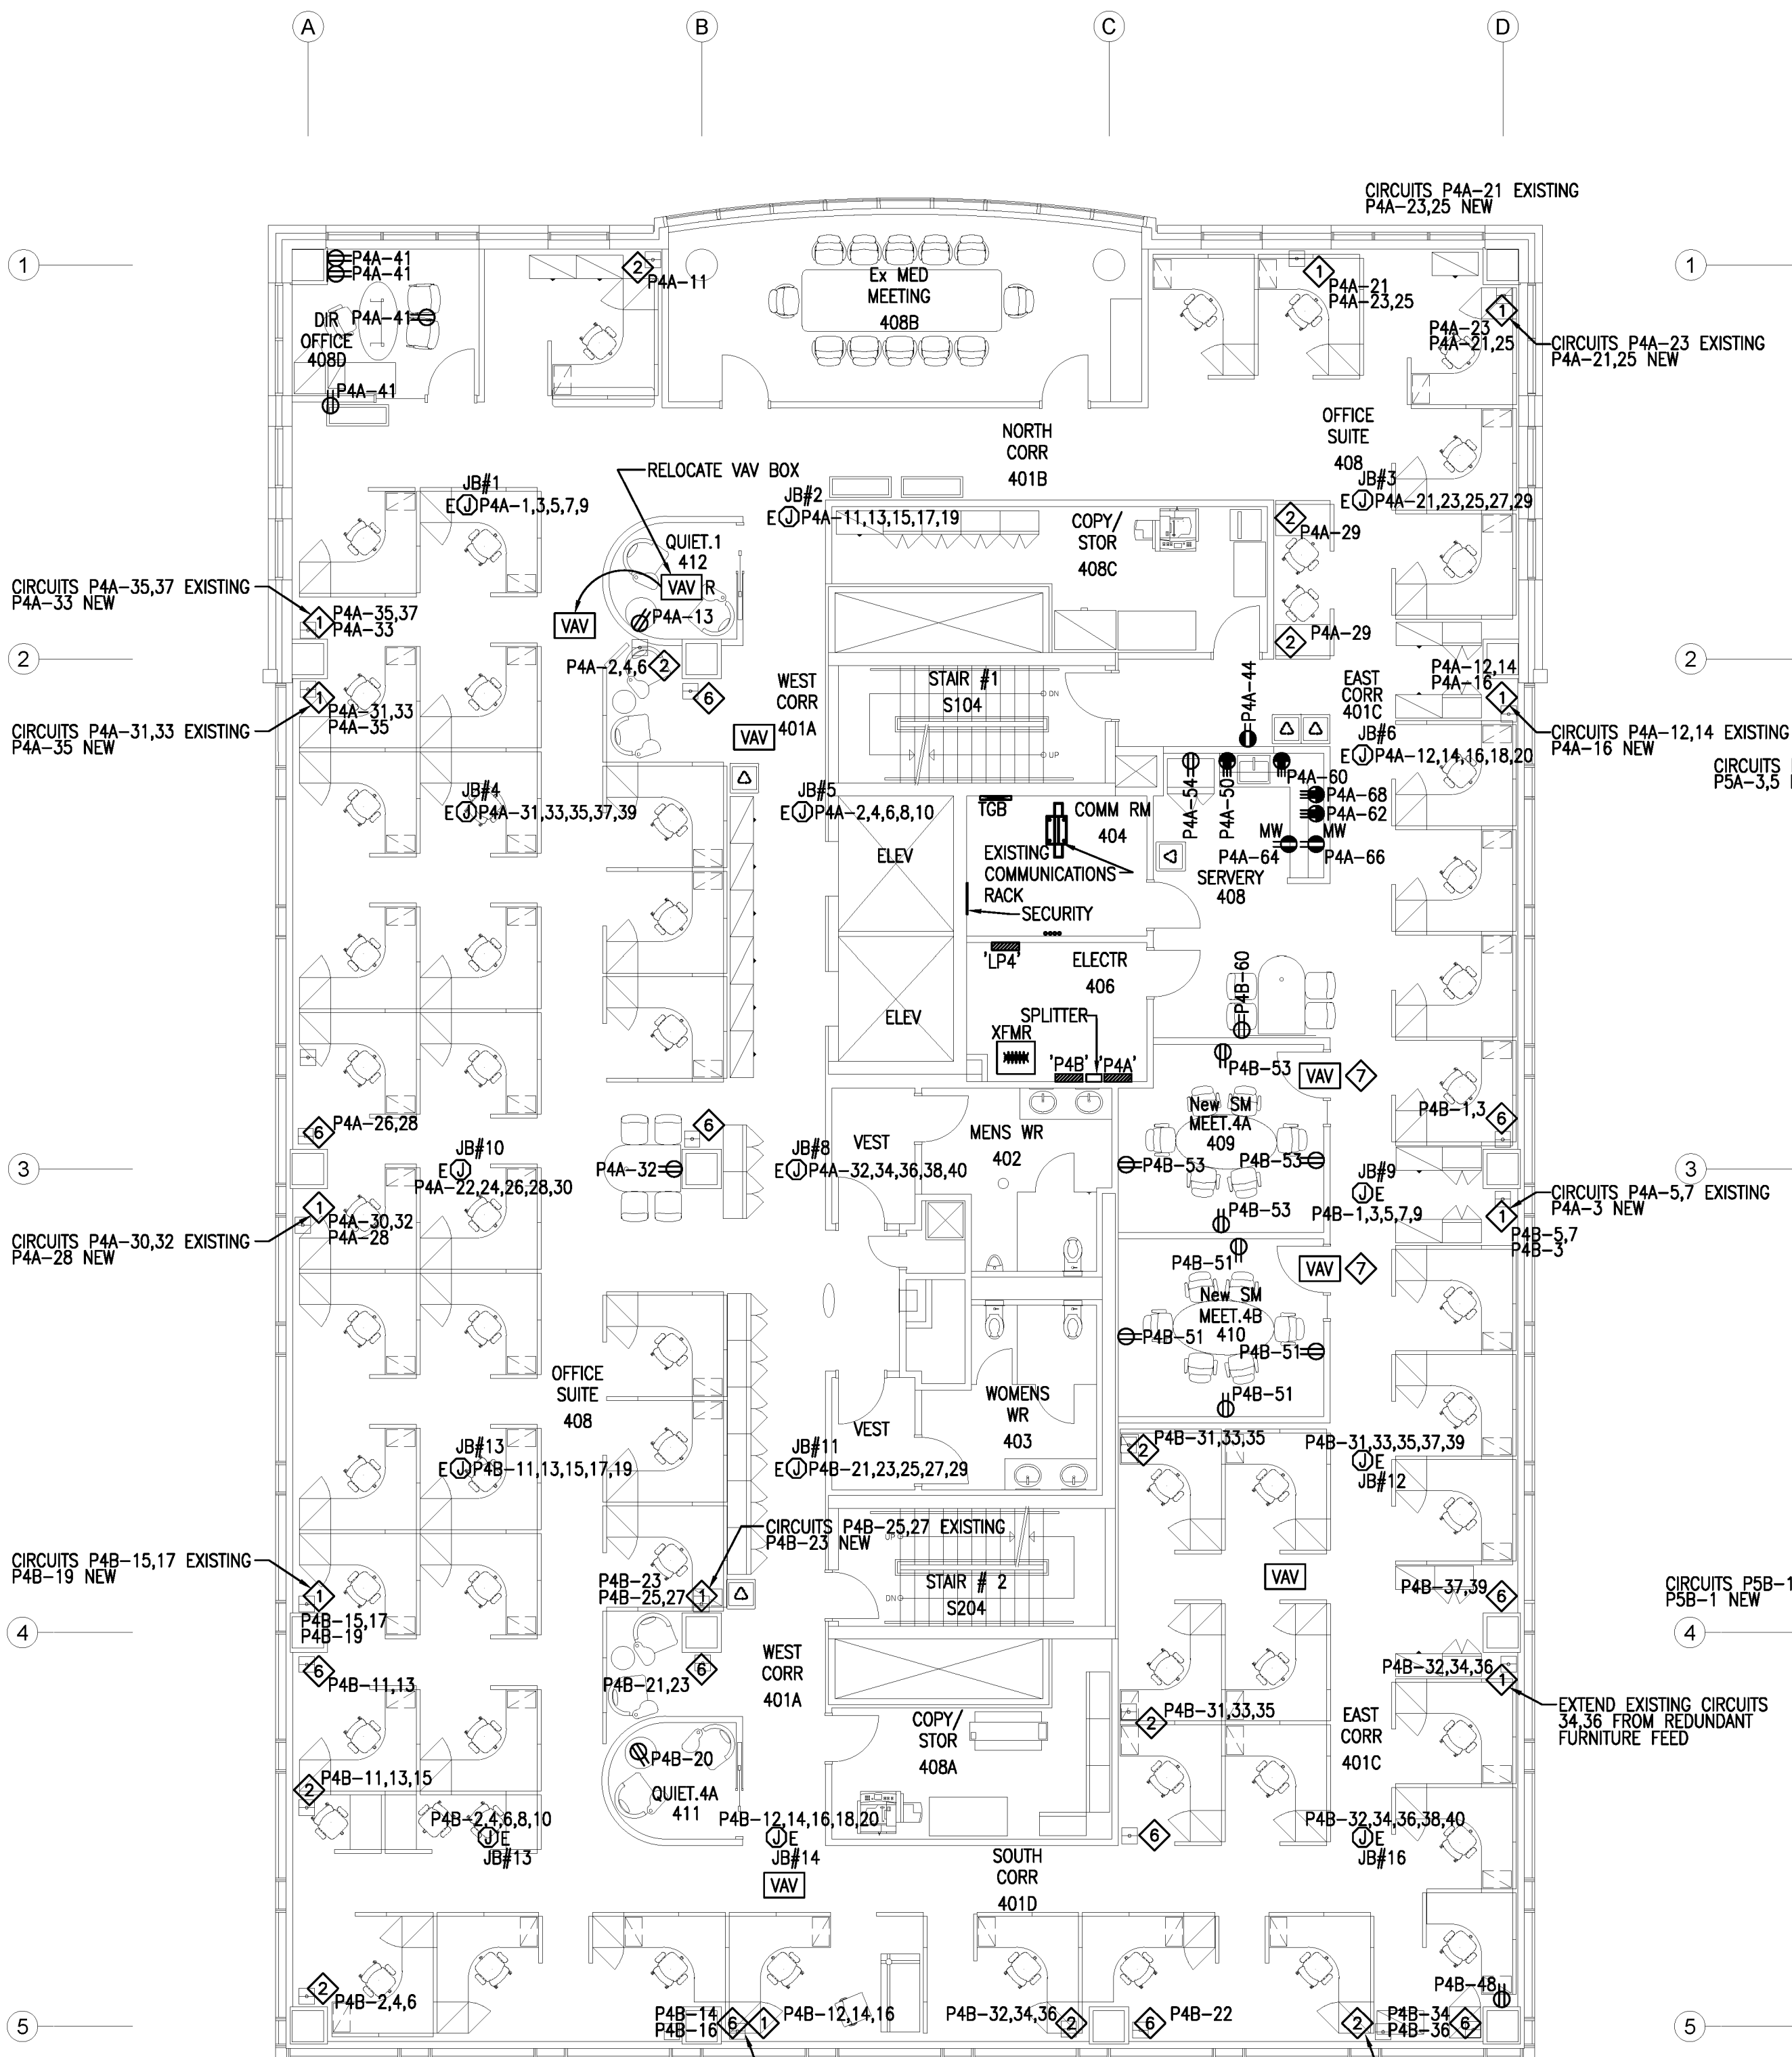

1
E.08
LEVEL 400 FLOOR PLAN - POWER
SCALE : 1:100

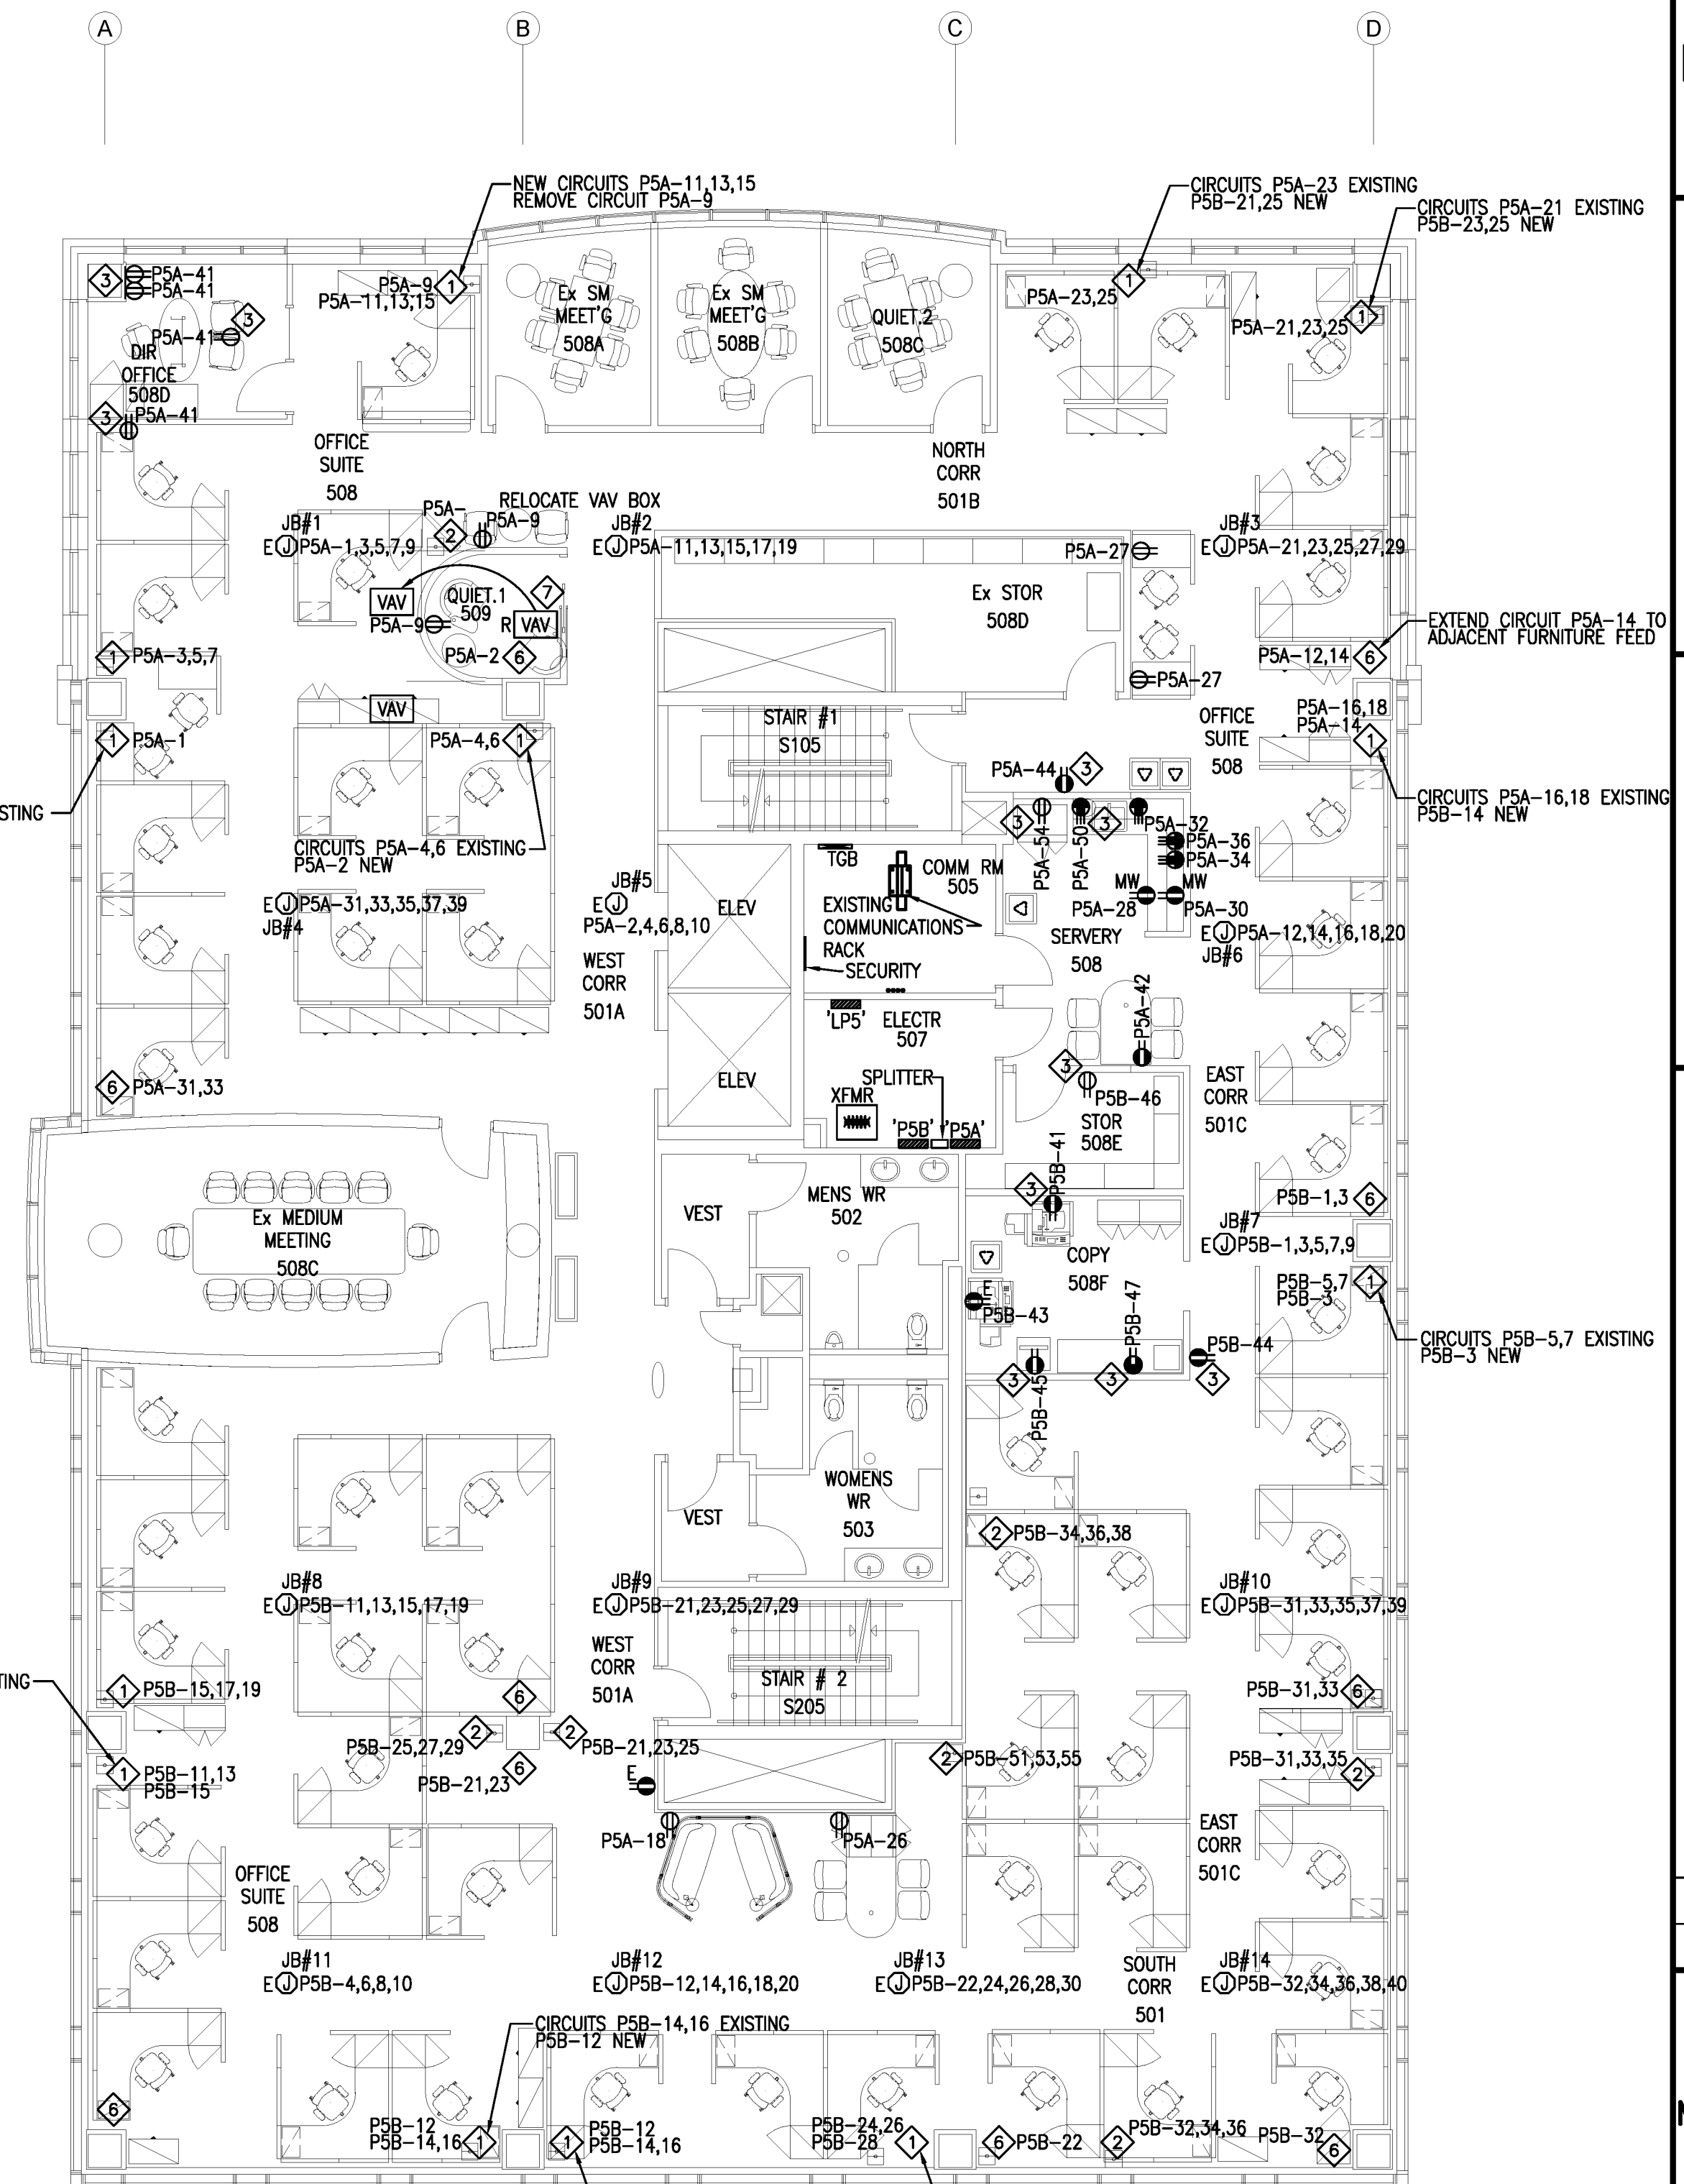

2
E.08
LEVEL 500 FLOOR PLAN - POWER
SCALE : 1:100

ELECTRICAL NOTES:

- EXISTING SYSTEMS FURNITURE FEED. RE-USE TO FEED NEW SYSTEMS FURNITURE.
- NEW SYSTEMS FURNITURE FEED. INSTALL 2 x 27mm CONDUITS DOWN WALL FROM JUNCTION BOX TO NEW FLUSH WALL 2 GANG BOX MOUNTED AT 458mm A.F.F. C/W SYSTEMS FURNITURE CONNECTION COVERPLATE TO MATCH EXISTING
- EXISTING CIRCUIT TO BE RE-USED FOR NEW DEVICE, EXTEND WIRING AS REQUIRED.
- FEED A MAXIMUM OF 6 SYSTEMS FURNITURE WORKSTATIONS FROM A THREE CIRCUIT FEED.
- INSTALL BLANK COVERPLATES ON ALL UN-USED EXISTING SYSTEMS FURNITURE CONNECTION.
- EXISTING FURNITURE FEED TO BE BLANKED OFF.
- VAV BOX RELOCATED TO SUIT NEW PARTITIONS. DISCONNECT 120V CIRCUIT TO EXISTING VAV BOX. RECONNECT 120V CIRCUIT TO RELOCATED VAV BOX. EXTEND WIRING AS REQUIRED.

NOTE:
FURNITURE FEED CIRCUITS WERE OBTAINED FROM AS BUILT ELECTRICAL DRAWING. ELECTRICAL CONTRACTOR SHALL VERIFY ON SITE EXACT CIRCUITS FEEDING EXISTING FURNITURE. RE-WORK CIRCUITS SO THAT EACH PIECE OF SYSTEMS FURNITURE HAS 3 CIRCUITS + NEUTRAL + GROUND. EXTEND CIRCUITS FROM CEILING MOUNTED JUNCTION BOXES DOWN EXISTING COLUMN FEEDS AS REQUIRED. ONE 3 CIRCUIT FEED SHALL FEED A MAXIMUM 6 WORKSTATIONS.