


ka designs
(902) 454-9889 kadesigns@eastlink.ca
3873 Memorial Drive, Halifax, N.S. B3K 5A4



DUMAC ENERGY LTD.
CONSULTING ENGINEERS
752 BEDFORD HIGHWAY
HALIFAX, N.S.
Tel: (902) 457-1300
Fax: (902) 457-1777
Email: DUMAC@DUMACNS.CA

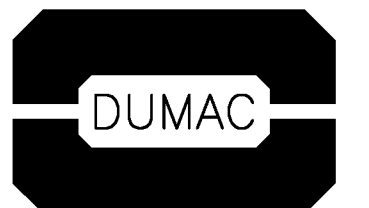

1.	ISSUED FOR TENDER	01.26.2018
revisions		date
project		project


CCG WP2.0 FIT-UP
MARITIME HEADQUARTERS
BEDFORD INSTITUTE OF OCEANOGRAPHY
DARTMOUTH
NOVA SCOTIA

drawing dessin

CCG FIT-UP
LEVELS 200 & 300
FLOOR PLANS -
POWER

designed	KADesigns	conçu
date		
drawn	KAD	dessiné
date	OCT.02.2018	
approved		approuvé
date		
Tender	IAN SCELES	Soumission
PWGC Project Manager	Administrateur de projets TPSGC	
project number		no. du projet
	R.082156.001	
drawing no.		no. du dessin


E.07

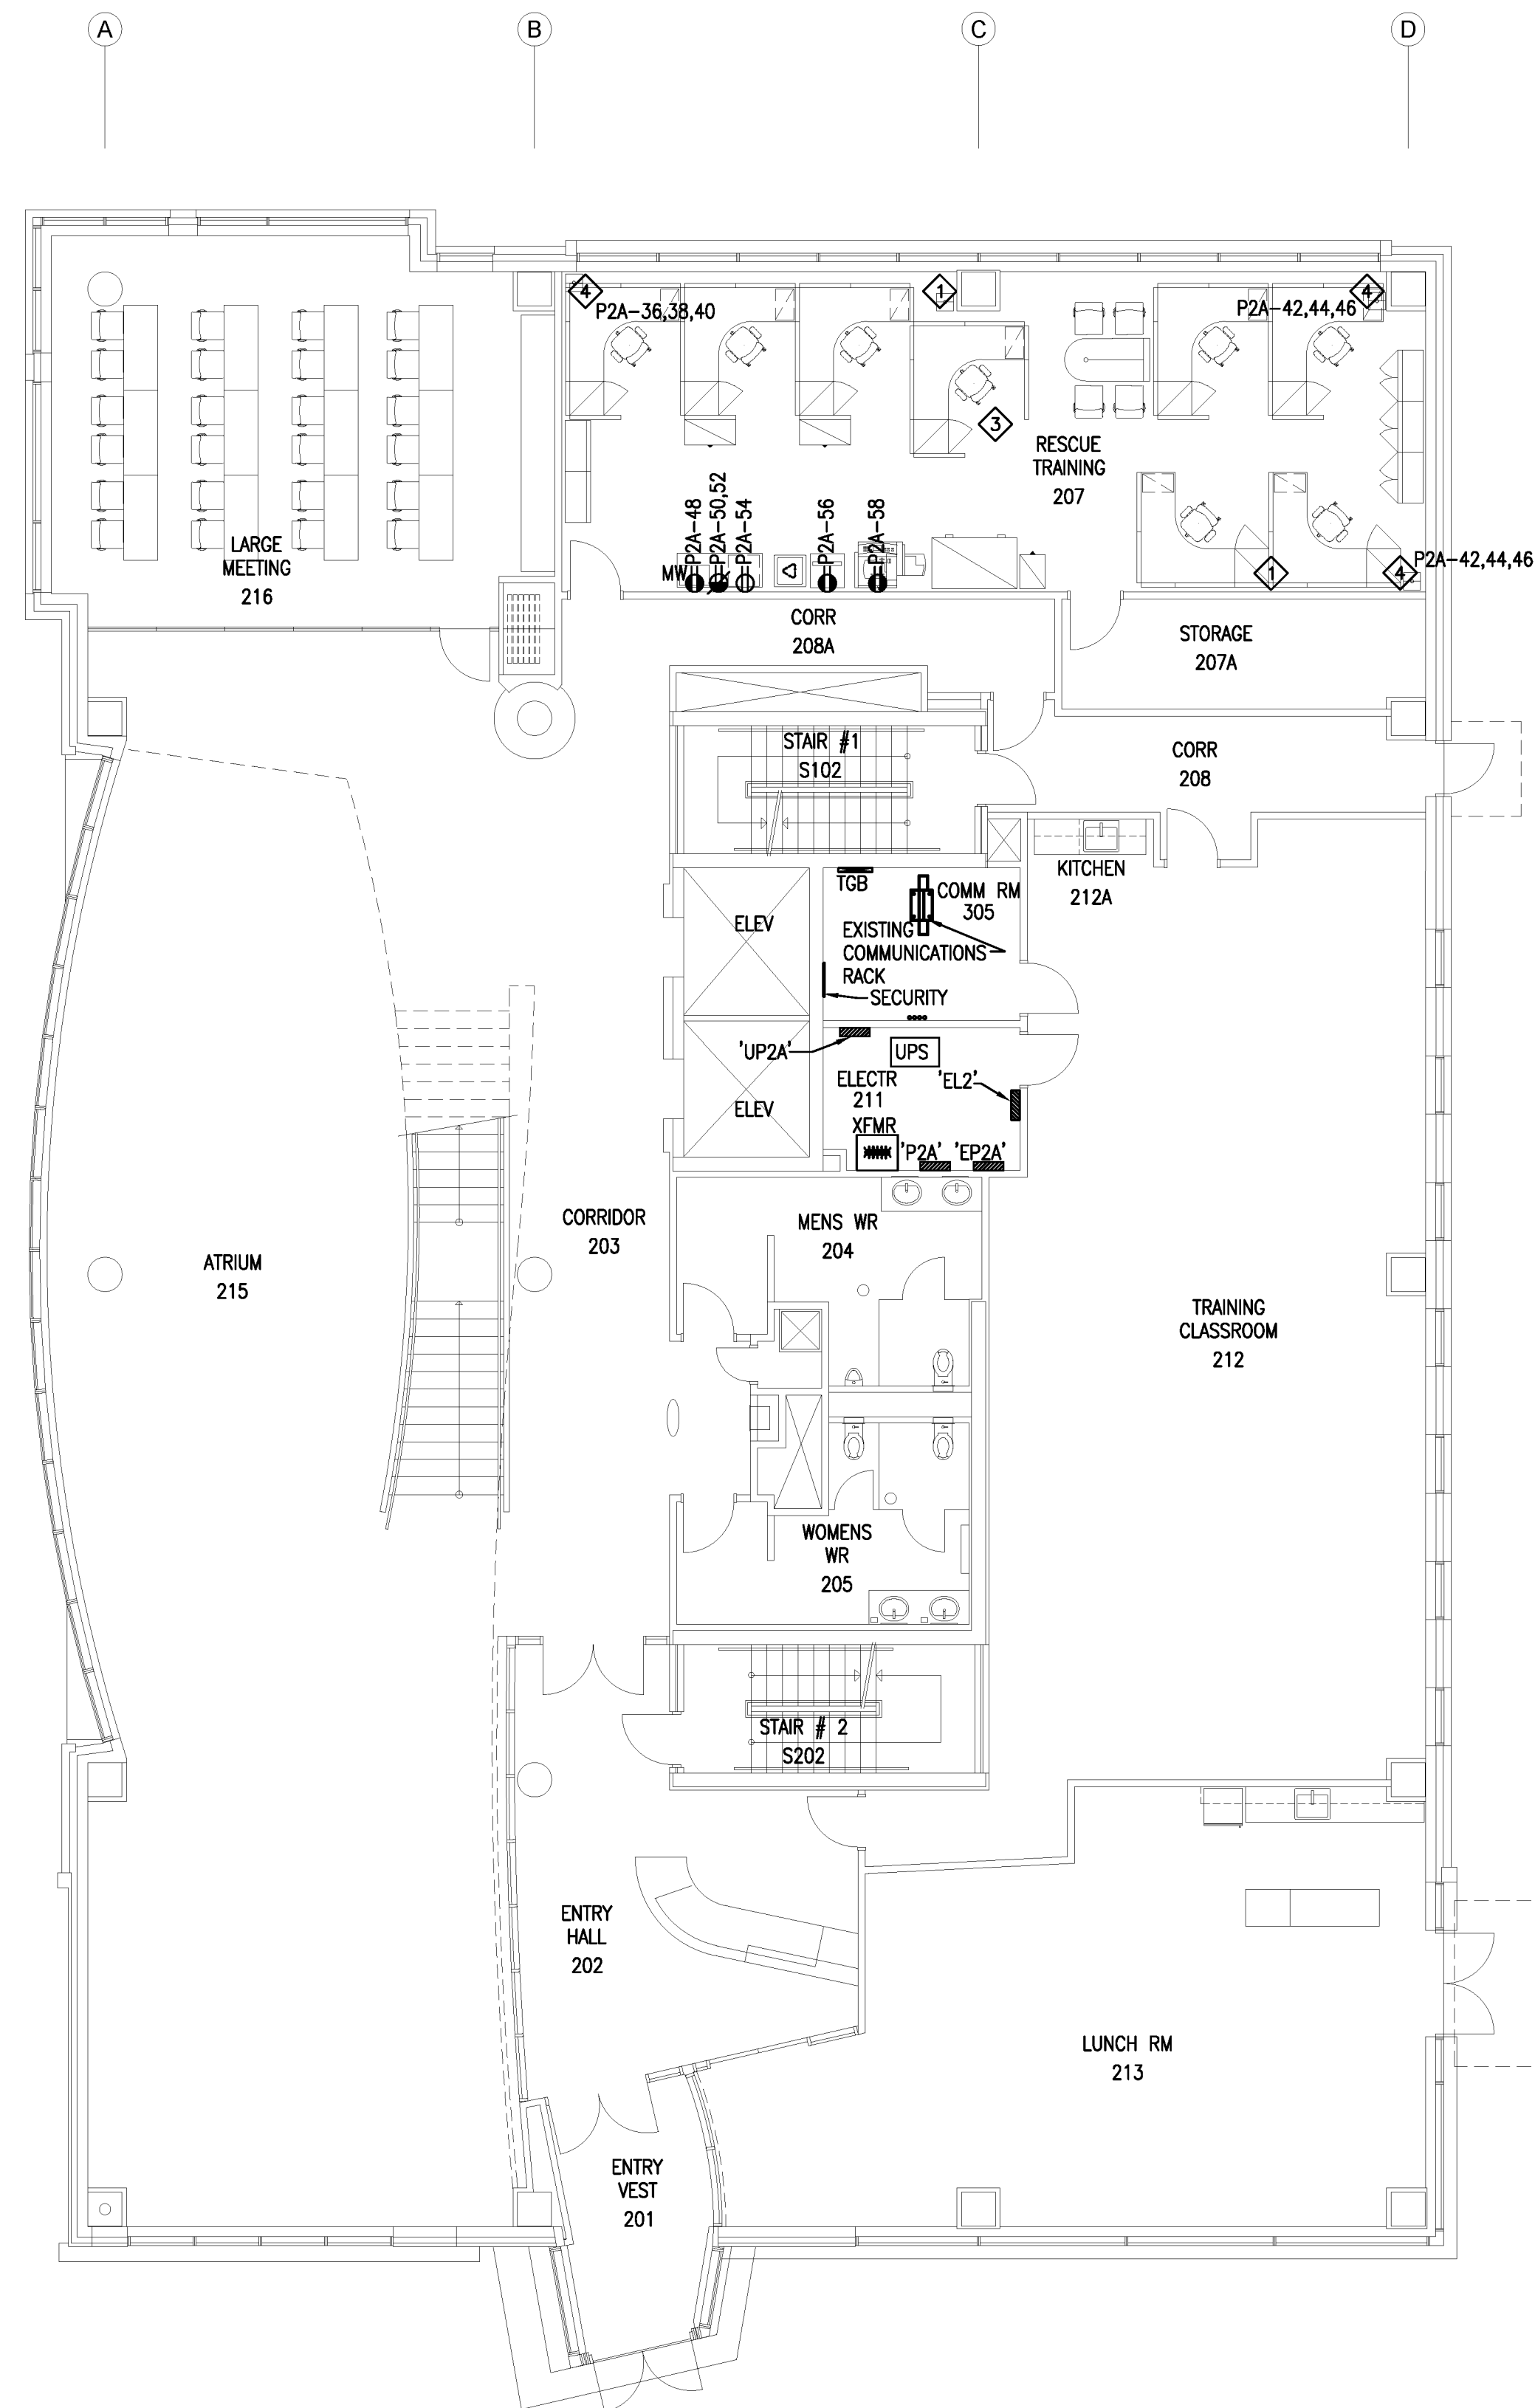

1 LEVEL 200 FLOOR PLAN - POWER
E.07
SCALE : 1:100
0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m

ELECTRICAL NOTES:

- EXISTING SYSTEMS FURNITURE FEED. RE-USE TO FEED NEW SYSTEMS FURNITURE.
- FEED A MAXIMUM OF 6 SYSTEMS FURNITURE WORKSTATIONS FROM A THREE CIRCUIT FEED.
- INSTALL BLANK COVERPLATE ON UN-USED EXISTING SYSTEMS FURNITURE CONNECTION.
- NEW SYSTEMS FURNITURE FEED. INSTALL 2 x 27mm CONDUITS DOWN WALL FROM JUNCTION BOX MOUNTED AT 458mm A.F.F. C/W SYSTEMS FURNITURE CONNECTION COVERPLATE TO MATCH EXISTING.

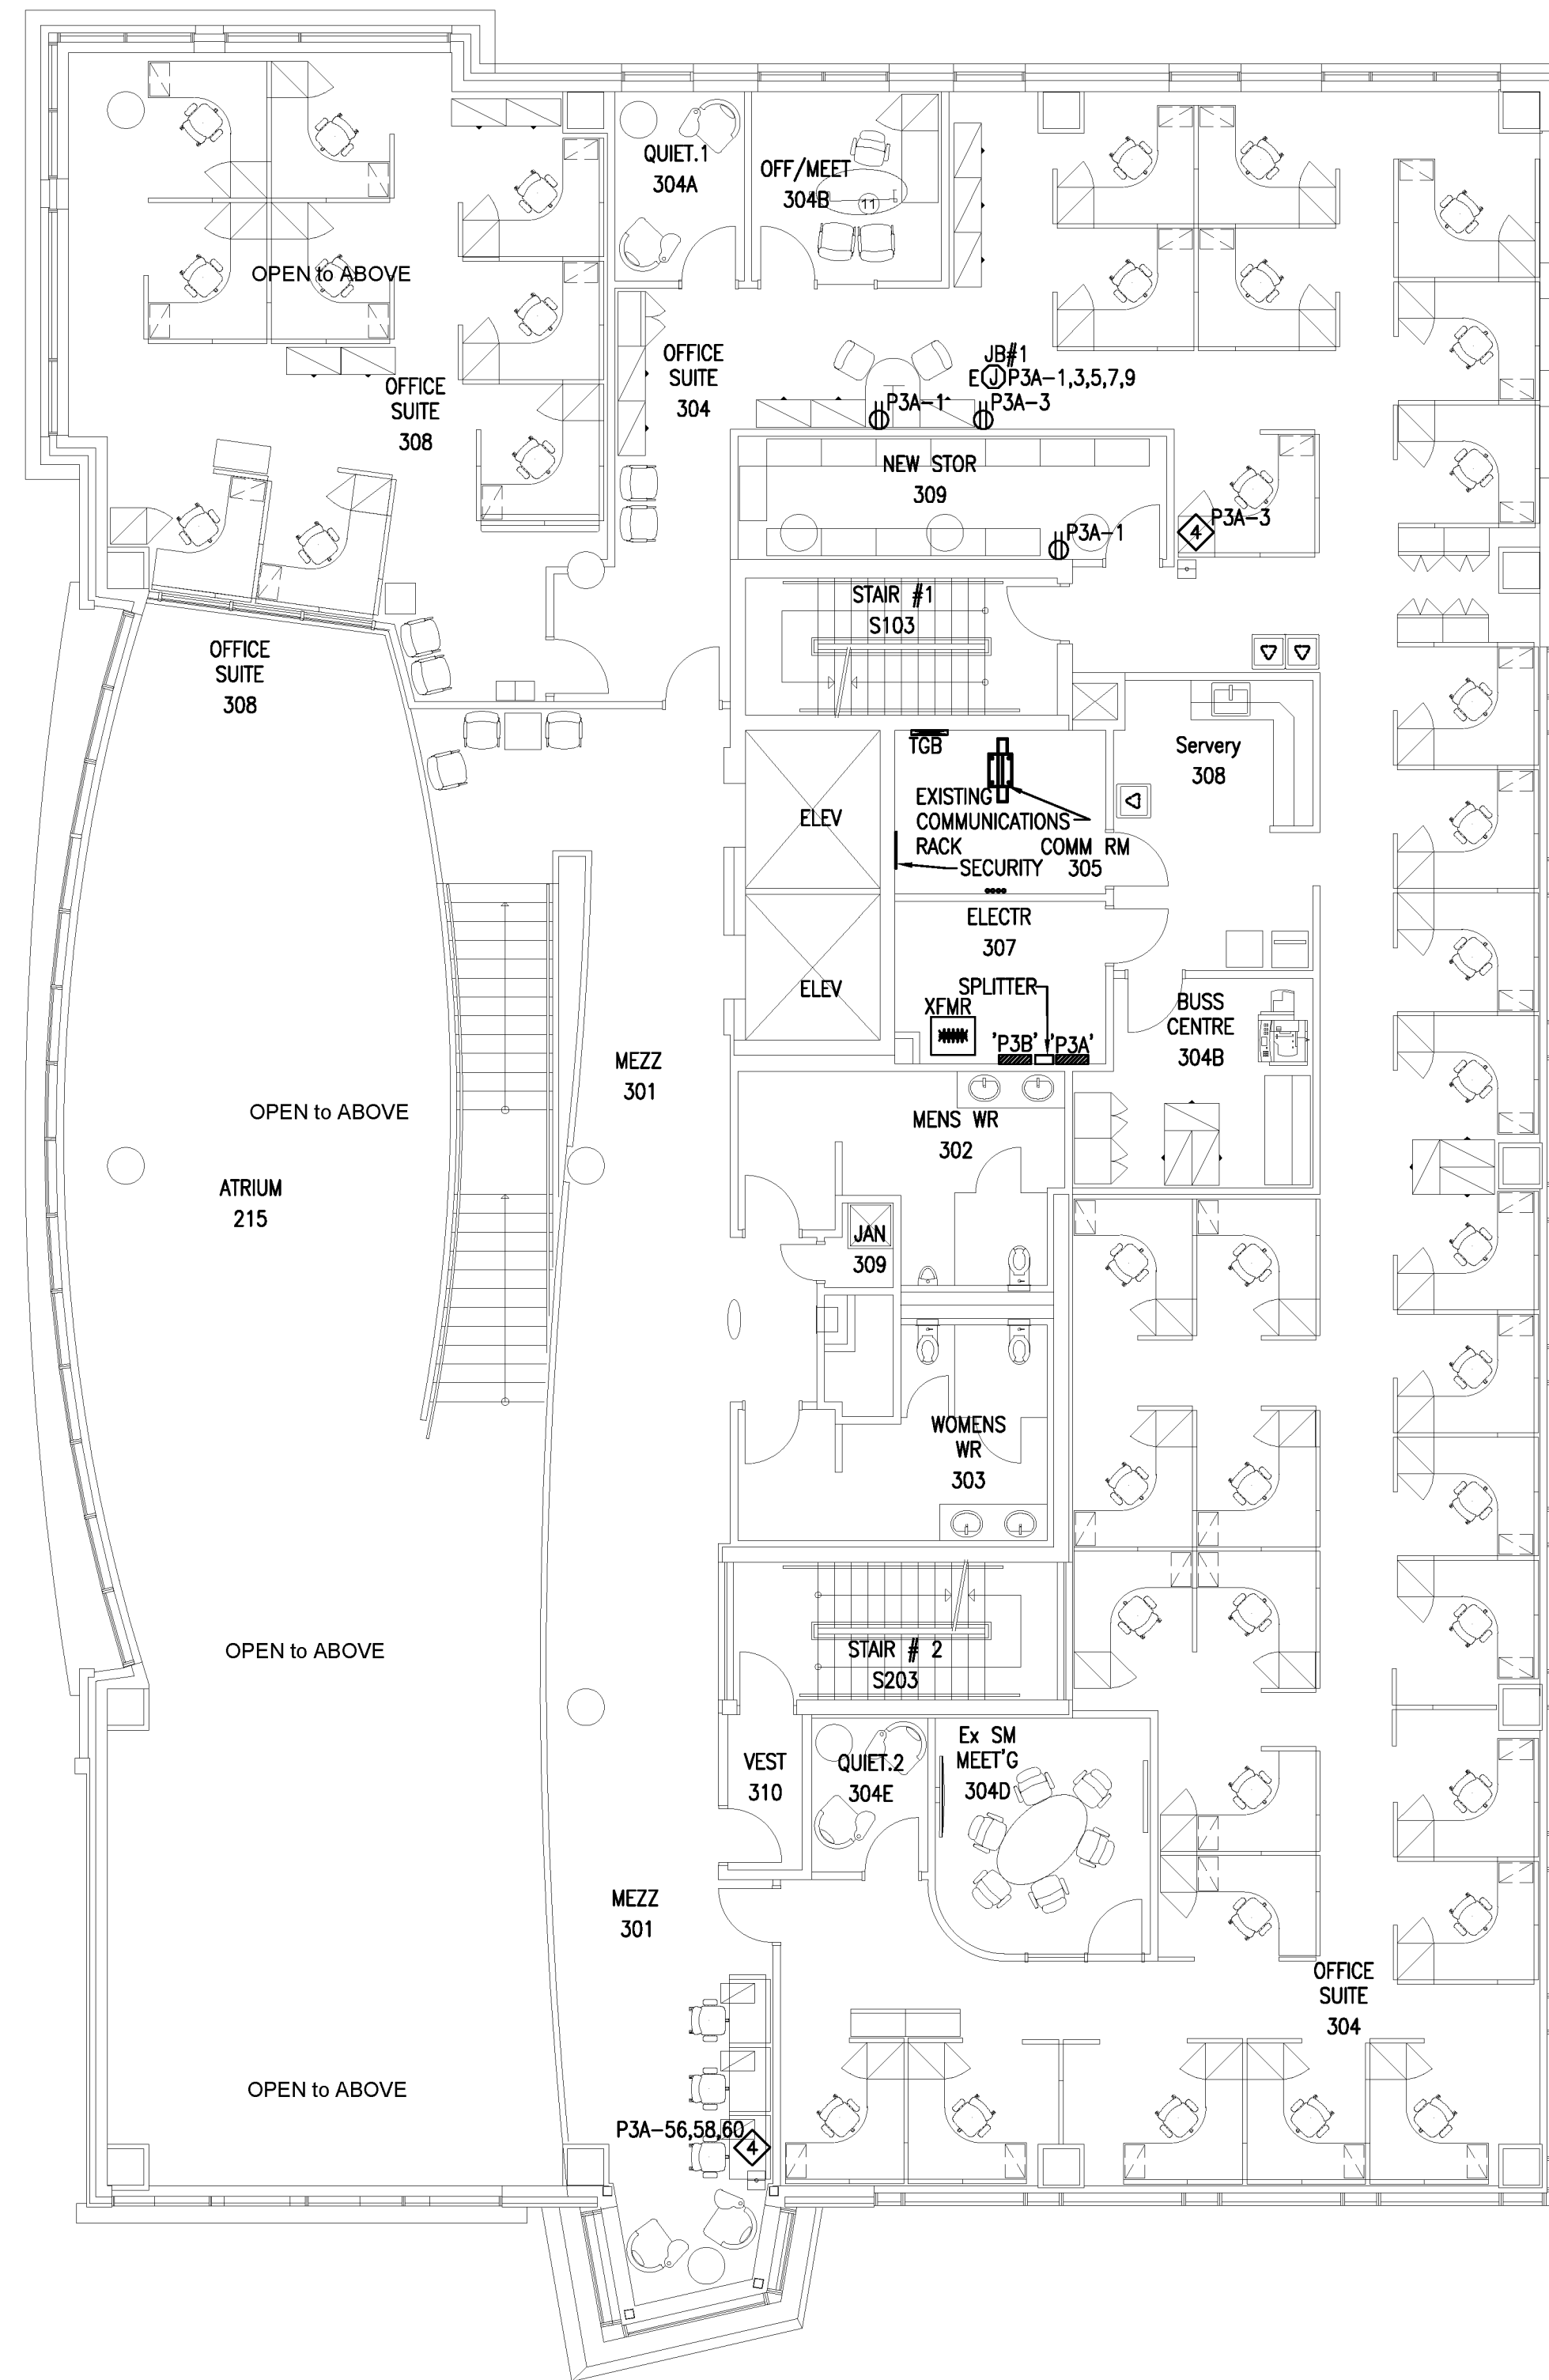

2 LEVEL 300 FLOOR PLAN - POWER
E.07
SCALE : 1:100
0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m

NOTE:
FURNITURE FEED CIRCUITS WERE OBTAINED FROM AS BUILT ELECTRICAL DRAWING. ELECTRICAL CONTRACTOR SHALL VERIFY ON SITE EXACT CIRCUITS FEEDING EXISTING FURNITURE. RE-WORK CIRCUITS SO THAT EACH PIECE OF SYSTEMS FURNITURE HAS 3 CIRCUITS + NEUTRAL + GROUND. EXTEND CIRCUITS FROM CEILING MOUNTED JUNCTION BOXES DOWN EXISTING COLUMN FEEDS AS REQUIRED. ONE 3 CIRCUIT FEED SHALL FEED A MAXIMUM 6 WORKSTATIONS.