



## RETURN BIDS TO:

## RETOURNER LES SOUMISSIONS À:

Bid Receiving Public Works & Government Services  
Canada/Réception des soumissions Travaux publics et  
Services gouvernementaux Canada

1713 Bedford Row

Halifax, N.S./Halifax, (N.E.)

Halifax

Nova Scotia

B3J 1T3

Bid Fax: (902) 496-5016

## SOLICITATION AMENDMENT MODIFICATION DE L'INVITATION

The referenced document is hereby revised; unless otherwise  
indicated, all other terms and conditions of the Solicitation  
remain the same.

Ce document est par la présente révisé; sauf indication contraire,  
les modalités de l'invitation demeurent les mêmes.

### Comments - Commentaires

### Vendor/Firm Name and Address

Raison sociale et adresse du  
fournisseur/de l'entrepreneur

### Issuing Office - Bureau de distribution

Atlantic Region Acquisitions/Région de l'Atlantique  
Acquisitions

1713 Bedford Row

Halifax, N.S./Halifax, (N.E.)

Halifax

Nova Scot

B3J 1T3

<b>Title - Sujet</b> Kentville Winery	
<b>Solicitation No. - N° de l'invitation</b> EB144-182595/A	<b>Amendment No. - N° modif.</b> 003
<b>Client Reference No. - N° de référence du client</b> EB144-18-2595	<b>Date</b> 2018-02-27
<b>GETS Reference No. - N° de référence de SEAG</b> PW-\$PWA-121-5719	
<b>File No. - N° de dossier</b> PWA-7-78135 (121)	<b>CCC No./N° CCC - FMS No./N° VME</b>
<b>Solicitation Closes - L'invitation prend fin</b> <b>at - à 02:00 PM</b> <b>on - le 2018-03-01</b>	<b>Time Zone</b> <b>Fuseau horaire</b> Atlantic Standard Time AST
<b>F.O.B. - F.A.B.</b> <b>Plant-Usine:</b> <input type="checkbox"/> <b>Destination:</b> <input checked="" type="checkbox"/> <b>Other-Autre:</b> <input type="checkbox"/>	
<b>Address Enquiries to: - Adresser toutes questions à:</b> Russell (PWA), Alex	<b>Buyer Id - Id de l'acheteur</b> pwa121
<b>Telephone No. - N° de téléphone</b> (902) 401-8180 ( )	<b>FAX No. - N° de FAX</b> (902) 496-5016
<b>Destination - of Goods, Services, and Construction:</b> <b>Destination - des biens, services et construction:</b>	

Instructions: See Herein

Instructions: Voir aux présentes

<b>Delivery Required - Livraison exigée</b>	<b>Delivery Offered - Livraison proposée</b>
<b>Vendor/Firm Name and Address</b> <b>Raison sociale et adresse du fournisseur/de l'entrepreneur</b>	
<b>Telephone No. - N° de téléphone</b> <b>Facsimile No. - N° de télécopieur</b>	
<b>Name and title of person authorized to sign on behalf of Vendor/Firm</b> <b>(type or print)</b> <b>Nom et titre de la personne autorisée à signer au nom du fournisseur/</b> <b>de l'entrepreneur (taper ou écrire en caractères d'imprimerie)</b>	
<b>Signature</b>	<b>Date</b>

**Amendment 003 is raised for the following:**

22. We need a site visit in order to confirm the location of the bus duct and panels in order to relocate them to the new drawings locations. The drawings are unclear to obtain this.

**Connor Note: There will not be a site visit. Image pointing out locations below.**



24. Question 14 of addendum # 2 specifies that all panel boards are to be rated 65KIAC . Currently on site most 42 cct panels are 10KAIC. Please confirm that you do indeed want 65KIAC for all panels due to size and cost difference?

Our interpretation of the Addendum #2 Q14 answer is:

All 120/208 3phase panels will have a 225Amp bus rating with 10KIAC for the breakers.

All 600V 3phase panels will be 65KIAC.

The intent was for all panelboards (120/208V) to be fully rated at 65kAIC as the fault current off of the 1350A bus was calculated to be approximately 45kA. As per new information, we will require 65kAIC series rated panelboards with 10kAIC branch circuit breakers.

25. If our interpretation is wrong and all panels do indeed need to be 65KIAC we are unable to get GFI breakers to fit a 65KIAC panel.

Refer to Q24 answer. In order to source GFI breakers, series rated panelboards with 65kAIC main breaker will be accepted in order to meet design requirements. Panels 'PR', 'PRA' and '2U' will each require a main breaker rated 100A, 3P, 65kAIC. Panels 'PRC' and 'EM-11' will require a main breaker rated 200A, 3P, 65kAIC. All series rated panels are to be marked at the time of installation in a conspicuous and legible manner to indicate that components must only be replaced with components of the same type and rating. Contractor is to coordinate series rated panelboards with panelboard manufacturer.


26. We can't seem to find the piping spec for the glycol piping. Can you please advise what material will be used Stainless or Black iron?

A26 Glycol Piping is to ASTM A53/A53M, Grade B as indicated in specification section 23 21 13.02 Hydronic systems: Steel

27. In regards to **Const. Of Kentville Research Winery (EB144-182595/A)**

Can you provide the information in regards to the bus duct that will be feeding panel PRC?

Schneider requires the job # off of the unit or to be told what exactly is there, so they know what is required.

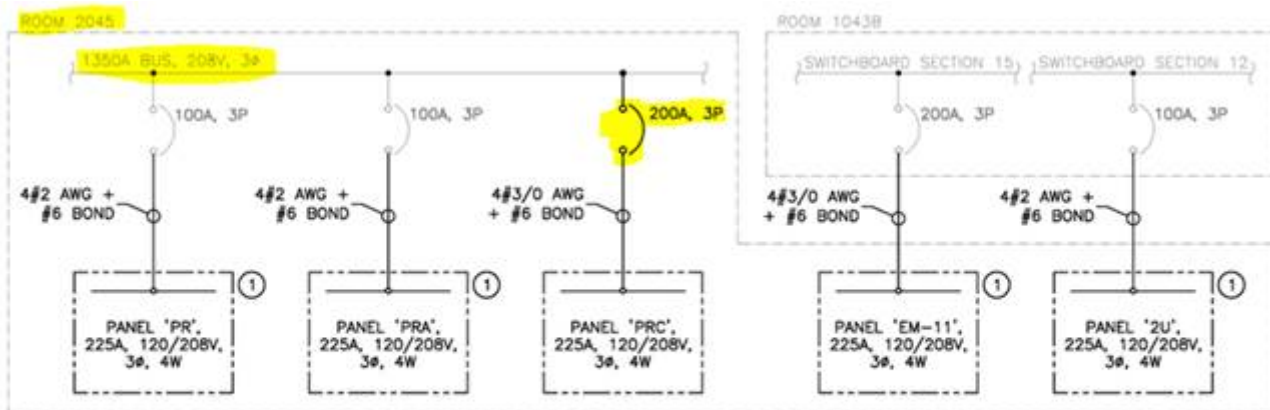

5  
E2

### SCHEMATIC – PROPOSED PARTIAL SINGLE LINE DIAGRAM

NOTES: (1)

1. ALL PANELS MUST BE FULLY RATED AT 65KAIC AS THE FAULT CURRENT OFF OF THE 1350A BUS WAS CALCULATED TO BE APPROXIMATELY 45KA.

- A27 The Bus Duct is Federal Pioneer,  
1350 amps,  
120/208 volts,  
3 phase,  
4 wire,  
Type – FST,  
Order Number – 02-12938

Solicitation No. - N° de l'invitation  
EB144-182595

Amd. No. - N° de la modif.  
003

Buyer ID - Id de l'acheteur  
pwa121

Client Ref. No. - N° de réf. du client

File No. - N° du dossier

CCC No./N° CCC - FMS No./N° VME

***All other terms and conditions remain the same.***