



RETURN BIDS TO:

RETOURNER LES SOUMISSIONS À:

Public Works and Government Services Canada
ATB Place North Tower
10025 Jasper Ave./10025 ave. Jaspe
5th floor/5e étage
Edmonton
Alberta
T5J 1S6
Bid Fax: (780) 497-3510

**SOLICITATION AMENDMENT
MODIFICATION DE L'INVITATION**

The referenced document is hereby revised; unless otherwise indicated, all other terms and conditions of the Solicitation remain the same.

Ce document est par la présente révisé; sauf indication contraire, les modalités de l'invitation demeurent les mêmes.

Comments - Commentaires

Vendor/Firm Name and Address
Raison sociale et adresse du
fournisseur/de l'entrepreneur

Issuing Office - Bureau de distribution
Public Works and Government Services Canada
ATB Place North Tower
10025 Jasper Ave./10025 ave Jasper
5th floor/5e étage
Edmonton
Alberta
T5J 1S6

Title - Sujet Second Floor Fit-up - GOCB	
Solicitation No. - N° de l'invitation EV385-183075/A	Amendment No. - N° modif. 001
Client Reference No. - N° de référence du client PWGSC EV385-183075	Date 2018-03-19
GETS Reference No. - N° de référence de SEAG PW-\$PWU-004-11337	
File No. - N° de dossier PWU-7-40256 (004)	CCC No./N° CCC - FMS No./N° VME
Solicitation Closes - L'invitation prend fin at - à 02:00 PM on - le 2018-04-06	Time Zone Fuseau horaire Mountain Daylight Saving Time MDT
F.O.B. - F.A.B. Plant-Usine: <input type="checkbox"/> Destination: <input type="checkbox"/> Other-Autre: <input type="checkbox"/>	
Address Enquiries to: - Adresser toutes questions à: Espedido, Karielen K.	Buyer Id - Id de l'acheteur pwu004
Telephone No. - N° de téléphone (780) 497-3859 ()	FAX No. - N° de FAX (780) 497-3510
Destination - of Goods, Services, and Construction: Destination - des biens, services et construction: PWGSC GOCB 2nd Floor, 101 22nd Street East Saskatoon, SK	

Instructions: See Herein

Instructions: Voir aux présentes

Delivery Required - Livraison exigée	Delivery Offered - Livraison proposée
Vendor/Firm Name and Address Raison sociale et adresse du fournisseur/de l'entrepreneur	
Telephone No. - N° de téléphone Facsimile No. - N° de télécopieur	
Name and title of person authorized to sign on behalf of Vendor/Firm (type or print) Nom et titre de la personne autorisée à signer au nom du fournisseur/ de l'entrepreneur (taper ou écrire en caractères d'imprimerie)	
Signature	Date

This amendment has been raised with the following changes:

AMENDMENT #001:

On page 5 of 21 :

DELETE:

SI03 OPTIONAL SITE VISIT

1. There will be a site visit on Monday, March 26, 2018 at 1:30 PM. Interested bidders are to meet at the Commissionaires Desk on the Main Floor of the Government of Canada Building (101 22nd Street East, Saskatoon, SK).

INSERT:

SI03 OPTIONAL SITE VISIT

1. There will be a site visit on Monday, March 26, 2018 at 10:00 AM. Interested bidders are to meet at the Commissionaires Desk on the Main Floor of the Government of Canada Building (101 22nd Street East, Saskatoon, SK).

ADDENDUM #001:

The following changes to the tender documents are effective immediately and will form part of the contract documents:

CLARIFICATIONS

Architectural

Refer to drawings Architectural sheet A120 and Electrical sheet EP2.1 Add steel stud framing and gypsum wall board to furr out existing stair wall within Room 220 to accommodate new power and data outlets.

Mechanical


Refer to attached Mechanical RDM-01 and RDM-02. Revision cloud indicates area of changes to the original drawing set. All other items not tagged are to remain as per construction documents.

QUESTIONS & ANSWERS

Q1 I was looking at the drawings for this project and was wondering if there was a requirement for a Security Systems contractor or if you had one already? As well, I wanted to clarify that this is a different project from SAS-101 Fit-Up?


A1 A Security Systems contractor will not be required. General Contractor shall coordinate their work with End User's security contractor. The SAS-101 Fit-Up is a different and separate project.

END OF AMENDMENT

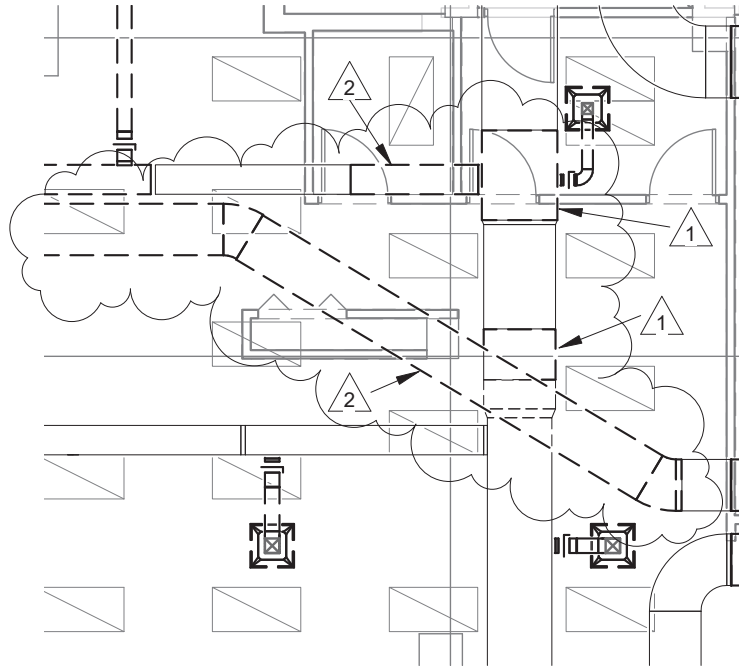

KEY NOTES

- 1 DEMOLISH EXISTING PORTION OF DUCTWORK AS REQUIRED TO ACCOMMODATE NEW SECURITY BARS DURING RENOVATION.
- 2 DEMOLISH DUCTWORK AS SHOWN TO ACCOMMODATE NEW WALL CONSTRUCTION DURING RENOVATION.

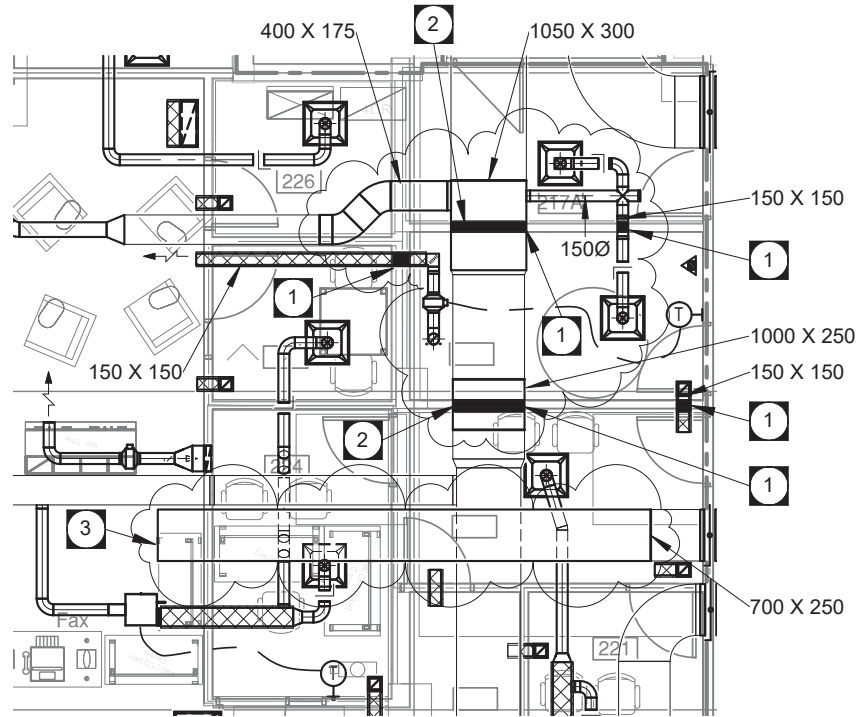

KEY NOTES

- 1 PROVIDE PRE-MANUFACTURED DUCT SECURITY BAR SYSTEM COMPLETE WITH DUCT SLEEVE. BARRIER BARS SHALL BE 13MM STEEL RODS, PLACED NO MORE THAN 150MM VERTICALLY AND 600MM HORIZONTALLY APART. SYSTEM SHALL BE FULLY WELDED. CONTRACTOR TO CONFIRM SLEEVE LENGTH ON SITE PRIOR TO ORDERING. INSTALL AS PER MANUFACTURER INSTALLATION GUIDELINES.
- 2 WHERE SECURITY BAR SYSTEM EXCEEDS MAXIMUM ALLOWABLE DIMENSIONS AS SET BY THE MANUFACTURER, CONTRACTOR SHALL FIELD WELD SECTIONS OF SECURITY BAR SYSTEMS TOGETHER TO FULLY COVER DUCT OPENING. REFER TO MANUFACTURER GUIDELINES FOR REQUIREMENTS.
- 3 OPEN ENDED DUCT WITHIN DROPPED CEILING.