


PRELIMINARY
NOT FOR CONSTRUCTION

CK A + I D

Suite 101
4632 1st Street
Calgary, Alberta
T2C 2L3
T. 403.269.710
F. 403.269.759

COUPLAND, KRAEMER
ARCHITECTURE + INTERIOR DESIGN INC.

203 WELLMAN CRESCENT
SASKATOON SASKATCHEWAN CANADA S7T 0J1
TEL.: 1-306-665-6223 | FAX: 1-306-665-8589 | WWW.WSPGROUP.COM

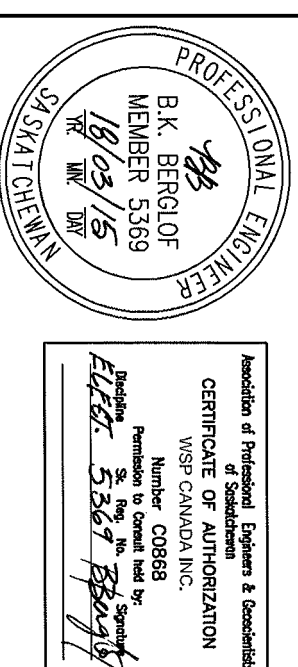

Revision/ Iteration	Description/Description	Date/Date
0	ISSUED PORT TENDER	2016/01/16
1		
2		
3		
4		
5		

**Immigration, Refugees and
Citizenship Canada**

**Saskatoon
Saskatchewan**


Project title/Titre du projet
Government of Canada Building
101 - 22 Street East

**IRCC Relocation Fit-up
Saskatoon, Saskatchewan**

Approved by/Approve for	
Designed by/Concept for	
1.M	
Drawn by/Execute for	
1.M	
PKSC Project Manager/Assistant to Project PKSC	
AR	
PKSC Architectural and Engineering Resources Manager/ Resource Allocation of the Project Group, PKSC	
Client/client	

2ND FLOOR - DEMOLITION LIGHTING

Project No./No. du projet	Sheet/feuille	Revision no. La révision no.
R.076325.006	E2.1 OF	0

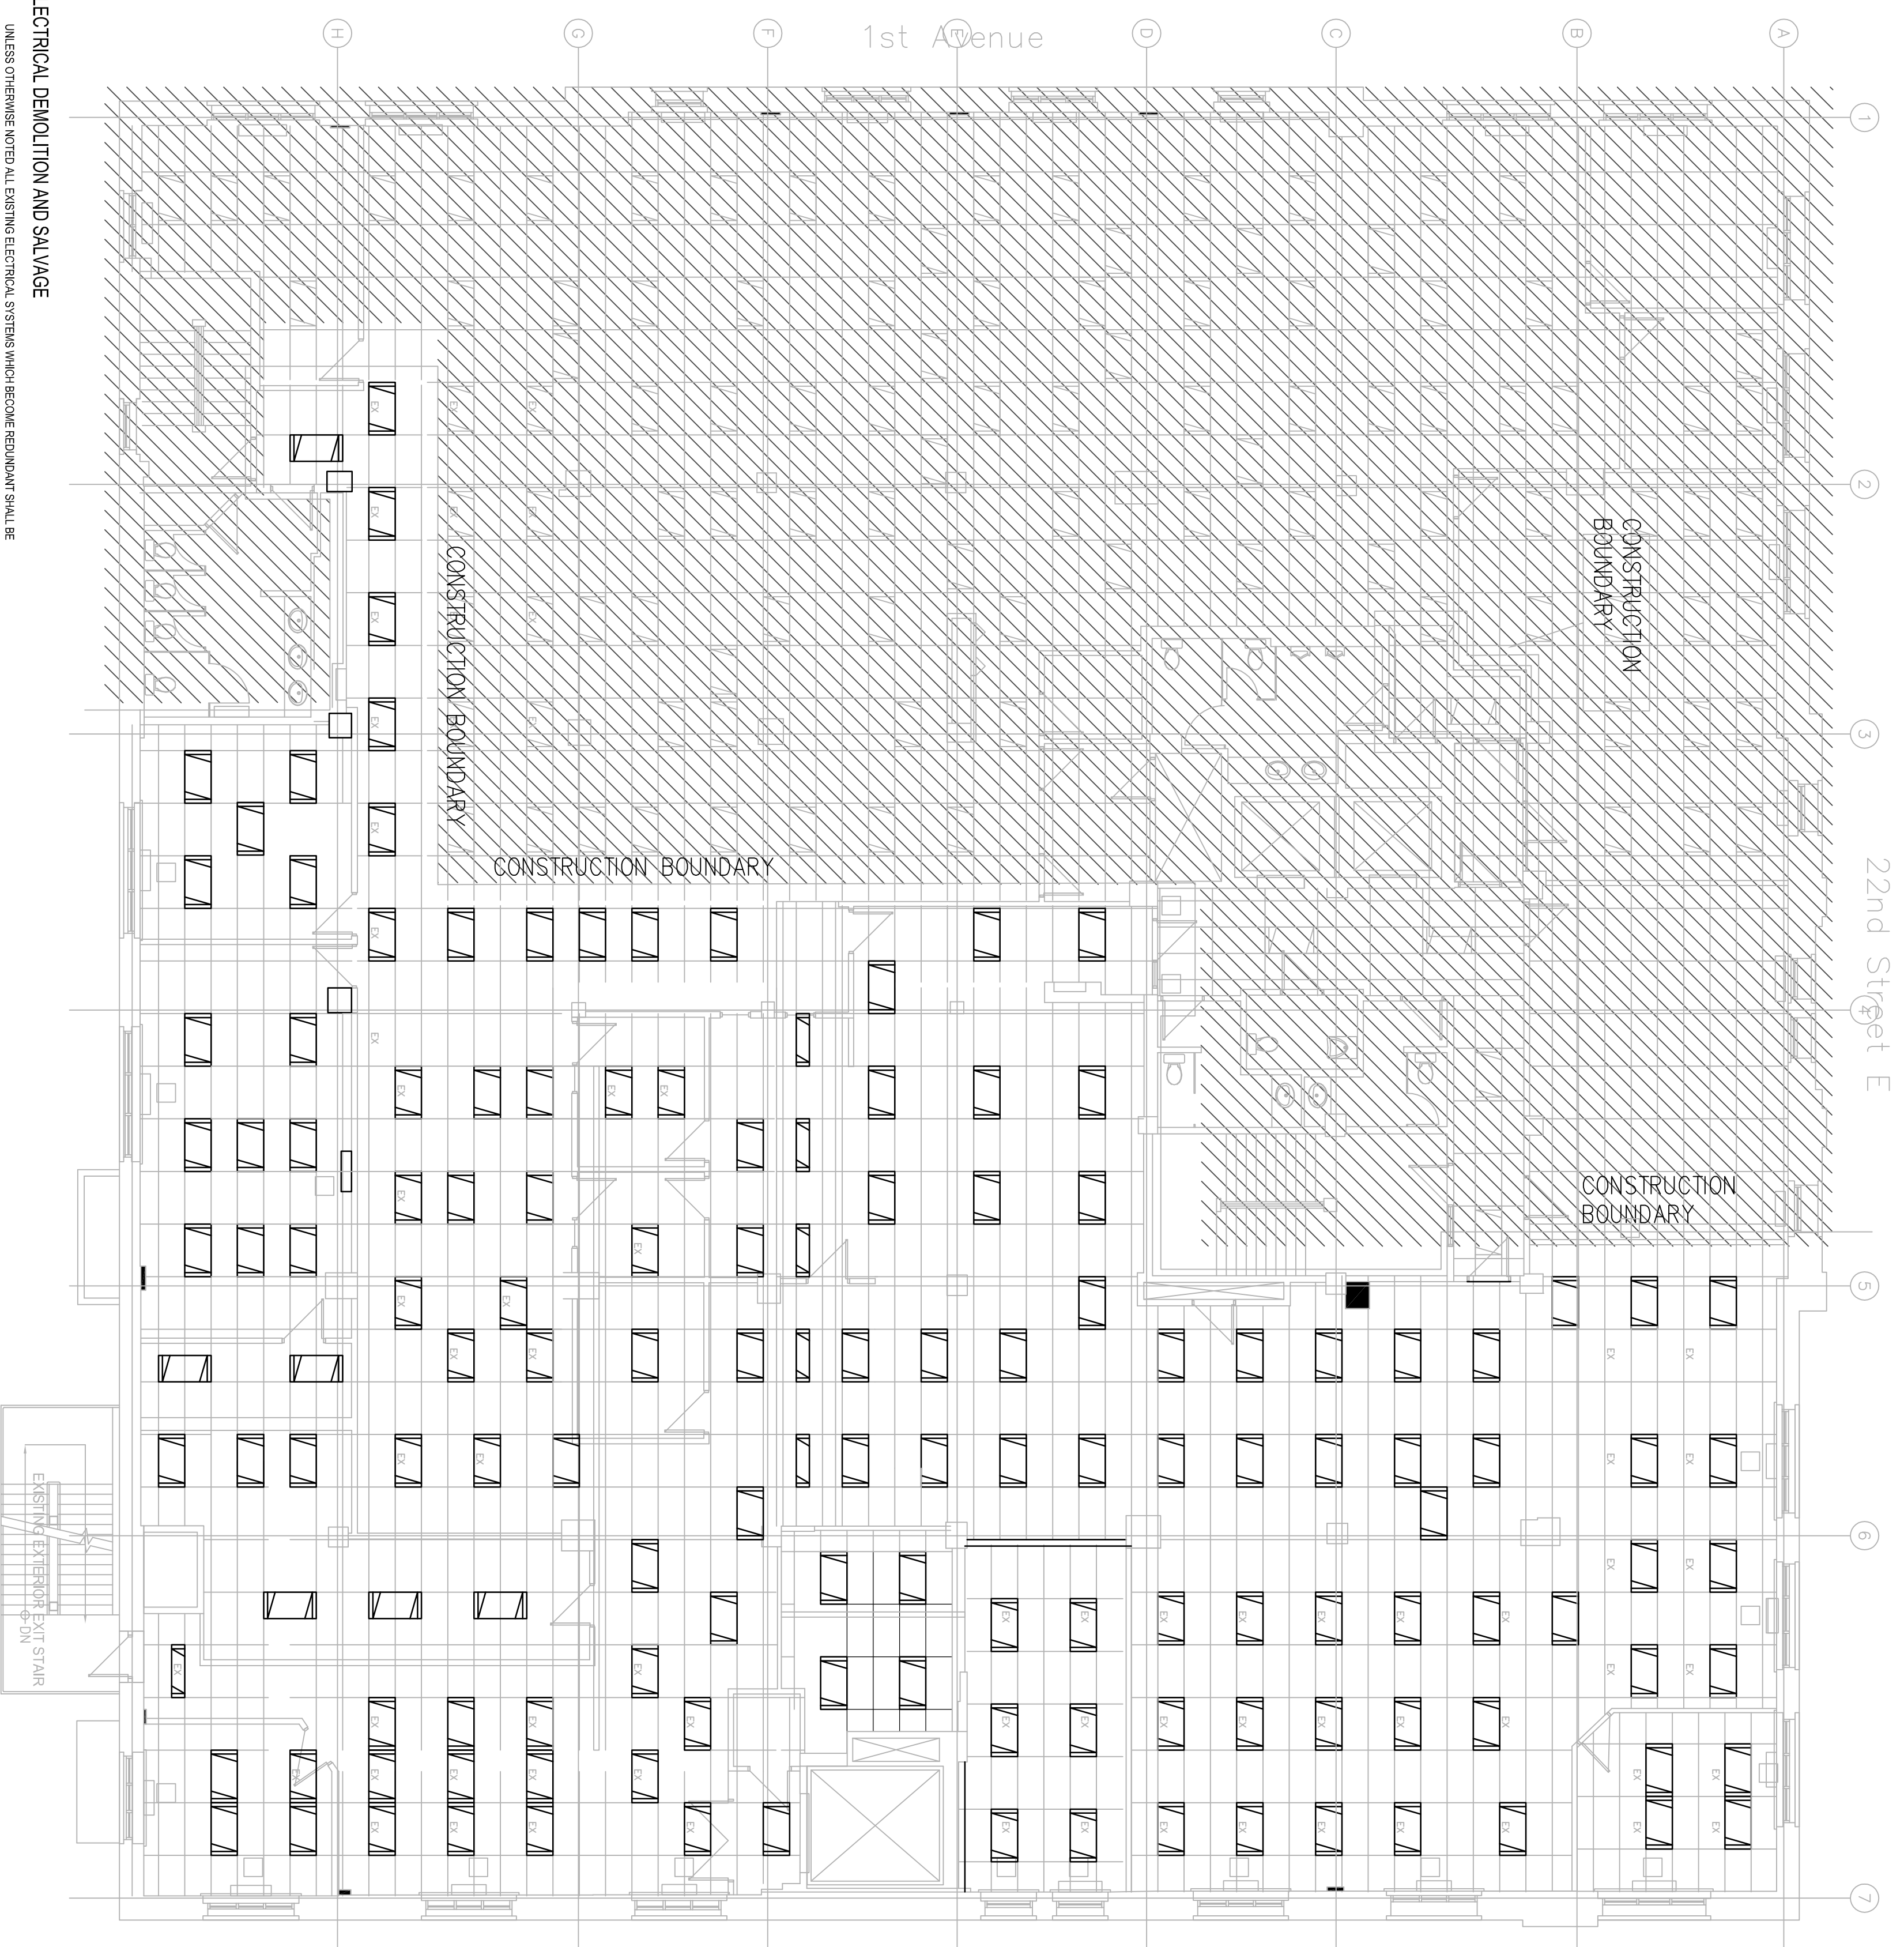

ELECTRICAL DEMOLITION AND SALVAGE

1. UNLESS OTHERWISE NOTED, ALL EXISTING ELECTRICAL SYSTEMS WHICH BECOME REDUNDANT SHALL BE REMOVED BY THE CONTRACTOR.
2. REMOVE ALL REDUNDANT EXISTING CONDUIT WHERE ACCESSIBLE.
3. REMOVE ALL REDUNDANT EXISTING CONDUIT TOYERS TO SOURCE OF ORIGIN.
4. CUT AND PATCH EXISTING WALLS WHERE REQUIRED TO ACCOMMODATE NEW EQUIPMENT OR CONDUIT. LEAVE FINISHED SURFACE OF WALL IN BUILDING TO PAINT CONDITION.
5. TURN ALL SURVAGE MATERIAL OVER TO BUILDING OWNER.
6. CONTRACTOR SHALL FIRST STOP TO THINKER TO DETERMINE EXTENT OF DEMOLITION REQUIRED. NO EXTRA MATERIAL BE CONSIDERED FOR WORK RESULTING FROM CONDITIONS THAT WOULD HAVE BEEN EVIDENT TO THE PERSONS OF EXAMINATION OF THE PROJECT.
7. CONTRACTOR SHALL UPDATE AND CONFIRM PANEL SCHEDULES AND LOADS FOR ALL PANELS AFFECTED BY THIS DEMOLITION.
8. MAINTAIN CONTINUITY OF EXISTING BRANCHED CIRCUITS AS REQUIRED TO PROVIDE POWER TO REMAINING EQUIPMENT DEVICES AND LUMINAIRES THAT ARE NOT BEING REMOVED.
9. ANY EXISTING CONDITIONS INCURRED ARE BASED UPON PREPARATION PROVIDED BY OTHERS. THE CONTRACTOR SHALL ADJUST FOR ACTUAL FIELD CONDITIONS IN AN ADDITIONAL EXPENSE TO THE OWNER.
10. ALL EXISTING LIGHTING & CONTROLS THROUGHOUT CONSTRUCTION SPACE TO BE DEMOLISHED.

2ND FLOOR DEMOLITION - LIGHTING

PMWSC - A1 - 841X594