



263 BELLAU CRESCENT  
SASKATCHEWAN SASKATCHEWAN CANADA, S7T 0J1  
TEL: 1-506-665-5223 FAX: 1-506-665-5681 WWW.WSP.COM



Association of Professional Engineers & Geoscientists  
CERTIFICATE OF AUTHORIZATION  
WSP Canada Inc.  
Number C09859  
Permission to Consult held by:  
Sergey  
MECHANICAL 21291

Revision /	Description / Description	Date / Date
0	ISSUED FOR TENDER	2018/03/16
1		
2		
3		
4		
5		

**Immigration, Refugees and  
Citizenship Canada**

Saskatoon  
Saskatchewan


Project title/Titre du projet  
Government of Canada Building  
101 - 22 Street East

**IRCC Relocation Fit-up  
Saskatoon, Saskatchewan**

Approved by/Approve par  
BD  
Designed by/Concept par  
NY  
Drawn by/Dessiné par  
ML  
PWSSC Project Manager/Administrateur de Projets TPSSC  
PWSSC, Architectural and Engineering Resources Manager/  
Ressources Architectural et de Directeur d'ingénierie, TPSSC  
Client/Client


**HVAC ZONING FLOOR PLANS**

Project No./No. du  
R.076325.006  
Sheet/Feuille  
M2.3  
Revision no./  
no. de révision  
0

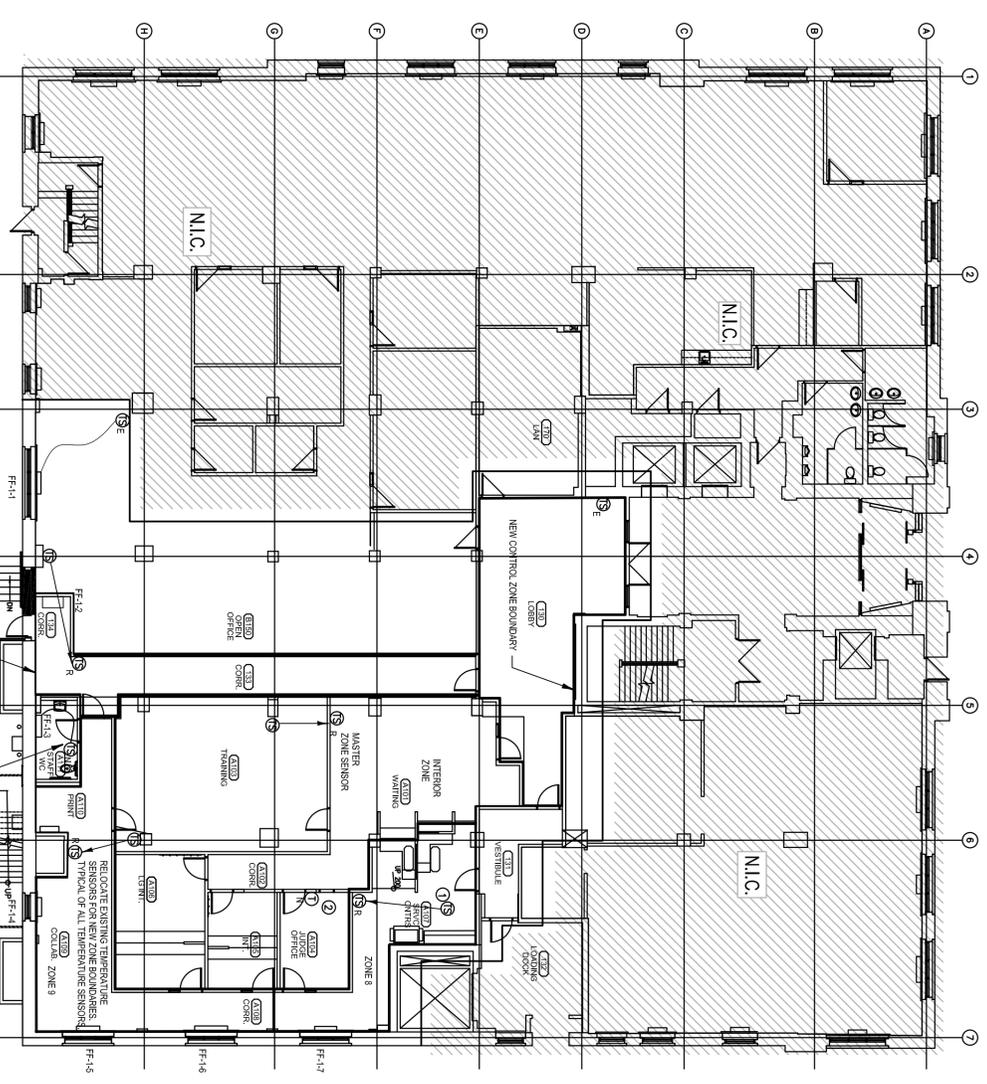

**1**  
1:125  
**MAIN FLOOR HVAC ZONING PLAN**

- KEYNOTES**
- EXISTING ZONE 8 TEMPERATURE SENSOR WAS DAMAGED CONTROL WIRING. REPLACE CONTROL WIRING BACK TO MECHANICAL ROOM.
  - PROVIDE NEW PROGRAMMABLE THERMOSTAT TO PLANT HEATER WITH CONTROL WIRING TO EXISTING DDC SYSTEM. COORDINATE WITH BUILDING OPERATOR FOR REQUIRED USER INTERFACE CHANGES. CONTACTS CONTRACTOR TO PROVIDE CHANGES.

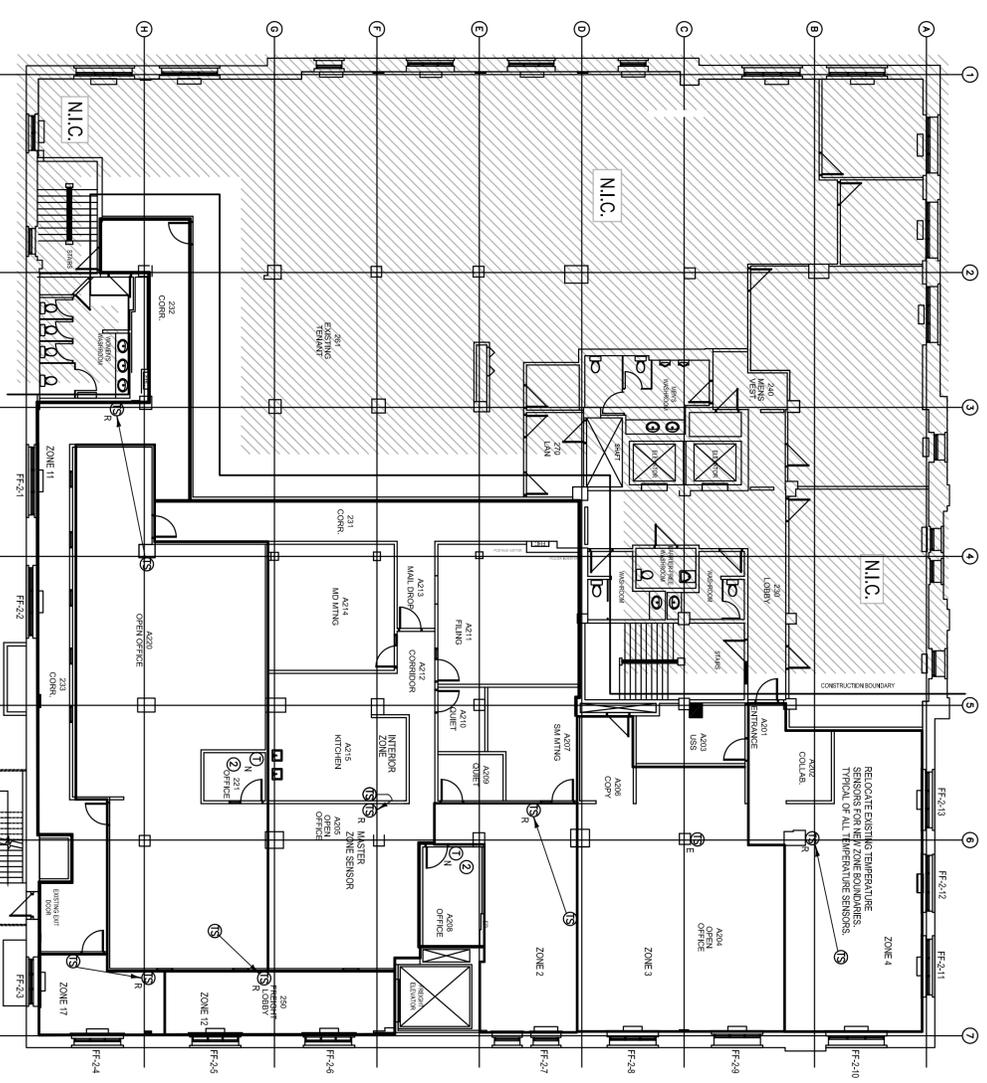

**2**  
1:125  
**SECOND FLOOR HVAC ZONING PLAN**

- GENERAL ZONE NOTES**
- GENERAL CONTRACTOR / CONTRACTS CONTRACTOR TO UPDATE BUILDING DDC SYSTEM ON USER INTERFACE TO SHOW NEW ZONING, UPDATE NAMERS FOR ZONES. COORDINATE WITH BUILDING OPERATORS FOR EXISTING DDC SYSTEM AND REQUIREMENTS FOR SYSTEM UPDATES.
  - RELOCATE EXISTING TEMPERATURE SENSORS TO LOCATIONS SHOWN ON DRAWING.

