

**PRELIMINARY
NOT FOR CONSTRUCTION**

CK A + I D
GOULD KNABERN
ARCHITECTURE DESIGN INC.

wsp
203 MELLIUM GESSERT
SASKATOON, SASKATCHEWAN, CANADA S7T 1J1
TEL: 1-306-596-8223 | FAX: 1-306-596-8891 | WWW.WSPRFP.COM

PROFESSIONAL ENGINEER
B.K. BERGLÖF
MEMBER 5369
SASKATCHEWAN
18/03/15
10/03/15

Association of Professional Engineers & Geoscientists
CERTIFICATE OF AUTHORIZATION
WSP-CANADA INC.
Member in Good Standing
18/03/15
10/03/15
Erick 5369 Berglöf


5			
4			
3			
2			
1			
0	ISSUED FOR TENDER	2018/03/16	
Revision/	Description/Description	Date/Date	
Client/Client			

**Immigration, Refugees and
Citizenship Canada**
Saskatoon
Saskatchewan

Projet titre/Titre du projet
Government of Canada Building
101 - 22 Street East
**IRCC Relocation Fit-up
Saskatoon, Saskatchewan**

Approved by/Approve par
Designed by/Conçu par
Drawn by/Dessiné par
PWS: Project Manager/Manager de projet PWS
AR: Project Architect/Architecte de projet PWS
WSP: Technical and Engineering Resources Manager/
Manager des ressources techniques et d'ingénierie PWS
Client/Client

Drawing title/Titre du dessin
**2ND FLOOR - DEMOLITION
POWER & SYSTEMS**
Project No./No. de projet
R.076325.006
Sheet/Feuille
E2.2
OF
Revision No./
Le numéro de
0

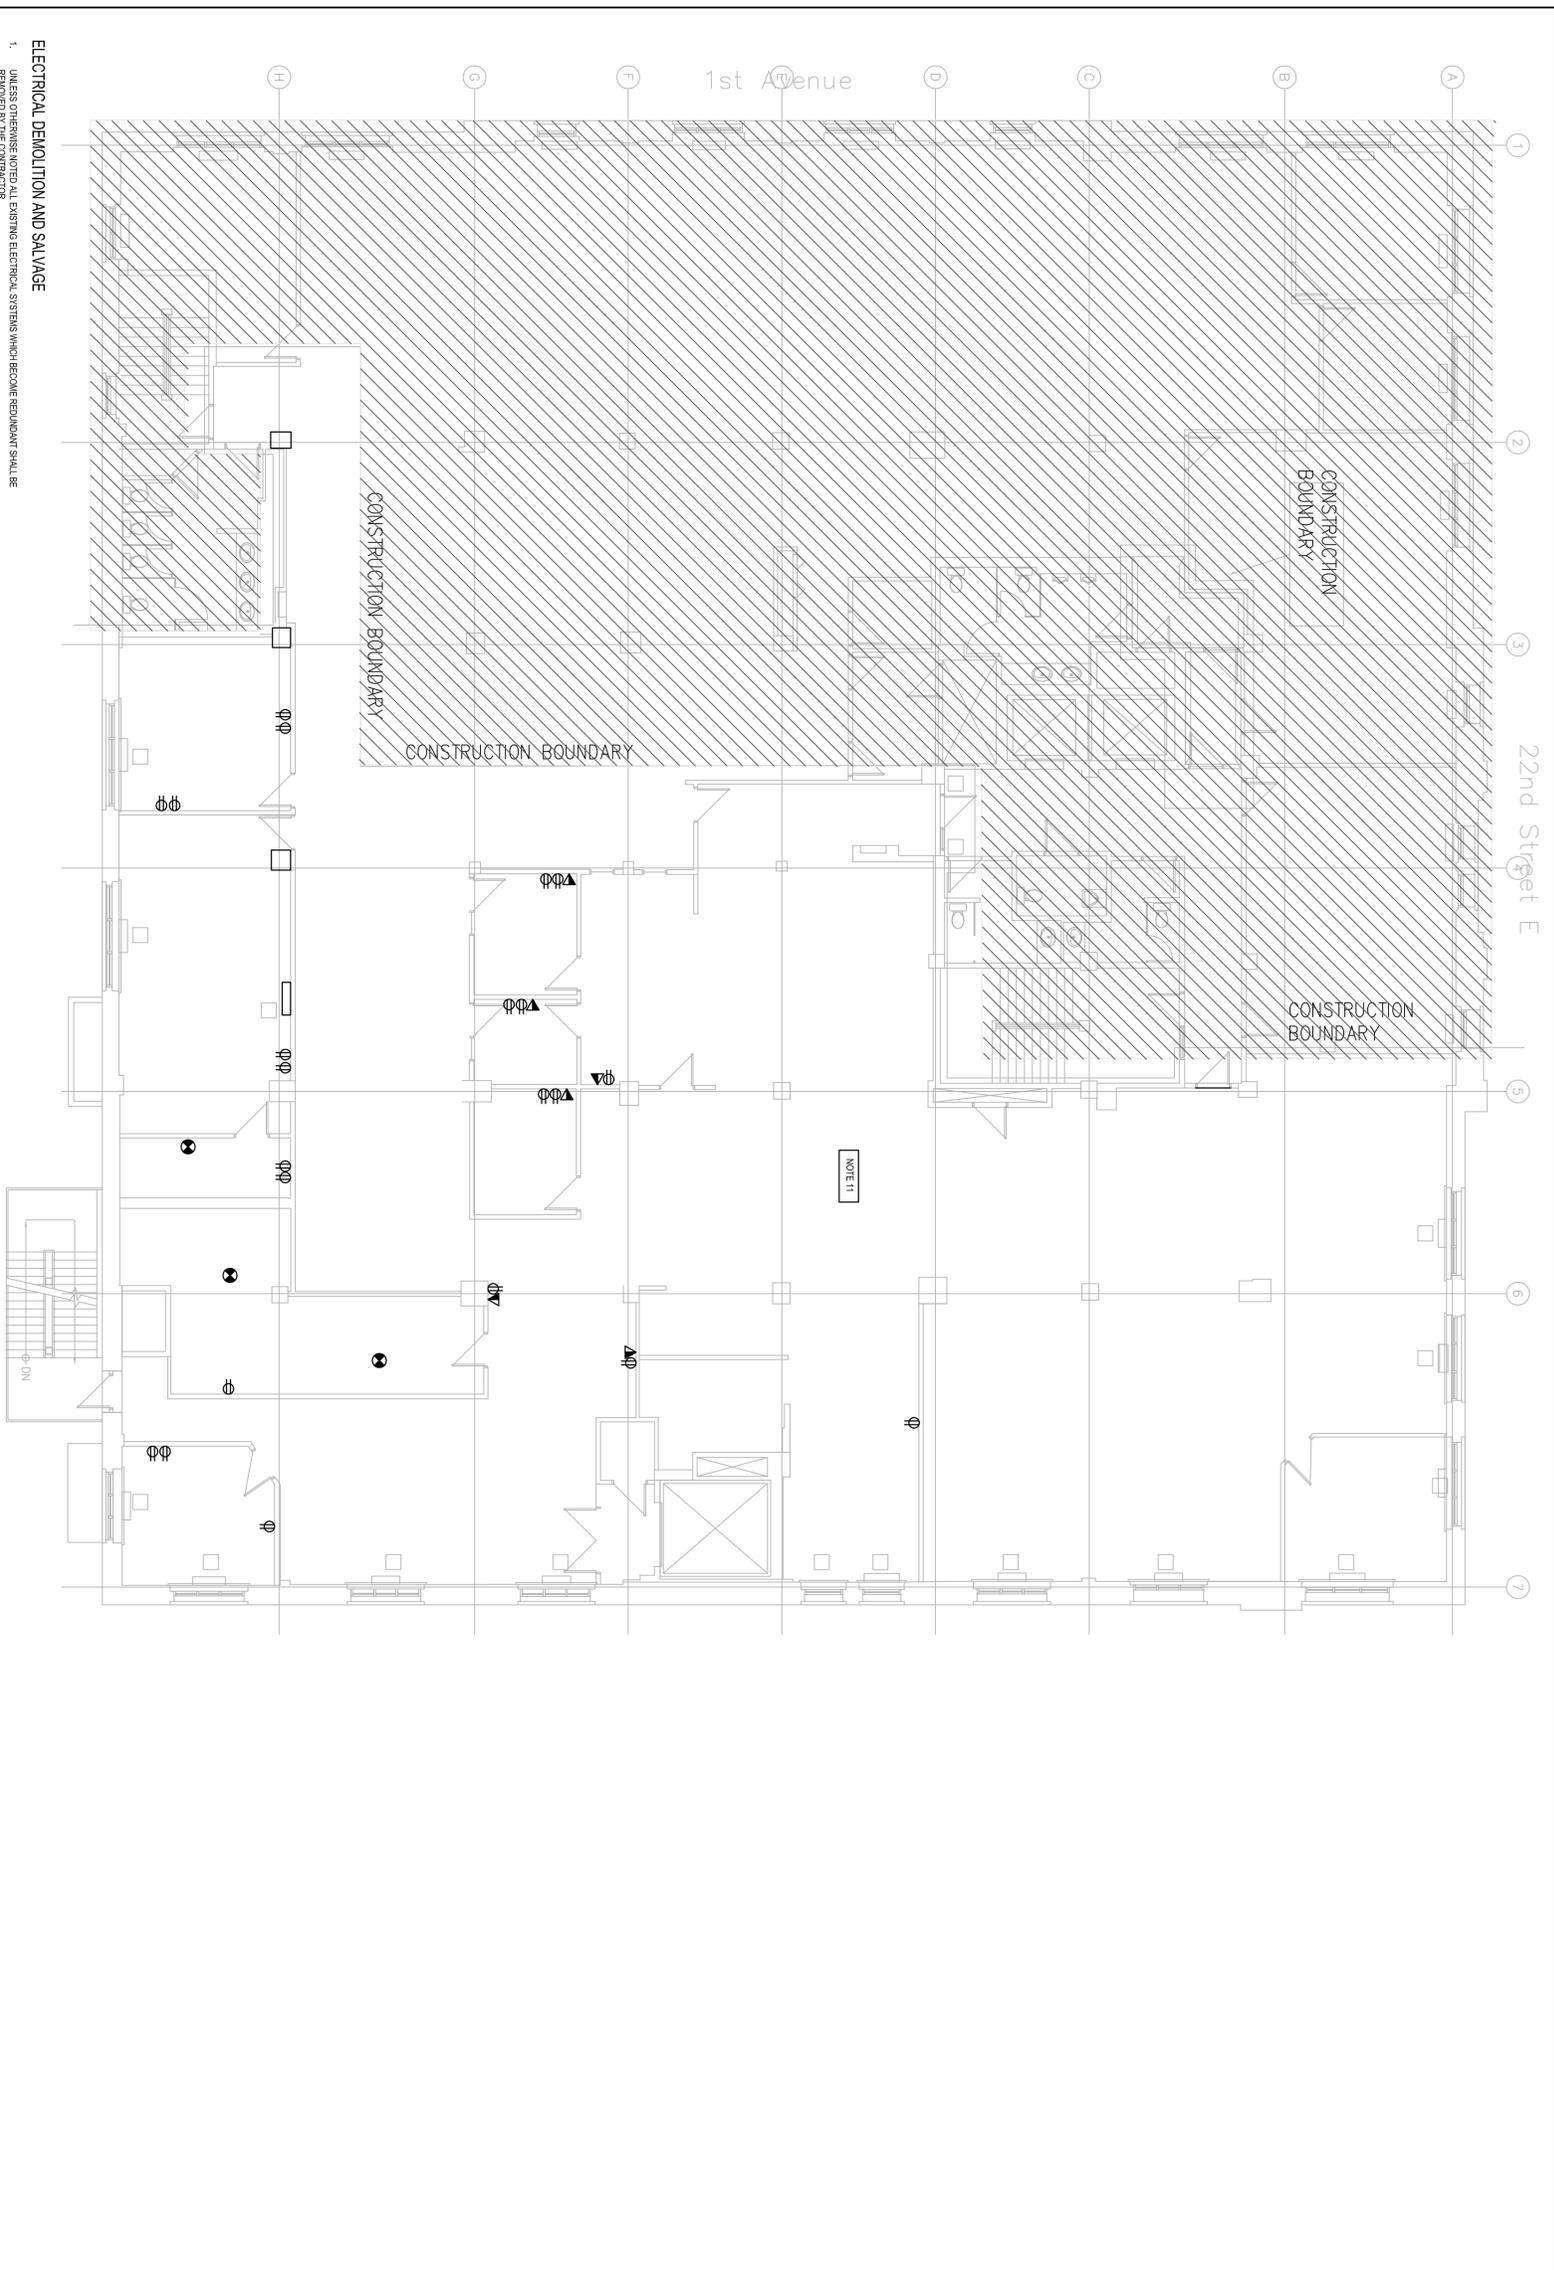

1 E2.2 2ND FLOOR DEMOLITION - POWER & SYSTEMS
1:100

- ELECTRICAL DEMOLITION AND SALVAGE**
1. UNLESS OTHERWISE NOTED, ALL EXISTING ELECTRICAL SYSTEMS WHICH BECOME REDUNDANT SHALL BE REMOVED BY THE CONTRACTOR.
 2. REMOVE ALL REDUNDANT EXISTING CONDUIT WHERE ACCESSIBLE.
 3. REMOVE ALL REDUNDANT EXISTING CONDUCTORS TO POINT OF SOURCE.
 4. CUT AND PATCH EXISTING WALLS WHERE REQUIRED TO ACCOMMODATE NEW EQUIPMENT OR CONDUIT.
 5. TURN ALL SALVAGE MATERIAL OVER TO BUILDING OWNER.
 6. CONTRACTOR SHALL VISIT SITE PRIOR TO TENDER TO DETERMINE EXTENT OF DEMOLITION REQUIRED. CONTRACTOR SHALL BE RESPONSIBLE FOR ASSESSING REMAINING CONDITIONS THAT WOULD HAVE BEEN EXISTENT ON THE DATE OF BIDDING OF THE SITE.
 7. CONTRACTOR SHALL UPDATE AND CORRECT PANEL SCHEDULES AND LOGS FOR ALL PANELS AFFECTED BY THIS DEMOLITION.
 8. MAINTAIN CONTINUITY OF EXISTING BRANCH CIRCUITS AS REQUIRED TO PROVIDE POWER TO REMAINING EQUIPMENT DEVICES AND LUMINAIRES THAT ARE NOT BEING REMOVED.
 9. ANY EXISTING CONDITIONS INDICATED ARE BASED UPON INFORMATION PROVIDED BY OTHERS. THE CONTRACTOR SHALL ADJUST FOR ACTUAL FIELD CONDITIONS AT NO ADDITIONAL EXPENSE TO THE OWNER.
 10. ALL IT CABLING TO BE DEMOLISHED BACK TO IT ROOM. CONTRACTOR RESPONSIBLE FOR DEMOLITION OF ALL CONDUIT & PATHWAYS IN ADDITION TO CABLING INFRASTRUCTURE.
 11. ALL EXISTING SERVICE PANELS THROUGHOUT CONSTRUCTION SPACE TO BE REMOVED ALONG WITH ALL ASSOCIATED ELECTRICAL WIRING.

