


**SUPPLY DIFFUSER DETAIL**

SCALE : N.T.S.

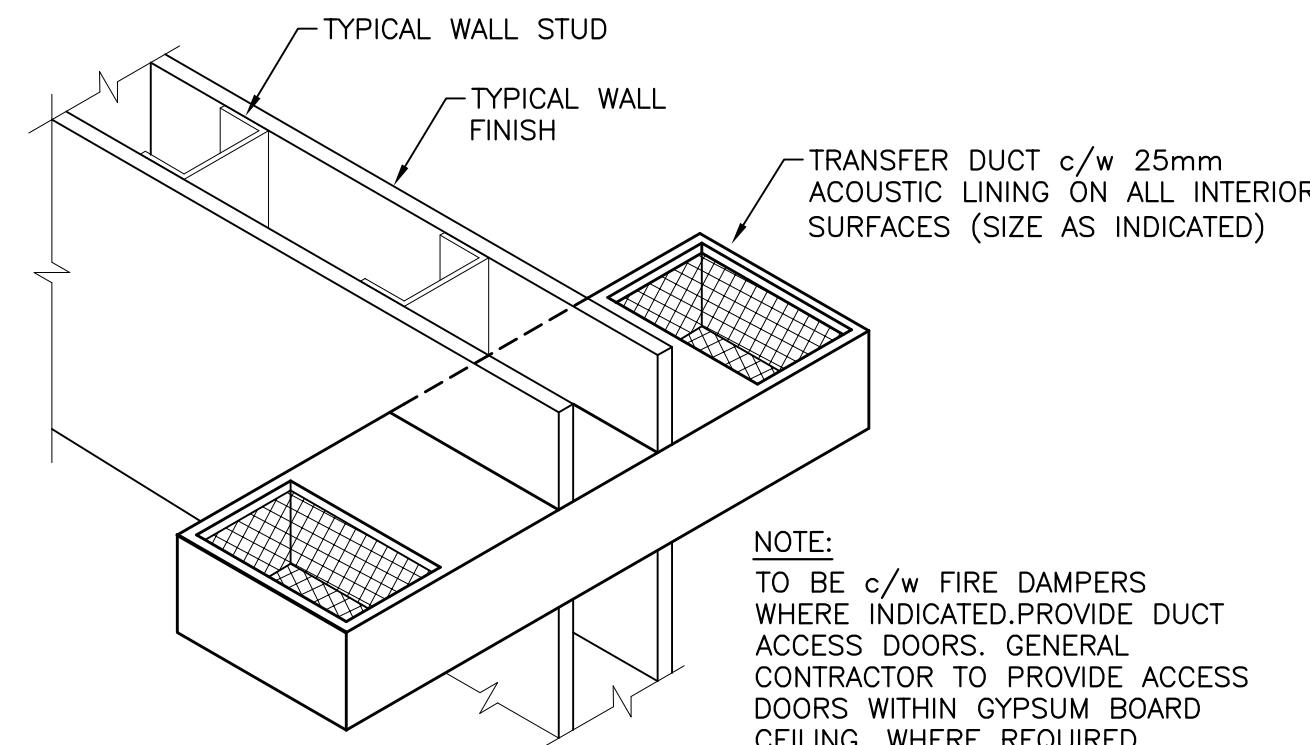


**TRANSFER OPENING SCHEDULE**

TAG	EXTERIOR DIMENSIONS (WxHxL) mm	INTERIOR AND OPENING (WxHxL) mm	L/S RANGE	REMARKS
TO-1	350x300x1200	300x250x1200	0-120	TO BE c/w 25mm OF ACOUSTIC INSULATION
TO-2	600x400x1500	550x350x1500	121-280	TO BE c/w 25mm OF ACOUSTIC INSULATION
TO-3	750x450x1500	700x400x1500	281-614	TO BE c/w 25mm OF ACOUSTIC INSULATION


**RETURN AIR TRANSFER DUCT DETAIL**

SCALE : N.T.S.

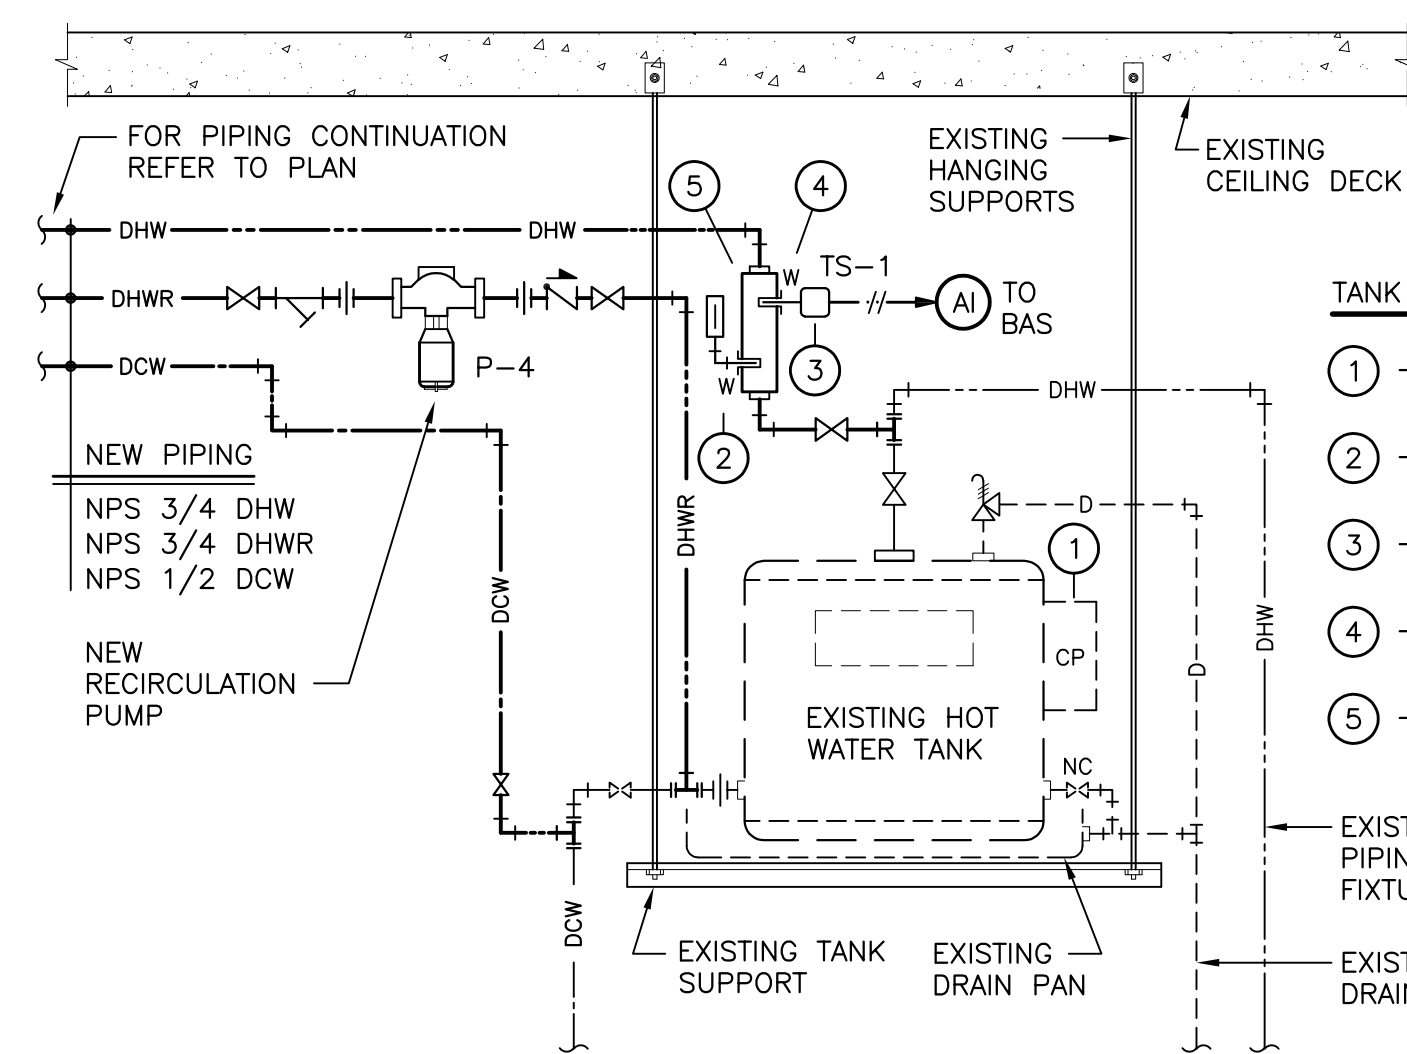


**CEILING SUSPENDED DHWT DETAIL**

SCALE : N.T.S.

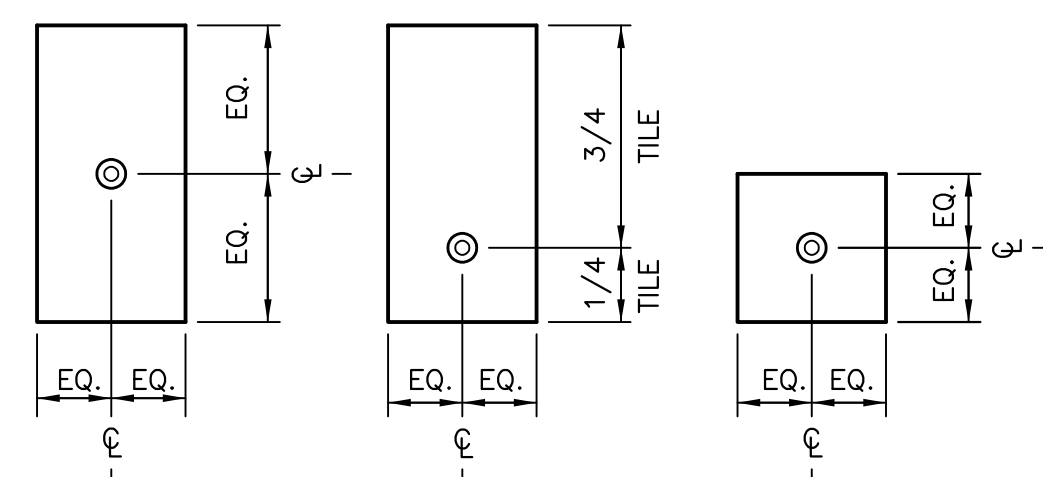


**ACOUSTIC TILE PENDENT LOCATION DETAIL**

SCALE : N.T.S.

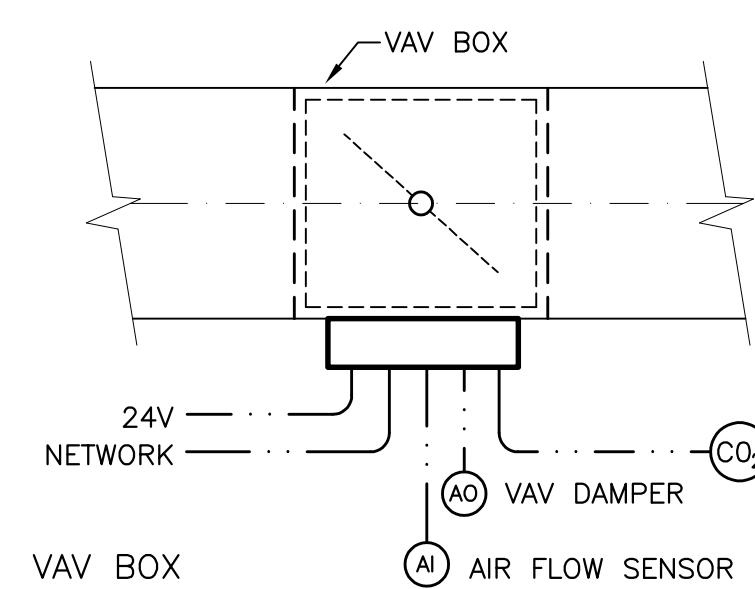


**VAV BOX CONTROL DETAIL**

SCALE : N.T.S.

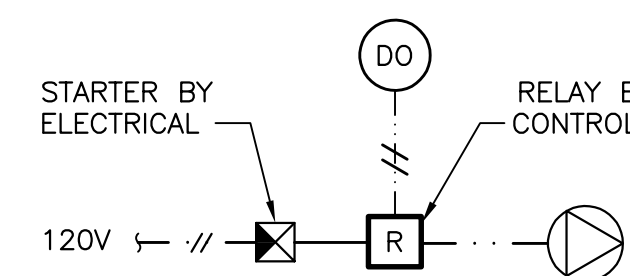


**P-4 PUMP CONTROL**

SCALE : N.T.S.

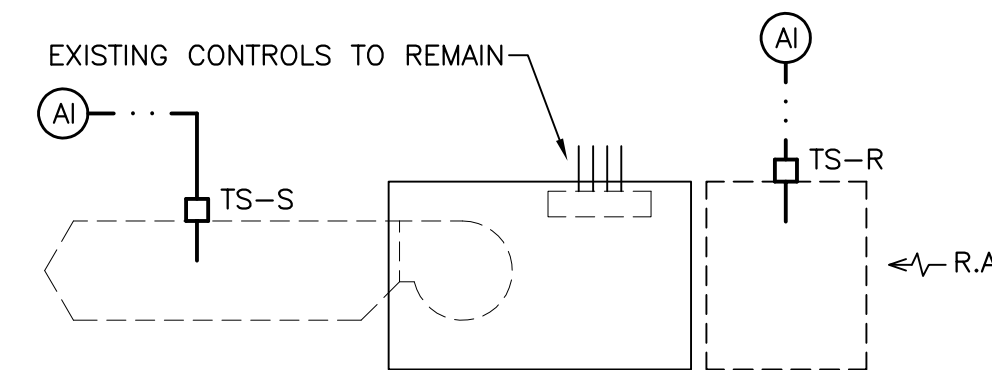


**HEAT PUMP CONTROLS EXISTING UNITS**

SCALE : N.T.S.

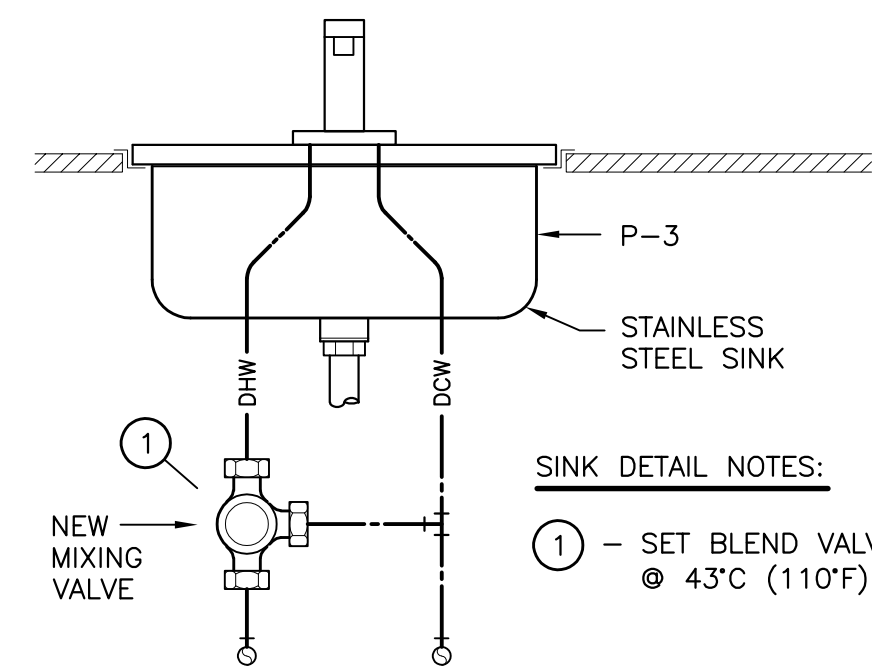


**MIXING VALVE DETAIL**

SCALE : N.T.S.

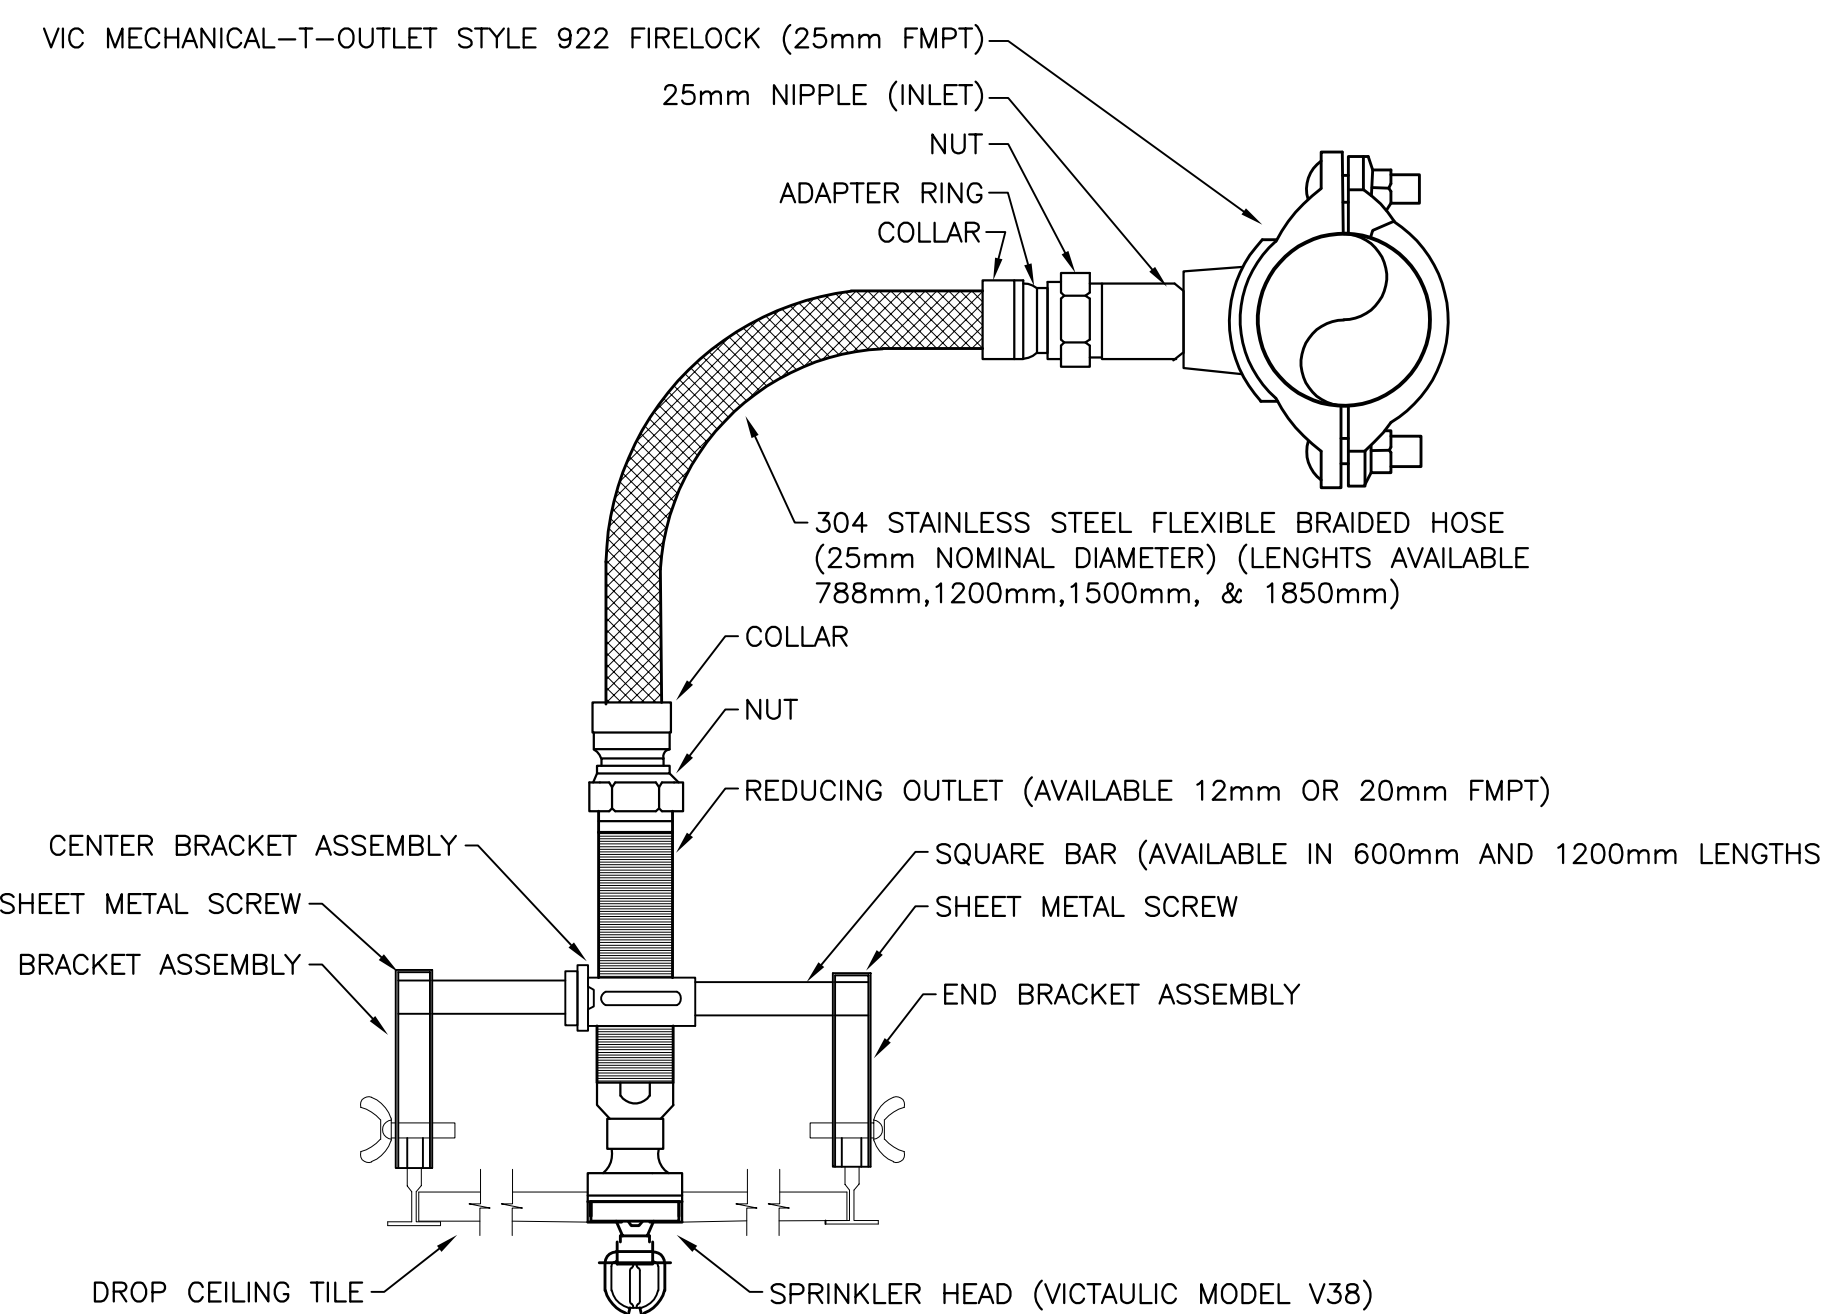


**FLEXIBLE HOSE SPRINKLER ASSEMBLY DETAIL**

SCALE : N.T.S.

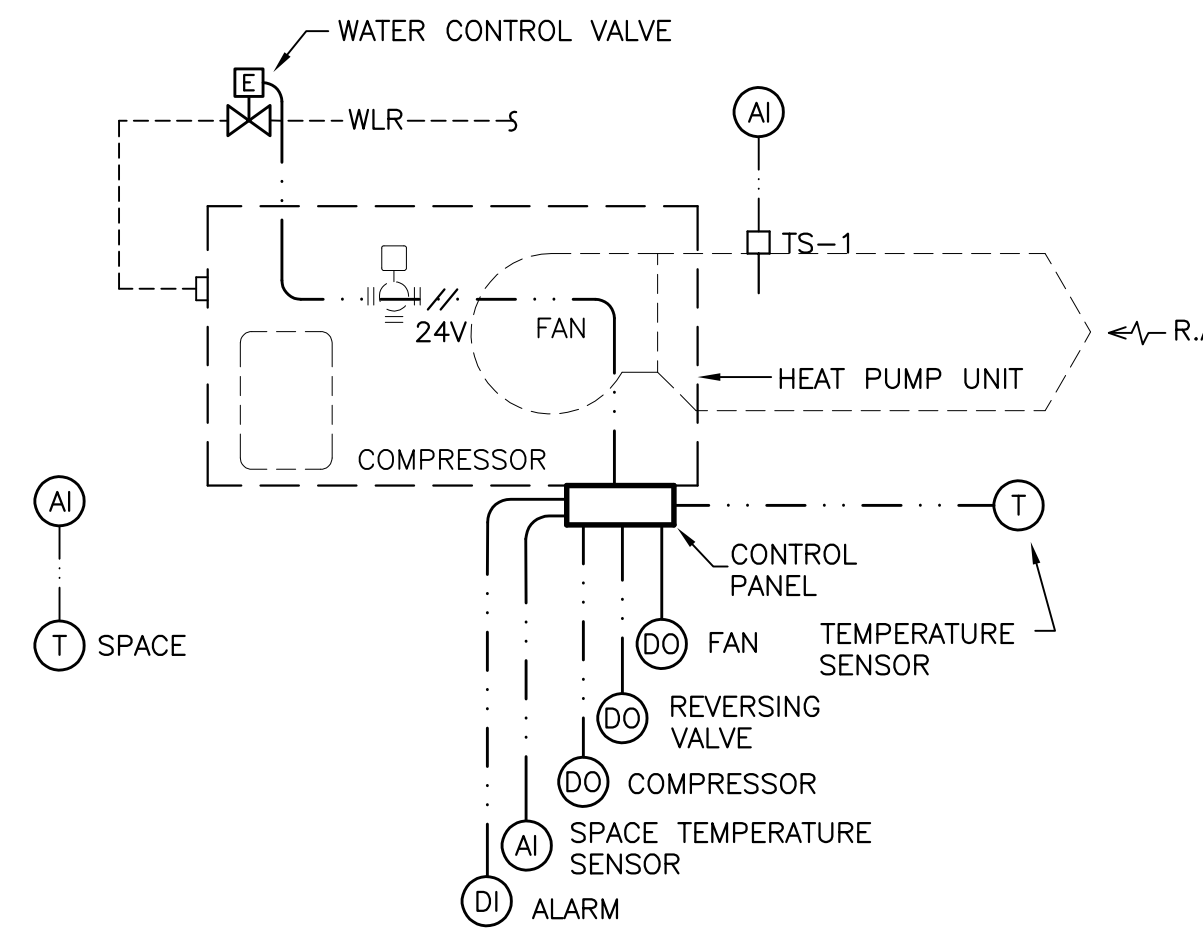


**HEAT PUMP CONTROLS NEW UNIT**

SCALE : N.T.S.

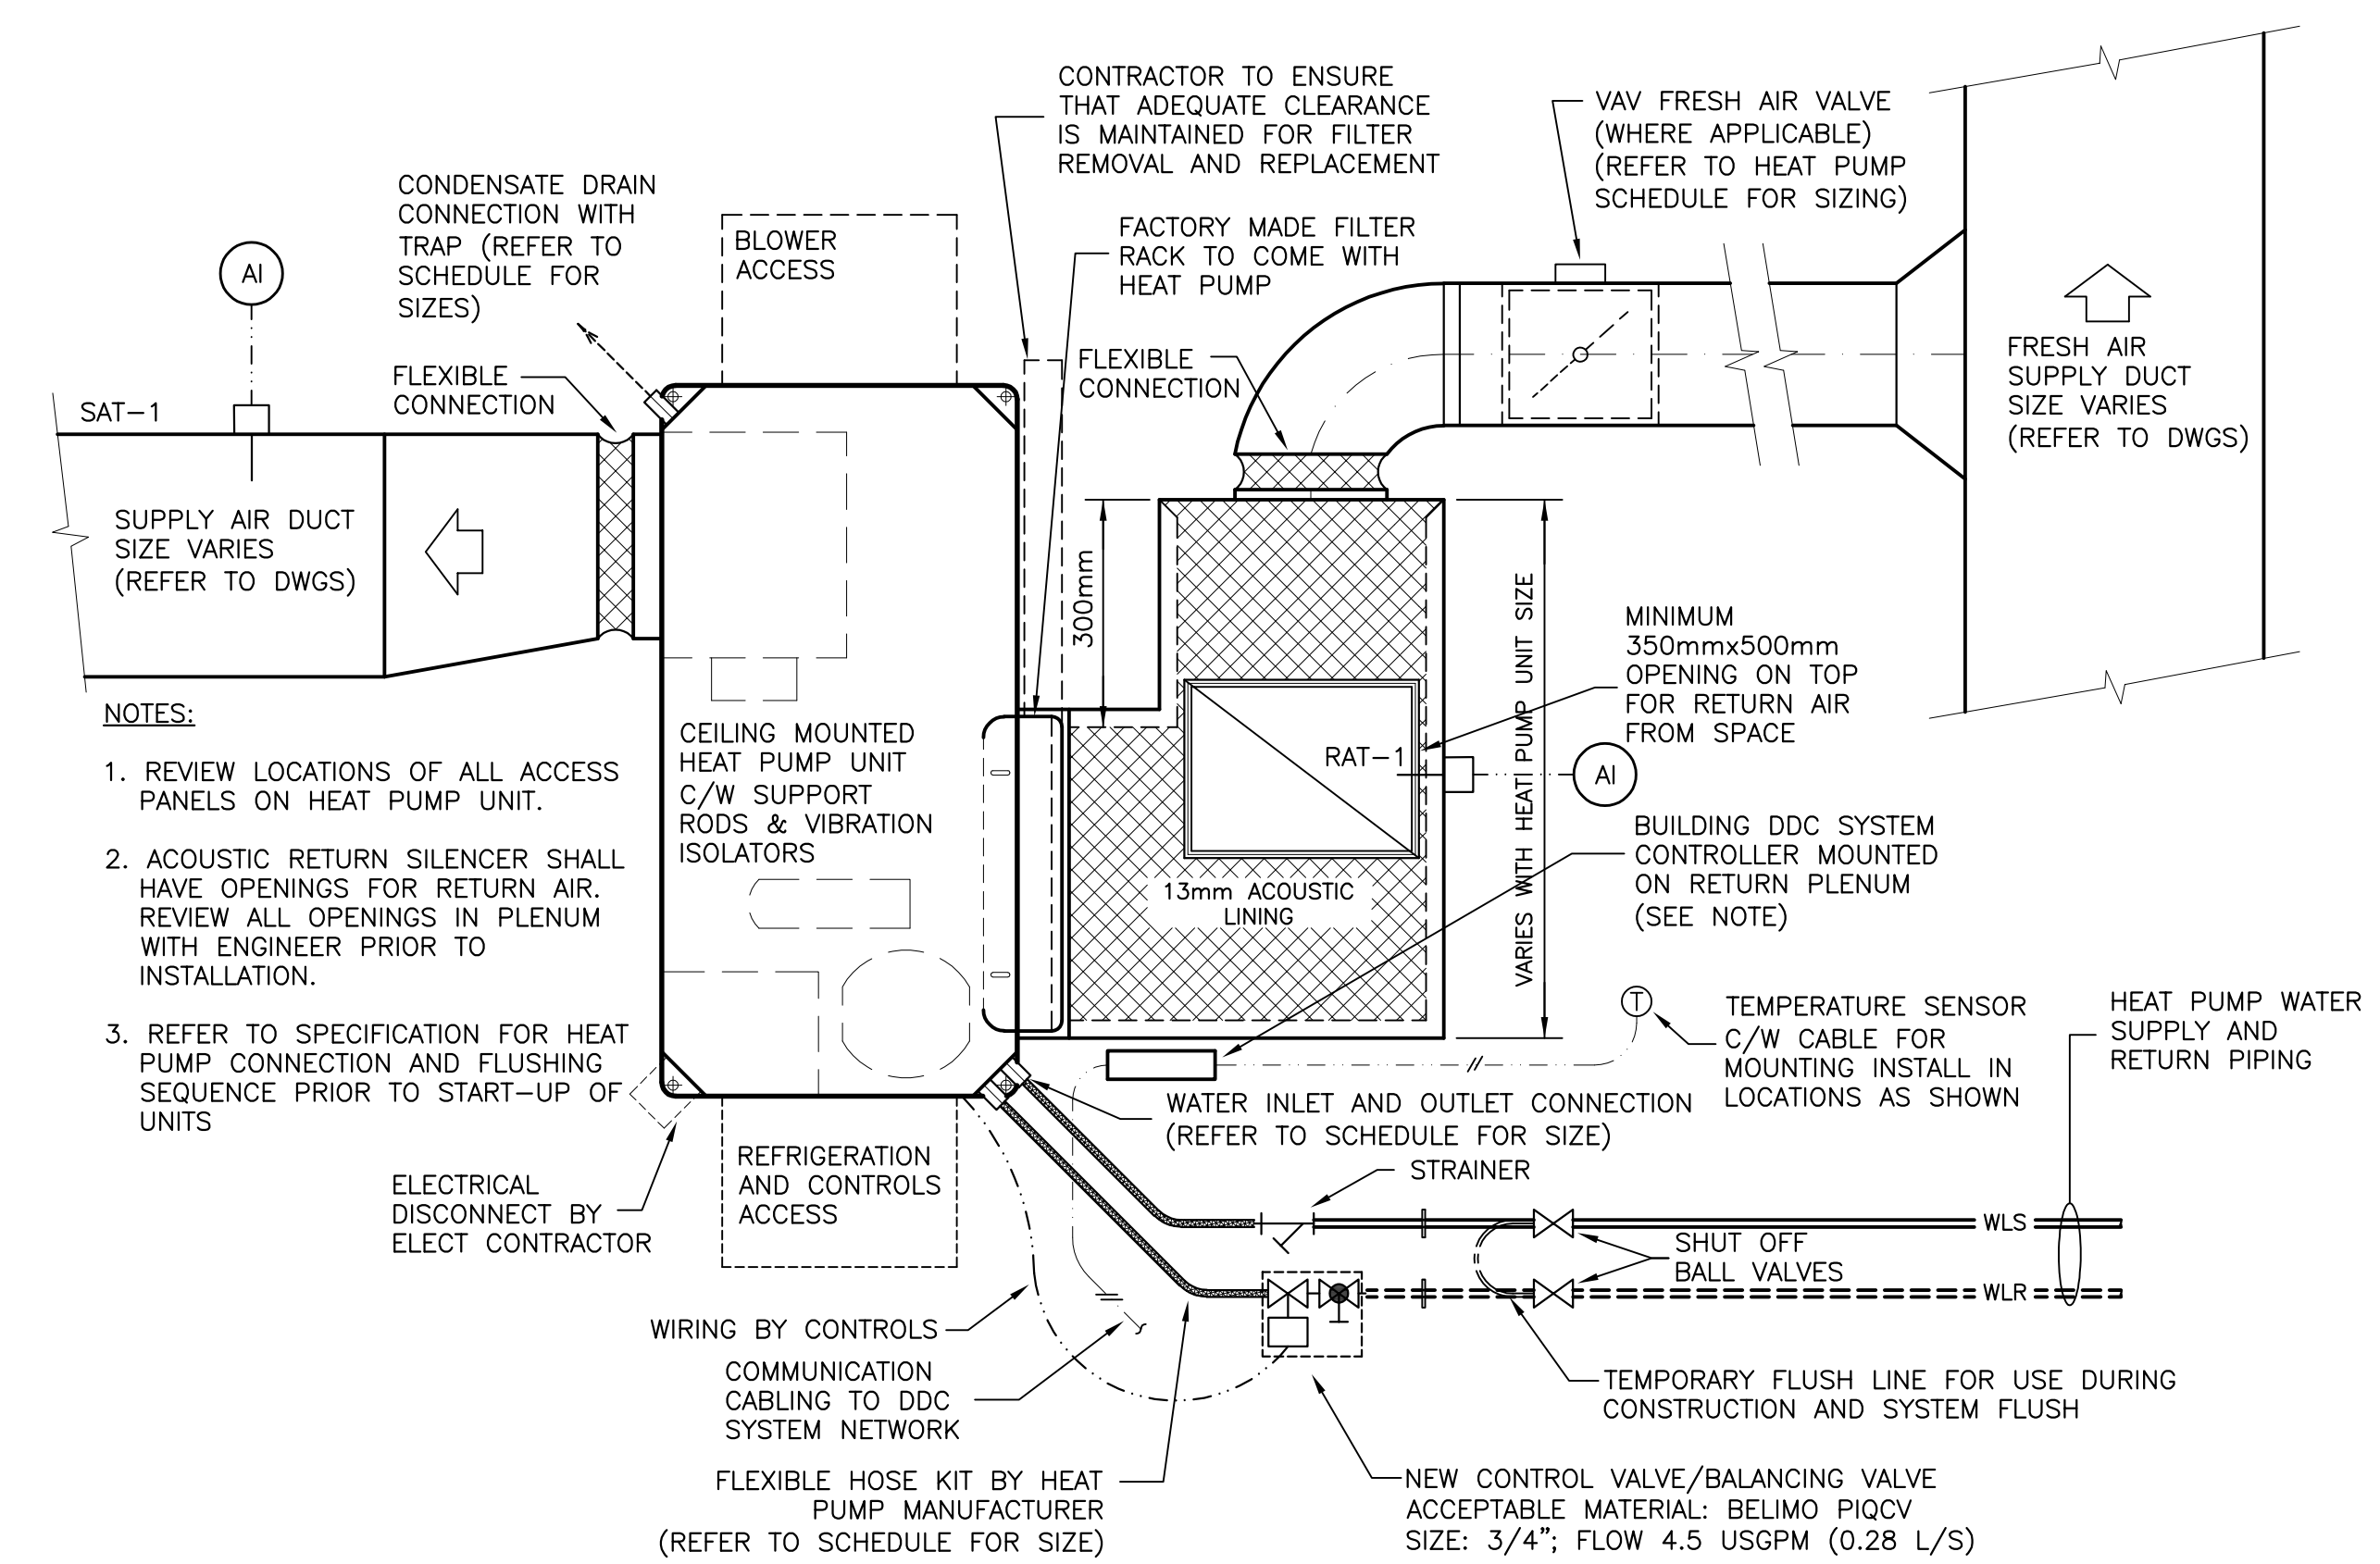

**NEW HEAT PUMP DETAIL**

SCALE : N.T.S.

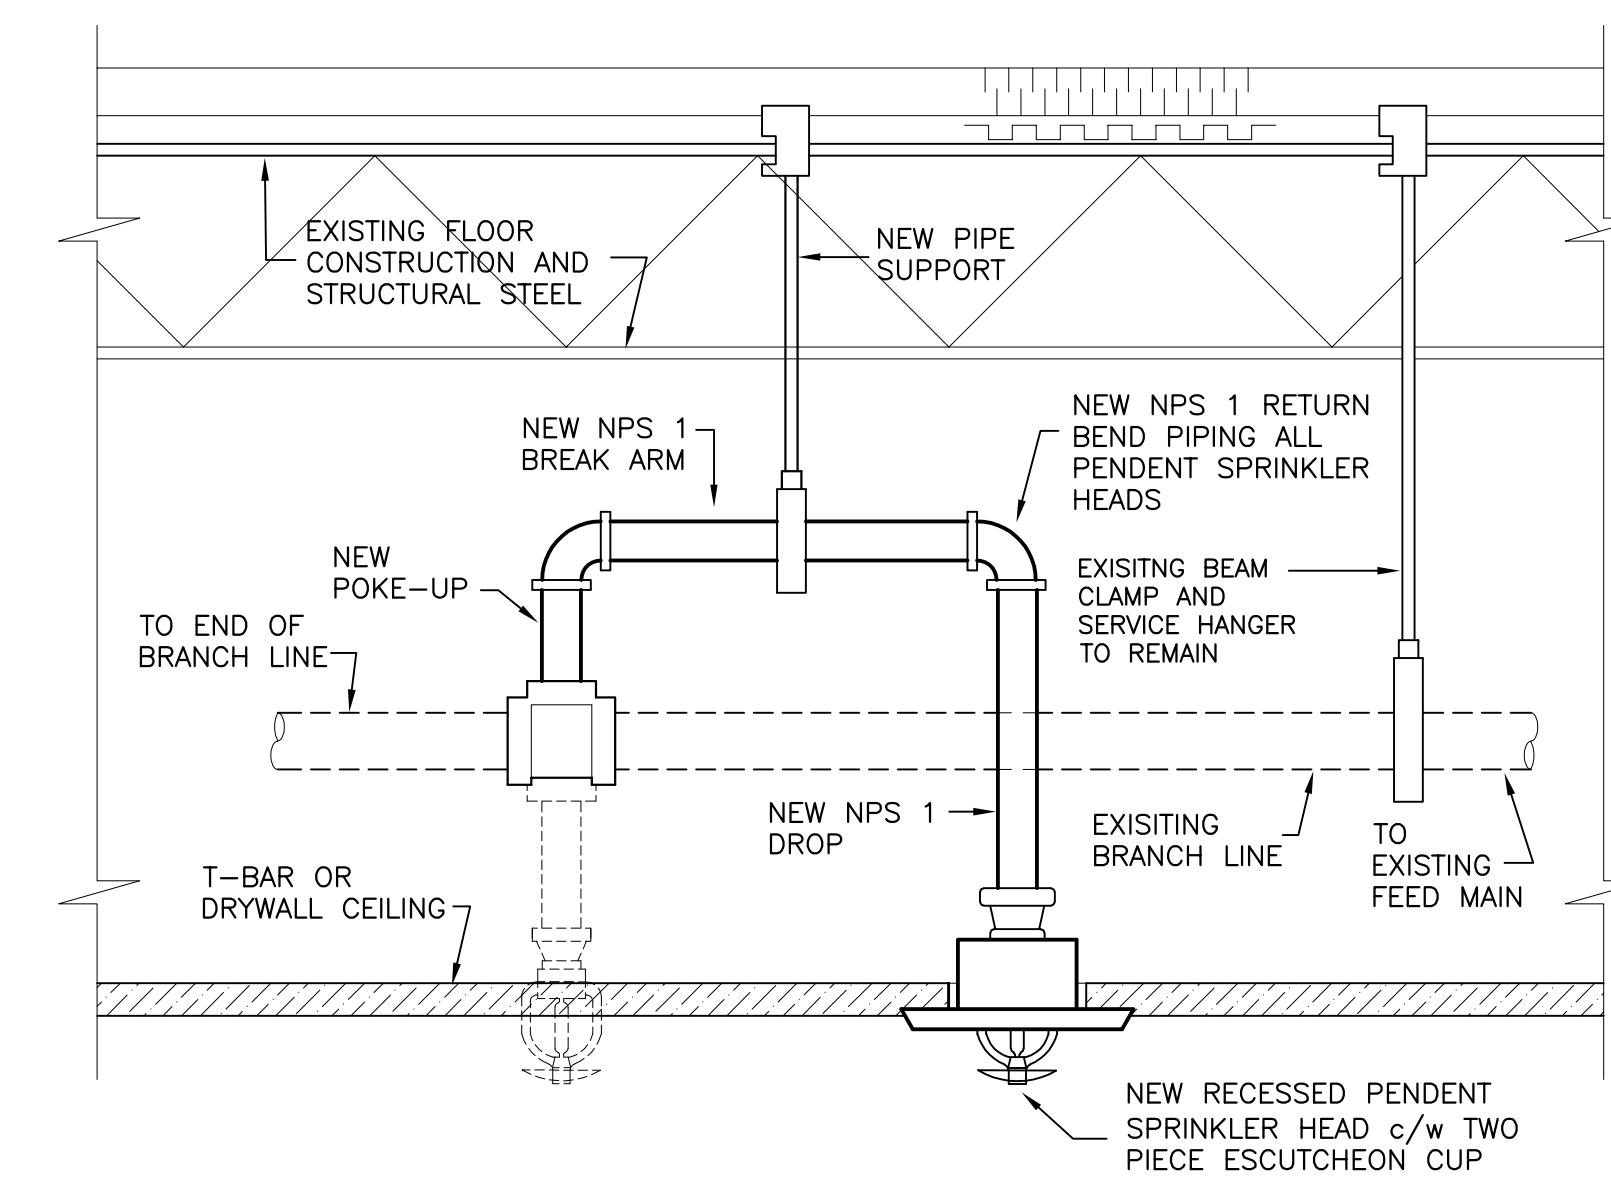

**SPRINKLER HEAD RETURN BEND DETAIL**

SCALE : N.T.S.