

PLOT DATE: March 28, 2018 TIME: 2:26 PM FULL PATH AND FILENAME: P:\RCMP\_PROJECTS\NCCA17-0228 - RCMP - DTI LUNCHROOM EXPANSION\509-DELIV\ELECTRICAL\LEGEND SYMBOLS TABLE - PMA-STD-100.cdw

LEGEND OF SYMBOLS

OCT 2014

LIGHTING		MECHANICAL		COMMUNICATION SYSTEMS		FIRE ALARM	
	RECESSED LED / INCANDESCENT / COMPACT FLUORESCENT LUMINAIRE		MOTOR		VOICE OUTLET		SMOKE ALARM
	SURFACE LED / INCANDESCENT / COMPACT FLUORESCENT LUMINAIRE		MOTOR C/W DISCONNECT SWITCH		DATA OUTLET		SMOKE ALARM/CARBON MONOXIDE ALARM
	WALL LED / INCANDESCENT / COMPACT FLUORESCENT LUMINAIRE		MOTOR C/W MANUAL STARTER		COMBINATION VOICE/DATA OUTLET		SMOKE ALARM/CARBON MONOXIDE ALARM C/W STROBE
	LED / INCANDESCENT / COMPACT FLUORESCENT WALL WASHER		UNFUSED DISCONNECT SWITCH		TELEVISION OUTLET		SMOKE DETECTOR
	RECESSED LED / INCANDESCENT / COMPACT FLUORESCENT LUMINAIRE ON EMERGENCY POWER		FUSED DISCONNECT SWITCH		COMBINATION VOICE/TELEVISION OUTLET		SMOKE DETECTOR IN CEILING PLENUM
	SURFACE LED / INCANDESCENT / COMPACT FLUORESCENT LUMINAIRE ON EMERGENCY POWER		COMBINATION MAGNETIC STARTER/DISCONNECT SWITCH		FLOOR MOUNTED VOICE OUTLET		SMOKE DETECTOR UNDER FLOOR
	WALL LED / INCANDESCENT / COMPACT FLUORESCENT LUMINAIRE ON EMERGENCY POWER		MAGNETIC STARTER		FLOOR MOUNTED DATA OUTLET		RATE OF RISE HEAT DETECTOR
	RECESSED FLUORESCENT LUMINAIRE		FAN SPEED CONTROLLER		FLOOR MOUNTED COMBINATION VOICE/DATA OUTLET		FIXED HIGH TEMPERATURE 200°F HEAT DETECTOR (88 C)
	SURFACE FLUORESCENT LUMINAIRE		THERMOSTAT		FLOOR MOUNTED TELEVISION OUTLET		FIXED HIGH TEMPERATURE 135°F HEAT DETECTOR (58 C)
	WALL FLUORESCENT LUMINAIRE		SENSOR		CEILING MOUNTED DATA OUTLET		DUCT SMOKE DETECTOR - 'SA' DENOTES SUPPLY AIR, 'RA' DENOTES RETURN AIR
	WALL FLUORESCENT LUMINAIRE ON EMERGENCY POWER		MOTOR IDENTIFICATION TAG (REFER TO MECHANICAL SCHEDULE)		CEILING MOUNTED TELEVISION OUTLET		DUCT SMOKE DETECTOR C/W SHUTDOWN RELAY
	FLUORESCENT STRIP LUMINAIRE		BASEBOARD HEATER		MICROPHONE OUTLET		FIRE ALARM PULL STATION
	FLUORESCENT STRIP LUMINAIRE ON EMERGENCY POWER				PA SPEAKER - CEILING MOUNTED		SPRINKLER FLOW SWITCH
	RECESSED FLUORESCENT LUMINAIRE ON EMERGENCY POWER	<b>POWER</b>			PA SPEAKER - WALL MOUNTED		SPRINKLER TAMPER SWITCH
	SURFACE FLUORESCENT LUMINAIRE ON EMERGENCY POWER		SINGLE/SPECIAL PURPOSE RECEPTACLE		VOLUME CONTROLLER		SPRINKLER PRESSURE SWITCH
	TRACK LIGHTING C/W LIGHTING HEADS AS SHOWN		DUPLEX RECEPTACLE		CHIME		END OF LINE RESISTOR
	POLE MOUNTED LUMINAIRE		ISOLATED GROUND RECEPTACLE		CLOCK - CEILING MOUNTED		FIRE ALARM BELL
	LIGHTING BOLLARD		GROUND FAULT RECEPTACLE		CLOCK - WALL MOUNTED		FIRE ALARM COMBINATION BELL AND STROBE
	LIGHTING LUMINAIRE TYPE TAG		SPLIT/SWITCHED CIRCUIT RECEPTACLE		PAC-POLE		FIRE ALARM HORN
	EXIT LIGHT - CEILING (C/W ARROWS AS INDICATED)		20A T-SLOT RECEPTACLE		WATER DETECTOR		FIRE ALARM COMBINATION HORN AND STROBE
	EXIT LIGHT - WALL (C/W ARROWS AS INDICATED)		FOURPLEX RECEPTACLE		GROUND BAR		FIRE ALARM MINI HORN/STROBE WITH SILENCE BUTTON
	EMERGENCY POWER BATTERY PACK		ISOLATED GROUND FOURPLEX RECEPTACLE		BACKBOARD		FIRE ALARM MINI HORN WITH SILENCE BUTTON
	EMERGENCY POWER BATTERY PACK C/W LIGHTING HEADS		COMPUTER DUPLEX RECEPTACLE (FED W/ DEDICATED NEUTRAL)				FIRE ALARM STROBE
	EMERGENCY POWER BATTERY PACK C/W R. HEADS & EXIT LIGHT		COMPUTER FOURPLEX RECEPTACLE (FED W/ DEDICATED NEUTRAL)	<b>SECURITY SYSTEMS</b>			FIRE ALARM MINI SPEAKER WITH SILENCE BUTTON
	SINGLE REMOTE EMERGENCY LIGHTING HEAD - CEILING MOUNT		FLOOR MOUNTED RECEPTACLE		SECURITY HORN		FIRE ALARM SPEAKER - CEILING MOUNTED
	DOUBLE REMOTE EMERGENCY LIGHTING HEAD - CEILING MOUNT		FLOOR MOUNTED ISOLATED GROUND RECEPTACLE		PUSH BUTTON		FIRE ALARM COMBINATION SPEAKER/STROBE - CEILING MOUNTED
	SINGLE REMOTE EMERGENCY LIGHTING HEAD - WALL MOUNT		FLOOR MOUNTED FOURPLEX ISOLATED GROUND RECEPTACLE		MAGNETIC DOOR HOLD OPEN		FIRE ALARM SPEAKER - WALL MOUNTED
	DOUBLE REMOTE EMERGENCY LIGHTING HEAD - WALL MOUNT		FLOOR MOUNTED COMPUTER DUPLEX RECEPTACLE W/DEDICATED NEUTRAL		MAGNETIC LOCK		FIRE ALARM COMBINATION SPEAKER/STROBE - WALL MOUNTED
	SWITCH - SINGLE, TWO, AND THREE GANG		CEILING MOUNTED SINGLE/SPECIAL PURPOSE RECEPTACLE		ELECTRIC STRIKE		FIRE PHONE
	2 POLE SWITCH		CEILING MOUNTED DUPLEX RECEPTACLE		DOOR POSITION SWITCH		ISOLATION MODULE
	SWITCH - 3 WAY		CEILING MOUNTED JUNCTION/SLAB BOX		REQUEST TO EXIT SENSOR		SUITE AUDIBLE ISOLATOR
	SWITCH - LOW VOLTAGE		FLOOR MOUNTED JUNCTION/SLAB BOX		SECURITY MOTION SENSOR		CONTROL MODULE
	SWITCH - KEY SWITCH		WALL MOUNTED JUNCTION BOX		CARD READER		MONITORING MODULE
	SWITCH - MANUAL STARTER		ELECTRICAL PANELBOARD - SURFACE MOUNTED		2-WAY VOICE/PANIC	<b>GENERAL</b>	
	SWITCH - DIMMER SWITCH		ELECTRICAL PANELBOARD - RECESSED		INTERCOM		CONDUIT CONCEALED IN WALL OR CEILING
	SWITCH - OCCUPANCY SENSOR SWITCH		CONTACTOR		SECURITY STROBE		CONDUIT CONCEALED IN SLAB OR RUN UNDERGROUND
	SWITCH C/W PILOT LIGHT - SINGLE GANG		CAR PLUG POST		CCTV CAMERA		CONDUIT UP
	SWITCH - TIMER SWITCH		TIME CLOCK		GLASS BREAKAGE SENSOR		CONDUIT DOWN
	PHOTO ELECTRIC CELL		SINGLE PHASE DIRECT CONNECTION		KEYPAD		CONDUIT STUB
	OCCUPANCY SENSOR - CEILING MOUNTED		THREE PHASE DIRECT CONNECTION		INTERCOM		CONDUIT CONTINUATION
	DAYLIGHT HARVESTING LIGHT SENSOR		DROP CORD		RELAY MODULE		DENOTES WEATHERPROOF DEVICE
	ON / OFF ROOM CONTROLLER						DENOTES UNSWITCHED LUMINAIRE (NIGHT LIGHT)
	0-10V DIMMING CONTROLLER						DENOTES DEVICE TO REMOVE OR RELOCATE
	LIGHTING CONTROL POWER PACK						DENOTES RELOCATED DEVICE
							DENOTES FURNITURE MOUNTED DEVICE
							DENOTES EXISTING TO REMAIN

DRAWING LIST	
Sheet Number	Sheet Title
E00-00-00	ELECTRICAL COVER SHEET
E00-00-01	DEMOLITION AND NEW POWER & SYSTEMS PLANS
E10-00-00	LIGHTING PLAN, SCHEDULES AND SINGLE LINE DIAGRAM
E20-00-00	ELECTRICAL SPECIFICATIONS
E20-00-01	ELECTRICAL SPECIFICATIONS

DATE	ISSUED FOR	REV
2018-02-07	ISSUED FOR 60% REVIEW	A
2018-03-02	ISSUED FOR 95% REVIEW	B
2018-03-29	ISSUED FOR TENDER	C


This drawing has been prepared solely for the use of the CLIENT and there are no representations of any kind made by NORR Architects Engineers Planners to any party with whom NORR Architects Engineers Planners has not entered into a contract.

This drawing shall not be used for construction purposes until the seal appearing hereon is signed and dated by the Architect or Engineer.

Project Component	LUNCHROOM EXPANSION
Keyplan	

Consultants

Architectural: NORR Architects Engineers Planners  
 Structural: NORR Architects Engineers Planners  
 Mechanical: NORR Architects Engineers Planners  
 Electrical: NORR Architects Engineers Planners

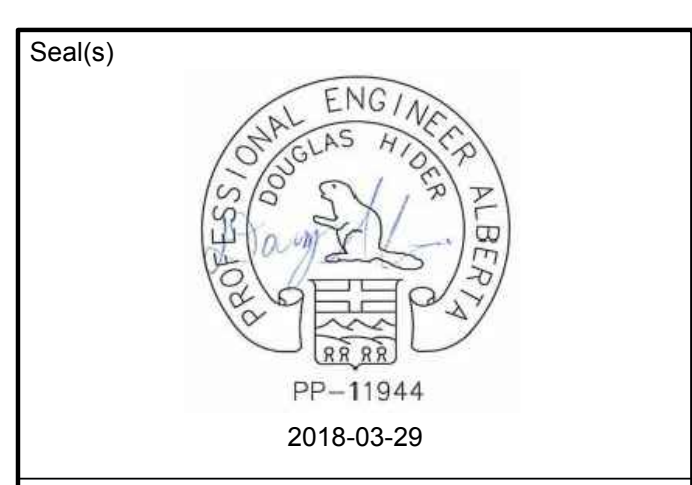

**NORR**

2300, 411 - 1st Street SE,  
 Calgary, AB Canada T2G 4Y5  
 norr.com

NORR ARCHITECTS ENGINEERS PLANNERS  
 A Partnership of Limited Companies

Victor Smith, Architect, A.A.A., R. Arch., M.A.R.C.  
 Bruce G. McManis, Architect, A.A.A., R. Arch., M.A.R.C.  
 A. Brian Baskerville, Architect, A.A.A., R. Arch., M.A.R.C.  
 Andrew Tisdale, P. Eng., A.P.E.C.A.  
 Chris Pitt, P. Eng., A.P.E.C.A.

Project Manager	Drawn
D. HIDER	D. LAM
Project Leader	Checked
D. HIDER	D. HIDER
Client	RCMP


Project  
**INNISFAIL PDSTC  
 LUNCHROOM EXPANSION**

Drawing Title  
**ELECTRICAL  
 COVERSHEET**


Check Scale (may be photo reduced)  
 0 1inch 0 10mm

Project No. **NCCA17-0228**  
 Drawing No. **E00-00-00**


PLOT DATE: March 29, 2018 TIME: 2:27 PM FULL PATH AND FILENAME: P:\RCMP\_PROJECTS\NCCA17-0228 - RCMP - DTF LUNCHROOM EXPANSION\500-DELIVABLES\500-00-01.DWG PLOTSYCLE TABLE: Ingenium-SmallFormat.Dgn.cdb

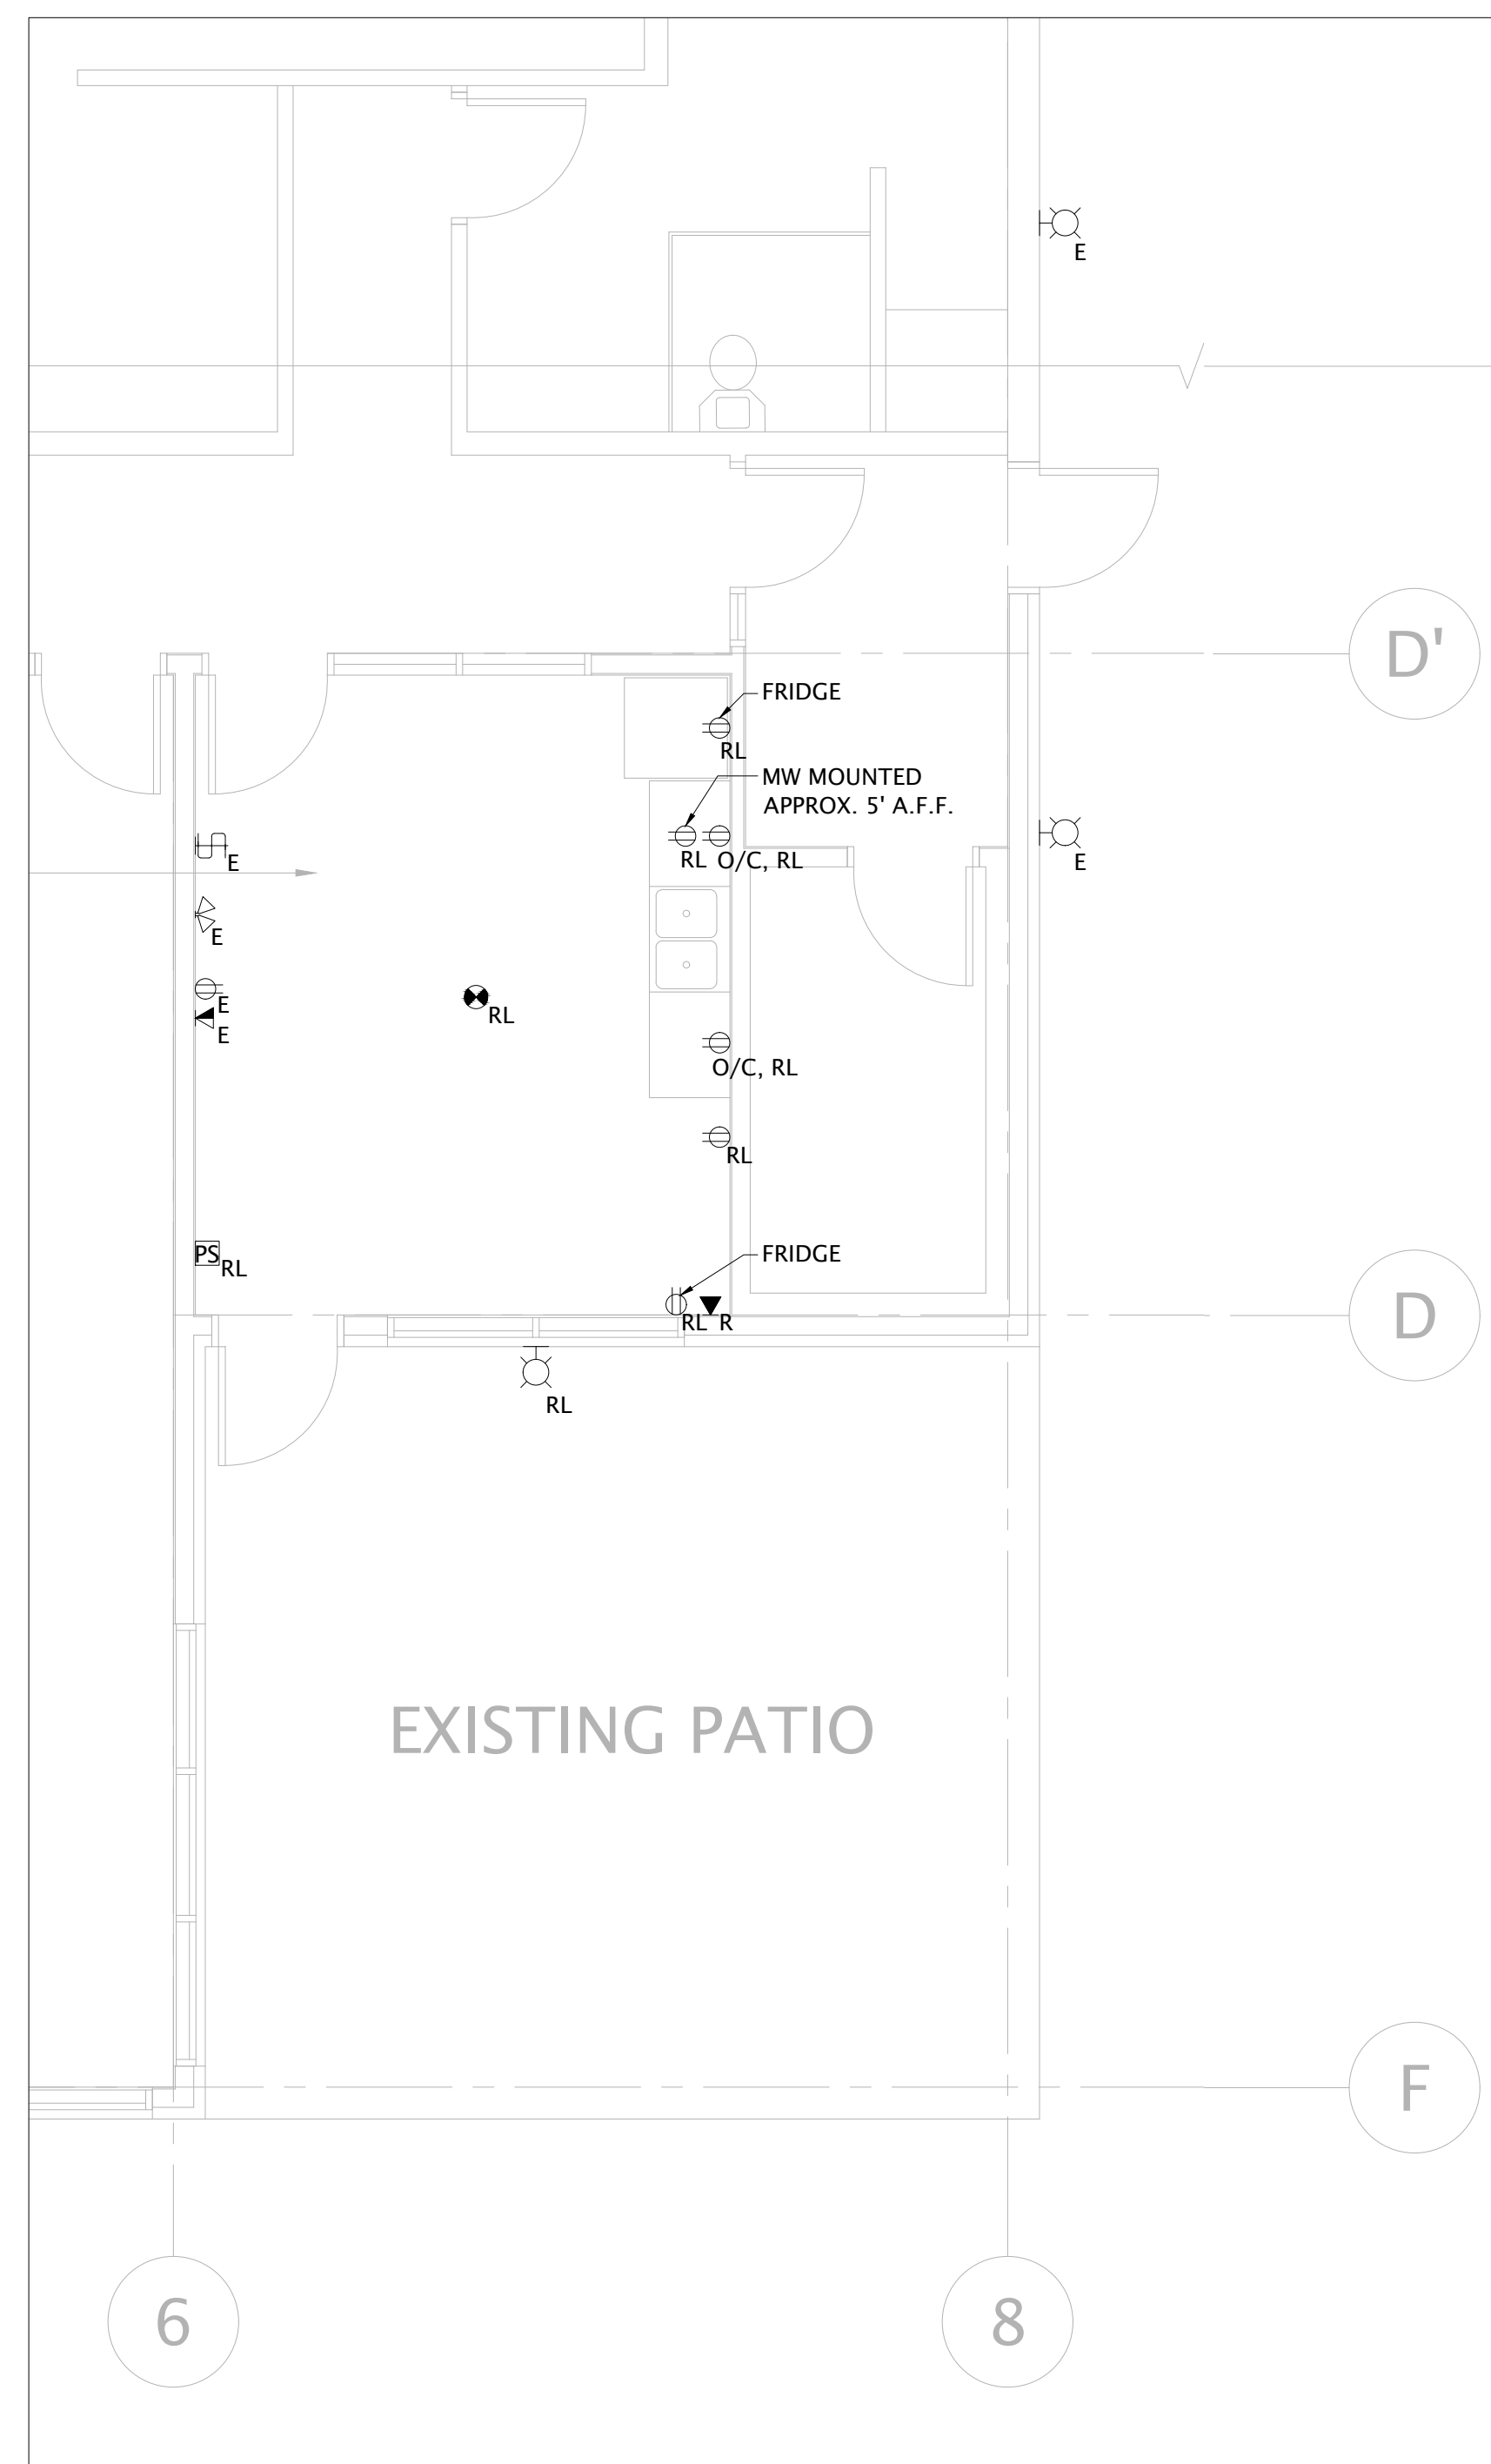

01 DEMOLITION POWER & SYSTEMS PLAN  
E00-00-01 1:50

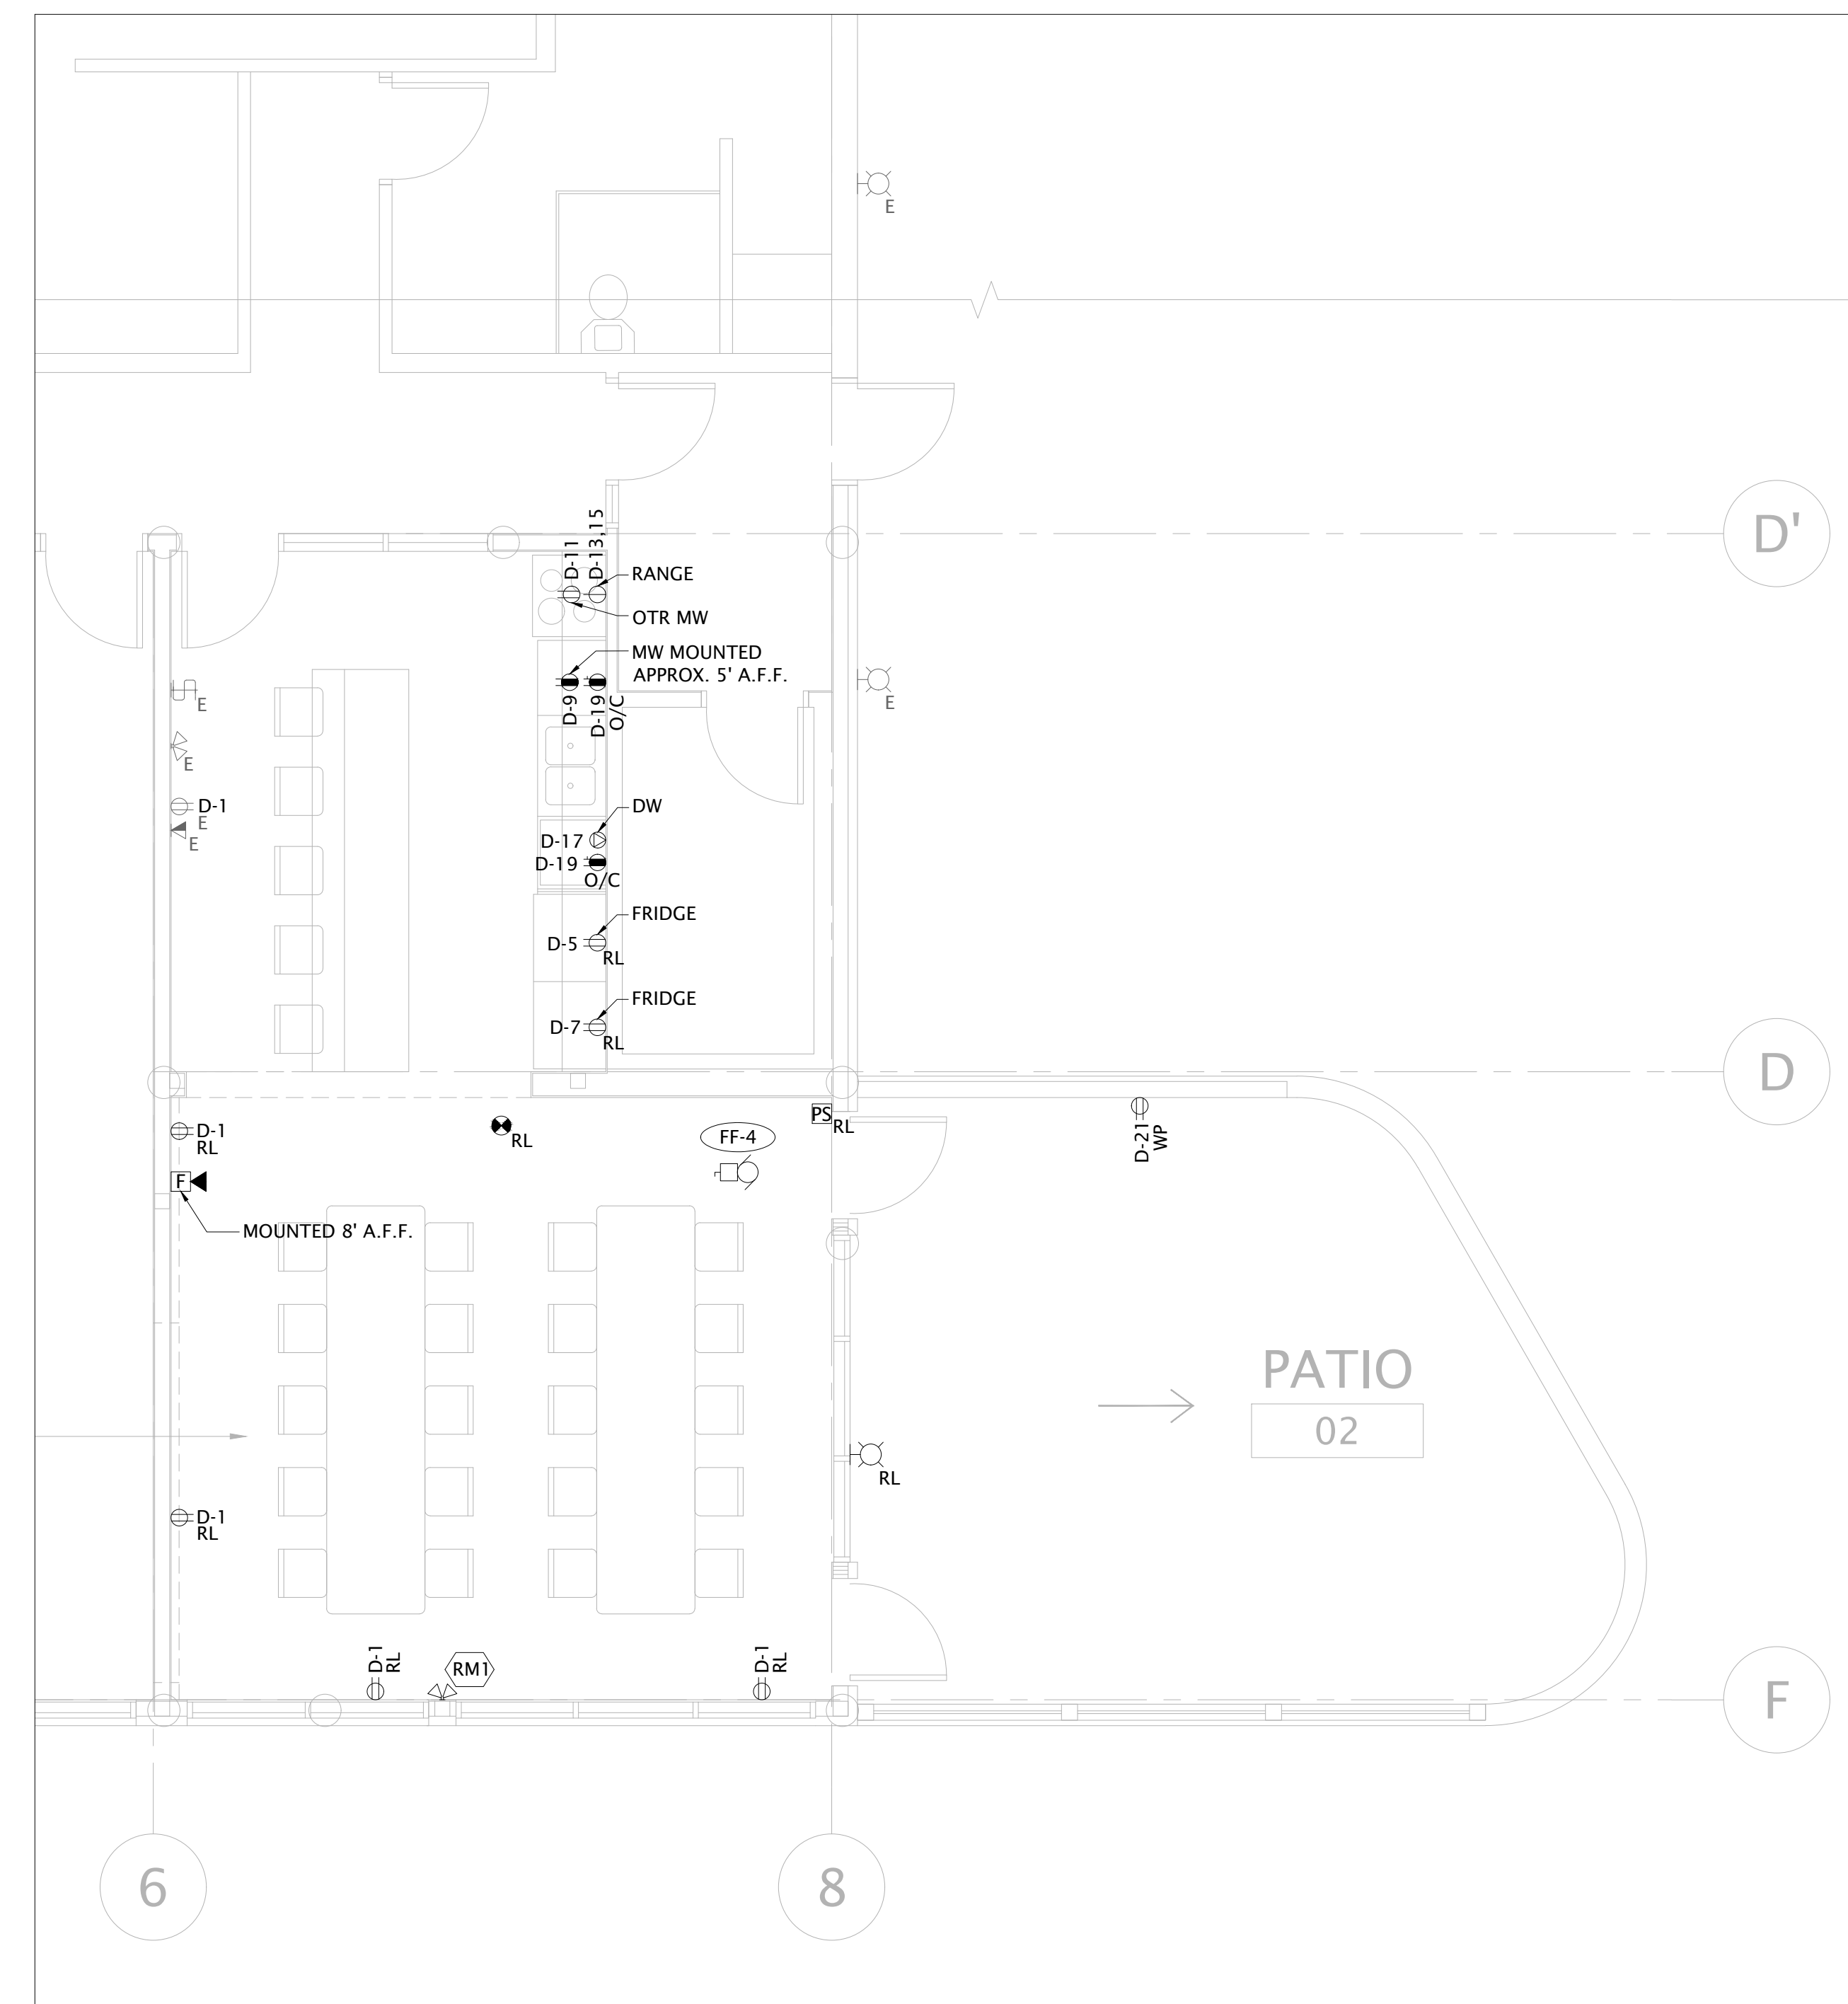

02 NEW POWER & SYSTEMS PLAN  
E00-00-01 1:50

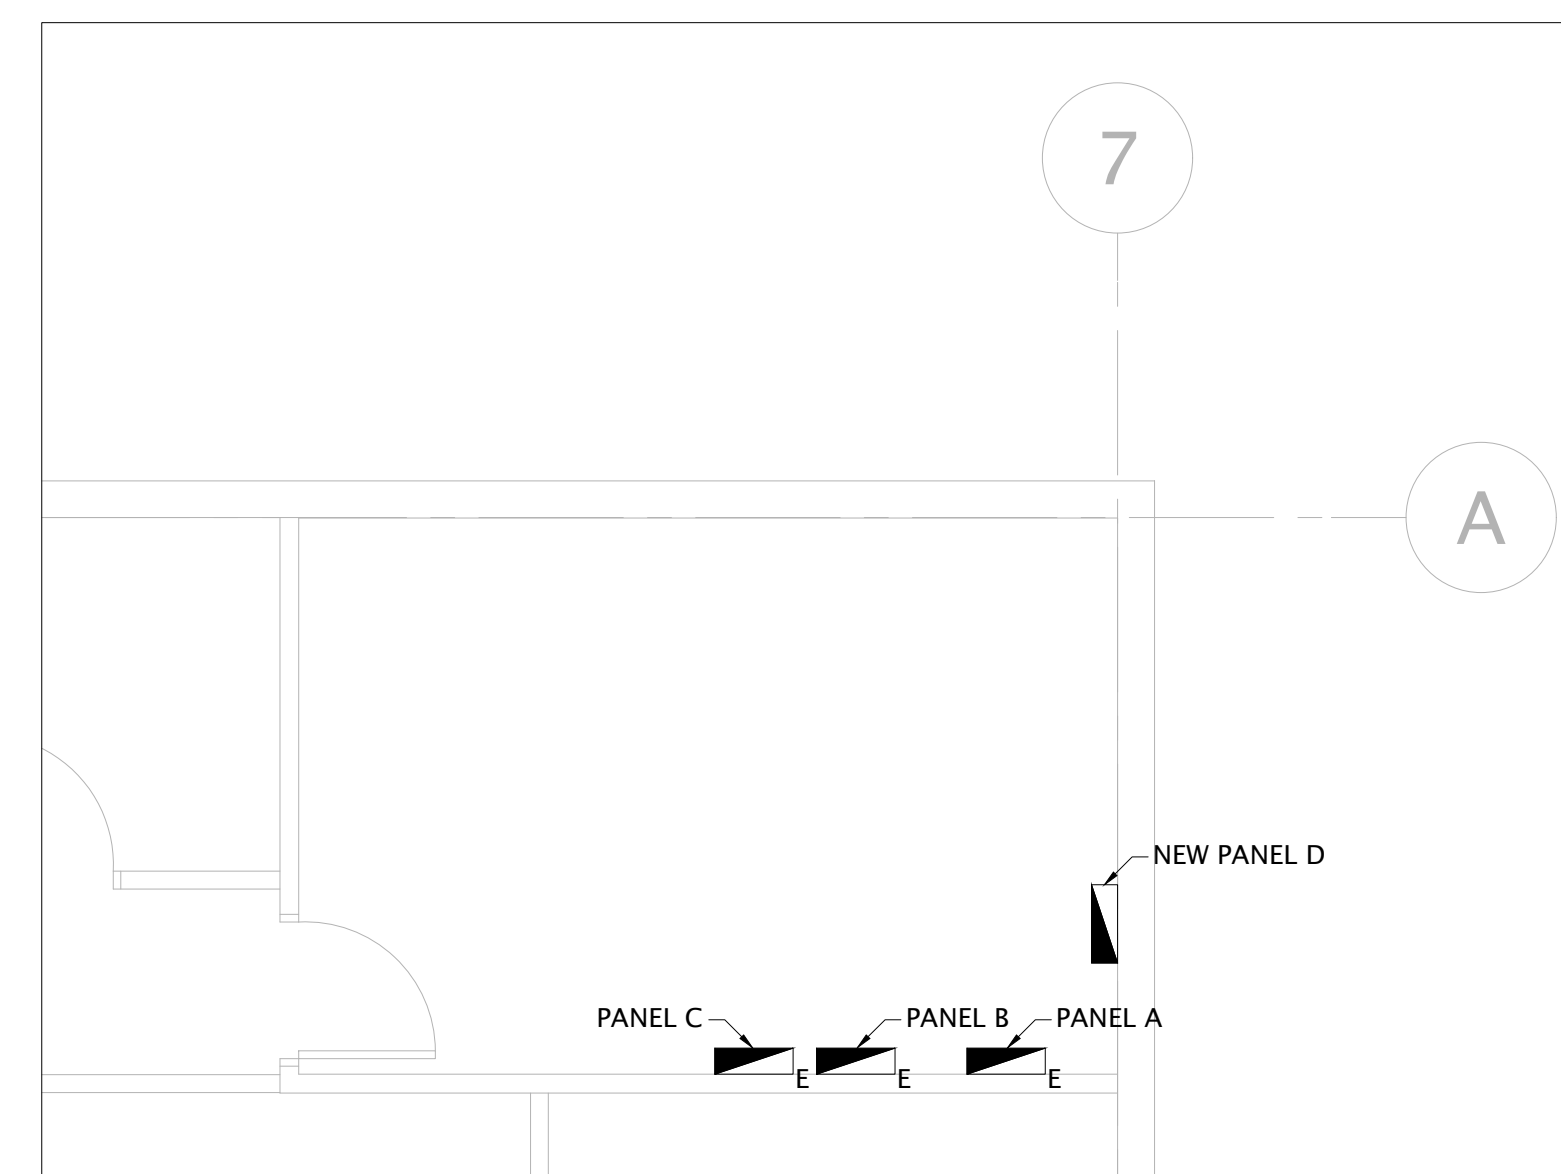

03 ELECTRICAL ROOM  
E00-00-01 1:50

GENERAL NOTES:


- A. ELECTRICAL DRAWINGS TO BE READ IN CONJUNCTION WITH ARCHITECTURAL, STRUCTURAL AND MECHANICAL DRAWINGS.
- B. NEW AND RELOCATED FIRE ALARM DEVICES TO BE CONNECTED TO EXISTING FIRE ALARM SYSTEM AND VERIFIED.
- C. ALL EXISTING LIGHTING TO BE REMOVED SHALL BE CLEANED AND RETURNED TO THE OWNER.
- D. EXISTING LIGHT SWITCH TO BE USED TO CONTROL NEW LIGHTING. REFER TO DRAWING E10-00-00 FOR NEW LIGHTING PLAN.
- E. ELECTRICAL CONTRACTOR TO SUPPLY AND INSTALL PANEL D TO BE FED OFF OF PANEL A. PANEL D TO FEED ALL NEW ELECTRICAL DEVICES IN LUNCH ROOM. REFER TO DRAWING E10-00-00 FOR PANEL SCHEDULE.
- F. ALL ASSOCIATED CONDUIT AND CABLE FROM RELOCATED AND EXISTING TO REMAIN ELECTRICAL DEVICES SHALL BE REMOVED BACK TO THE SOURCE. CIRCUIT BREAKERS IN EXISTING PANELS THAT NO LONGER SERVICE EQUIPMENT SHALL BE MARKED AS SPARE. THE HEAD END DEVICE SHALL BE REUSED, RELOCATED AND CIRCUITED AS INDICATED.
- G. ELECTRICAL CONTRACTOR TO SUPPLY AND INSTALL ALL BACK BOXES CONDUIT, AND CABLING INCLUDING TERMINATIONS FOR POWER AND COMMUNICATION RECEPTACLES. ELECTRICAL CONTRACTOR RESPONSIBLE TO LABEL AND TEST ALL NEW LINES TO ENSURE OPERATIONAL READINESS.
- H. NEW EMERGENCY LIGHTING TO BE FED OFF OF NEAREST EXISTING BATTERY PACK. ELECTRICAL CONTRACTOR TO VERIFY EXISTING BATTERY PACK HAS ENOUGH CAPACITY TO HOLD NEW AND EXISTING DEVICES FOR 30 MINUTES. CONSULT WITH ELECTRICAL ENGINEER IF EXISTING BATTERY PACK IS LOADED TO FULL CAPACITY.
- I. MOUNTING HEIGHT OF RELOCATED EXTERIOR LIGHT TO MATCH EXISTING.

DATE	ISSUED FOR	REV
2018-02-07	ISSUED FOR 60% REVIEW	A
2018-03-02	ISSUED FOR 95% REVIEW	B
2018-03-29	ISSUED FOR TENDER	C

This drawing has been prepared solely for the use of the CLIENT and there are no representations of any kind made by NORR Architects Engineers Planners to any party with whom NORR Architects Engineers Planners has not entered into a contract.  
This drawing shall not be used for construction purposes until the seal appearing hereon is signed and dated by the Architect or Engineer.

Project Component <b>LUNCHROOM EXPANSION</b>
Keyplan

Consultants  
Architectural: NORR Architects Engineers Planners  
Structural: NORR Architects Engineers Planners  
Mechanical: NORR Architects Engineers Planners  
Electrical: NORR Architects Engineers Planners

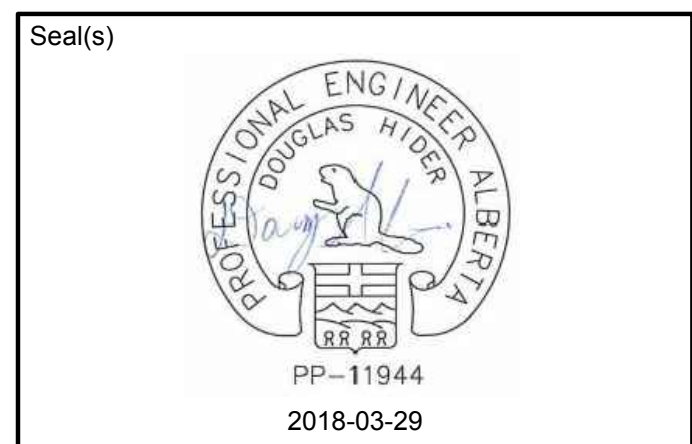

**NORR**  
2300, 411 - 1st Street SE,  
Calgary, AB Canada T2G 4Y5  
norr.com  
NORR ARCHITECTS ENGINEERS PLANNERS  
A Partnership of Limited Companies  
Victor Smith, Architect, A.A.A., B.Arch., M.A.S.C.  
Doug G. McManus, Architect, A.A.A., M.Arch., M.A.S.C.  
A. Brian Baskerville, Architect, A.A.A., B.Arch., M.A.S.C.  
Arlene Tjepkema, P.Eng., P.E.C.E.A.  
Chris Hill, P.Eng., P.E.C.E.A.


Project Manager D. HIDER	Drawn D. LAM
Project Leader D. HIDER	Checked D. HIDER
Client <b>RCMP</b>	

Project  
**INNISFAIL PDSTC  
LUNCHROOM EXPANSION**


Drawing Title  
**DEMOLITION AND NEW  
POWER & SYSTEM PLANS**

Check Scale (may be photo reduced) 0 1inch 0 10mm
Project No. <b>NCCA17-0228</b>
Drawing No. <b>E00-00-01</b>


PLOT DATE: March 28, 2018 TIME: 2:27 PM FULL PATH AND FILENAME: P:\RCMP\_PROJECTS\NCCA17-0228 - RCMP - DTF LUNCHROOM EXPANSION\500-DEL\ELECTRICAL\01-00-00.DWG PLOTS\SYLVE TABLE - Ingenium\SmallFormat\Design.dwg

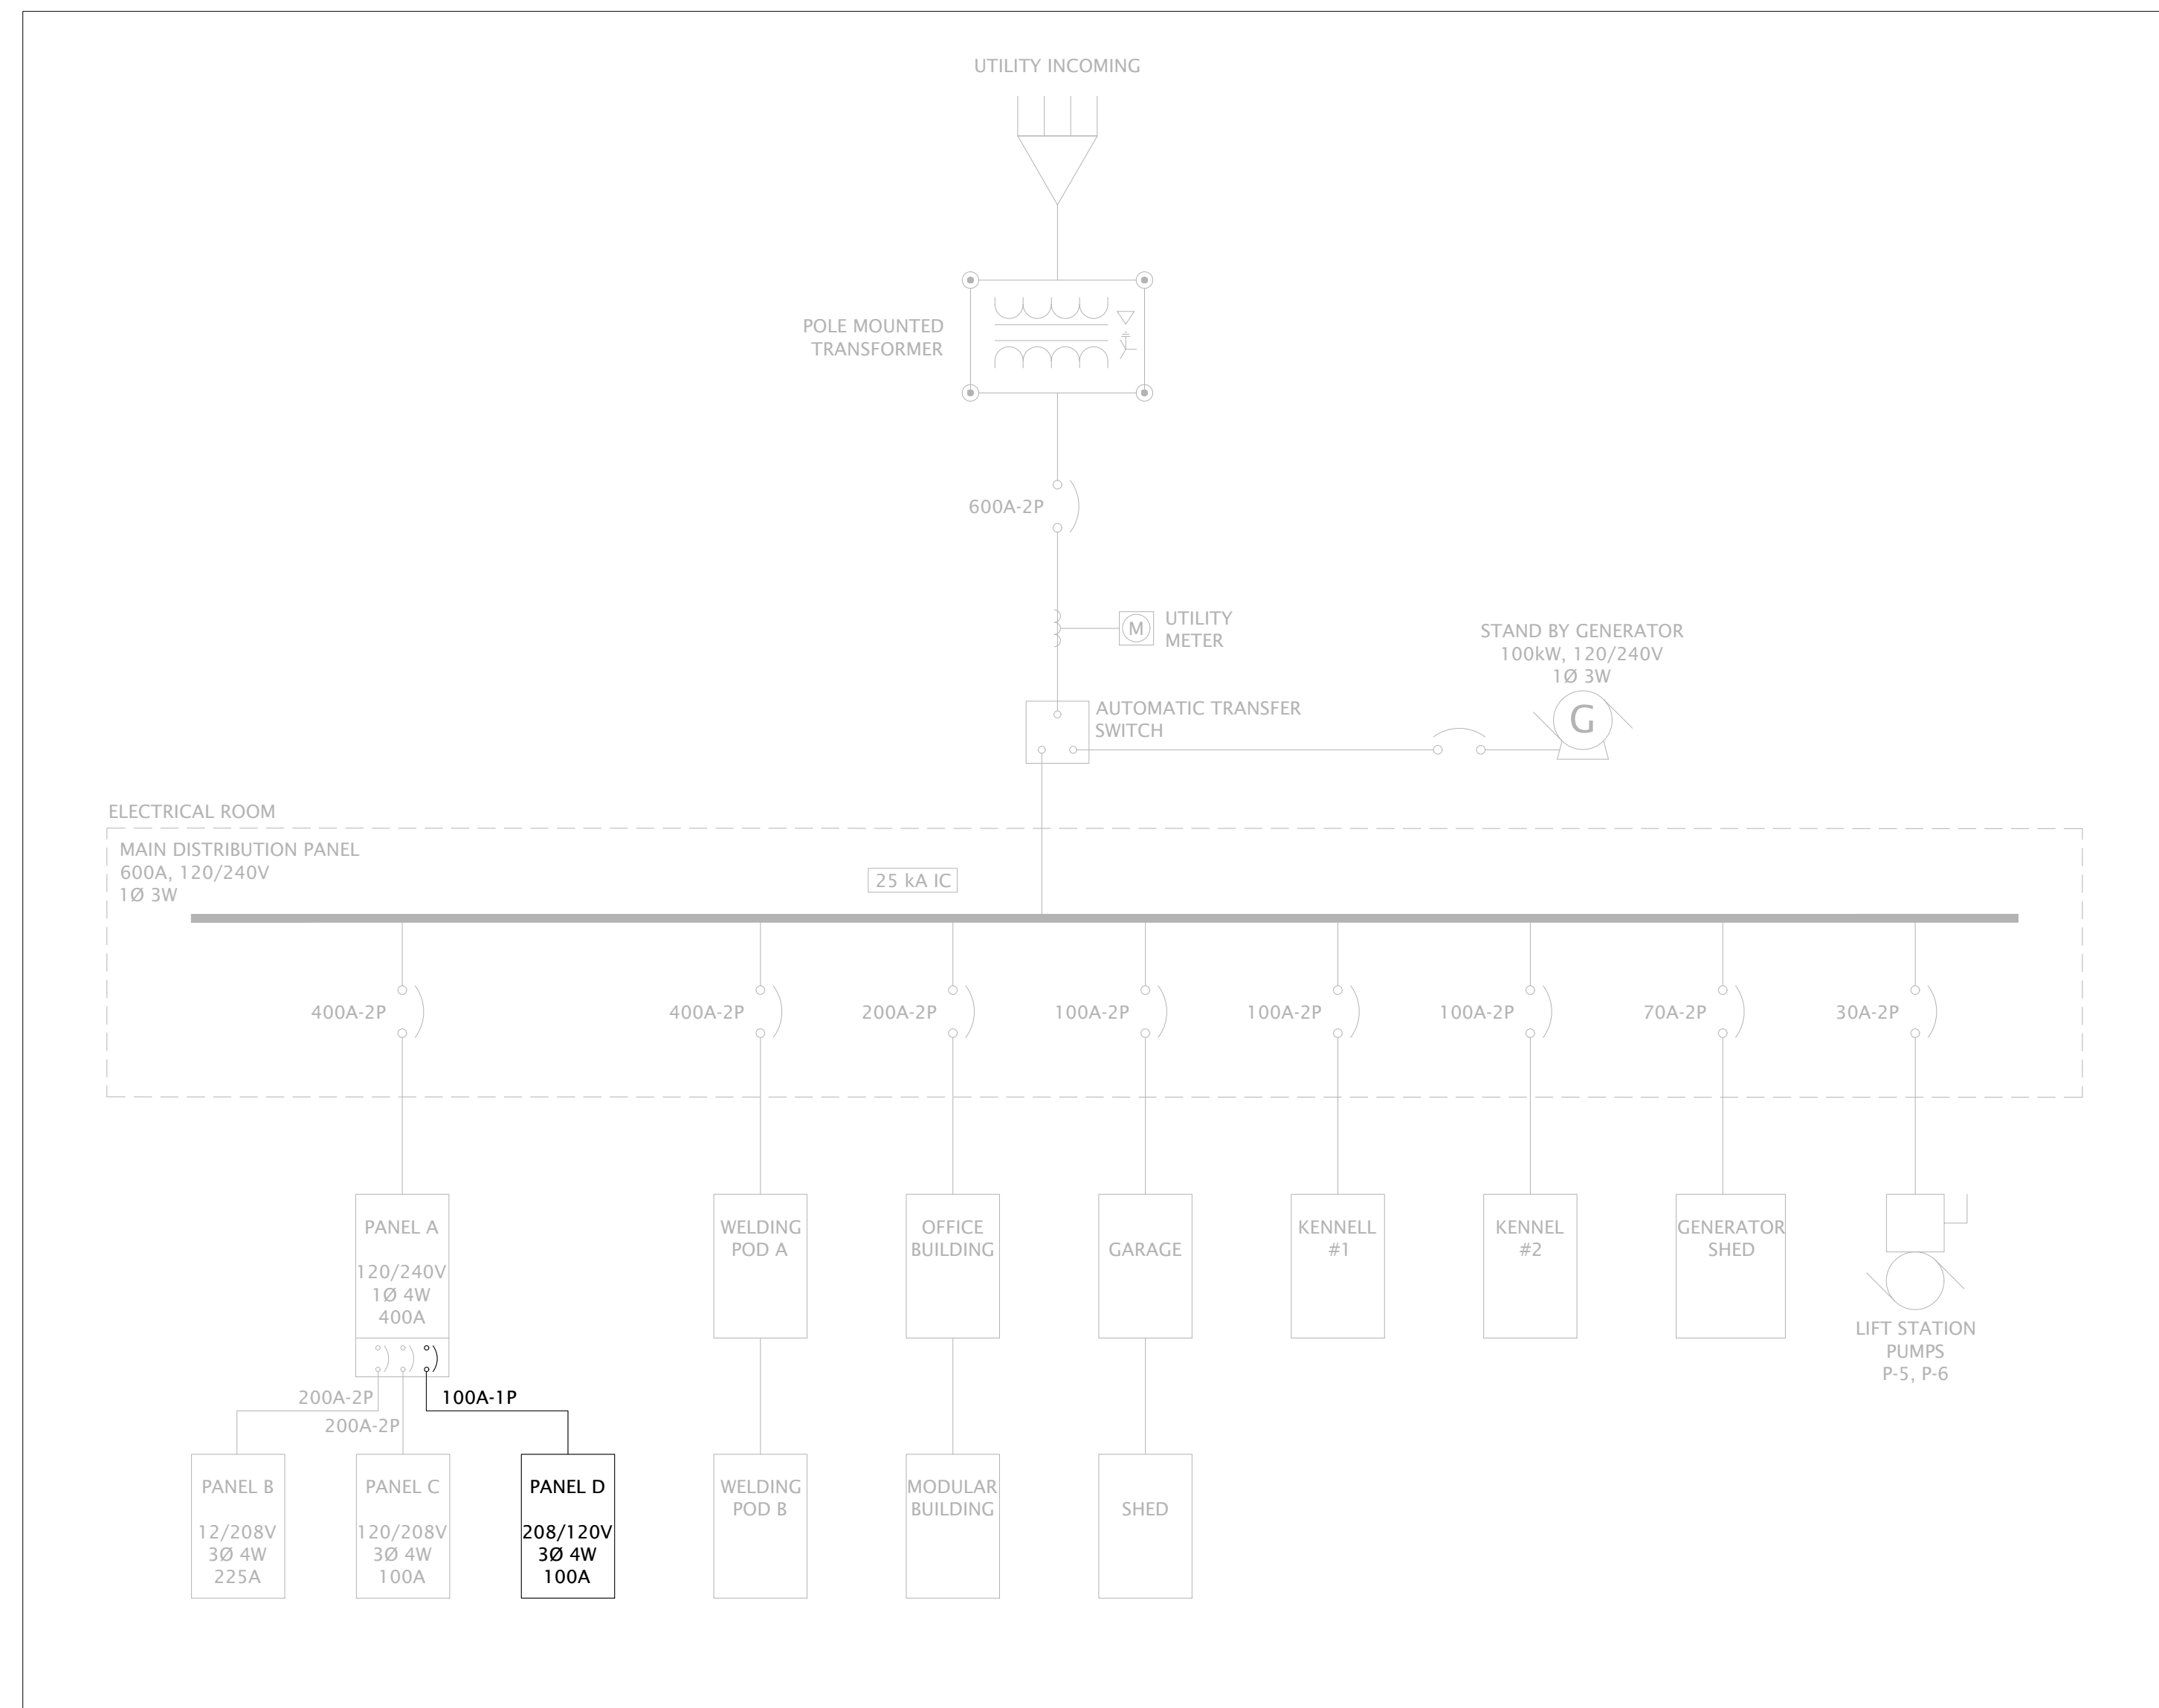


01 SINGLE LINE DIAGRAM  
E10-00-00 N.T.S.

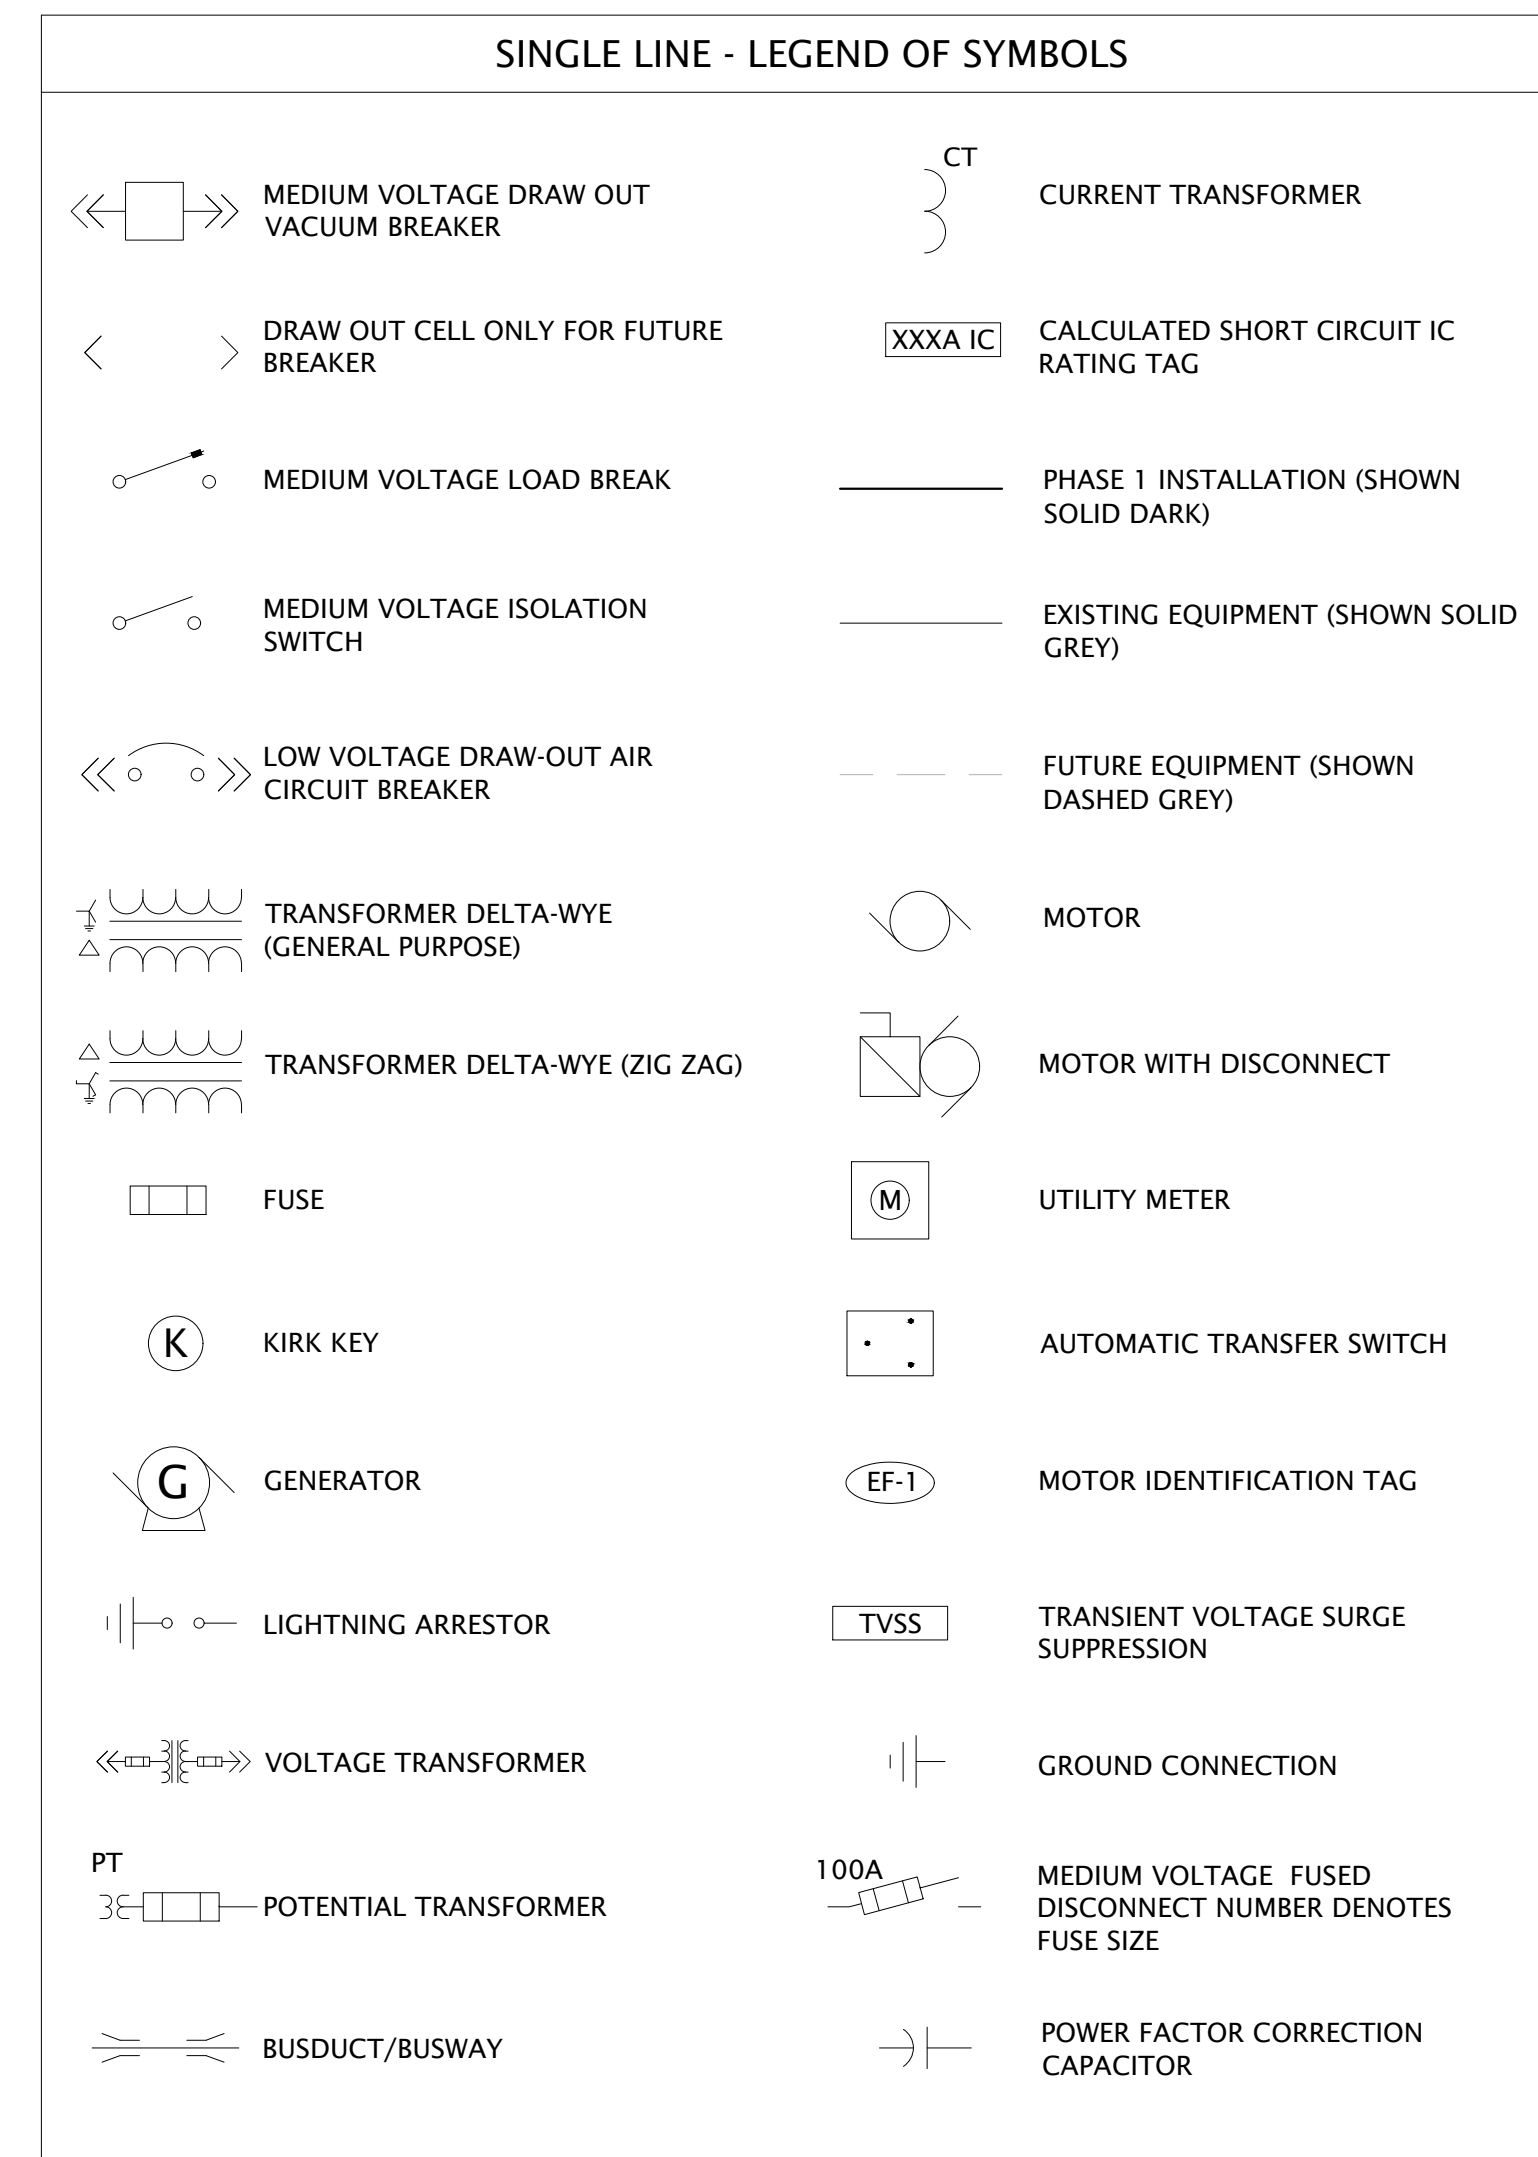

- GENERAL NOTES:**
- ELECTRICAL DRAWINGS TO BE READ IN CONJUNCTION WITH ARCHITECTURAL, STRUCTURAL AND MECHANICAL DRAWINGS.
  - NEW AND RELOCATED FIRE ALARM DEVICES TO BE CONNECTED TO EXISTING FIRE ALARM SYSTEM AND VERIFIED.
  - ALL EXISTING LIGHTING TO BE REMOVED SHALL BE CLEANED AND RETURNED TO THE OWNER.
  - EXISTING LIGHT SWITCH TO BE USED TO CONTROL NEW LIGHTING. REFER TO DRAWING E10-00-00 FOR NEW LIGHTING PLAN.
  - ELECTRICAL CONTRACTOR TO SUPPLY AND INSTALL PANEL D TO BE FED OFF OF PANEL A. PANEL D TO FEED ALL NEW ELECTRICAL DEVICES IN LUNCH ROOM. REFER TO DRAWING E10-00-00 FOR PANEL SCHEDULE.
  - ALL ASSOCIATED CONDUIT AND CABLE FROM RELOCATED AND EXISTING TO REMAIN ELECTRICAL DEVICES SHALL BE REMOVED BACK TO THE SOURCE. CIRCUIT BREAKERS IN EXISTING PANELS THAT NO LONGER SERVICE EQUIPMENT SHALL BE MARKED AS SPARE. THE HEAD END DEVICE SHALL BE REUSED, RELOCATED AND CIRCUITED AS INDICATED.
  - ELECTRICAL CONTRACTOR TO SUPPLY AND INSTALL ALL BACK BOXES CONDUIT, AND CABLING INCLUDING TERMINATIONS FOR POWER AND COMMUNICATION RECEPTACLES. ELECTRICAL CONTRACTOR RESPONSIBLE TO LABEL AND TEST ALL NEW LINES TO ENSURE OPERATIONAL READINESS.
  - NEW EMERGENCY LIGHTING TO BE FED OFF OF NEAREST EXISTING BATTERY PACK. ELECTRICAL CONTRACTOR TO VERIFY EXISTING BATTERY PACK HAS ENOUGH CAPACITY TO HOLD NEW AND EXISTING DEVICES FOR 30 MINUTES. CONSULT WITH ELECTRICAL ENGINEER IF EXISTING BATTERY PACK IS LOADED TO FULL CAPACITY.
  - MOUNTING HEIGHT OF RELOCATED EXTERIOR LIGHT TO MATCH EXISTING.

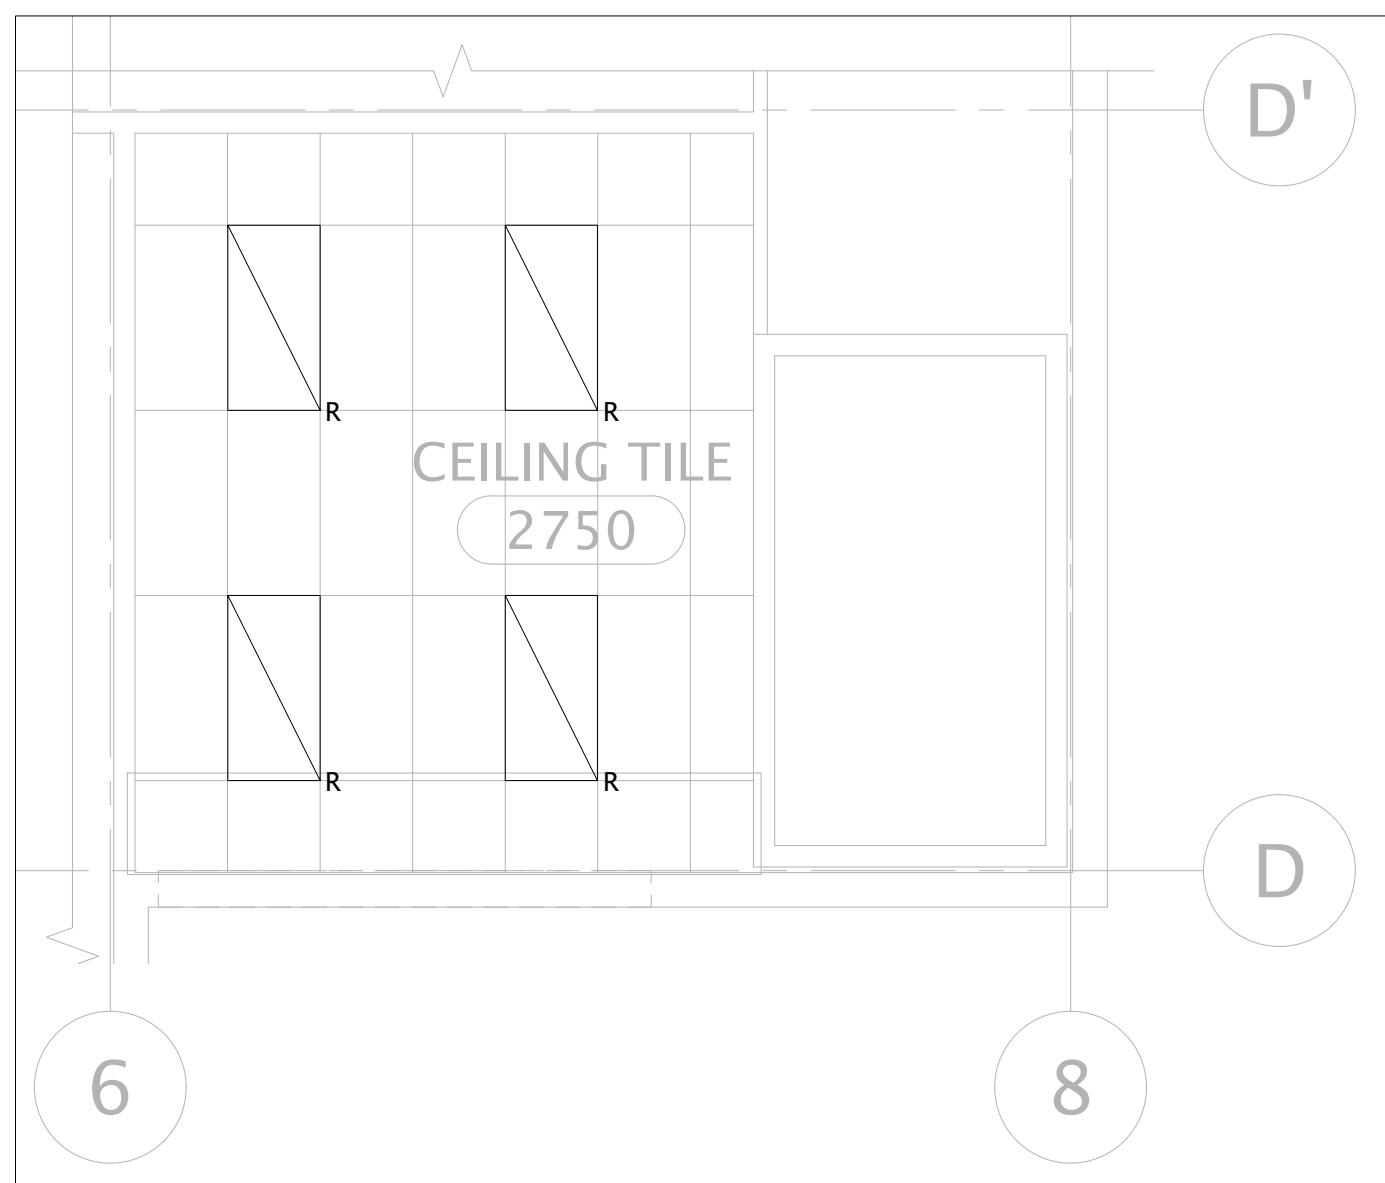

02 DEMOLITION LIGHTING PLAN  
E10-00-00 1:50

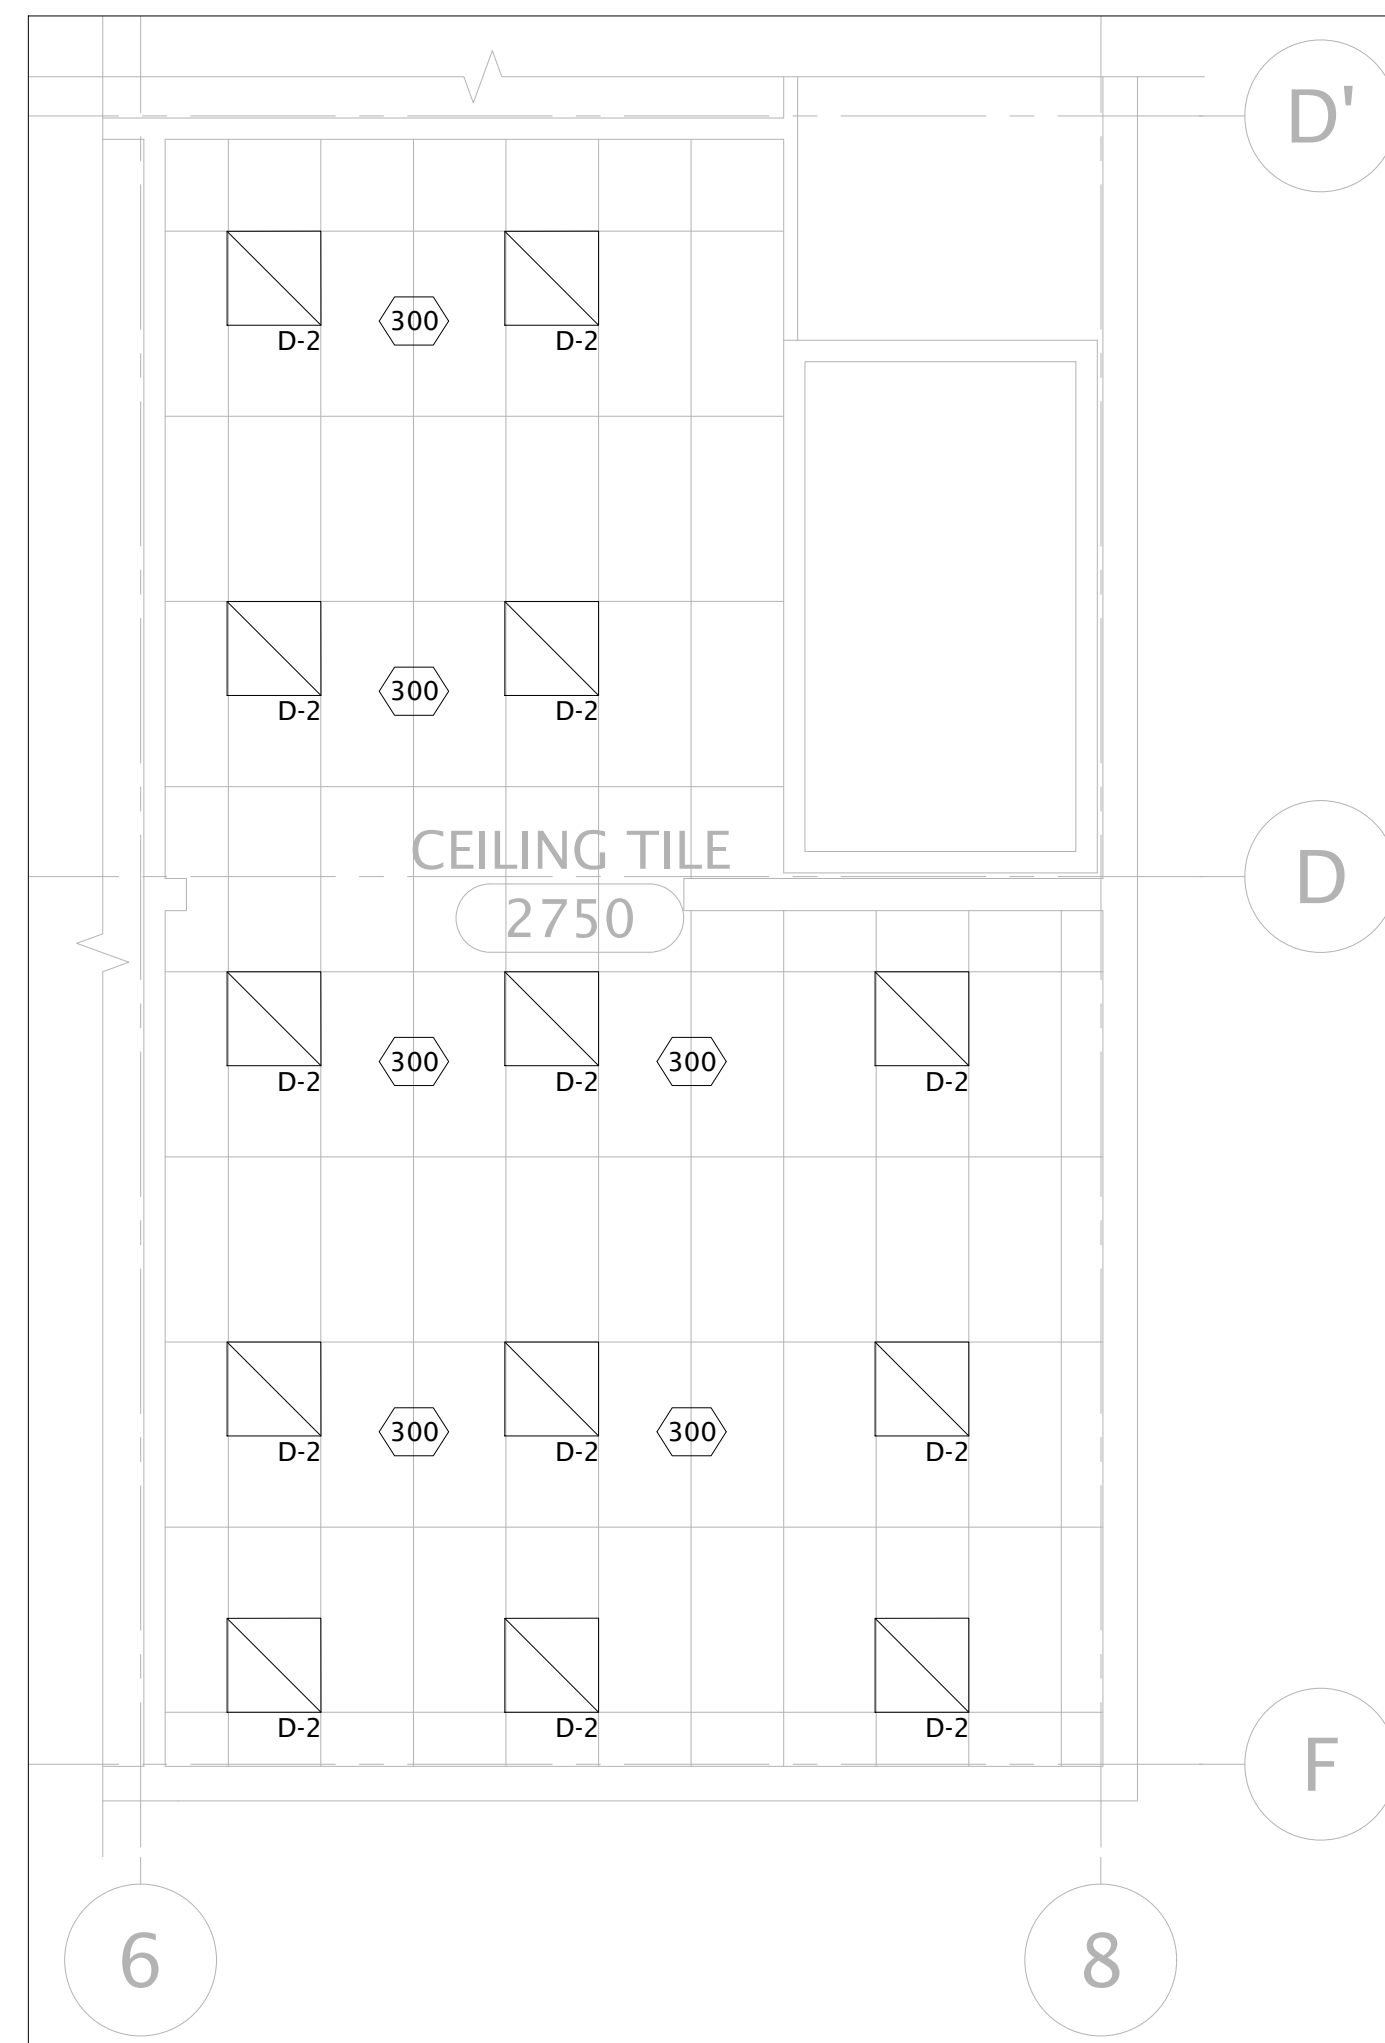

03 NEW LIGHTING PLAN  
E10-00-00 1:50

Ckt No.	Load Description	Volt-Amperes			Breaker Pole	Wire Size	Breaker A Pole	Volt-Amperes			Load Description	Ckt No.
		A	B	C				A	B	C		
1	RECEPTACLES	1200			1 15		15 1	400			LIGHTING	2
3	RECEPTACLES	800			1 15		30 2	3000			RANGE	4
5	FRIDGE		1400		1 15		15 1	1400		3000	DISHWASHER	6
7	FRIDGE	1400			1 15		15 1	1400			T-SLOT GFCI	8
9	MICROWAVE	1000			1 15		20 1	800			EXTERIOR RECEPTACLE	10
11	MICROWAVE		1000		1 15		15 1	400			FF-4	12
13							15 1	100				14
15												16
17												18
19												20
21												22
23												24

Odd Circuit Number Subtotals		2600	1800	2400	Features:			1900	3800	3400
Bus and Lugs Rating (A):	SLD	Total Phase A Load: 4.5 kVA			Remarks:					
Main Circuit Breaker Rating (A):	SLD	Total Phase B Load: 5.6 kVA								
Circuit Breaker IC Rating (KA):	SLD	Total Phase C Load: 5.8 kVA								
Phase:	3	Total Connected Load: 15.9 kVA								
Wires:	4	Demand Factor: 100 %								
Line to Line Voltage (V):	208	Demand Load: 15.9 kVA								
Line to Neutral Voltage (V):	120	Future Load: 0.0 kVA								
Number of Poles:	42	Total Demand Load: 15.9 kVA								
Mounting:		Total Demand Current: 44.1 A								

**Panelboard PANEL D**

**NORR** 221-10th Avenue SE Suite 100, Calgary AB Canada T2G 0V9

LUMINAIRE SCHEDULE									
TYPE	PHOTO	DESCRIPTION	TYPE	WATTS	NO.	VOLTS	MANUFACTURER	MOUNTING	REMARKS
300		2' x 2' FIXTURE	LED	29		120	CORELITE MODEL# EEX-WL-2L35-1D-LNV-22-T1-STD	RECESSED	
RM1		REMOTE HEADS	LED	6		12	STANPRO MODEL# 32-32-4W-LA-WH	WALL	MOUNTING HEIGHT TO MATCH EXISTING

NOTES:

DATE	ISSUED FOR	REV
2018-02-07	ISSUED FOR 60% REVIEW	A
2018-03-02	ISSUED FOR 95% REVIEW	B
2018-03-29	ISSUED FOR TENDER	C

This drawing has been prepared solely for the use of the CLIENT and there are no representations of any kind made by NORR Architects Engineers Planners to any party with whom NORR Architects Engineers Planners has not entered into a contract.


This drawing shall not be used for construction purposes until the seal appearing hereon is signed and dated by the Architect or Engineer.

Project Component  
**LUNCHROOM EXPANSION**

Keyplan

Consultants

Architectural: NORR Architects Engineers Planners  
Structural: NORR Architects Engineers Planners  
Mechanical: NORR Architects Engineers Planners  
Electrical: NORR Architects Engineers Planners

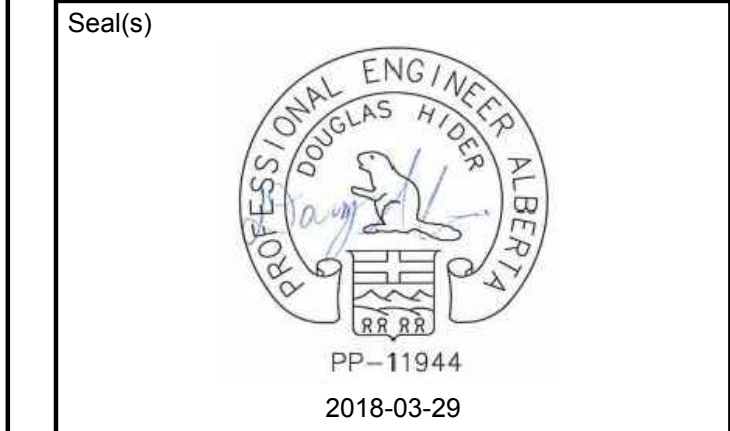

**NORR**

2300, 411 - 1st Street SE,  
Calgary, AB Canada T2G 4Y5  
norr.com

NORR ARCHITECTS ENGINEERS PLANNERS  
A Partnership of Limited Companies

Victor Smith, Architect, A.A.A., R. Arch., M.A.S.C.  
Bruce G. McManis, Architect, A.A.A., R. Arch., M.A.S.C.  
A. Ross Buchanan, Architect, A.A.A., R. Arch., M.A.S.C.  
Ardur Tjebkja, P. Eng., A.P.E.C.A.  
Chris P. P. Eng., A.P.E.C.A.

Project Manager D. HIDER	Drawn D. LAM
Project Leader D. HIDER	Checked D. HIDER

Client  
**RCMP**

Project  
**INNISFAIL PDSTC LUNCHROOM EXPANSION**

Drawing Title  
**LIGHTING PLANS, SCHEDULES AND SINGLE LINE DIAGRAM**

Check Scale (may be photo reduced)  
0 10mm

Project No.  
**NCCA17-0228**

Drawing No.  
**E10-00-00**



<p>4) THE OWNER SHALL PROMPTLY GIVE THE CONTRACTOR NOTICE IN WRITING OF OBSERVED DEFECTS AND DEFICIENCIES THAT OCCUR DURING THE WARRANTY PERIOD.</p> <p>5) THE CONTRACTOR SHALL CORRECT OR PAY FOR DAMAGES RESULTING FROM CORRECTIONS MADE UNDER THE REQUIREMENTS OF PARAGRAPH 1.8.3.</p> <p>6) THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING PRODUCT WARRANTIES IN EXCESS OF ONE YEAR ON BEHALF OF THE OWNER FROM THE MANUFACTURER. THESE PRODUCT WARRANTIES SHALL BE ISSUED BY THE MANUFACTURER TO THE BENEFIT OF THE OWNER.</p> <p>7) THE CONTRACTOR SHALL PROVIDE A TWENTY FIVE (25) YEAR EXTENDED PRODUCT WARRANTY OF LIFETIME APPLICATION ASSURANCE WARRANTY FOR THE COMMUNICATIONS NETWORK. THE WARRANTY SHALL BE BACKED UP BY THE MANUFACTURER AND TAKEN OVER BY THE MANUFACTURER OR HIS REPRESENTATIVE IF THE CONTRACTOR FAILS TO FOLLOW THROUGH WITH THE REQUIREMENTS OF THE WARRANTY.</p> <p>8) THE COMMUNICATIONS NETWORK IS DEFINED AS ALL REQUIRED PASSIVE EQUIPMENT AND CABLING, INCLUDING HARDWARE, TERMINATIONS, AND JACKS, CONFIGURED TO PROVIDE DATA AND VOICE CONNECTIVITY FROM EACH DATA OR VOICE OUTLET PROVIDED BY THE CONTRACTOR IN THIS CONTRACT.</p> <p>9) THE SYSTEM ASSURANCE SHALL COVER THE APPLICATIONS THAT THE INSTALLED SYSTEM IS DESIGNED TO SUPPORT FOR A TWENTY FIVE (25) YEAR PERIOD.</p> <p>10) THE COPPER SYSTEM SHALL BE CONSTRUCTED TO CONFORM TO ANSITIA-568-B.2-10-2008 - TRANSMISSION PERFORMANCE SPECIFICATIONS FOR 4 PAIR 1000 AUGMENTED CAT 6 CABLING COMMERCIAL BUILDING TELECOMMUNICATIONS CABLING STANDARDS.</p> <p>11) THE FIBER SYSTEM SHALL BE CONSTRUCTED TO CONFORM TO ANSIEIA-568-B.3-2009 - OPTICAL FIBER CABLING COMPONENTS STANDARD AND ANSITIA/EIA-568-B.3-1-2009 - OPTICAL FIBER CABLING COMPONENTS STANDARD ADDENDUM 1 - ADDITIONAL TRANSMISSION PERFORMANCE SPECIFICATIONS FOR 50 /125 (m OPTICAL FIBER CABLES)</p> <p>12) THE EXTENDED PRODUCT WARRANTY AND THE SYSTEMS ASSURANCE TOGETHER COMPRISE THE STRUCTURED CABLING SYSTEM QUALITY ASSURANCE PROGRAM.</p> <p>13) UPON SUCCESSFUL COMPLETION OF THE STRUCTURED CABLING INSTALLATION AND SUBSEQUENT TESTING BY CERTIFIED TECHNICAL PERSONNEL THE CONTRACTOR SHALL PROVIDE TO THE OWNER A NUMBERED CERTIFICATE REGISTERING THE INSTALLATION.</p>	<p>32.1. INSTALLATION</p> <p>32.1.1. HORIZONTAL CABLING WILL BE RUN IN CONDUIT AND CABLE TRAY PROVIDED UNDER THIS CONTRACT.</p> <p>32.1.2. THE INSTALLATION OF EXPOSED CABLES SHALL BE MANAGED TO PROVIDE A NEAT INSTALLATION AND SHALL BE RUN PARALLEL TO BUILDING LINES.</p> <p>32.1.3. EXPOSED CABLE IN RETURN AIR PLENUM ARE TO BE ATTACHED TO THE CEILING EVERY 3 FEET BY J-HOOKS OR HILTI HOOKS. BUNDLES OF MULTIPLE CABLES ARE TO BE NEATLY SECURED WITH VELCRO STRIPS.</p> <p>32.1.4. ALL CABLES BETWEEN WALL OR FURNITURE OUTLETS AND TERMINATION ROOMS SHALL BE CONTINUOUS WITHOUT ANY BREAKS OR SPLICES TO MINIMIZE POTENTIAL FAULT LOCATIONS.</p> <p>32.1.5. PLENUM RATED FT4/FT6 CABLES MAY BE ROUTED EXPOSED ABOVE THE SUSPENDED CEILING IN THE RETURN AIR PLENUM. PLENUM RATED CABLES SHALL BE LABELLED FT4 OR FT6 ALONG THE LENGTH OF THE CABLE JACKET. CABLES NOT CARRYING ONE OF THESE DESIGNATIONS MUST BE ROUTED IN ENCLOSED RACEWAYS.</p> <p>32.1.6. PROVIDE IDENTIFICATION TAGS AT ALL OUTLETS BLOCKS AND TERMINATION CABINETS. IDENTIFICATION TAGS TO BE KROY TYPE 200 LABELS. PROVIDE CIRCULAR CABLE IDENTIFICATION TAGS AT EACH END OF EACH CABLE. IDENTIFICATION CODES ARE TO BE SPECIFIED BY JOB NAME.</p> <p>32.1.7. INSTALL ALL PATCH CORDS IN ACCORDANCE WITH THE OWNERS I.T. DEPARTMENT OR THE PERSON IN CHARGE OF THE TELECOMMUNICATIONS INFRASTRUCTURE.</p> <p>32.1.8. BEND RADIUS OF CABLES SHALL BE MAINTAINED AS RECOMMENDED BY THE MANUFACTURER AND PER TIA AND BICSI STANDARDS.</p> <p>32.1.9. LOCATIONS AND QUANTITY OF OUTLETS AS SHOWN ON DRAWINGS.</p> <p>32.1.10. RACK LOCATION AND PANEL INSTALLATION AS SHOWN IN DETAIL DRAWINGS.</p>	<p>35.5. REPLACE BURNT-OUT LAMPS FOR FLUORESCENT, INCANDESCENT, AND LOW VOLTAGE LUMINAIRES WHERE REQUIRED.</p> <p>35.6. ALL FLUORESCENT LUMINAIRES TO BE SUPPLIED COMPLETE WITH LAMPS AND ELECTRONIC BALLAST &lt;10% THD, RAPID START OR PROGRAMMED START.</p> <p>35.7. UNLESS OTHERWISE NOTED, ALL FLUORESCENT LAMPS SHALL BE STANDARD 3500K, T8 LOW MERCURY, CRI 85.</p> <p>35.8. INCANDESCENT LAMPS TO BE 5,000 HOURS, 130 VOLT EXTENDED SERVICE TYPE.</p> <p>35.9. SPECIAL LAMPS TO BE USED WHERE INDICATED WITH THE LONGEST LIFE AVAILABLE IN EACH CATEGORY.</p> <p>35.10. ACCEPTABLE LAMP MANUFACTURERS: SYLVANIA, GE, PHILLIPS.</p> <p>35.11. ACCEPTABLE BALLAST MANUFACTURERS: GE, PHILLIPS, LUTRON.</p> <p>35.12. LUMINAIRE SCHEDULE - REFER TO DRAWINGS.</p>
<p>29.0. COMMUNICATION WIRING SYSTEM</p> <p>29.1. GENERAL</p> <p>THE ELECTRICAL CODE REFERRED TO IN THESE SPECIFICATIONS IS THE NATIONAL ELECTRICAL CODE AS CURRENTLY ADOPTED BY THE PROVINCE OF ALBERTA. ALL WORK WILL BE PROVIDED IN STRICT COMPLIANCE WITH THE ELECTRICAL CODE AND ALL REGULATIONS THAT MAY APPLY.</p> <p>WHERE STANDARDS EXIST, FOR A PARTICULAR CATEGORY, PRODUCTS USED ON THIS PROJECT WILL BE LISTED BY AN APPROVED NATIONALLY RECOGNIZED TESTING LABORATORY (NRTL), AND BE APPROVED OR LISTED FOR THE INTENDED SERVICE AND APPLICATION.</p> <p>THESE SPECIFICATIONS DO NOT UNDERTAKE TO REPEAT THE REQUIREMENTS OF CODES, REGULATIONS OR NRTL LISTING OR LABELING INSTRUCTIONS. THE SPECIFICATIONS OR DRAWINGS MAY REQUIRE ITEMS OR WORK BEYOND THE REQUIREMENTS OF APPLICABLE CODES OR REGULATIONS. THE STRICTER, HIGHER QUALITY, GREATER QUANTITY OR HIGHER COST WILL BE PROVIDED. IT IS INCUMBENT ON THE INSTALLER, MATERIAL AND EQUIPMENT SUPPLIERS TO MEET THESE SPECIFICATIONS, APPLICABLE CODES, REGULATIONS, AND NRTL LISTING AGENCY RESTRICTIONS.</p> <p>29.2. MANUFACTURER</p> <p>THE COPPER CABLING SYSTEM AND OPTICAL FIBER CABLING SYSTEM DESIGN USES LEVITON CONNECTORS AND SUPERIOR ESSEX CABLES.</p> <p>THE WORD "MANUFACTURER" WILL INCLUDE THE MANUFACTURER, THE MANUFACTURER'S REPRESENTATIVE, THE DISTRIBUTOR, THE FABRICATOR, AND THE SUPPLIER OF THE PARTICULAR CLASSIFICATION OF EQUIPMENT, SYSTEM, PRODUCT, AND MATERIAL.</p> <p>ALL WORK, EQUIPMENT, AND SYSTEMS WILL BE MANUFACTURED, PROVIDED, REPAIRED, INSTALLED, AND TESTED IN ACCORDANCE WITH THE LATEST EDITION AND ALL CURRENT AMENDMENTS OF THE APPLICABLE PUBLICATIONS AND STANDARDS OF THE CANADIAN ELECTRICAL CODE AND THE LATEST VERSION OF THE ANSIEIA/TIA 568 SERIES AS OF THE DATE OF THE CONTRACT DOCUMENTS. WHEN THE SPECIFICATION REQUIREMENTS EXCEED THE REQUIREMENTS OF THESE PUBLICATIONS AND STANDARDS THE SPECIFICATIONS WILL GOVERN.</p> <p>THE ABOVE REQUIREMENTS WILL NOT IN ANY WAY LIMIT RESPONSIBILITY OR REQUIREMENTS TO COMPLY WITH ALL OTHER CODES, STANDARDS AND LAWS.</p> <p>29.3. PERFORMANCE</p> <p>SYSTEM SHALL PROVIDE "FUTURE PROOF" CHANNEL PERFORMANCE AND GUARANTEED MARGINS AS NOTED IN THIS DOCUMENT AND IS GUARANTEED TO EXCEED ANSITIA/EIA-568-B.2 CATEGORY 6 SPECIFICATIONS FOR INSERTION LOSS, NEXT, PSNEXT, ACR, PSACR, ELFEXT, PSELFEXT AND RETURN LOSS TO 250 MHZ. THE SYSTEM IS ALSO GUARANTEED 12 DB PSACR HEADROOM AT 250 MHZ.</p> <p>29.4. SOURCE QUALITY CONTROL</p> <p>ALL MATERIALS SHALL BE PURCHASED FROM DISTRIBUTORS AUTHORIZED BY SYSTEM MANUFACTURERS TO SELL NEW AND UNUSED COMPONENTS.</p> <p>29.5. WALLPLATES</p> <p>MANUFACTURER - PROVIDE WALLPLATES AS SPECIFIED BELOW:</p> <ol style="list-style-type: none"> <li>1) LEVITON QUICKPORT SINGLE GANG 2-PORT WALLPLATES WITH ID WINDOWS       <ol style="list-style-type: none"> <li>a. PART # - 42080-2(W/S)</li> </ol> </li> <li>2) LEVITON QUICKPORT SINGLE GANG 4-PORT WALLPLATES WITH ID WINDOWS       <ol style="list-style-type: none"> <li>b. PART # - 42080-4(W/S)</li> </ol> </li> <li>3) OR PRE-APPROVED EQUAL</li> <li>4) WALL PLATES TO BE WHITE.</li> </ol> <p>29.6. JACKS</p> <p>MANUFACTURER - PROVIDE DATA CONNECTORS AS SPECIFIED BELOW:</p> <ol style="list-style-type: none"> <li>1) LEVITON EXTREME® 6+ CAT 6 CONNECTOR WITH / RETENTION FORCE TECHNOLOGY       <ol style="list-style-type: none"> <li>a. PART # 6111D-R(W/S)</li> </ol> </li> <li>2) OR PRE-APPROVED EQUAL</li> </ol> <p>3) PROVIDE BLANK MODULES FOR UNUSED PORTS</p> <p>4) JACKS TO BE WHITE</p> <p>29.7. PATCH CABLES</p> <ol style="list-style-type: none"> <li>1) PATCH CABLES SHALL BE PROVIDED FOR ALL TERMINATED VOICE AND DATA PORTS, FOR BOTH ENDS OF EACH LINE. THE CORDAGE SHALL USE 23 AWG SOLID COPPER CONDUCTORS IN A BONDED PAIR CONFIGURATION FOR RELIABLE LONG TERM CHANNEL PERFORMANCE TO 625 MHz. THE TRANSMISSION CHARACTERISTICS OF THE CORDAGE WILL BE GUARANTEED TO BE 625 MHz. THAT PATCH CABLES SHALL SUPPORT 10Gb/s, FT-4, 23 AWG COPPER, BELDEN 10G4 OR APPROVED EQUAL.</li> <li>2) THE QUANTITY OF THE PATCH CABLES FOR CONNECTION BETWEEN SWITCHES AND PATCH PANELS IN THE LAN ROOMS IS TO BE AT LEAST THE SAME AMOUNT AS THE NUMBER OF PORTS ON THE HORIZONTAL PATCH PANELS. LENGTH OF PATCH CABLES TO BE 7ft OR 2m.</li> <li>3) THE QUANTITY OF PATCH CABLES FOR CONNECTION AT THE WORKSTATION END IS TO BE AT LEAST THE SAME AMOUNT AS THE NUMBER OF PORTS ON THE HORIZONTAL PATCH PANELS. LENGTH OF PATCH CABLES SHOULD BE 15ft OR 4.5m.</li> </ol>	<p>33.0. TESTING PROCEDURES</p> <p>33.0.1. CABLING SYSTEMS SHALL MEET OR EXCEED THE ELECTRICAL AND TRANSMISSION CHARACTERISTICS OF THE SYSTEMS SPECIFIED.</p> <p>33.0.2. CABLE SEGMENTS AND LINKS SHALL BE TESTED FROM BOTH ENDS OF THE CABLE FOR EACH OF THE CONSTRUCTION PHASES. (VERIFY THAT CABLE LABELING MATCHES AT BOTH ENDS).</p> <p>33.0.3. THE SYSTEM SHALL NOT BE CONSIDERED CERTIFIED UNTIL THE TESTER HAS ACKNOWLEDGED THAT THE PERFORMANCE OF THE PHYSICAL LAYER OF THE SYSTEM HAS BEEN FULLY TESTED AND IS OPERATIONAL AT THE COMPLETION OF THE INSTALLATION PHASE.</p> <p>33.0.4. FIELD TESTING EQUIPMENT: SUBMIT DURING SHOP DRAWING REVIEW ON THE TESTING EQUIPMENT TO BE UTILIZED ON THIS PROJECT. THE INSTALLER SHALL TEST ALL CABLES INSTALLED UNDER THIS SECTION.</p> <p>1) UNSHIELDED TWISTED PAIR TESTING EQUIPMENT:</p> <ol style="list-style-type: none"> <li>a.) THE CABLE TESTER SHALL HAVE A WIDE VARIETY OF PREPROGRAMMED CABLE TYPES AS AN INTEGRAL PART OF ITS TESTING SYSTEM AND HAVE THE ABILITY TO TEST CABLES LESS THAN 6 FEET (6FT.) FROM THE TEST POINT.</li> <li>b.) TESTING SHALL BE ACCOMPLISHED USING LEVEL III OR HIGHER FIELD TESTER THAT IS LOADED WITH THE MOST CURRENT VERSION OF TEST SOFTWARE BY THE MANUFACTURER OF THE TEST EQUIPMENT.</li> <li>c.) PROVIDE FACTORY CALIBRATION REPORT OF FIELD TEST EQUIPMENT.</li> </ol> <p>33.0.1. TEST RESULTS:</p> <ol style="list-style-type: none"> <li>1) THE TEST RESULTS INFORMATION FOR EACH LINK SHALL BE RECORDED IN THE MEMORY OF THE FIELD TESTER UPON COMPLETION OF THE TEST. THE TESTER SHALL BE CAPABLE OF STORING TEST DATA IN EITHER INTERNAL OR EXTERNAL MEMORY. THE EXTERNAL MEDIA USED SHALL BE LEFT TO THE DISCRETION OF THE USER.</li> <li>2) THREE (3) PRINTED COPIES OF THE TEST RESULTS SHALL BE PROVIDED UPON COMPLETION OF THE PROJECT TO THE OWNER.</li> <li>3) TEST RESULTS SHALL INCLUDE THE FOLLOWING:       <ol style="list-style-type: none"> <li>a.) APPLICABLE ROOM NUMBER OF JACK LOCATION (ROOM NUMBER PER CONTRACT DOCUMENTS).</li> <li>b.) APPLICABLE TELECOMMUNICATIONS ROOM NUMBER.</li> <li>c.) CIRCUIT I.D. NUMBER WITH CORRESPONDING JACK IDENTIFIER.</li> <li>d.) WIRE MAP.</li> <li>e.) LENGTH.</li> <li>f.) INSERTION LOSS.</li> <li>g.) NEAR-END CROSSTALK (NEXT) LOSS.</li> <li>h.) PS-NEXT (POWER SUM NEAR END CROSS TALK).</li> <li>i.) ELFEXT (EQUAL LEVEL FAR END CROSS TALK).</li> <li>j.) PS-ELFEXT (POWER SUM EQUAL LEVEL FAR END CROSS TALK).</li> <li>k.) PROPAGATION DELAY.</li> <li>l.) DELAY SKEW.</li> <li>m.) RETURN LOSS.</li> </ol> </li> </ol>	<p>37.0. ENGINEER'S INSPECTIONS</p> <p>37.1. AT MINIMUM, AN INSPECTION WILL BE CARRIED OUT BY THE ENGINEER AT ROUGH-IN STAGE AND AT COMPLETION.</p> <p>37.2. THE ELECTRICAL CONTRACTOR SHALL ADVISE THE ENGINEER WHEN ALL WORK HAS BEEN COMPLETED ABOVE THE SUSPENDED CEILING, EITHER DRYWALL OR T-BAR.</p> <p>37.3. FAILURE TO NOTIFY THE ENGINEER IN TIME WILL NECESSITATE THE REMOVAL OF ALL CEILING FOR INSPECTION PURPOSES.</p> <p>37.4. THE ELECTRICAL CONTRACTOR SHALL NOTIFY THE ENGINEER AND SHALL ALLOW AT LEAST 3 WORKING DAYS NOTICE OF THE INSTALLATION OF CEILING.</p>

DATE	ISSUED FOR	REV
2018-02-07	ISSUED FOR 60% REVIEW	A
2018-03-02	ISSUED FOR 95% REVIEW	B
2018-03-29	ISSUED FOR TENDER	C


This drawing has been prepared solely for the use of the CLIENT and there are no representations of any kind made by NORR Architects Engineers Planners to any party with whom NORR Architects Engineers Planners has not entered into a contract.

This drawing shall not be used for construction purposes until the seal appearing hereon is signed and dated by the Architect or Engineer.

Project Component
<b>LUNCHROOM EXPANSION</b>
Keyplan

Consultants
Architectural: NORR Architects Engineers Planners Structural: NORR Architects Engineers Planners Mechanical: NORR Architects Engineers Planners Electrical: NORR Architects Engineers Planners

Seal(s)

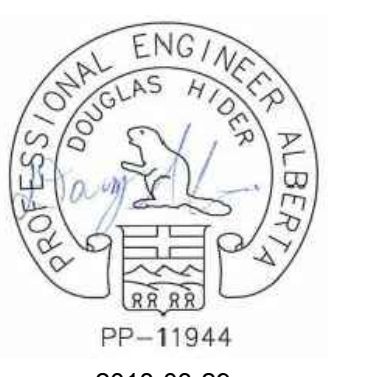

PP-11944  
2018-03-29

**NORR**

2300, 411 - 1st Street SE,  
Calgary, AB Canada T2G 4Y5  
norr.com

**NORR ARCHITECTS ENGINEERS PLANNERS**  
A Partnership of Limited Companies

Professional Engineers (Alberta) Inc., Professional Engineers (Ontario) Inc., Professional Engineers (British Columbia) Inc., Professional Engineers (Quebec) Inc., Professional Engineers (Saskatchewan) Inc., Professional Engineers (Manitoba) Inc., Professional Engineers (New Brunswick) Inc., Professional Engineers (Nova Scotia) Inc., Professional Engineers (Prince Edward Island) Inc., Professional Engineers (Newfoundland and Labrador) Inc., Professional Engineers (Yukon) Inc., Professional Engineers (Northwest Territories) Inc., Professional Engineers ( Nunavut) Inc.

Victor Smith, Architect, A.A.A. B. Arch. M.A.S.C.  
Bruce G. McManus, Architect, A.A.A. B. Arch. M.A.S.C.  
R. Bruce Robinson, Architect, A.A.A. B. Arch. M.A.S.C.  
Arlene Topley, P. Eng. P.Eng. P.Eng.  
Chris P. P. Eng. P.Eng.

Project Manager	Drawn
D. HIDER	D. LAM
Project Leader	Checked
D. HIDER	D. HIDER
Client	
<b>RCMP</b>	

Project  
**INNIFAIL PDSTC LUNCHROOM EXPANSION**

Drawing Title  
**ELECTRICAL SPECIFICATIONS**

Check Scale (may be photo reduced)	0 1inch 0 10mm
Project No.	NCCA17-0228
Drawing No.	E20-00-01