



RETURN BIDS TO:

RETOURNER LES SOUMISSIONS Á:

**Parks Canada Agency  
1869 Upper Water Street,  
Suite AH 201  
Halifax, Nova Scotia  
B3J 1S9**

SOLICITATION AMENDMENT

MODIFICATION DE L'INVITATION

The referenced document is hereby revised; unless otherwise indicated, all other terms and conditions of the Solicitation remain the same.

Ce document est par la présente révisé; sauf indication contraire, les modalités de l'invitation demeurent les mêmes.

Comments - Commentaries

Vendor/Firm Name and Address  
Raison sociale et adresse du fournisseur/de l'entrepreneur

Issuing Office - Bureau de distribution

**Parks Canada Agency  
1869 Upper Water Street,  
Suite AH 201  
Halifax, Nova Scotia  
B3J 1S9**

|  |                                |  |
|--|--------------------------------|--|
| <b>Title-Sujet</b><br>Outdoor Theatre Upgrades, Terra Nova National Park   |                                |  |
| <b>Solicitation No. - No. de l'invitation</b><br>5P201-18-0060/A   |                                | <b>Amendment No./N° de modification de l'invitation</b><br>002 |
| <b>Client Ref. No. - No. de réf du client.</b><br>457  |                                | <b>Date:</b><br>31 May 2018                                    |
| <b>GETS Reference No. - No de reference de SEAG</b><br>PW-18-00828643  |                                |  |
| <b>Solicitation Closes:</b>  |                                |  |
| <b>at - á</b><br>14:00   | <b>on - le</b><br>07 June 2018 | <b>Time Zone - Fuseau horaire</b><br>ADT - HAA                 |
| <b>F.O.B. - F.A.B.</b>   |                                |  |
| <b>Plant-Usine:</b> <input type="checkbox"/> <b>Destination:</b> <input checked="" type="checkbox"/> <b>Other-Autre:</b> <input type="checkbox"/>                |                                |  |
| <b>Address Inquiries to: - Adresser toute demande de renseignements à :</b><br>Jaime Creaser, <a href="mailto:Jaime.Creaser@pc.gc.ca">Jaime.Creaser@pc.gc.ca</a> |                                |  |
| <b>Telephone No. - No de téléphone</b><br>(902) 426-7513   |                                | <b>Fax No. - No de FAX:</b><br>(902) 426-1775                  |
| <b>Destination of Goods, Services, and Construction:</b><br><b>Destinations des biens, services et construction:</b><br><br>See Herein – Voir ici                |                                |  |

**TO BE COMPLETED BY THE BIDDER (type or print)**  
**À ÊTRE COMPLÉTER PAR LE SOUMISSIONNAIRE (taper ou écrire en caractères d'imprimerie)**

|  |             |
|--|-------------|
| <b>Vendor/Firm Name - Nom du fournisseur/de l'entrepreneur</b>   |             |
| <b>Address - Adresse</b>   |             |
| <b>Name of person authorized to sign on behalf of the Vendor/Firm</b><br><b>Nom de la personne autorisée à signer au nom du fournisseur/ de l'entrepreneur</b> |             |
| <b>Titale - Titre</b>  |             |
| <b>Telephone No. - N° de téléphone:</b> _____  |             |
| <b>Facsimile No. - N° de télécopieur:</b> _____  |             |
| <b>Signature</b>   | <b>Date</b> |

Solicitation No. - N° de l'invitation  
5P201-18-0060/A

Amd. No. - N° de la modif.  
002

Buyer - l'acheteur  
Jaime Creaser

Client Ref. No. - N° de réf. du client  
457

File Name - Nom du dossier  
Outdoor Theatre Upgrades, Terra Nova National Park

## **AMENDMENT 002**

**This amendment is being raised to replace drawing E1 (Electrical) with the attached drawing dated May 30, 2018.**

---

**ALL OTHER TERMS AND CONDITONS REMAIN THE SAME.**

---

LEGEND

LIGHTING

- (A) INCANDESCENT/HID/LED/COMPACT FLUORESCENT LIGHTING FIXTURE, CEILING MOUNTED. LETTER DENOTES TYPE. SEE LIGHTING FIXTURE SCHEDULE & SPECIFICATIONS FOR DESCRIPTION.
- (KA) INCANDESCENT/HID/LED/COMPACT FLUORESCENT LIGHTING FIXTURE, WALL MOUNTED. LETTER DENOTES TYPE. SEE LIGHTING FIXTURE SCHEDULE & SPECIFICATIONS FOR DESCRIPTION.
- (A) FLUORESCENT LIGHTING FIXTURE. LETTER DENOTES TYPE. SEE LIGHTING FIXTURE SCHEDULE & SPECIFICATIONS FOR DESCRIPTION.
- S<sub>a,b</sub> SINGLE POLE TOGGLE SWITCH, 15 AMP, SPECIFICATION GRADE, WHITE C/W STAINLESS STEEL COVERPLATE. SEE SPEC. FOR MORE INFORMATION. MOUNT 1200mm ABOVE FINISHED FLOOR.
- p "a" OR "b" INDICATES CIRCUIT TO BE CONTROLLED.
- k "p" INDICATES PILOT LIGHT
- "k" INDICATES KEY OPERATED
- S<sub>3</sub> "3" INDICATES THREE WAY SWITCH, SIMILAR TO ABOVE.
- S<sub>4</sub> "4" INDICATES FOUR WAY SWITCH, SIMILAR TO ABOVE.
- (D) INCANDESCENT/LED DIMMER TO SUIT LIGHTING FIXTURE BEING DIMMED. RATED 120 VOLT, SPECIFICATION GRADE C/W COVERPLATE. MOUNT 1200mm ABOVE FINISHED FLOOR.

EMERGENCY/EXIT LIGHTING

- (E) EMERGENCY LIGHTING BATTERY UNIT "LUMACELL" #RG12S200-2LD7 OR EQUAL, 120 VOLT AC, 12 VOLT DC, BATTERY TO WALL MOUNT 2400mm. ABOVE FINISHED FLOOR. BE RATED FOR 200 WATTS (6W FOR 90 MINUTES MINIMUM) C/W TWO 4W MR-16 LED HEADS & COME WITH A 10 YEAR RATED LIFE MINIMUM. #1 INDICATES BATTERY PACK DESIGNATION.
- (L) REMOTE HEAD "LUMACELL" #MQM2LD7 (DOUBLE) OR EQUAL, 12 VOLT, C/W 4 WATT, MR16 LED LAMPS. WALL MOUNT 2400mm. ABOVE FINISHED FLOOR. #1 INDICATES CONNECTION TO BATTERY PACK #1
- (X) EXIT SIGN. "LUMACELL" LA1WU SERIES (RUNNING MAN) NRCAN/CSA COMPLIANT. UNIVERSAL MOUNT 120 VOLT AC & 12 VOLT DC, C/W 25 YEAR LED TYPE LAMPS. SEE LIGHTING FIXTURE SCHEDULE AND SPECIFICATION. ARROWS INDICATE DIRECTION OF TRAVEL. WALL MOUNT 2400mm. ABOVE FINISHED FLOOR.
- (X) COMBO EXIT SIGN COMPLETE WITH TWO HEADS. "LUMACELL" LAC-1-W-1250-2-LD7 SERIES NRCAN/CSA COMPLIANT. UNIVERSAL MOUNT 120 VOLT AC & 12 VOLT DC, C/W EXIT SIGN (RUNNING MAN) AND TWO 4 WATT, MR16, 25 YEAR LED TYPE LAMPS. SELF-POWERED.

WIRING DEVICES

- (WP) DUPLEX U-GROUND RECEPTACLE, 120 VOLT, 15 AMP, SPECIFICATION GRADE. WHITE & C/W STAINLESS STEEL COVERPLATE. WALL MOUNT 400mm ABOVE FINISHED FLOOR. "WP" INDICATES WEATHERPROOF COVERPLATE.
- (WP) GFCI DUPLEX RECEPTACLE, 120 VOLT, 15 AMP, WHITE, SPECIFICATION GRADE C/W STAINLESS STEEL COVERPLATE. MOUNTED ON EXTERIOR POST. "WP" INDICATES WEATHERPROOF COVERPLATE.
- (WP) DUPLEX U-GROUND RECEPTACLE, 120 VOLT, 15 AMP, SPECIFICATION GRADE. WHITE & C/W STAINLESS STEEL COVERPLATE. WALL MOUNT 150mm TO CENTER ABOVE COUNTER. "WP" INDICATES WEATHERPROOF COVERPLATE.
- (WP) DUPLEX U-GROUND RECEPTACLE, 120 VOLT, 20 AMP, SPECIFICATION GRADE. WHITE & C/W STAINLESS STEEL COVERPLATE. WALL MOUNT 400mm ABOVE FINISHED FLOOR. "WP" INDICATES WEATHERPROOF COVERPLATE.
- (WP) GFCI DUPLEX RECEPTACLE, 120 VOLT, 20 AMP, WHITE, SPECIFICATION GRADE C/W STAINLESS STEEL COVERPLATE. WALL MOUNT 400mm ABOVE FINISHED FLOOR.
- (WP) DUPLEX U-GROUND RECEPTACLE, 120 VOLT, 20 AMP, SPECIFICATION GRADE. WHITE & C/W STAINLESS STEEL COVERPLATE. WALL MOUNT 150mm TO CENTER ABOVE COUNTER. "WP" INDICATES WEATHERPROOF COVERPLATE.
- (WP) DUPLEX U-GROUND RECEPTACLE MOUNTED IN WEATHERPROOF FLOOR BOX IN EXTERIOR STAGE FLOOR. 120 VOLT, 15 AMP, SPECIFICATION GRADE. WHITE & C/W STAINLESS STEEL COVERPLATE. "WP" INDICATES WEATHERPROOF COVERPLATE.
- (DMX) NEW DMX LIGHTING CONTROL OUTLET C/W WEATHERPROOF COVERPLATE AND TYPE FD BOX. MOUNTING HEIGHT TO MATCH EXISTING RECEPTACLES. SECURE DMX CABLE CONDUIT TO EXISTING STEEL POST. COORDINATE ON SITE.

ELECTRIC HEATING


- (HE) ELECTRIC HEATER. SEE HEATER FIXTURE SCHEDULE AND/OR SPECIFICATION FOR DESCRIPTION.
- (T) LOW VOLTAGE ELECTRONIC THERMOSTAT C/W TAMPERPROOF COVER. OUELLET OTH24 OR APPROVED EQUAL. MOUNT 1200mm ABOVE FINISH FLOOR.

CONTROLS & MISCELLANEOUS



- (D) DISCONNECT SWITCH SUPPLIED AND INSTALLED BY ELECTRICAL DIVISION UNLESS NOTED OTHERWISE, EEMAC 2 (SPRINKLER PROOF) FOR INTERIOR AND EEMAC 4X FOR EXTERIOR.
- (M) ELECTRIC MOTOR, SUPPLIED BY MECHANICAL DIVISION, WIRED BY ELECTRICAL DIVISION.

DEMOLITION NOTES:

1. CONTRACTOR TO PROVIDE ALL CUTTING, PATCHING AND PAINTING TO MATCH EXISTING. COORDINATE ON SITE.
2. ALL WORK SHALL BE SCHEDULED AND COORDINATED WITH OWNER REPRESENTATIVE.
3. CONTRACTOR SHALL BE RESPONSIBLE FOR CLEAN UP AND DISPOSALS OF WORK AREA ON A DAILY BASIS. AFTER EACH WORKING SHIFT BUILDING TO BE CLEANED AND FREE OF DEBRIS. BUILDING GARBAGE BINS ARE NOT TO BE USED.
4. ANY ELECTRICAL SYSTEM SHUTDOWN TO BE SCHEDULED AFTER NORMAL BUSINESS HOURS AND SHALL BE COORDINATED WITH OWNER REPRESENTATIVE. SUFFICIENT NOTICE SHALL BE GIVEN. 5 WORKING DAYS NOTICE IS REQUIRED FOR ANY DISRUPTION.
5. N/A.
6. ALL WIRING TO BE INSTALLED IN CONDUIT AS INDICATED.
7. ACCESS TO BUILDING TO BE COORDINATED WITH OWNER REPRESENTATIVE.
8. LABEL ALL EQUIPMENT WITH LAMACOID TAGS.
9. ALL EXISTING ELECTRICAL EQUIPMENT REMOVED TO BE TURNED OVER TO OWNER. IF OWNER REFUSES THEN CONTRACTOR TO REMOVE FROM SITE AND DISPOSE.

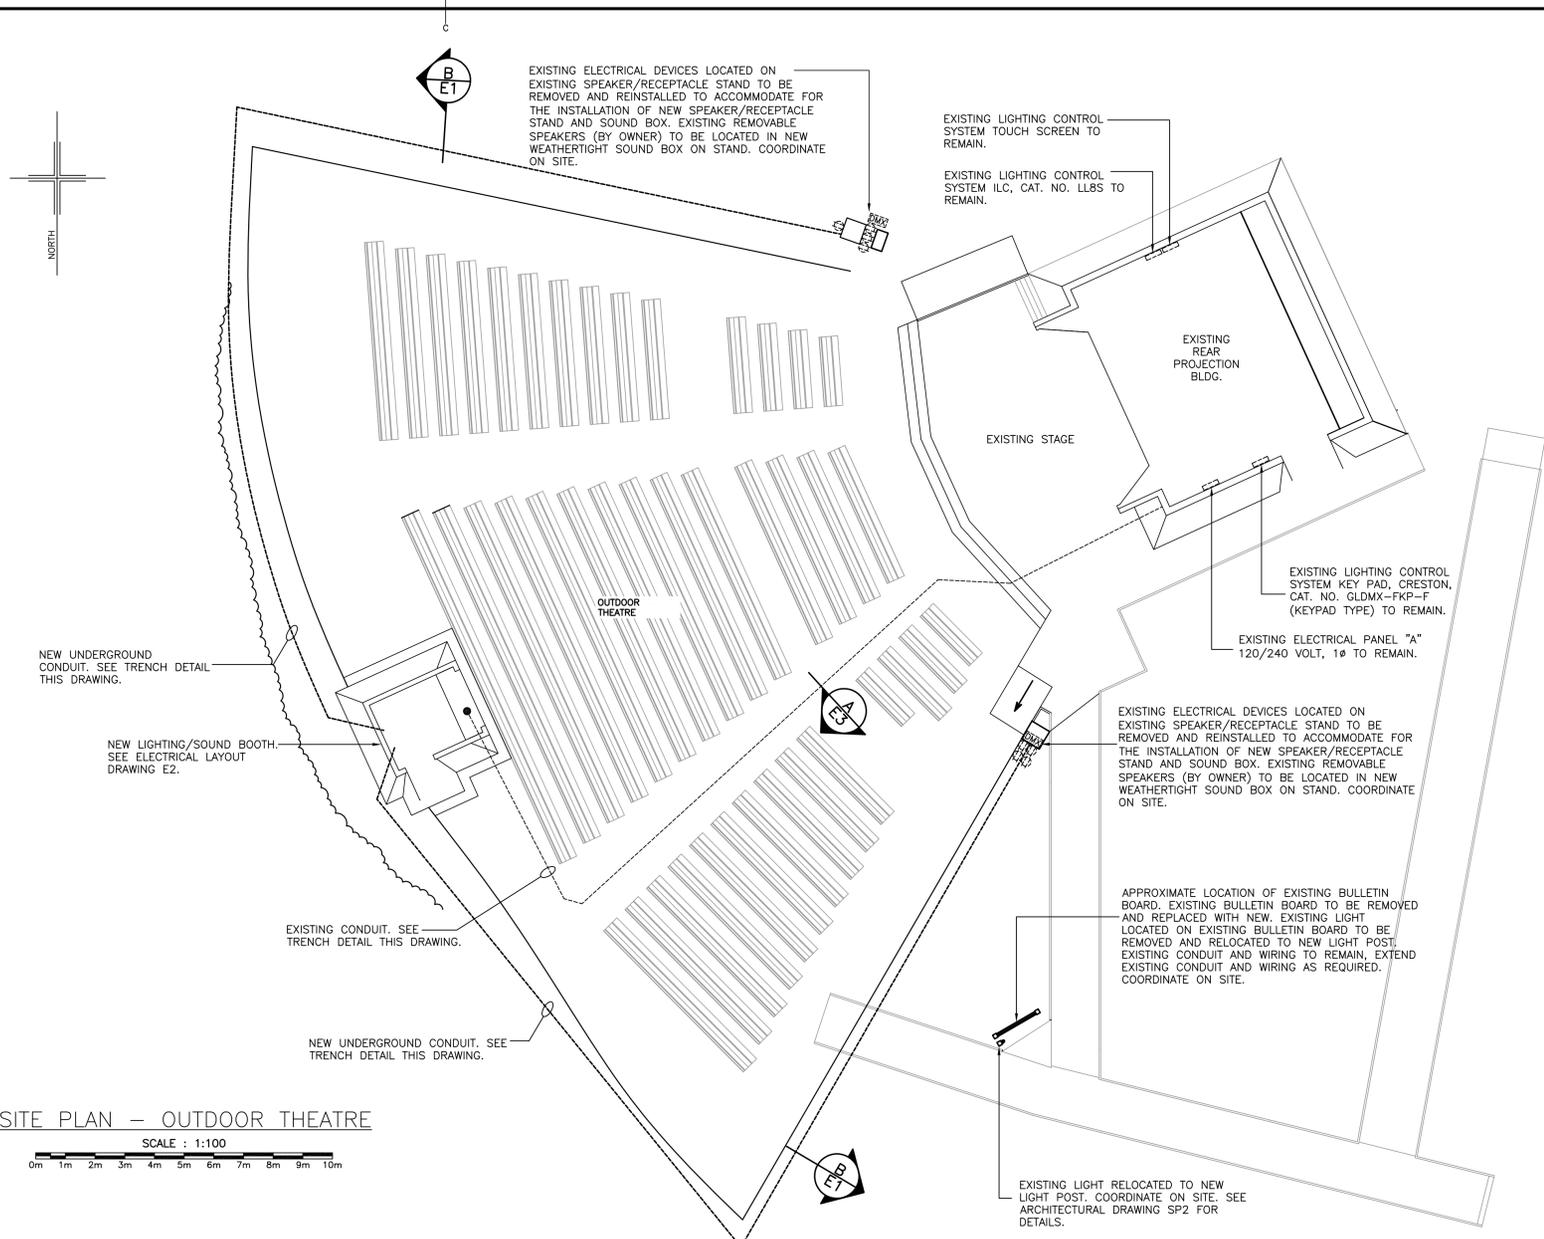


SITE PLAN - OUTDOOR THEATRE

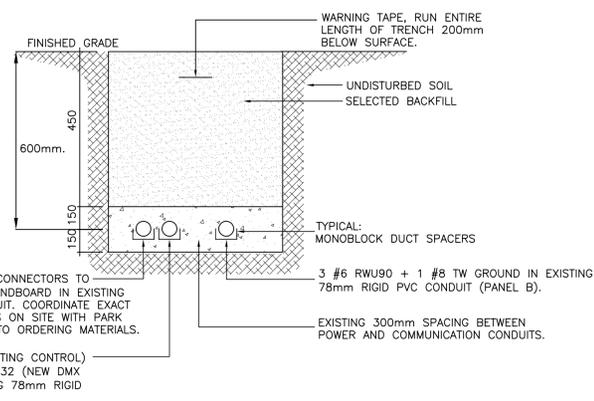

EXISTING TRENCH DETAIL

SCALE : N.T.S.

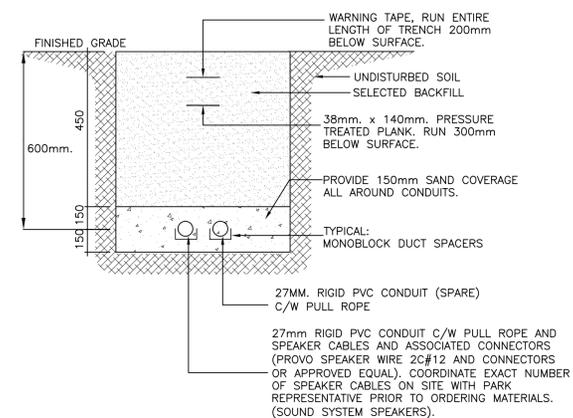

NEW TRENCH DETAIL

SCALE : N.T.S.

PERMIT

PROVINCE OF NEWFOUNDLAND  
PERMIT HOLDER  
Class "A"  
This Permit Allows  
CROSBIE ENGINEERING LIMITED

To practice Professional Engineering in Newfoundland and Labrador  
Permit No. as issued by PEG-NE 00123  
which is valid for the year 2018.

STAMP

REGISTERED PROFESSIONAL ENGINEER  
KENNETH R.P. NEIL  
SIGNATURE  
MAY 30 2018  
NEWFOUNDLAND & LABRADOR

|   |                          |          |
|---|--------------------------|----------|
| 1 | ISSUED FOR ADDENDUM #1   | 30.05.18 |
| 0 | ISSUED FOR TENDER        | 16.03.18 |
| C | RE-ISSUED FOR REVIEW     | 25.01.18 |
| B | RE-ISSUED FOR 99% REVIEW | 15.01.18 |
| A | ISSUED FOR 99% REVIEW    | 06.12.17 |

project

**OUTDOOR THEATRE UPGRADES NEWMAN SOUND**

TERRA NOVA NATIONAL PARK GLOVERTOWN NL

drawing

design

LEGEND, SITE PLAN AND TRENCH DETAILS

designed K.N. conq

date DECEMBER 2017

drawn D.R. dessin

date DECEMBER 2017

approved TRE UPGRADES approuv

date

Tender

Submission

PWSC Project Manager Administrateur de projets TPSCG

project number no. du projet

**PCA NO. 457**

drawing no. no. du dessin

E1