

GENERAL NOTES:

1. CONTRACTOR TO VISIT SITE TO TRACE OUT ALL SYSTEMS BEFORE INITIATING WORK. COORDINATE SYSTEM SHUT DOWNS & SERVICE INTERRUPTIONS WITH OWNER.
2. PROVIDE ALL MATERIALS & LABOUR REQUIRED TO INSTALL ALL REQUIRED COMPONENTS IN ACCORDANCE WITH APPLICABLE CODES, REGULATIONS & DRAWINGS THAT FORM PART OF THIS CONTRACT.
3. DO NOT SCALE FROM DRAWINGS.
4. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.
5. SEE ADDITIONAL NOTES ON DRAWINGS H-2, 3 AND 4.

A      A    DETAIL NO.  
B      B    LOCATION DRAWING NO. WHERE DETAIL WAS  
C      C    TAKEN FROM.  
C      C    DRAWING NO. WHERE DETAIL IS DRAWN

A - PLAN, SECTION, ELEVATION, OR DETAIL NO.  
B - NO. OF DRAWING WHERE ABOVE IS DRAWN

C	REISSUED FOR TENDER	JUL. 2018
B	ISSUED FOR TENDER	JUN. 2018
A	ISSUED FOR 99% REVIEW	APR. 2018
revisions		date

project	proj
---------	------

**NORTHWEST ATLANTIC  
FISHERIES CENTRE (NAFC)  
COOLING & VENTILATION  
RENOVATIONS FOR POD G10**

drawing	dessin
---------	--------

EXISTING KITCHEN  
VENTILATION AND  
DEMOLITION PLAN

designed	conq
----------	------

date 04/07/2018

date 04/07/2018

approved	approved
----------	----------

date	04/07/2018
Tender	Soumission


PWGSC Project Manager      Administrateur de projets TPSG

project number	no. du projet
----------------	---------------

R.999102.002


drawing no. \_\_\_\_\_ no. du dessin \_\_\_\_\_

H-1


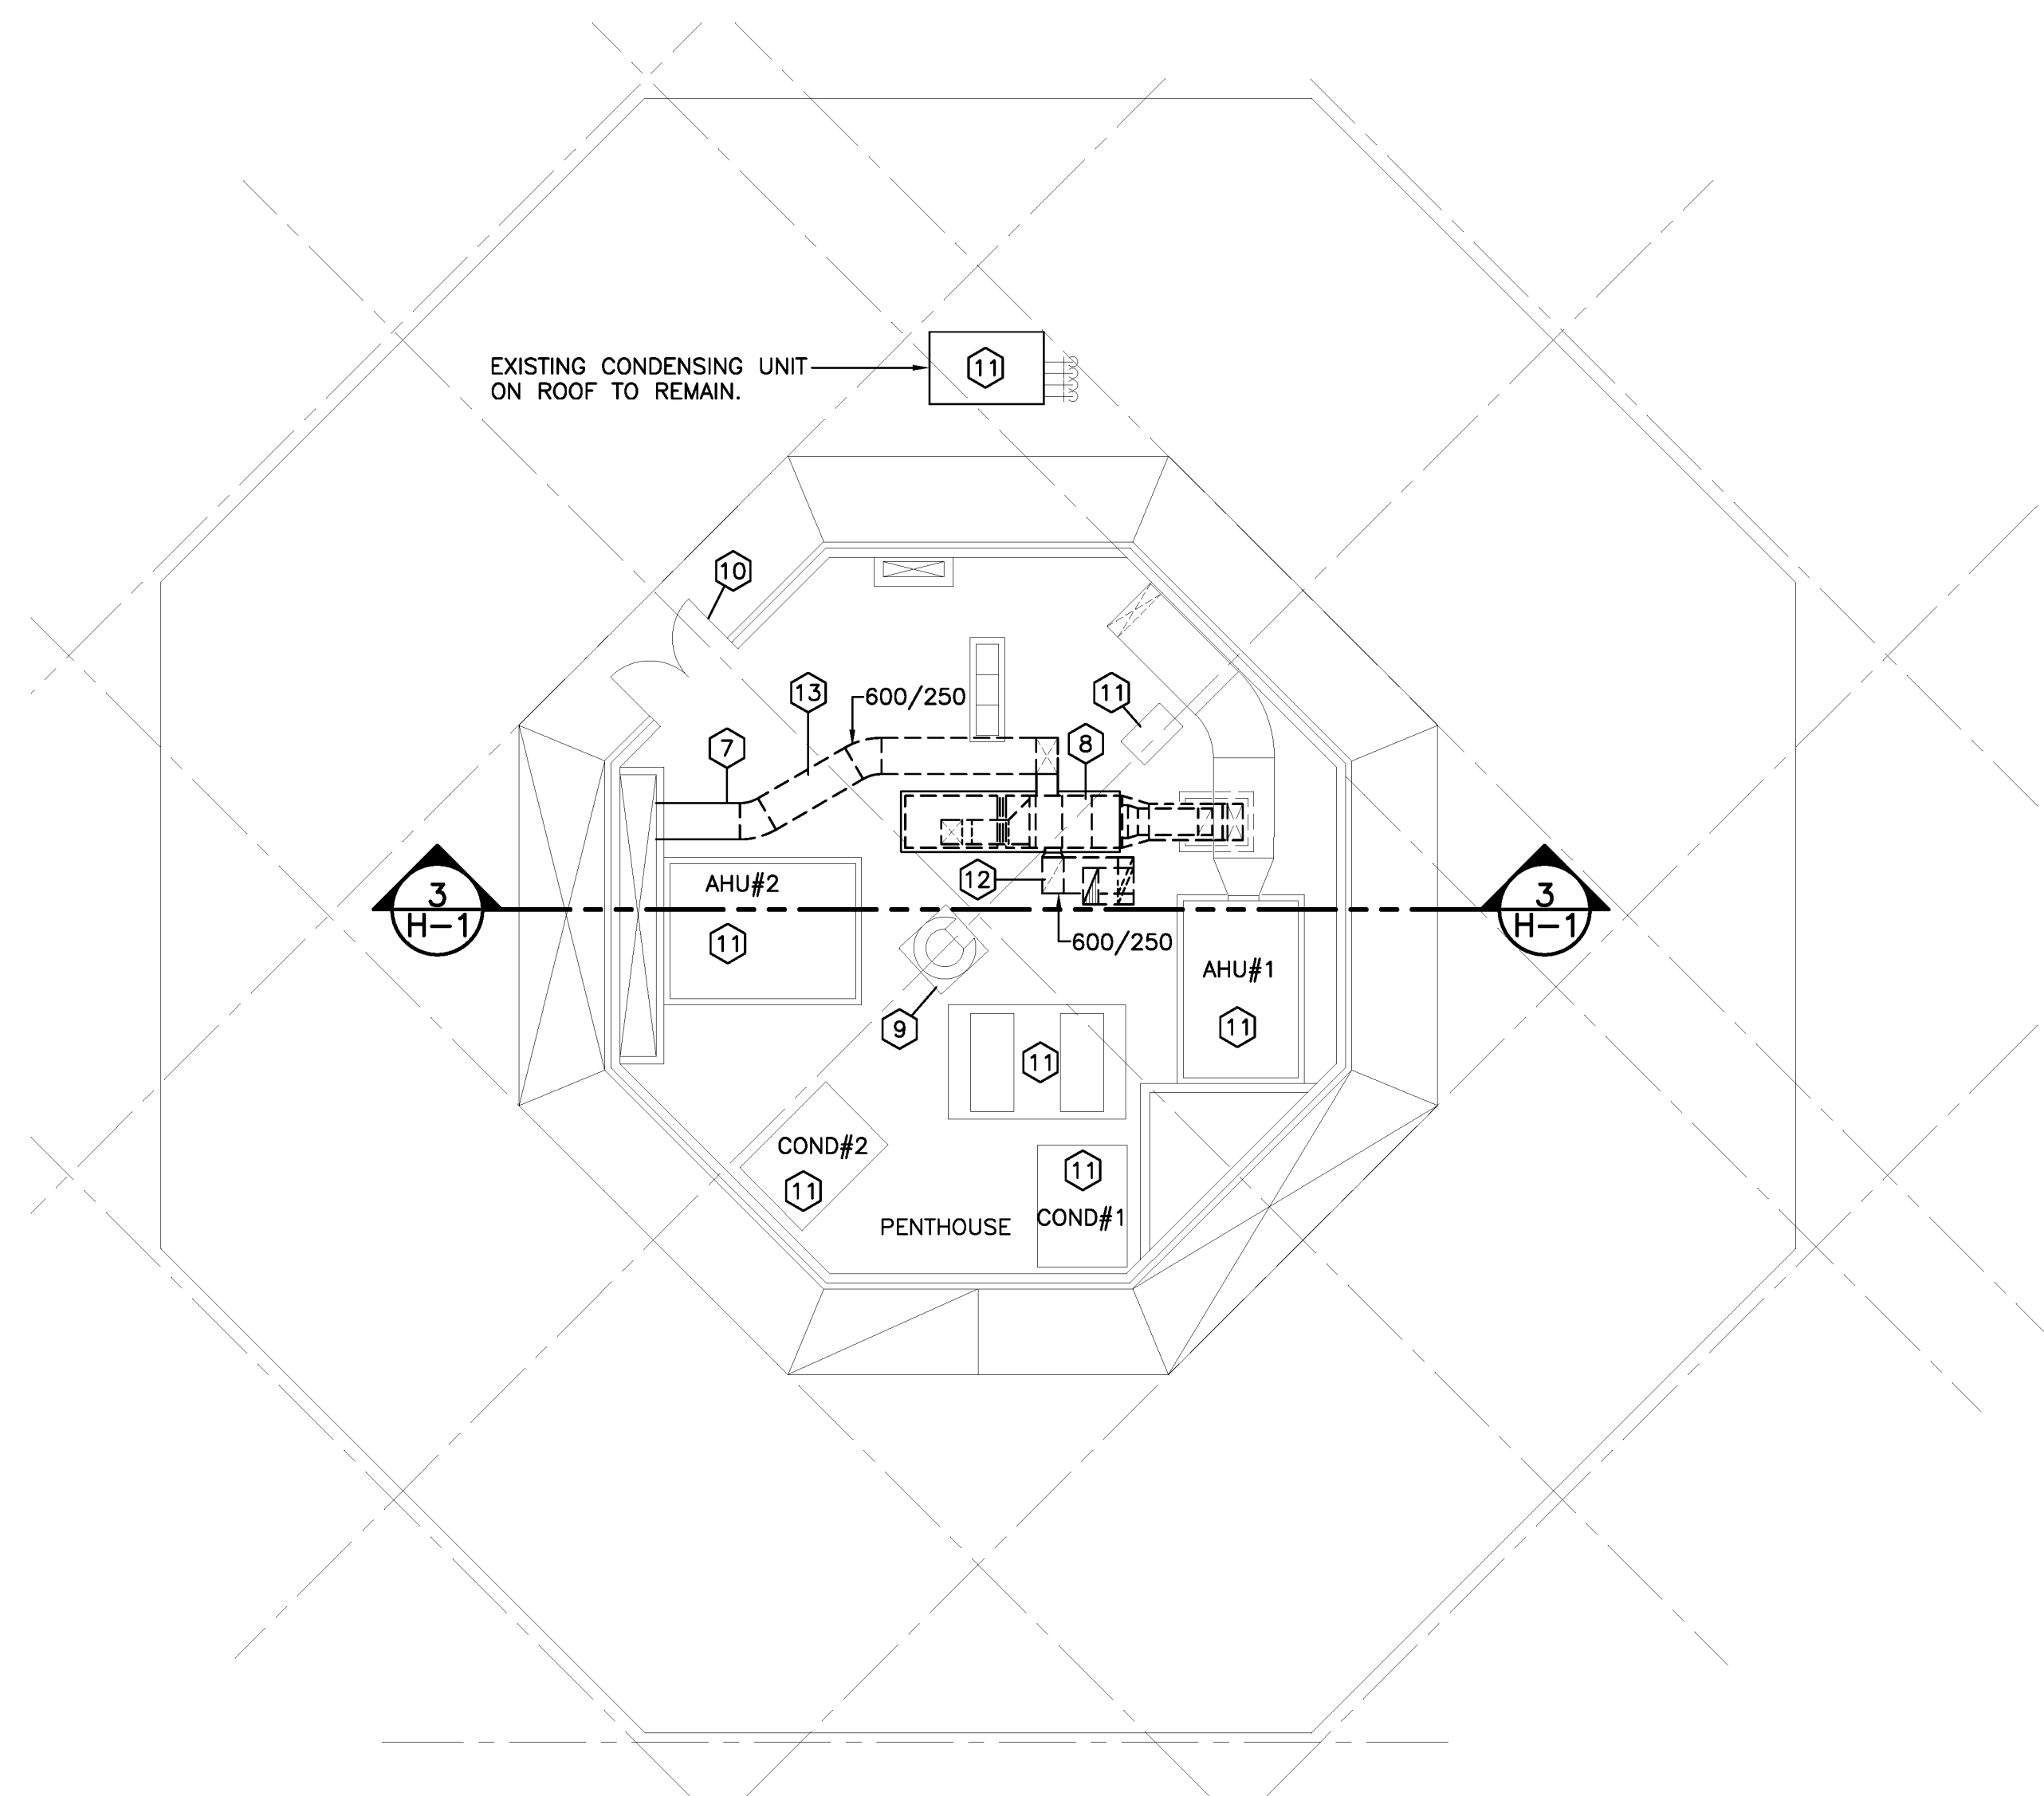


EXISTING PENTHOUSE PLAN - MODULE G10

SCALE : 1:100



0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m

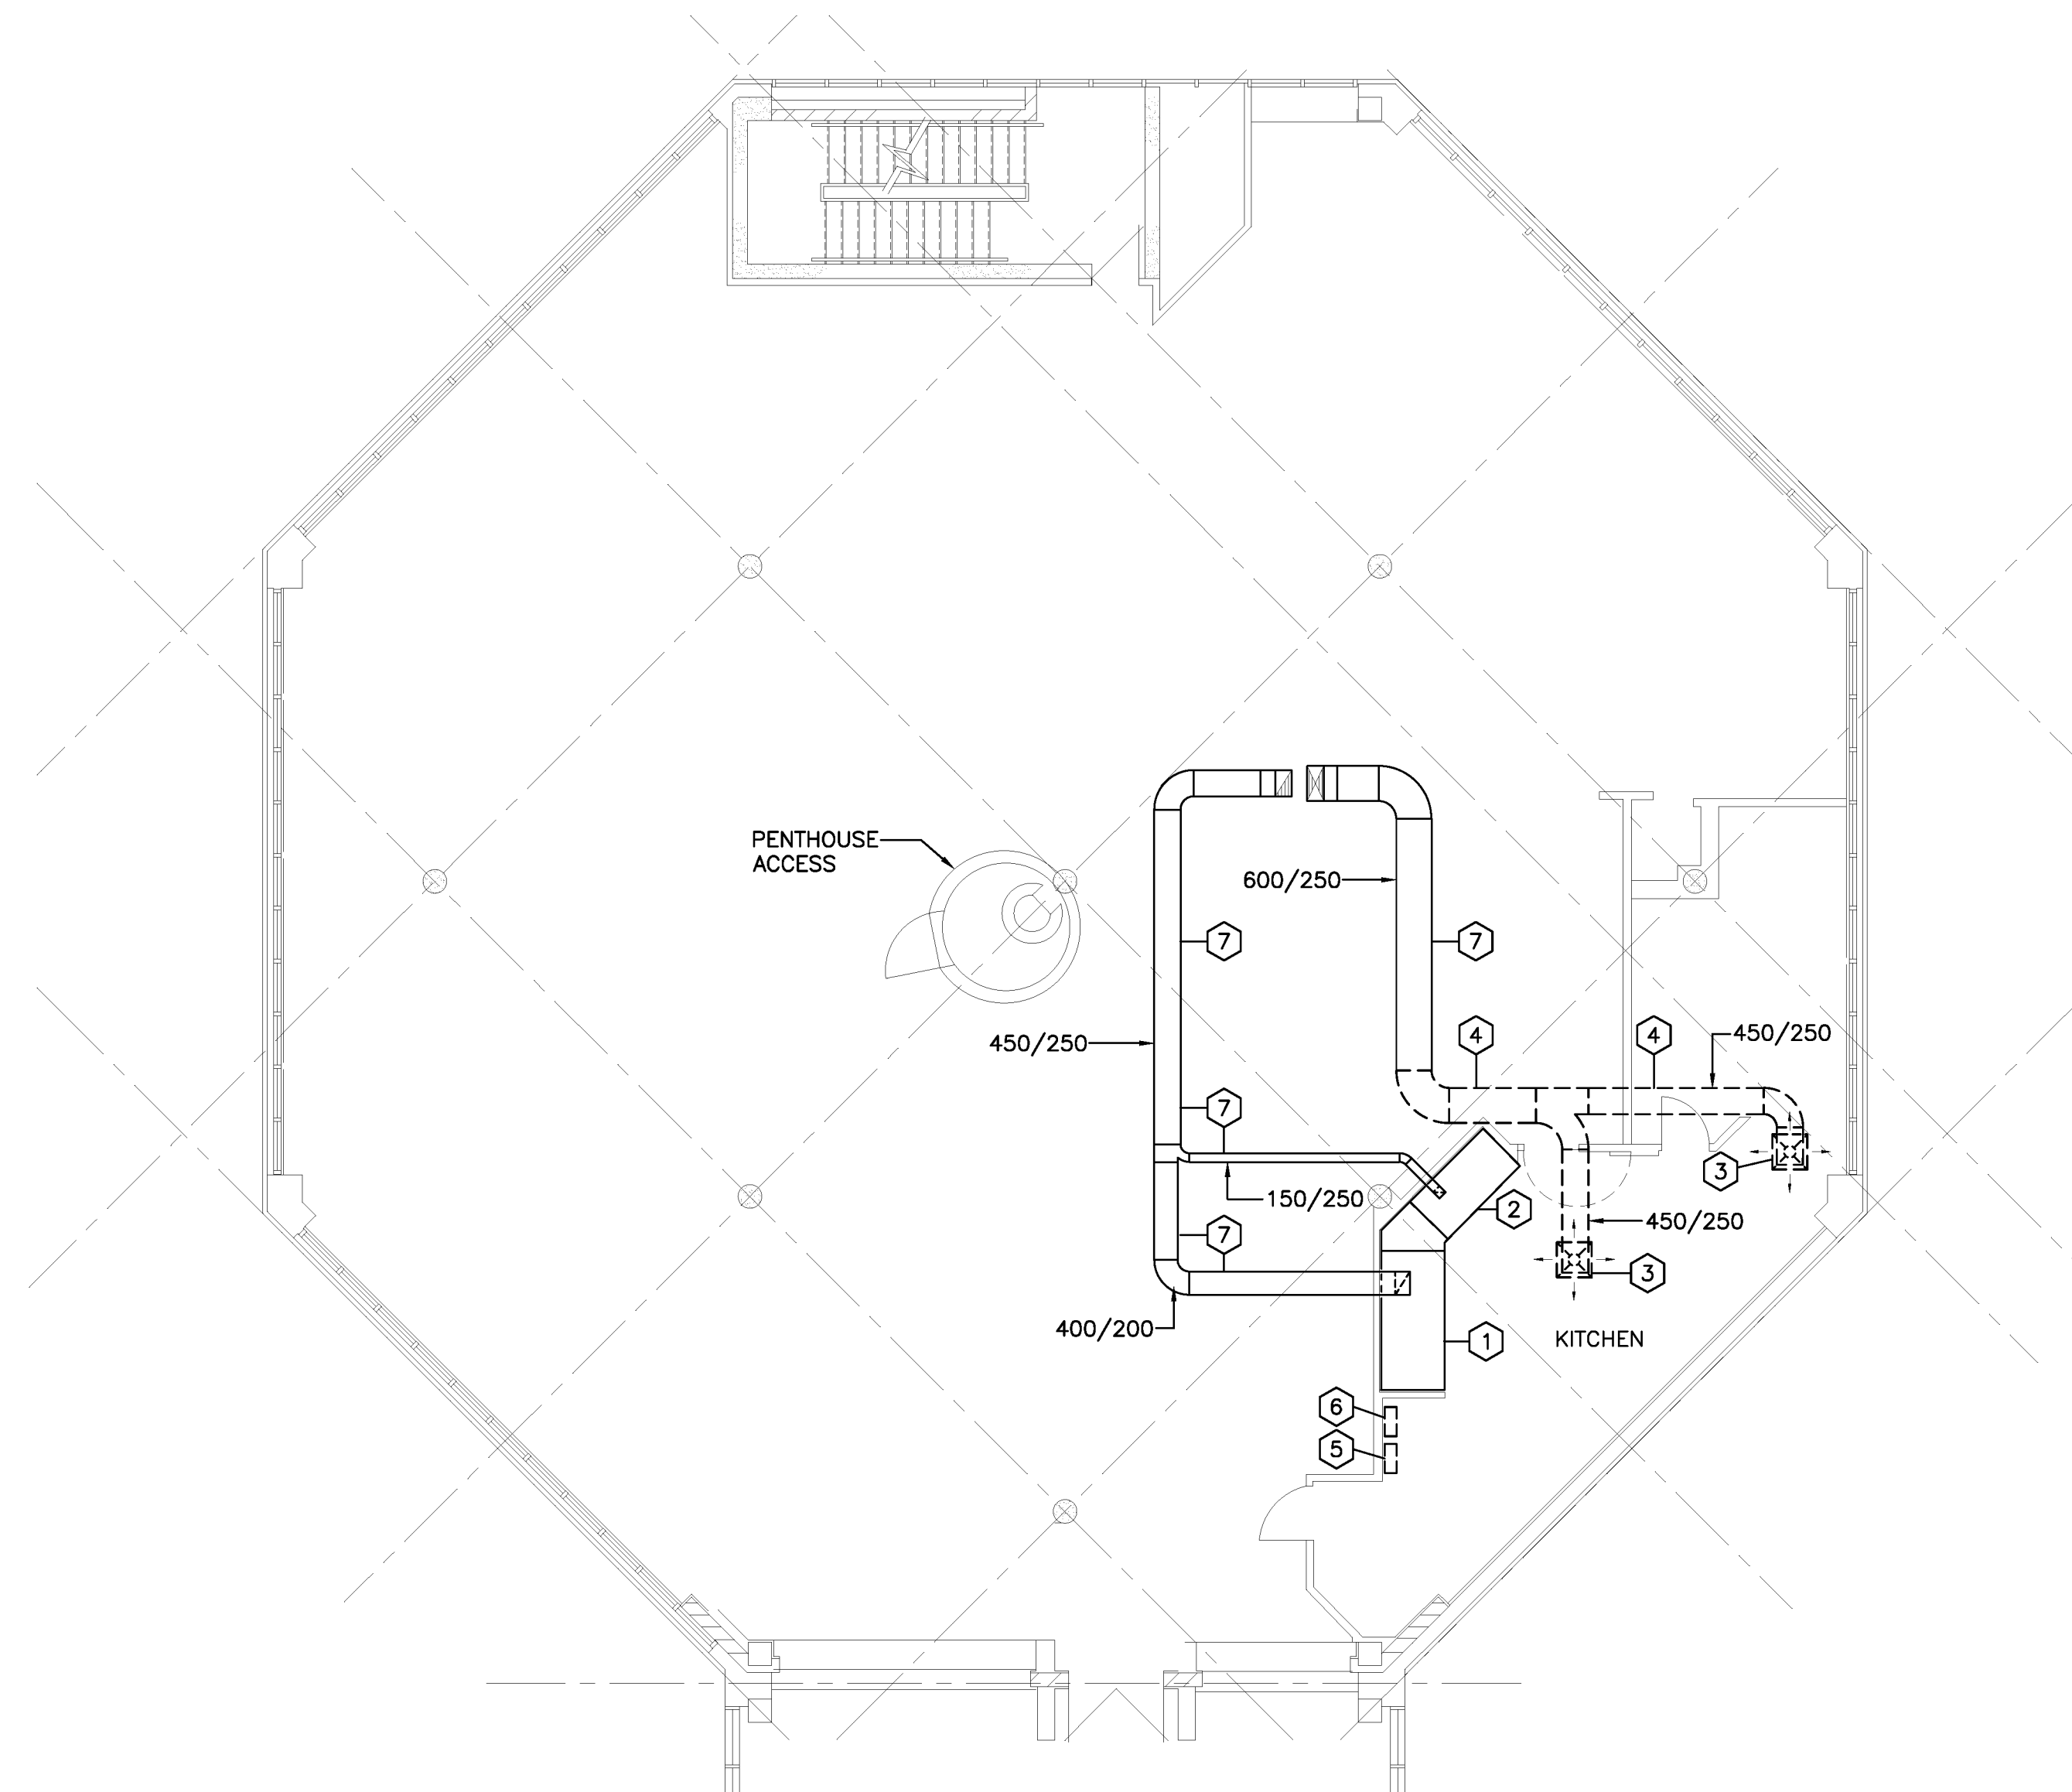


EXISTING KITCHEN HVAC PLAN - LEVEL 3 - MODULE G10

SCALE : 1:100



0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m




DRAWING NOTES:

- ① EXISTING RANGE HOOD 291 L/S/LM (188 CFM/LF) TO REMAIN. TOTAL AIRFLOW 690 L/S.
- ② EXISTING RANGE HOOD 260 L/S/LM (168 CFM/LF) TO REMAIN. TOTAL AIRFLOW 455 L/S.
- ③ REMOVE EXISTING SUPPLY AIR DIFFUSERS AND TURN OVER TO OWNER.
- ④ REMOVE EXISTING SUPPLY AIR DUCTS.
- ⑤ REMOVE EXISTING ECOLOGY UNIT CONTROL PANEL. MAKE GOOD WALL BEHIND PANEL.
- ⑥ KITCHEN HOOD WATER WASH PANEL TO BE REMOVED. MAKE GOOD WALL BEHIND PANEL FOR NEW PANEL INSTALLATION.
- ⑦ EXISTING DUCTS TO REMAIN.
- ⑧ REMOVE EXISTING ECOLOGY UNIT AND ERU, COORDINATE REMOVAL WITH PWGSC KITCHEN STAFF AND FACILITY MAINTENANCE, AND ELECTRICAL TRADES.
- ⑨ EXISTING PENTHOUSE ACCESS HATCH AND LADDER TO REMAIN.
- ⑩ REMOVE EXISTING EQUIPMENT THROUGH PENTHOUSE ROOF ACCESS DOORS. CONTRACTOR IS RESPONSIBLE FOR SAFE REMOVAL OF EQUIPMENT FROM ROOF.
- ⑪ EXISTING EQUIPMENT TO REMAIN.
- ⑫ EXISTING EXHAUST DUCTWORK, SHOWN IN DASHED LINES, TO BE REMOVED.
- ⑬ EXISTING FRESH AIR INTAKE DUCTWORK, SHOWN IN DASHED LINES, TO BE REMOVED.

GENERAL NOTES:

1. EQUIPMENT AND DUCTWORK TO BE REMOVED / REPLACED SHOWN WITH BOLD DASHED LINES.
2. EQUIPMENT AND DUCTWORK TO REMAIN SHOWN WITH LIGHT CONTINUOUS LINES.

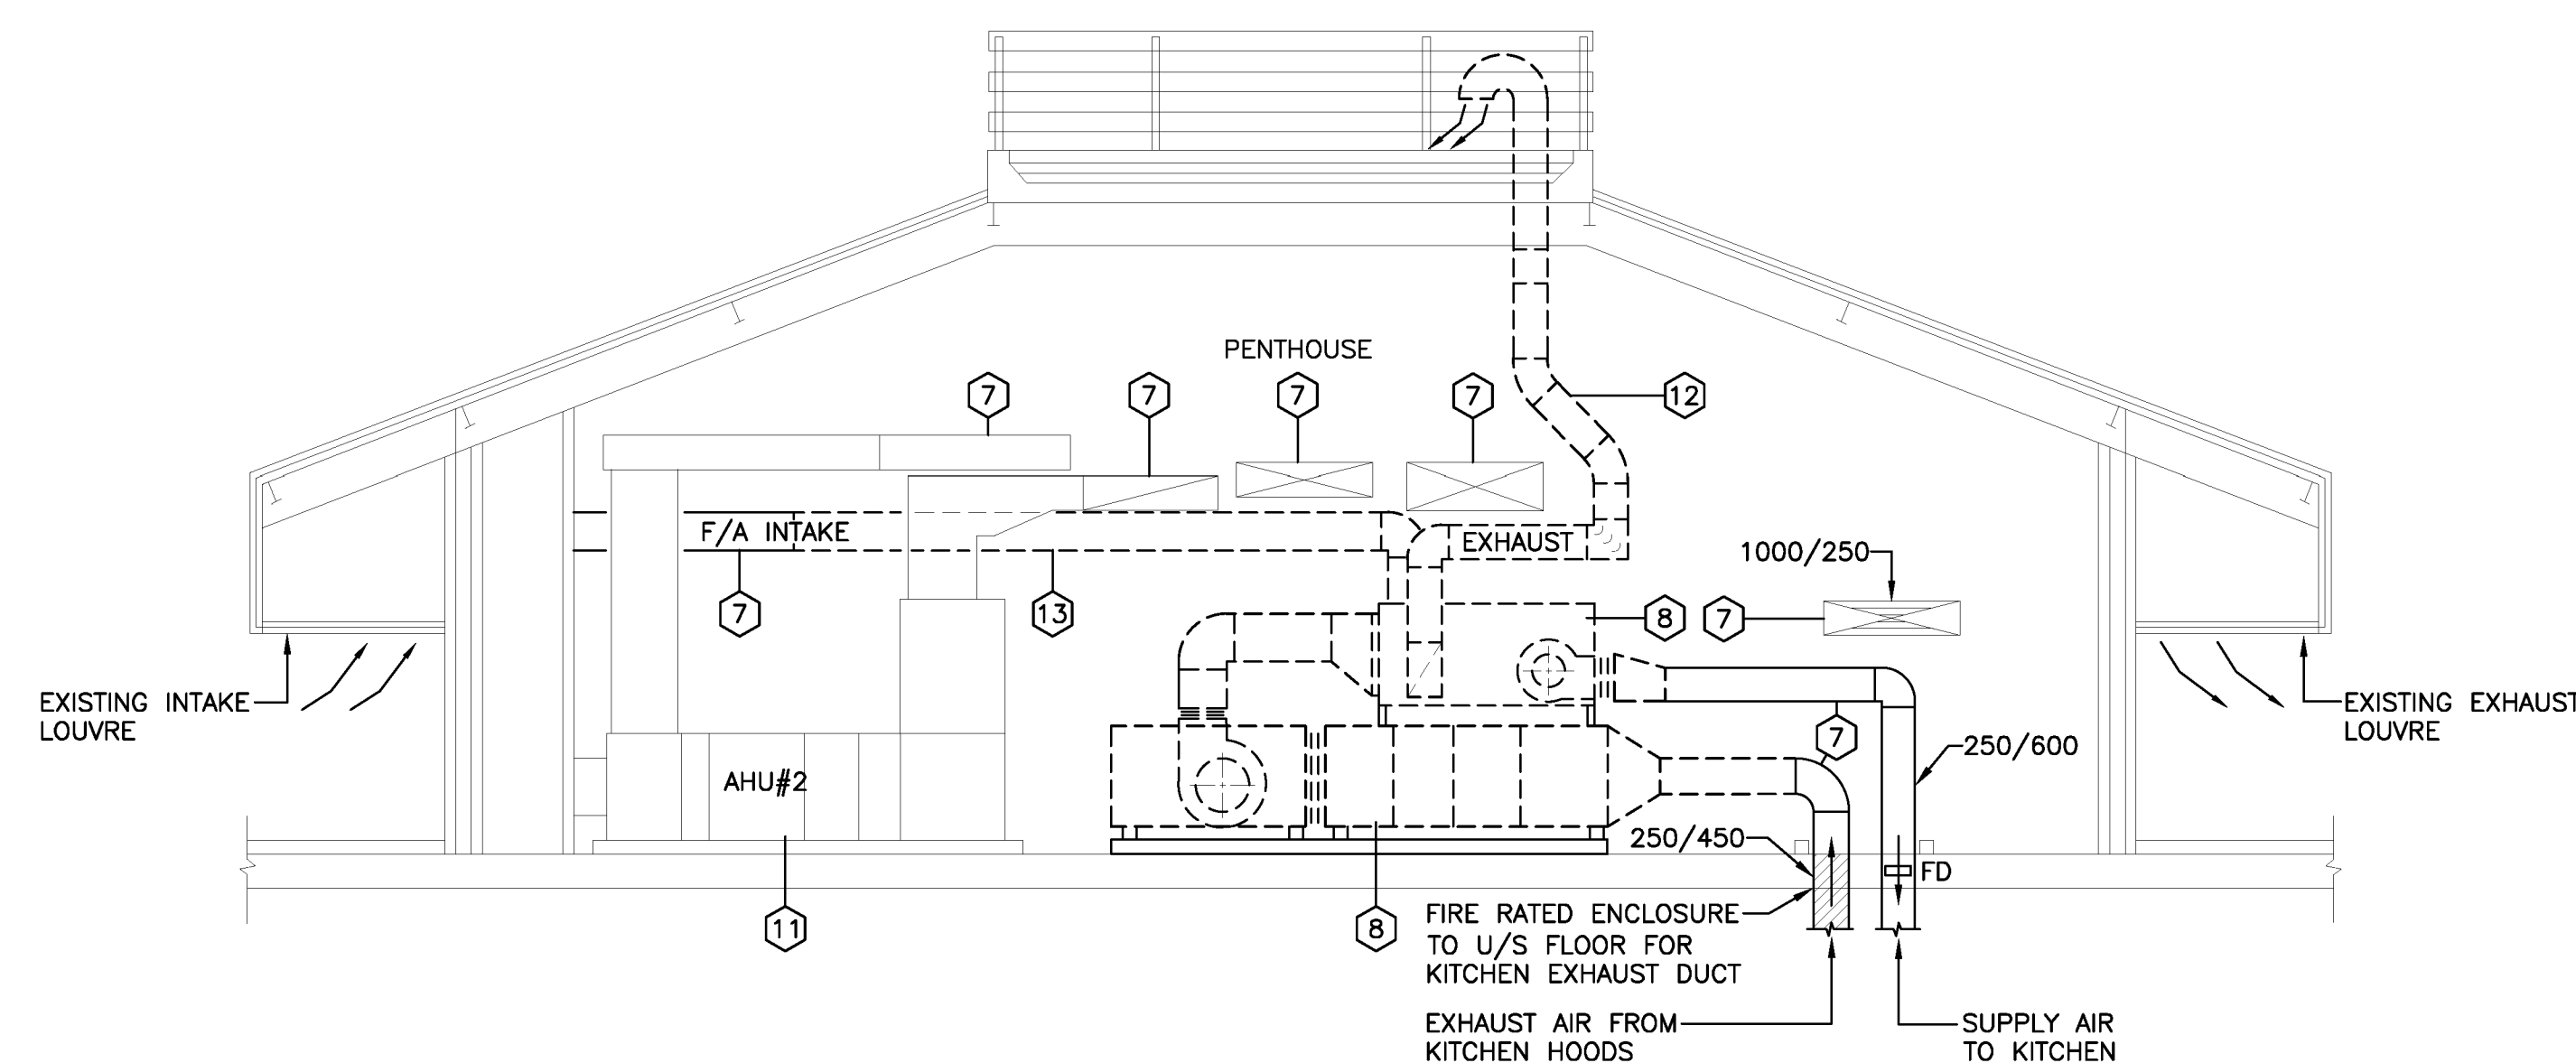

EXISTING ECOLOGY UNIT - ELEVATION VIEW

SCALE : 1:50

